

CITY: Seguin DATE: 02/21/2027 TIME: 11:32 MAP #: Sheet C43

PDI PROJECT #: 2024-0044 PROJECT NAME: Cordova Trails Unit 1 - Deweyville Lane

Flow Hydrant(s)		
Hydrant	A-1	A-2
Pitot (PSI)	<u>21</u>	<u>21</u>
Outlet Size ("	2.5	2.5
Coefficient	0.9	0.9
Flow Test (GPM)	<u>1538</u>	
Fire Flow @ 20 PSI	<u>1387 gpm</u>	

Pressure Hydrant(s)		
	B	C
Static (PSI)	<u>58</u>	---
Residual (PSI)	<u>12</u>	---

Water Main	
☒ Public	☐ Dead-End
☐ Private	☒ Circulating
Size ("	8"
Material	PVC


COMMENTS: _____

Witnessed by (print): Alexander Akeroyd of Protection Development, Incorporated


Signature: _____

Conducted by (print): Landon Jensen of Protection Development, Incorporated

Signature: _____

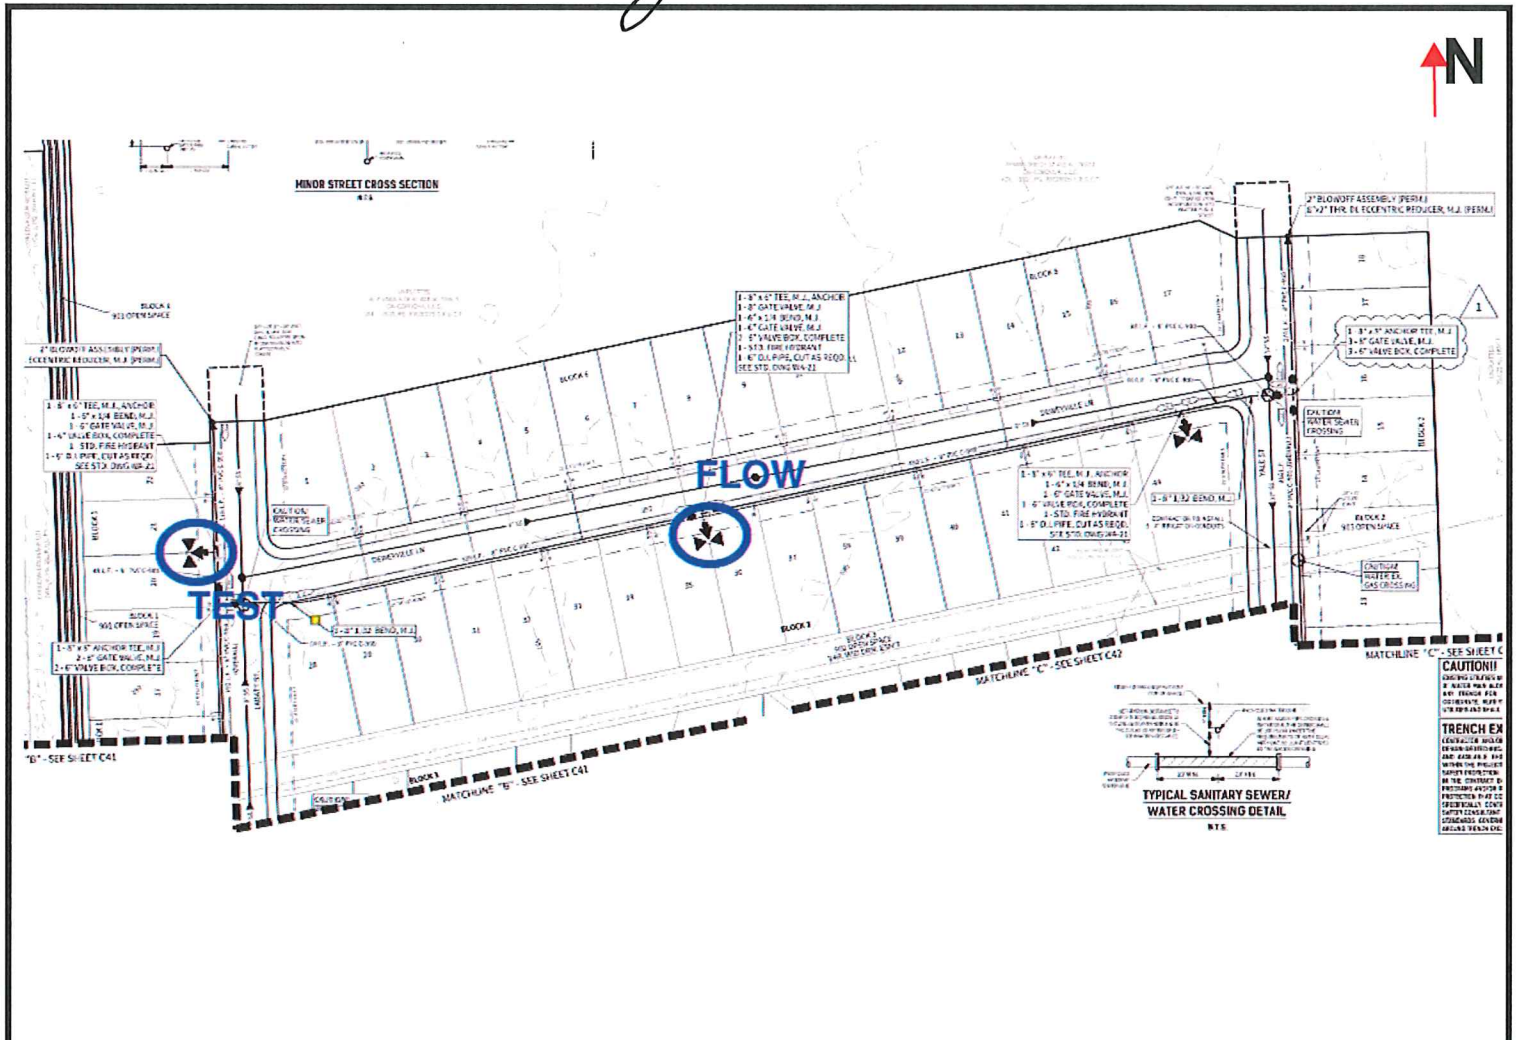

Project Name:	Cordova Trails Unit 1 - Deweyville Lane
Project Number:	24-0044
Test Date:	February 21, 2024
City:	Seguin

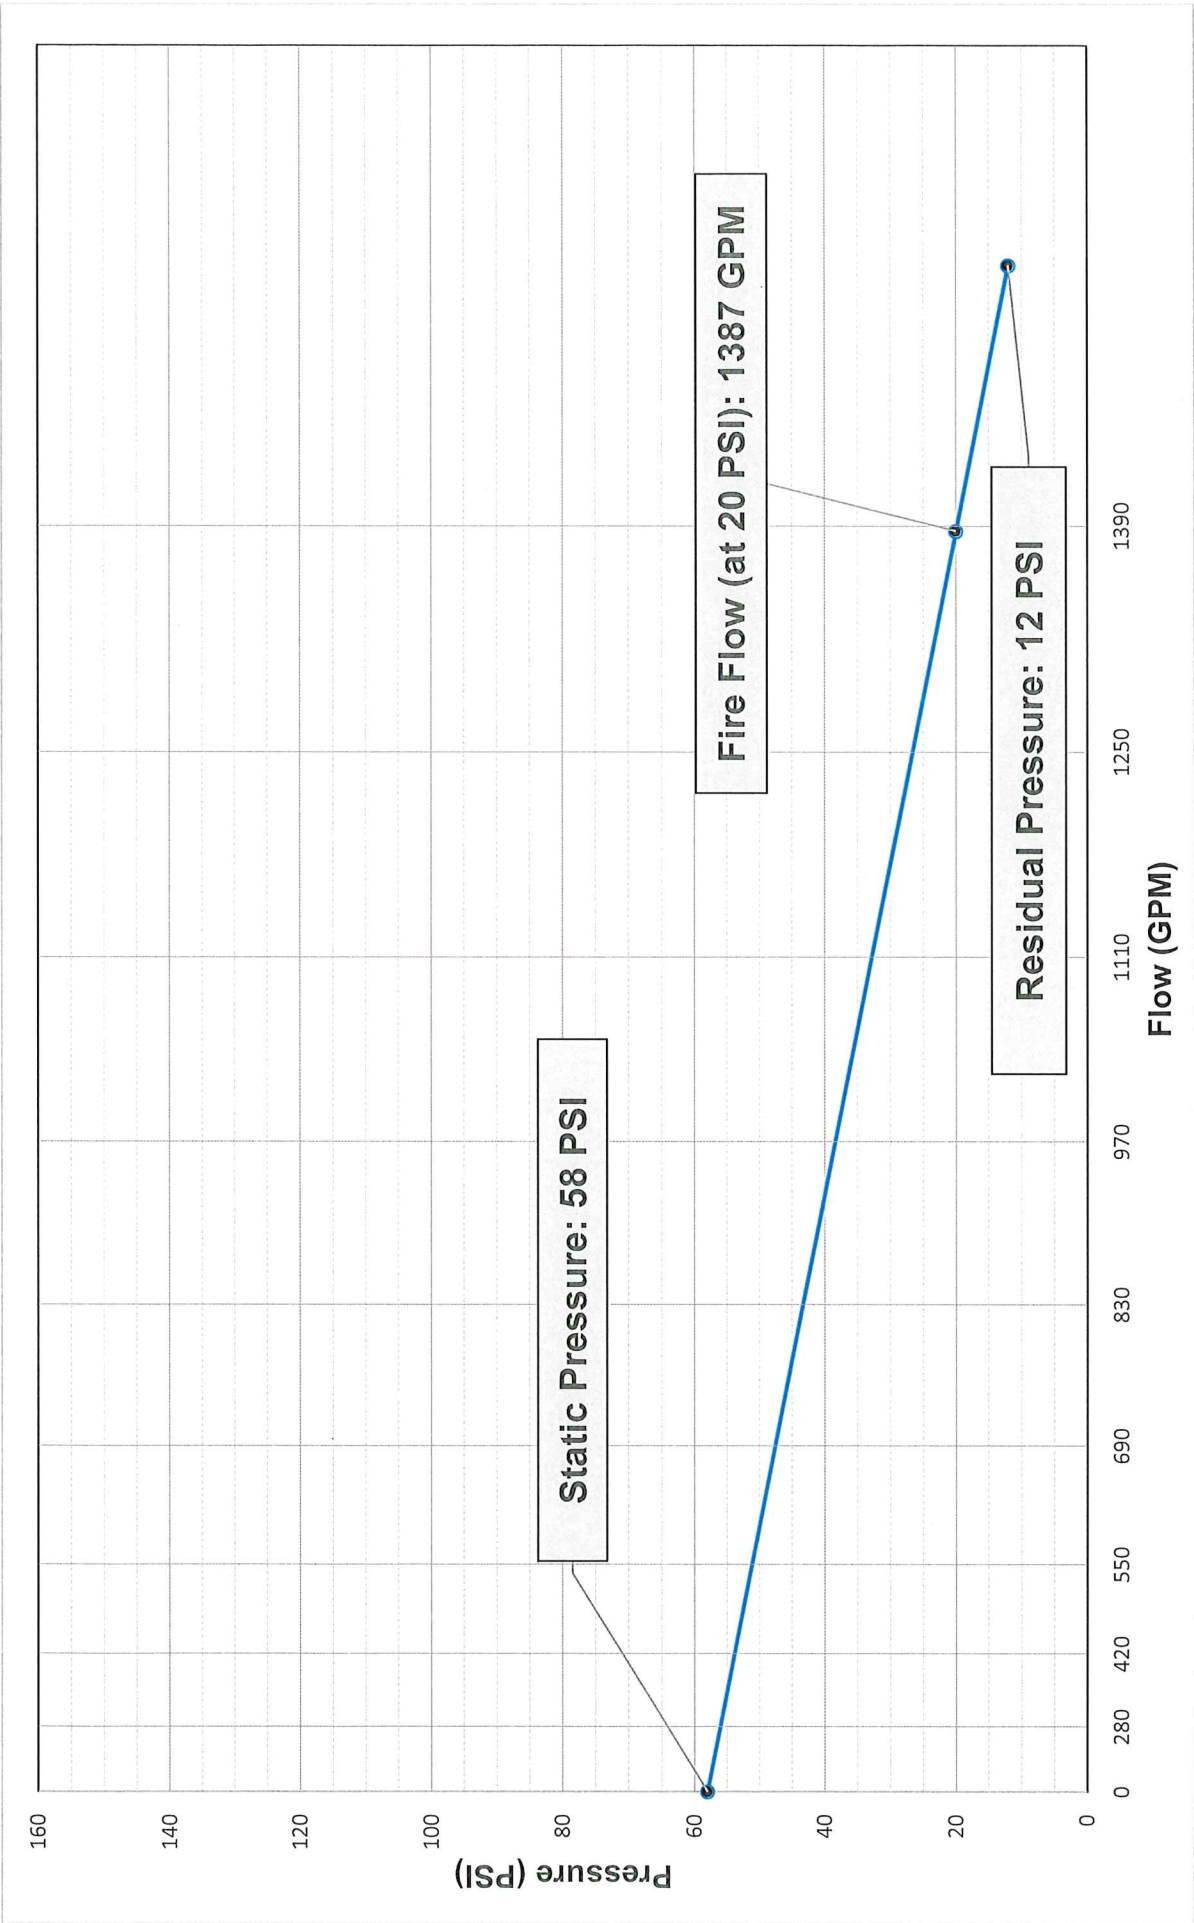

Static Pressure: 58 PSI	Residual Pressure: 12 PSI	Flow Test @ Residual Pressure: 1,538 GPM	Fire Flow (at 20 PSI): 1,387 GPM
-------------------------	---------------------------	--	----------------------------------