


CREEKS EDGE

SAN ANTONIO, TEXAS

CIVIL CONSTRUCTION PLANS

SHEET INDEX

Sheet Description	Sheet No.
COVER SHEET	C0.00
OVERALL DRAINAGE PLAN	C1.00
DRAIN "A" ~ STA. 0+33.42 TO END	C1.01
DRAIN "A" DEMO PLAN & DRAIN "A" DETAILS	C1.02
DRAIN "B" ~ STA. 1+43.61 TO END	C1.03
DRAIN "C" ~ STA. 8+06.42 TO END	C1.03
DRAIN "D" ~ STA. 1+00.00 TO END	C1.04
DRAIN DETAILS	C1.10
DRAIN DETAILS	C1.11
DRAIN DETAILS	C1.12
CREEKSIDE HOLLOW ~ STA. 1+00.00 TO STA. 4+27.41	C2.00
OAKSHADE COURT ~ STA. 4+27.41 TO STA. 6+04.25	C2.00
PINEGROVE WAY ~ STA. 6+04.25 TO END	C2.00
STREET DETAILS	C2.10
STREET DETAILS	C2.11
STREET DETAILS	C2.12
TRAFFIC CONTROL DETAILS	C2.13
TRAFFIC CONTROL DETAILS	C2.14
OVERALL SIGNAGE PLAN	C3.00
SIGNAGE DETAILS	C3.10
SIGNAGE DETAILS	C3.11
OVERALL WATER DISTRIBUTION PLAN	C4.00
WATER DISTRIBUTION PLAN DETAILS	C4.10
WATER DISTRIBUTION PLAN NOTES	C4.11
OVERALL SANITARY SEWER PLAN	C5.00
SS LINE "A" ~ STA. 1+00.00 TO END	C5.01
SANITARY SEWER DETAILS	C5.10
SANITARY SEWER NOTES	C5.11
OVERALL UTILITY PLAN	C6.00
OVERALL GRADING PLAN	C7.00
STORM WATER POLLUTION PREVENTION PLAN	C8.00
STORM WATER POLLUTION PREVENTION PLAN DETAILS	C8.10

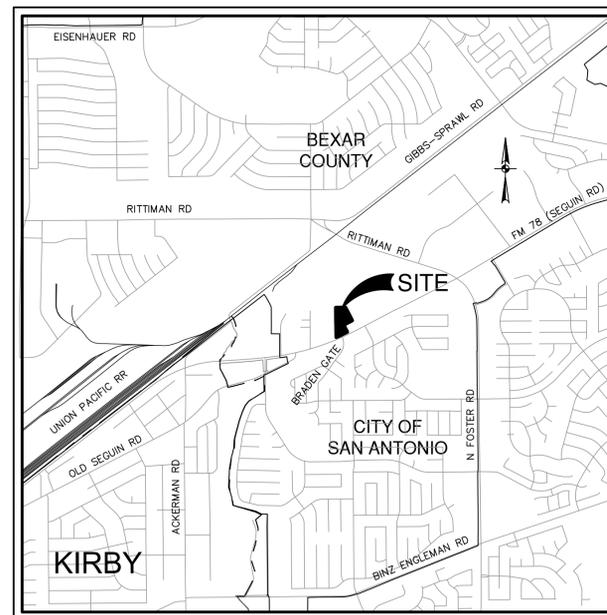

LOCATION MAP
NOT-TO-SCALE

PREPARED FOR:

S A PARTNERS INVESTMENT, LLC
7623 LOST CREEK GAP
BOERNE, TEXAS 78015

FEBRUARY 2026

PAPE-DAWSON

2000 NW LOOP 410 | SAN ANTONIO, TX 78213 | 210.375.9000
TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028800



WATER (SAWS PRESSURE ZONE 4)

DEVELOPER'S NAME: S A PARTNERS INVESTMENT, LLC
ADDRESS: 7623 LOST CREEK GAP
CITY: BOERNE STATE: TEXAS ZIP: 78015
PHONE# (210)-771-0861 FAX#
SAWS BLOCK MAP# 200598 TOTAL EDU'S 15 TOTAL ACREAGE 3.978
TOTAL LINEAR FOOTAGE OF PIPE: 172 LF 12" PIPE PLAT NO. 25-11800340
NUMBER OF LOTS 14 SAWS JOB NO. 25-1090



SEWERSHED - EAST
WASTEWATER TREATMENT PLANT: SALADO CREEK

DEVELOPER'S NAME: S A PARTNERS INVESTMENT, LLC
ADDRESS: 7623 LOST CREEK GAP
CITY: BOERNE STATE: TEXAS ZIP: 78015
PHONE# (210)-771-0861 FAX#
SAWS BLOCK MAP# 200598 TOTAL EDU'S 15 TOTAL ACREAGE 3.978
TOTAL LINEAR FOOTAGE OF PIPE: 8" 713 LF PLAT NO. 25-11800340
NUMBER OF LOTS 14 SAWS JOB NO. 25-1587

SHEET C0.00

HYDROLOGY SUMMARY TABLE (POST DEVELOPMENT - ATLAS 14 - PA3)

POINT	STRUCTURE	WATERSHED	TOTAL AREA (ACRES)	COMPOSITE C VALUE	OVERLAND FLOW		SHALLOW		CHANNEL FLOW (6 FPS)		TIME OF CONCENTRATION MINUTES	INTENSITY			FLOW			POINT
					LENGTH FEET	TRAVEL TIME MINUTES	LENGTH FEET	TRAVEL TIME MINUTES	LENGTH FEET	TRAVEL TIME MINUTES		I _s IN/HR	I _{ss} IN/HR	I ₁₀₀ IN/HR	Q _s CFS	Q _{ss} CFS	Q ₁₀₀ CFS	
-	SIDEWALK BOX	A1	1.36	0.80	25	5.0	445	3.0		0.0	8.0	6.82	9.45	11.75	7.42	10.28	12.78	-
1A	-	A2	0.82	0.88	0	5.0	284	2.0	0	0.0	7.0	7.12	9.89	12.32	5.14	7.14	8.89	1A
1	SIDEWALK BOX	A1+A2	2.18		REFERENCE STORM WATER MANAGEMENT REPORT FOR HYDRAULIC CALCULATIONS							11.84	16.41	20.40	1			
2	-	B1	0.92	0.75	100	10.5	245	1.5	0	0.0	12.0	5.84	8.00	9.96	4.03	5.52	6.87	2
3	CHANNEL	C1	1.15	0.96	0	5.0	345	2.5	256	1.5	9.0	6.54	9.04	11.22	7.22	9.98	12.39	3
4	CHANNEL	D1	0.52	0.95	0	5.0	345	3.0	190	1.0	9.0	6.42	8.87	11.01	3.17	4.38	5.44	4
-	CHANNEL	E1	3.11	0.95	80	8.5	600	3.0	105	0.5	12.0	5.84	8.05	9.95	17.25	23.77	29.40	-
5	CHANNEL	D1 + E1	3.63		REFERENCE STORM WATER MANAGEMENT REPORT FOR HYDRAULIC CALCULATIONS							19.36	26.69	33.02	5			

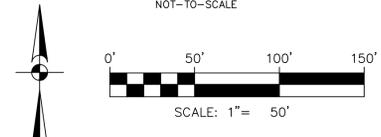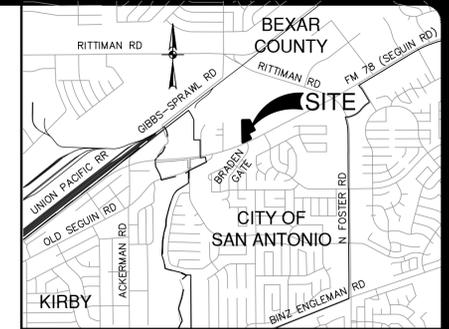

MASTER DRAINAGE LEGEND

- PROJECT LIMITS: [Symbol]
- EXISTING CONTOUR: [Symbol]
- 100 YR (ATLAS 14) FLOODPLAIN: [Symbol]
- 100 YR FLOODPLAIN: [Symbol]
- RUNOFF FLOW PATH: [Symbol]
- DRAINAGE AREA BOUNDARY: [Symbol]
- FHA LOT GRADING TYPE: [Symbol]
- PROPOSED DIRECTION OF FLOW: [Symbol]
- DRAINAGE CALCULATION POINT: [Symbol]
- DRAINAGE AREA: [Symbol]

CAUTION !!!
EXISTING UTILITIES ARE WITHIN THE LIMITS OF CONSTRUCTION. CONTRACTORS SHALL EXERCISE EXTRA CARE IN DIGGING ANY TRENCH OF PROPOSED UTILITIES. THE CONTRACTOR SHALL BE RESPONSIBLE TO COORDINATE, VERIFY THE EXACT LOCATION & IDENTIFY AREA OF CONFLICTS WITH EXISTING UTILITIES AND SHALL NOTIFY THE ENGINEER IF CONFLICT IS FOUND.

DRAINAGE & GRADING NOTES:


- THE CONTRACTOR WILL BE RESPONSIBLE FOR DETERMINING EXACT LOCATION OF ALL UTILITIES AND DRAINAGE STRUCTURES WHETHER SHOWN ON THE PLANS OR NOT. THE CONTRACTOR SHALL UNCOVER EXISTING UTILITIES PRIOR TO CONSTRUCTION TO VERIFY SIZE, GRADE, AND LOCATION. THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY OF ANY DEVIATIONS FROM PLANS PRIOR TO BEGINNING CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES, WHETHER SHOWN ON THE PLANS OR NOT, SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO REPAIR, AT HIS EXPENSE.
- ALL CONCRETE FOR TxDOT DRAINAGE STRUCTURES SHALL MEET TxDOT SPECIFICATIONS. ALL OTHER CONCRETE SHALL BE CLASS "A" 3000 PSI CYLINDER STRENGTH IN 28 DAYS.
- REFERENCE DRAINAGE DETAILS FOR PIPE TRENCH DETAILS, BOX CULVERT, HEADWALL, AND WINGWALL CONSTRUCTION DETAILS, AND BOX CULVERT BEDDING AND EXCAVATION LIMITS.
- CONTRACTOR SHALL GROUT ALL CURB INLETS AND JUNCTION BOXES TO PROVIDE FOR POSITIVE DRAINAGE.
- EARTHEN CHANNELS WILL BE VEGETATED BY SEEDING OR SODDING. 85% OF THE CHANNEL SURFACE MUST HAVE ESTABLISHED VEGETATION BEFORE THE CITY OF SAN ANTONIO WILL ACCEPT.
- CONTRACTOR SHALL MATCH TOP OF CHANNEL TO NATURAL GROUND AND MAINTAIN A MINIMUM CHANNEL DEPTH OF "D" AS SHOWN IN THE PROFILE.

CAUTION!!


CONTRACTOR SHALL BE REQUIRED TO LOCATE ALL PUBLIC OR PRIVATE UTILITIES INCLUDING BUT NOT LIMITING TO: WATER, SEWER, TELEPHONE AND FIBER OPTIC LINES, SITE LIGHTING ELECTRIC, SECONDARY ELECTRIC, PRIMARY ELECTRICAL DUCTBANKS, LANDSCAPE IRRIGATION FACILITIES, AND GAS LINES. ANY UTILITY CONFLICTS THAT ARISE SHOULD BE COMMUNICATED TO THE ENGINEER IMMEDIATELY AND PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL CONTACT 1-800-DIG-TESS A MINIMUM OF 48 HOURS PRIOR TO THE START OF CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THE REPAIR SHALL BE AT CONTRACTOR'S SOLE EXPENSE WHETHER THE UTILITY IS SHOWN ON THESE PLANS OR NOT.

TRENCH EXCAVATION SAFETY PROTECTION:

CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/ GEOTECHNICAL/ SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND/OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

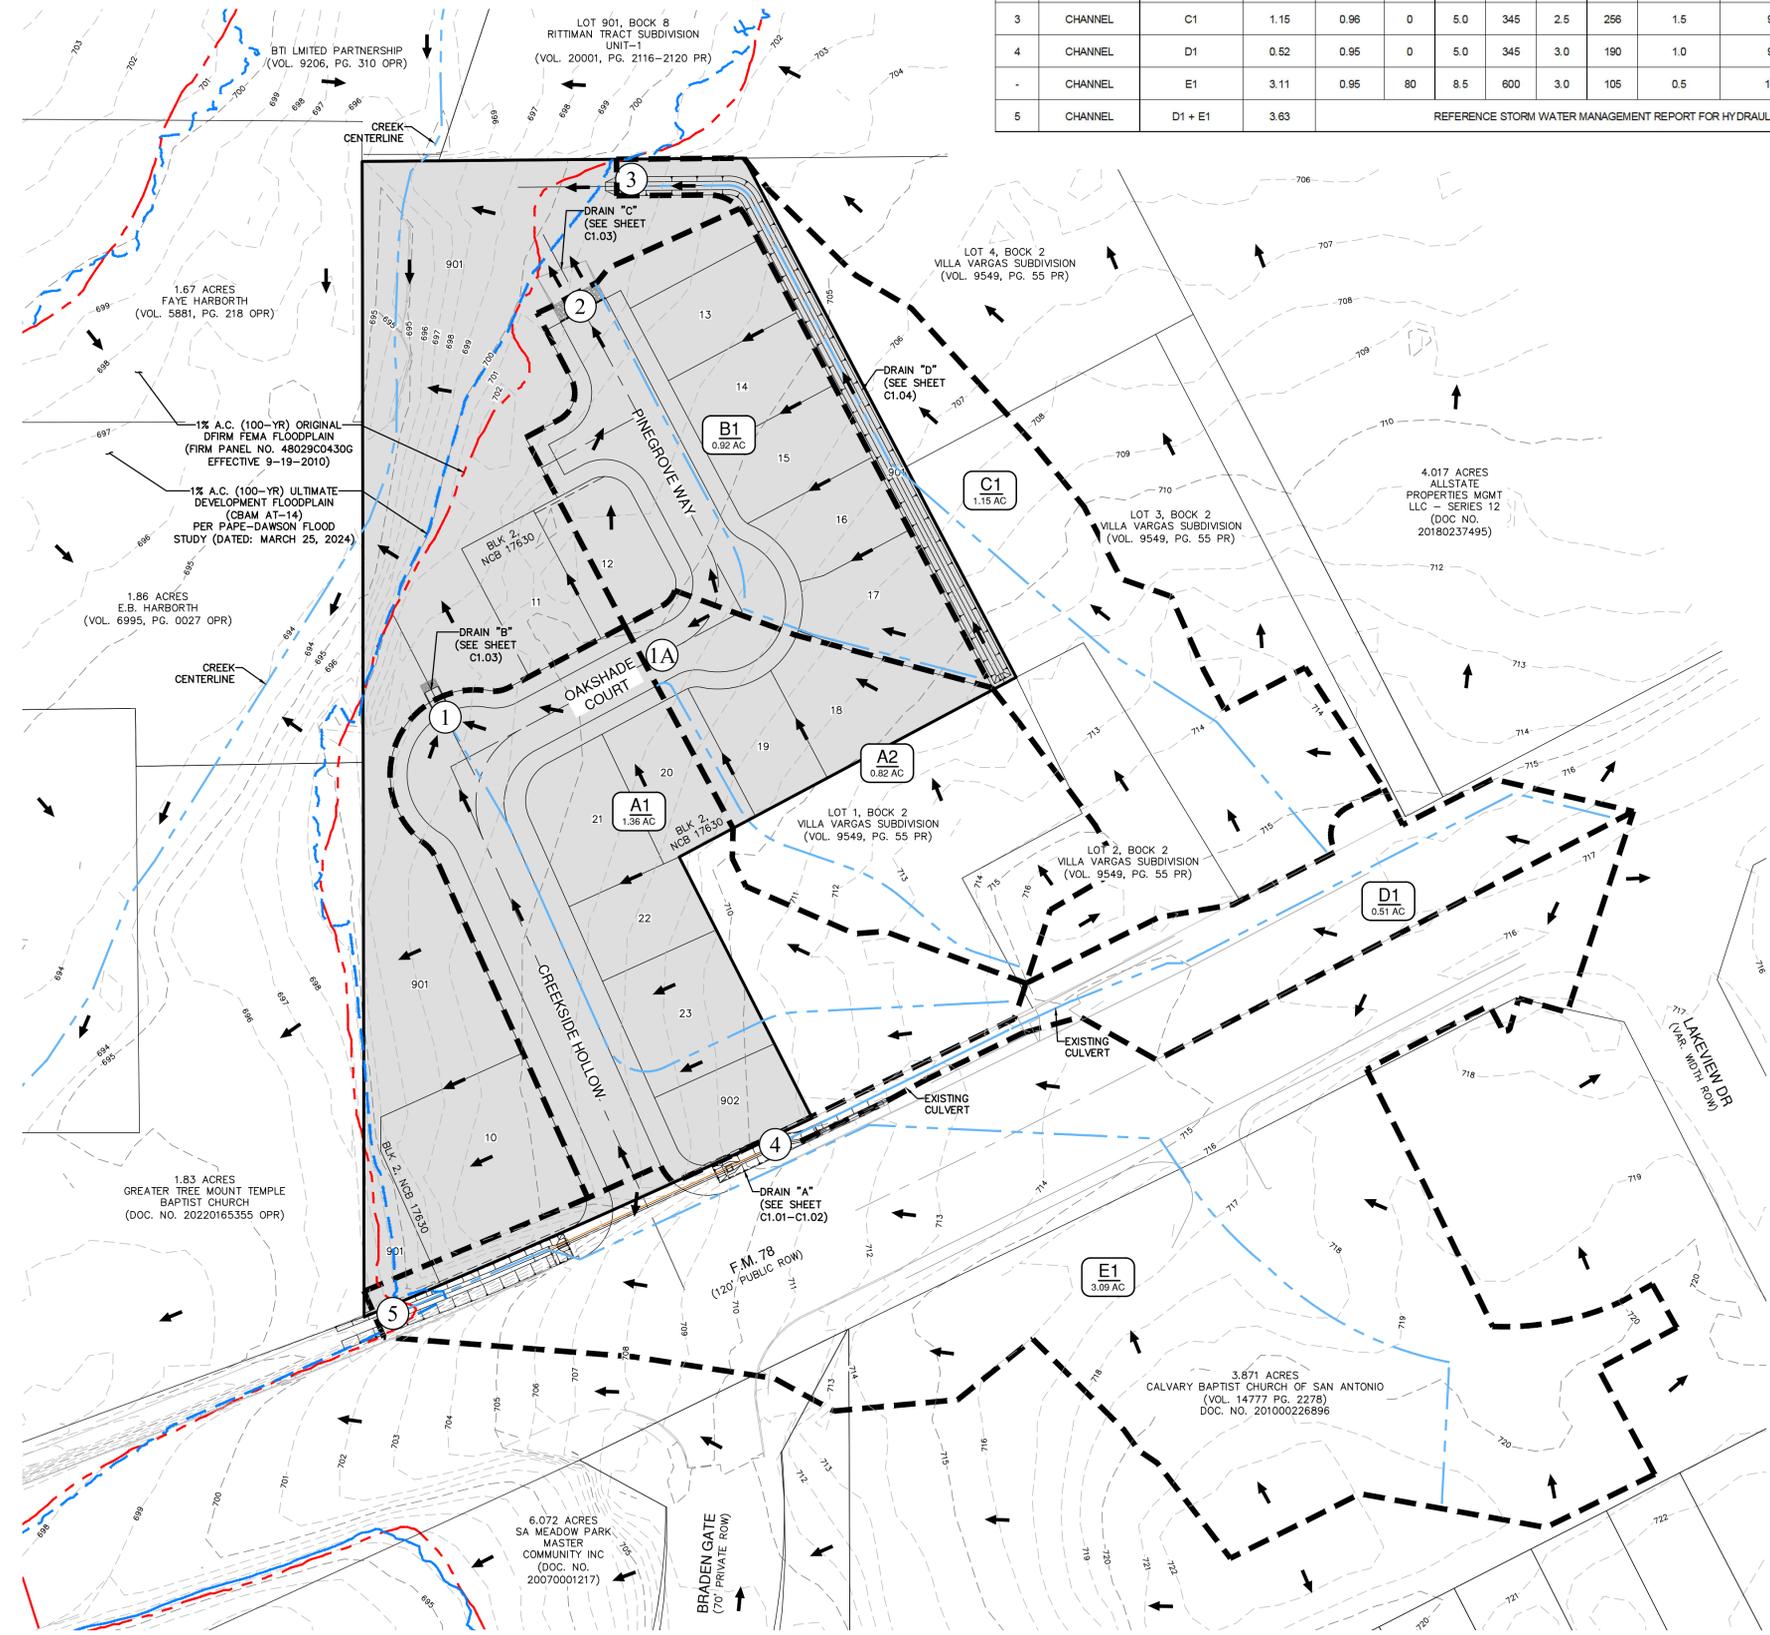

DATE	
NO.	
REVISION	



PAPE-DAWSON
2000 NW LOOP 410 | SAN ANTONIO, TX 78243 | 210.375.9000
TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028800


CREEKS EDGE
SAN ANTONIO, TEXAS
OVERALL DRAINAGE PLAN

PLAT NO.	25-11800340
JOB NO.	13657-10
DATE	FEBRUARY 2026
DESIGNER	CB
CHECKED	JA DRAWN CB
SHEET	C1.00

Notes: File: 06_2025_3_16.dwg User: J. Adame Date: 1/8/26
 This document has been produced from material that was stored and/or transmitted electronically and may have been inadvertently altered. Rely only on final hardcopy materials bearing the consultants' original signature and seal. Aerial imagery provided by Google/Esri unless otherwise noted. Imagery © 2016, CAPOCO, DigitalGlobe, Texas Orthographic Program, USDA Farm Service Agency.



DRAINAGE LEGEND

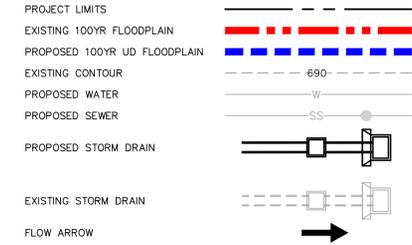

KEY LEGEND:

- (A) 1' VEHICLE NON-ACCESS EASEMENT (NOT-TO-SCALE)
- (B) 5' DEVELOPER SIDEWALK
- (C) 5' EXISTING SIDEWALK
- (D) 14' ELEC., GAS, TEL., CATV EASEMENT (VOL. 9549, PG 55 PR)
- (E) 25' BUILDING SETBACK (VOL. 9549, PG. 55 PR)
- (F) 5' DRAINAGE EASEMENT
- (G) 12' WATER EASEMENT
- (H) 14' ELEC., GAS, TEL., CATV EASEMENT
- (I) EFFECTIVE (EXISTING) FEMA 1% ANNUAL CHANCE (100-YR) FLOOD PLAIN (FIRM PANEL NO. 4802904300 EFFECTIVE 9-19-2010)
- (J) 1% ANNUAL CHANCE (100-YR) ATLAS 14 UD CONDITIONS FLOODPLAIN PER PAPE-DAWSON FLOOD STUDY (DATED: MARCH 25, 2024)
- (K) 13' ELEC., GAS, TEL., CATV EASEMENT
- (L) 10' PEDESTRIAN EASEMENT

OPEN CHANNEL NOTE:

CONTRACTOR SHALL REFERENCE TABLE 9.3.8.1 - "RETARDATION CLASS FOR LINING MATERIALS" PROVIDED ON SHEET C1.15 AND SUPPLIED RETARDANCE CLASS (RC) FOR CHOICE OF COVER WITHIN OPEN EARTHEN CHANNEL CROSS-SECTIONS.

DRAINAGE & GRADING NOTES:

1. A TxDOT ROW PERMIT MUST BE OBTAINED BEFORE WORKING IN TxDOT ROW. CONTRACTOR SHALL COORDINATE A TRAFFIC CONTROL PLAN FOR ALL WORK WITHIN THE ROW. ADDITIONAL WARNING SIGNS MAY BE RECOMMENDED BY THE ENGINEER ONCE THE ROADWAYS ARE CONSTRUCTED.
2. THE CONTRACTOR WILL BE RESPONSIBLE FOR DETERMINING EXACT LOCATION OF ALL UTILITIES AND DRAINAGE STRUCTURES WHETHER SHOWN ON THE PLANS OR NOT. THE CONTRACTOR SHALL UNCOVER EXISTING UTILITIES PRIOR TO CONSTRUCTION TO VERIFY SIZE, GRADE, AND LOCATION. THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY OF ANY DEVIATIONS FROM PLANS PRIOR TO BEGINNING CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES, WHETHER SHOWN ON THE PLANS OR NOT, SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO REPAIR, AT HIS EXPENSE.
3. ALL CONCRETE FOR TxDOT DRAINAGE STRUCTURES SHALL MEET TxDOT SPECIFICATIONS. ALL OTHER CONCRETE SHALL BE CLASS "A" 3000 PSI CYLINDER STRENGTH IN 28 DAYS.
4. REFERENCE DRAINAGE DETAILS FOR PIPE TRENCH DETAILS, BOX CULVERT, HEADWALL, AND WINGWALL CONSTRUCTION DETAILS, AND BOX CULVERT BEDDING AND EXCAVATION LIMITS.
5. CONTRACTOR SHALL GROUT ALL CURB INLETS AND JUNCTION BOXES TO PROVIDE FOR POSITIVE DRAINAGE.
6. EARTHEN CHANNELS WILL BE VEGETATED BY SEEDING OR SODDING. 85% OF THE CHANNEL SURFACE MUST HAVE ESTABLISHED VEGETATION BEFORE THE CITY OF SAN ANTONIO WILL ACCEPT.
7. CONTRACTOR SHALL MATCH TOP OF CHANNEL TO NATURAL GROUND AND MAINTAIN A MINIMUM CHANNEL DEPTH OF "D" AS SHOWN IN THE PROFILE.


CAUTION!!

CONTRACTOR SHALL BE REQUIRED TO LOCATE ALL PUBLIC OR PRIVATE UTILITIES INCLUDING BUT NOT LIMITING TO: WATER, SEWER, TELEPHONE AND FIBER OPTIC LINES, SITE LIGHTING ELECTRIC, SECONDARY ELECTRIC, PRIMARY ELECTRICAL DUCTBANKS, LANDSCAPE IRRIGATION FACILITIES, AND GAS LINES. ANY UTILITY CONFLICTS THAT ARISE SHOULD BE COMMUNICATED TO THE ENGINEER IMMEDIATELY AND PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL CONTACT 1-800-DIG-TESS A MINIMUM OF 48 HOURS PRIOR TO THE START OF CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THE REPAIR SHALL BE AT CONTRACTOR'S SOLE EXPENSE WHETHER THE UTILITY IS SHOWN ON THESE PLANS OR NOT.

TRENCH EXCAVATION SAFETY PROTECTION:

CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/ GEOTECHNICAL/ SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND/OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.



DATE	
NO.	REVISION



PAPE-DAWSON
 2000 NW LOOP 410 | SAN ANTONIO, TX 78243 | 210.375.9000
 TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028800


CREEKS EDGE
 SAN ANTONIO, TEXAS
 DRAIN "A" DEMO PLAN
 DRAIN "A" DETAILS

PLAT NO.	25-11800340
JOB NO.	13657-10
DATE	NOVEMBER 2025
DESIGNER	CB
CHECKED	JA DRAWN CB
SHEET	C1.02

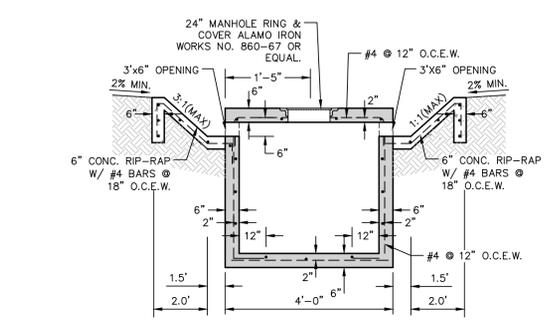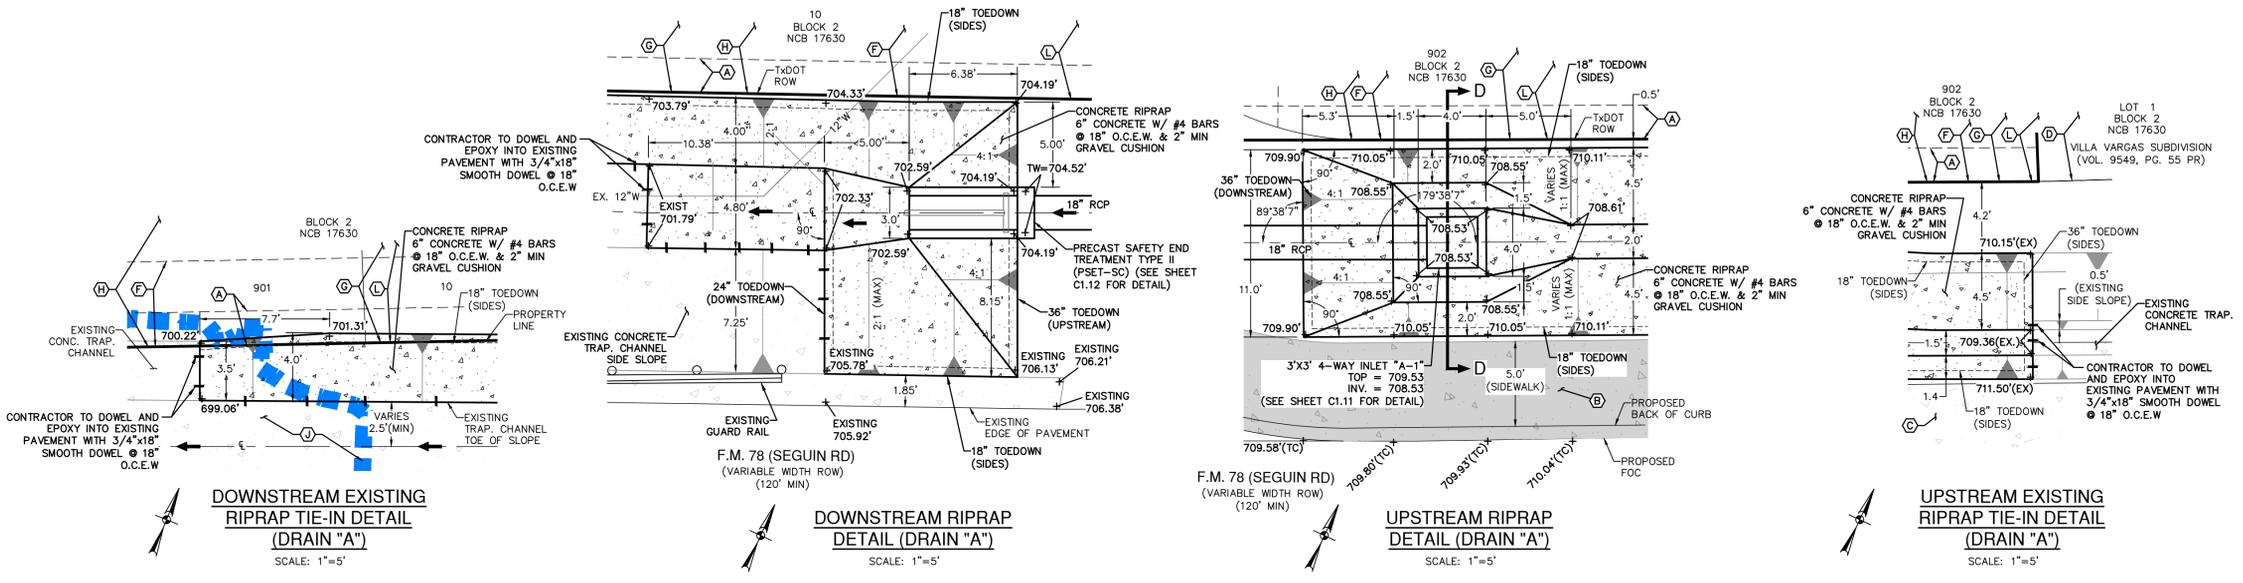






SECTION "D-D" (DRAIN "A")
 3'x3' 4-WAY INLET "A-1"
 NOT-TO-SCALE

HYDRAULIC CALCULATIONS	
4-WAY INLET "A-1" CURB OPENING (DRAIN "A")	
Q25 =	4.38 CFS
Bw =	C X L X h^(3/2) (WER EQ.)
C =	3.087
h =	0.50 FT (6")
C =	$\frac{Q}{C \times h^{3/2}}$
Lcal =	$\frac{4.38 \text{ CFS}}{(3.087)(0.50 \text{ FT})^{3/2}}$
Lcal =	4.01 FT
L =	USE 12" OPENING (3'x3' 4-WAY INLET)

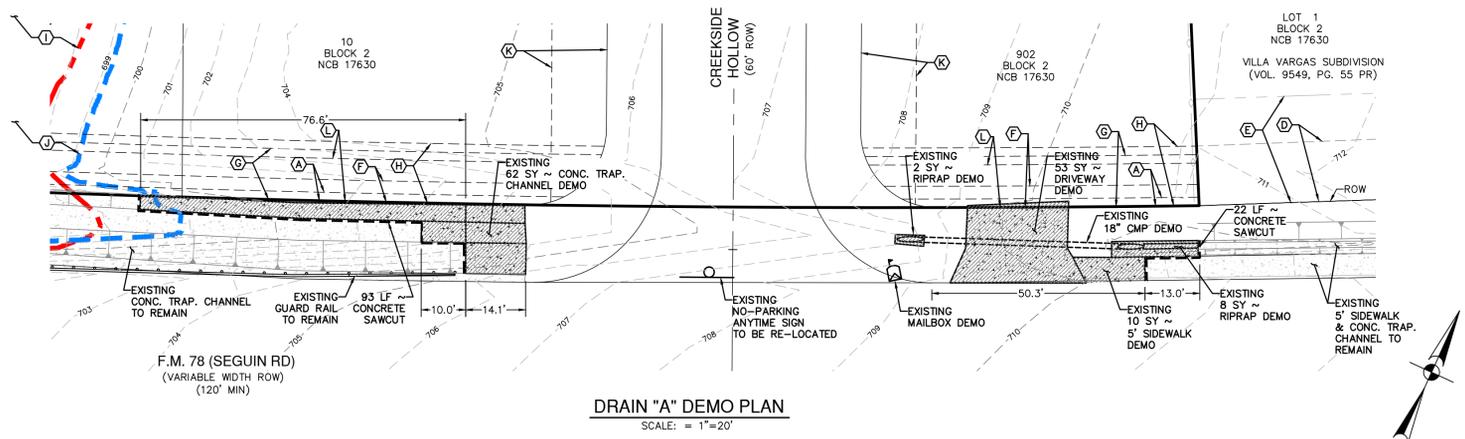

DRAIN "A" DEMO PLAN
 SCALE: 1"=20'

Date: Nov 06, 2025, 9:26am User: JD - kshifit
 Plot: PA-USA-25-11800340.dwg Path: C:\Users\jda\OneDrive\Documents\25-11800340.dwg
 THIS DOCUMENT HAS BEEN PRODUCED FROM MATERIAL THAT WAS STORED AND/OR TRANSMITTED ELECTRONICALLY AND MAY HAVE BEEN INADVERTENTLY ALTERED. RELY ONLY ON FINAL HARD COPY MATERIALS BEARING THE CONSULTANT'S ORIGINAL SIGNATURE AND SEAL. AERIAL IMAGERY PROVIDED BY GOOGLE; UNLESS OTHERWISE NOTED. Imagery © 2016 CAPCOOL Digital Globe, Texas Orthology Program, USDA Farm Service Agency.

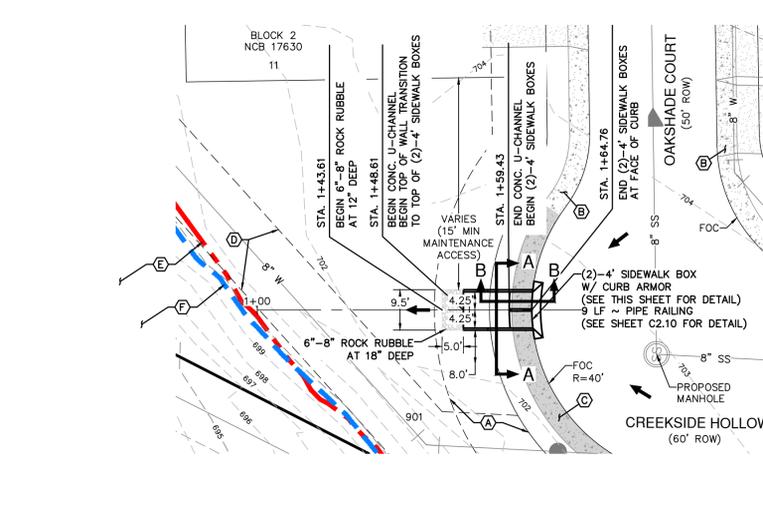
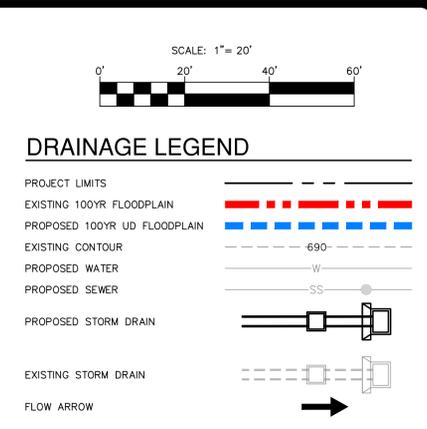
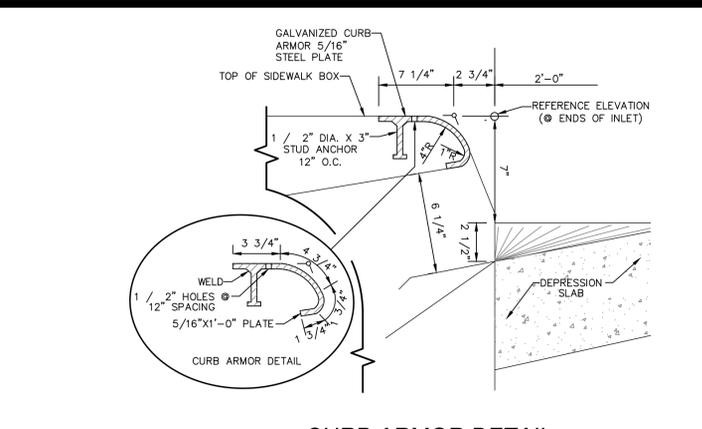
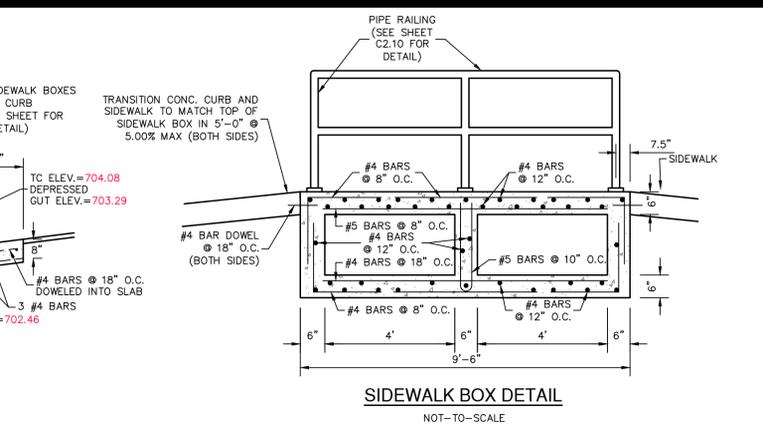
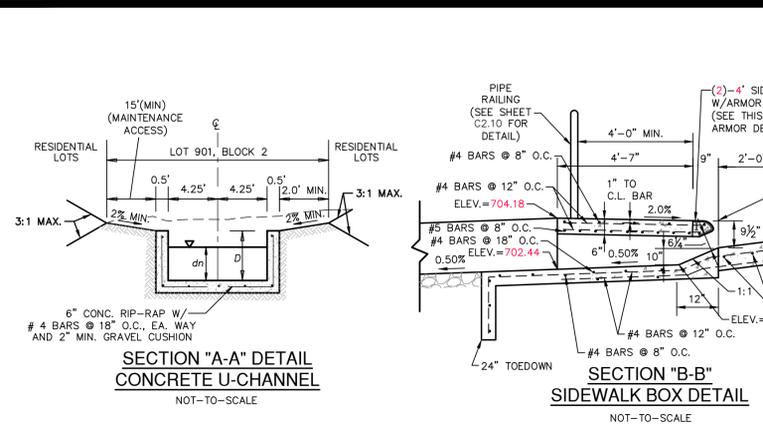


**HYDRAULIC CALCULATIONS
SIDEWALK BOX CURB OPENING
(DRAIN "B")**

Q25 = 16.41 CFS
 $B_w = C \times L \times h^{3/2}$ (WIER EQ.)
 $C = 3.087$
 $h = 0.79$ FT (9")
 $C = \frac{Q}{B_w \times h^{3/2}}$
 $C = 3.087$
 $L_{cal} = \frac{Q}{C \times h^{3/2}}$
 $L_{cal} = 7.57$ FT
 $L = 8'$ OPENING (2)-4' SIDEWALK BOX

**HYDRAULIC CALCULATIONS
ROCK RIPRAP
(OUTFALL)**
 STA. 1+43.61 TO 1+48.61
 Q25 = 16.41 CFS
 $B_w = 8.5'$
 $n = 0.035$
 $S = 0.50\%$
 $D = 1.50'$
 $dn = 0.83'$
 $V = 2.33$ fps
 $\tau_c = 0.22$ LB/FT²
 RC= ROCK D50=6in

**HYDRAULIC CALCULATIONS
CONC RIPRAP
(OUTFALL)**
 STA. 1+48.61 TO 1+59.43
 Q25 = 16.41 CFS
 $B_w = 8.5'$
 $n = 0.015$
 $S = 0.50\%$
 $D = 1.50'$
 $dn = 0.49'$
 $V = 3.94$ fps

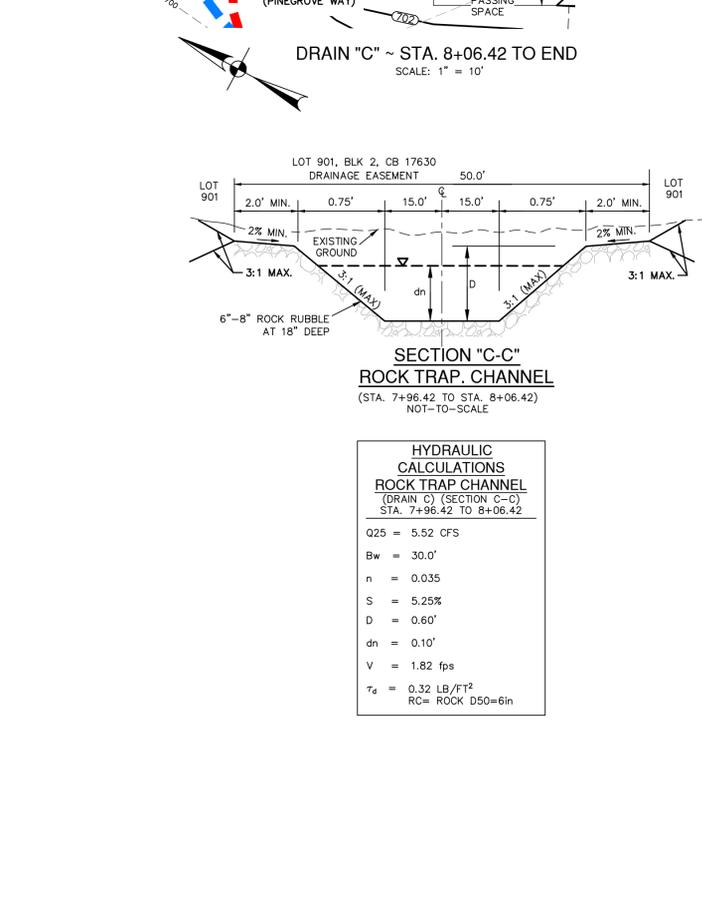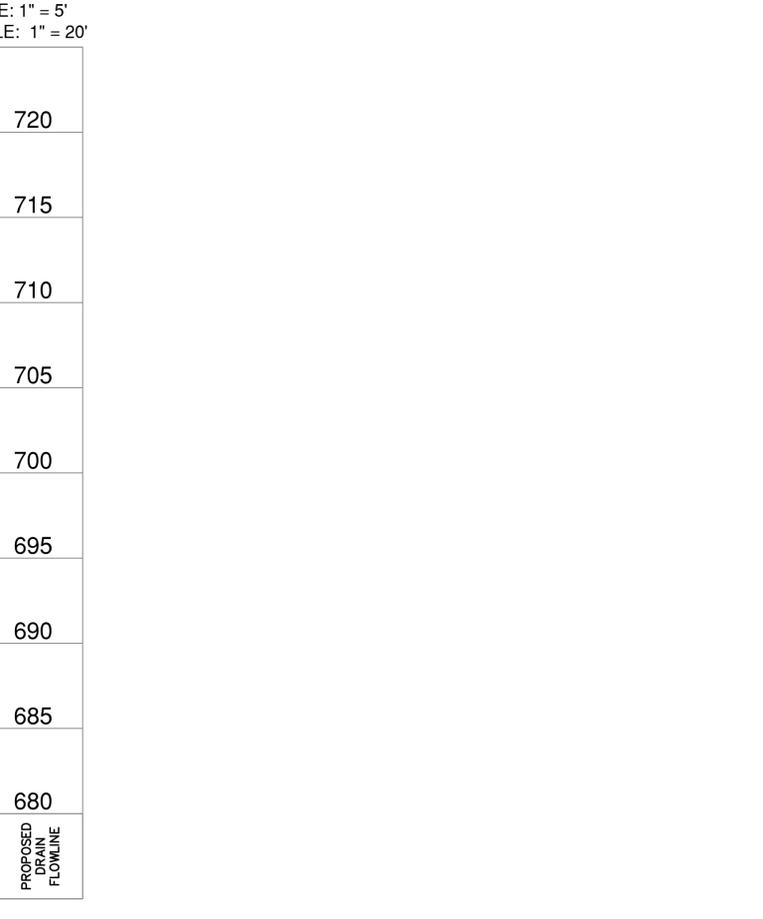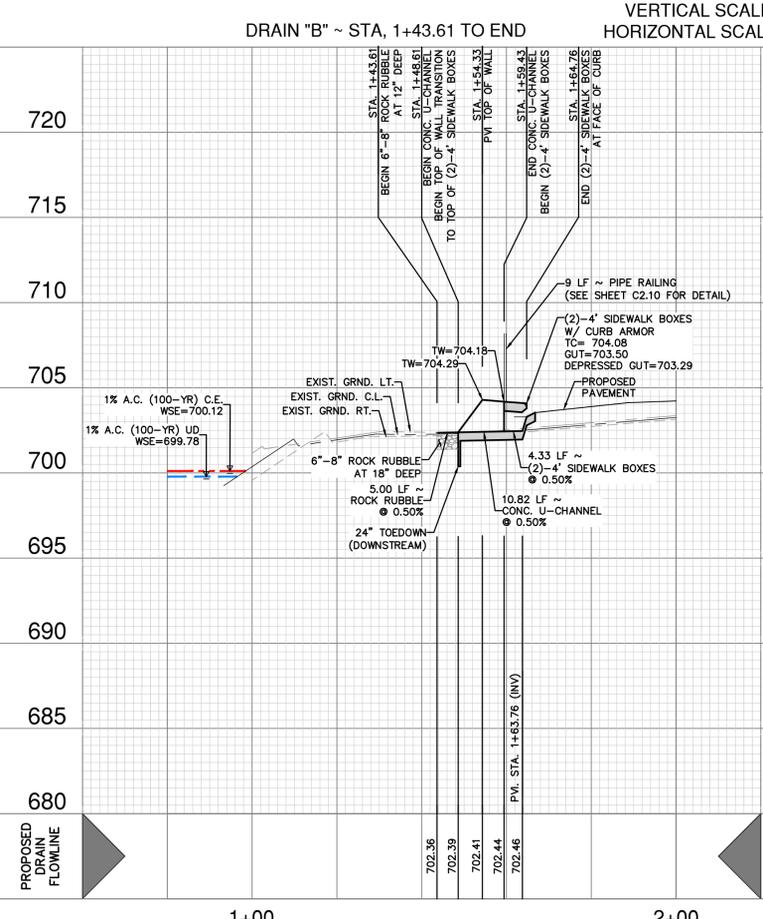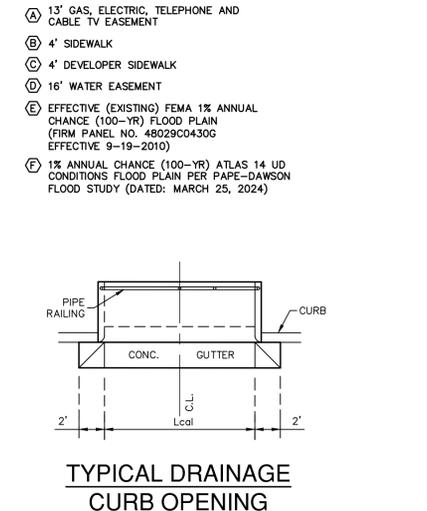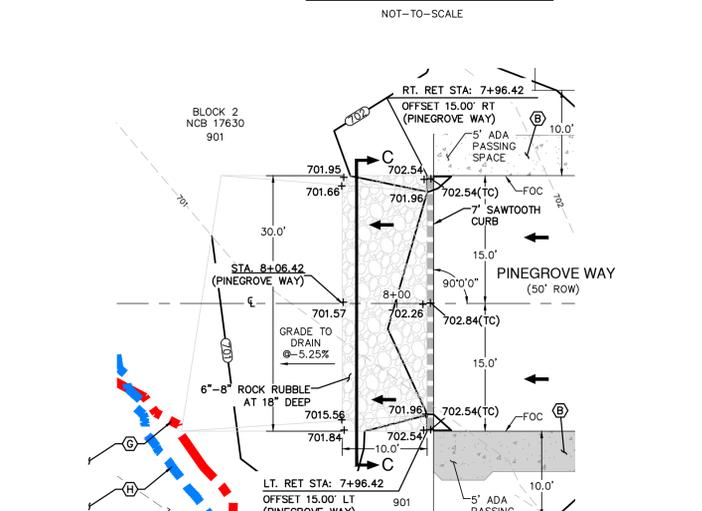

OPEN CHANNEL NOTE:
 CONTRACTOR SHALL REFERENCE TABLE 9.3.8.1 - "RETARDATION CLASS FOR LINING MATERIALS" PROVIDED ON SHEET C1.15 AND SUPPLIED RETARDANCE CLASS (RC) FOR CHOICE OF COVER WITHIN OPEN EARTHEN CHANNEL CROSS-SECTIONS.

DRAINAGE & GRADING NOTES:

- A TxDOT ROW PERMIT MUST BE OBTAINED BEFORE WORKING IN TxDOT ROW. CONTRACTOR SHALL COORDINATE A TRAFFIC CONTROL PLAN FOR ALL WORK WITHIN THE ROW. ADDITIONAL WARNING SIGNS MAY BE RECOMMENDED BY THE ENGINEER ONCE THE ROADWAYS ARE CONSTRUCTED.
- THE CONTRACTOR WILL BE RESPONSIBLE FOR DETERMINING EXACT LOCATION OF ALL UTILITIES AND DRAINAGE STRUCTURES WHETHER SHOWN ON THE PLANS OR NOT. THE CONTRACTOR SHALL UNCOVER EXISTING UTILITIES PRIOR TO CONSTRUCTION TO VERIFY SIZE, GRADE, AND LOCATION. THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY OF ANY DEVIATIONS FROM PLANS PRIOR TO BEGINNING CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES, WHETHER SHOWN ON THE PLANS OR NOT, SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO REPAIR, AT HIS EXPENSE.
- ALL CONCRETE FOR TxDOT DRAINAGE STRUCTURES SHALL MEET TxDOT SPECIFICATIONS. ALL OTHER CONCRETE SHALL BE CLASS "A" 3000 PSI CYLINDER STRENGTH IN 28 DAYS.
- REFERENCE DRAINAGE DETAILS FOR PIPE TRENCH DETAILS, BOX CULVERT, HEADWALL, AND WINGWALL CONSTRUCTION DETAILS, AND BOX CULVERT BEDDING AND EXCAVATION LIMITS.
- CONTRACTOR SHALL GROUT ALL CURB INLETS AND JUNCTION BOXES TO PROVIDE POSITIVE DRAINAGE.
- EARTHEN CHANNELS WILL BE VEGETATED BY SEEDING OR SODDING. 85% OF THE CHANNEL SURFACE MUST HAVE ESTABLISHED VEGETATION BEFORE THE CITY OF SAN ANTONIO WILL ACCEPT.
- CONTRACTOR SHALL MATCH TOP OF CHANNEL TO NATURAL GROUND AND MAINTAIN A MINIMUM CHANNEL DEPTH OF "D" AS SHOWN IN THE PROFILE.

CAUTION!!
 CONTRACTOR SHALL BE REQUIRED TO LOCATE ALL PUBLIC OR PRIVATE UTILITIES INCLUDING BUT NOT LIMITING TO: WATER, SEWER, TELEPHONE AND FIBER OPTIC LINES, SITE LIGHTING ELECTRIC, SECONDARY ELECTRIC, PRIMARY ELECTRICAL DUCTBANKS, LANDSCAPE IRRIGATION FACILITIES, AND GAS LINES. ANY UTILITY CONFLICTS THAT ARISE SHOULD BE COMMUNICATED TO THE ENGINEER IMMEDIATELY AND PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL CONTACT 1-800-DIG-TESS A MINIMUM OF 48 HOURS PRIOR TO THE START OF CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THE REPAIR SHALL BE AT CONTRACTOR'S SOLE EXPENSE WHETHER THE UTILITY IS SHOWN ON THESE PLANS OR NOT.

TRENCH EXCAVATION SAFETY PROTECTION:
 CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/ GEOTECHNICAL/ SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND /OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

DATE: _____

NO. REVISION: _____

STATE OF TEXAS
 JON D. ADAME
 82567
 LICENSED PROFESSIONAL ENGINEER

PAPE-DAWSON
 2000 NW LOOP 410 | SAN ANTONIO, TX 78213 | 210.375.9000
 TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028800


CREEKS EDGE
 SAN ANTONIO, TEXAS

DRAIN "B" ~ STA. 1+43.61 TO END
 DRAIN "C" ~ STA. 8+06.42 TO END




PLAT NO. 25-11800340
 JOB NO. 13657-10
 DATE FEBRUARY 2026
 DESIGNER CB
 CHECKED JA DRAWN CB
 SHEET C1.03

Notes: File: 06_2026_3_50.dwg User: JDA Date: 02/19/2026
 Plot: P:\Projects\25-11800340\Drawings\C1A1.dwg Scale: 1/8"=1'-0"


THIS DOCUMENT HAS BEEN PRODUCED FROM MATERIAL THAT WAS STORED AND/OR TRANSMITTED ELECTRONICALLY AND MAY HAVE BEEN INADVERTENTLY ALTERED. RELY ONLY ON FINAL HARDCOPY MATERIALS BEARING THE CONSULTANT'S ORIGINAL SIGNATURE AND SEAL. IMAGERY PROVIDED BY GOOGLE; UNLESS OTHERWISE NOTED. Imagery © 2016, CAPCO Digital Globe, Texas Orthology Program, USDA Farm Service Agency.

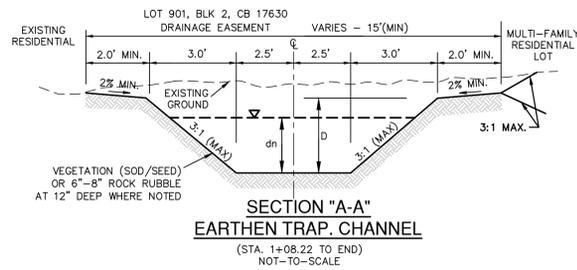

HYDRAULIC CALCULATIONS EARTH TRAP CHANNEL (DRAIN D) (SECTION A-A) STA. 1+08.22 TO 2+40.00	HYDRAULIC CALCULATIONS EARTH TRAP CHANNEL (DRAIN D) (SECTION A-A) STA. 2+40.00 TO 4+40.00	HYDRAULIC CALCULATIONS EARTH TRAP CHANNEL (DRAIN D) (SECTION A-A) STA. 4+40.00 TO END
Q25 = 9.98 CFS	Q25 = 9.98 CFS	Q25 = 9.98 CFS
Bw = 5.0'	Bw = 5.0'	Bw = 5.0'
n = 0.035	n = 0.035	n = 0.035
S = 1.80%	S = 2.18%	S = 3.85%
D = 1.00'	D = 1.00'	D = 1.00'
dn = 0.50'	dn = 0.48'	dn = 0.41'
V = 3.07 fps	V = 3.23 fps	V = 3.91 fps
$\tau_d = 0.45 \text{ LB/FT}^2$ RC= B,C,D	$\tau_d = 0.47 \text{ LB/FT}^2$ RC= B,C,D	$\tau_d = 0.47 \text{ LB/FT}^2$ RC= B,C,D

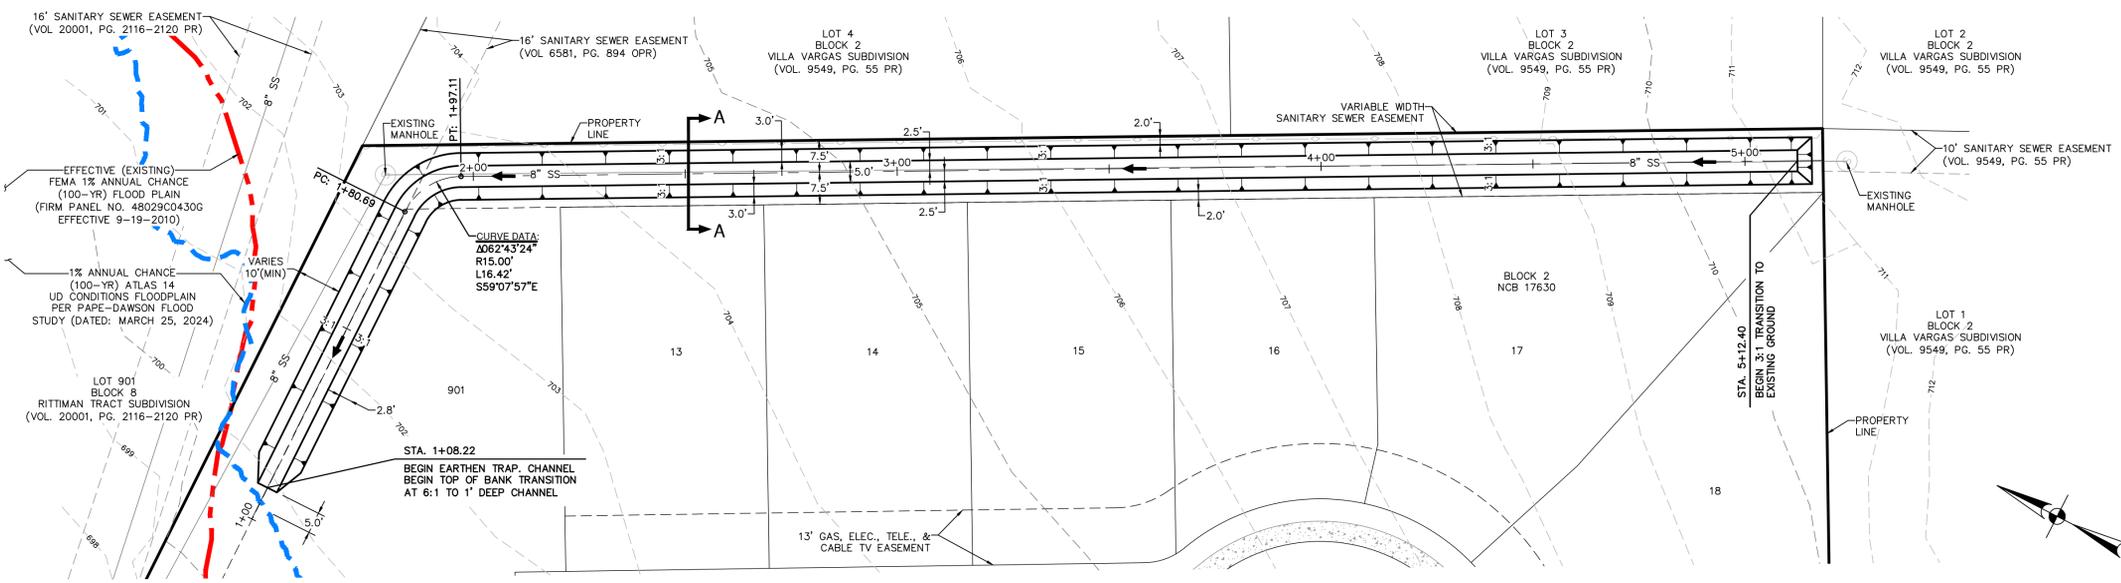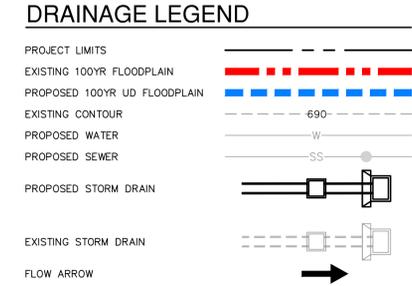

DRAIN "D" ~ STA. 1+00.00 TO END
VERTICAL SCALE: 1" = 5'
HORIZONTAL SCALE: 1" = 20'

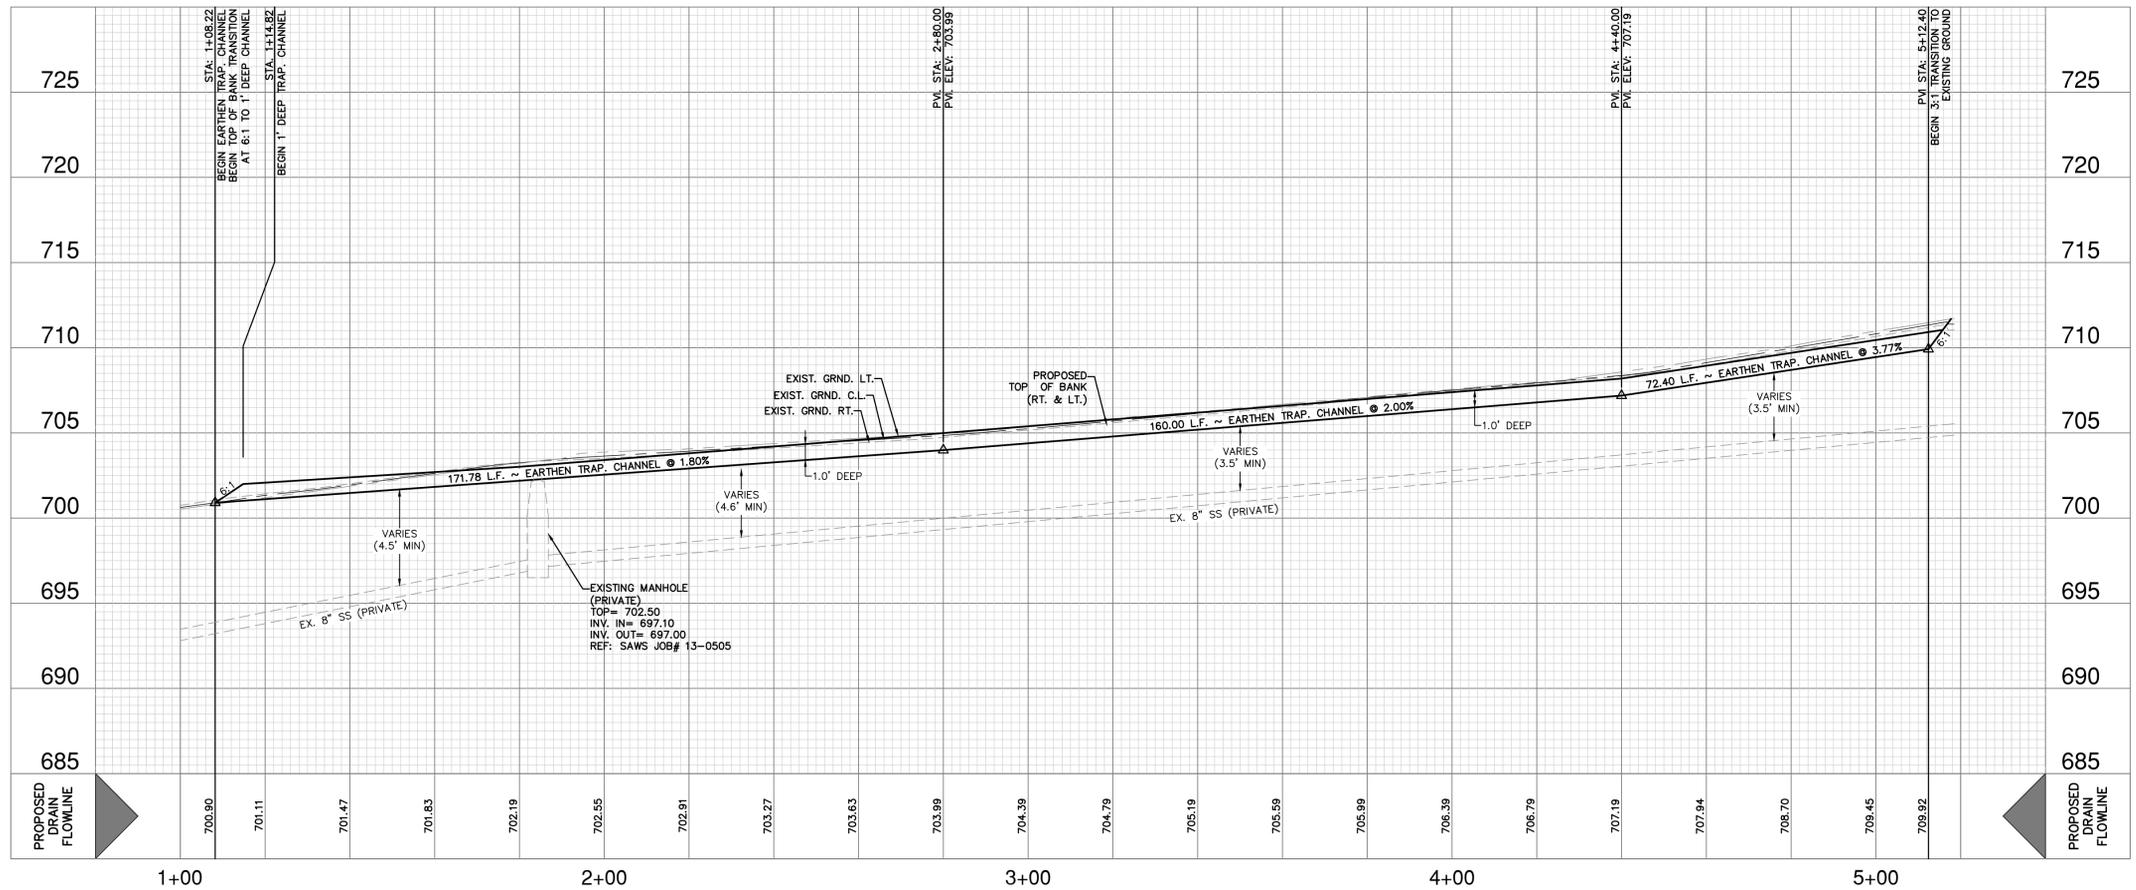

OPEN CHANNEL NOTE:
CONTRACTOR SHALL REFERENCE TABLE 9.3.8.1 - "RETARDATION CLASS FOR LINING MATERIALS" PROVIDED ON SHEET C1.15 AND SUPPLIED RETARDANCE CLASS (RC) FOR CHOICE OF COVER WITHIN OPEN EARTHEN CHANNEL CROSS-SECTIONS.

- DRAINAGE & GRADING NOTES:**
- A TxDOT ROW PERMIT MUST BE OBTAINED BEFORE WORKING IN TxDOT ROW. CONTRACTOR SHALL COORDINATE A TRAFFIC CONTROL PLAN FOR ALL WORK WITHIN THE ROW. ADDITIONAL WARNING SIGNS MAY BE RECOMMENDED BY THE ENGINEER ONCE THE ROADWAYS ARE CONSTRUCTED.
 - THE CONTRACTOR WILL BE RESPONSIBLE FOR DETERMINING EXACT LOCATION OF ALL UTILITIES AND DRAINAGE STRUCTURES WHETHER SHOWN ON THE PLANS OR NOT. THE CONTRACTOR SHALL UNCOVER EXISTING UTILITIES PRIOR TO CONSTRUCTION TO VERIFY SIZE, GRADE, AND LOCATION. THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY OF ANY DEVIATIONS FROM PLANS PRIOR TO BEGINNING CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES, WHETHER SHOWN ON THE PLANS OR NOT, SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO REPAIR, AT HIS EXPENSE.
 - ALL CONCRETE FOR TxDOT DRAINAGE STRUCTURES SHALL MEET TxDOT SPECIFICATIONS. ALL OTHER CONCRETE SHALL BE CLASS "A" 3000 PSI CYLINDER STRENGTH IN 28 DAYS.
 - REFERENCE DRAINAGE DETAILS FOR PIPE TRENCH DETAILS, BOX CULVERT, HEADWALL, AND WINGWALL CONSTRUCTION DETAILS, AND BOX CULVERT BEDDING AND EXCAVATION LIMITS.
 - CONTRACTOR SHALL GROUT ALL CURB INLETS AND JUNCTION BOXES TO PROVIDE FOR POSITIVE DRAINAGE.
 - EARTHEN CHANNELS WILL BE VEGETATED BY SEEDING OR SODDING. 85% OF THE CHANNEL SURFACE MUST HAVE ESTABLISHED VEGETATION BEFORE THE CITY OF SAN ANTONIO WILL ACCEPT.
 - CONTRACTOR SHALL MATCH TOP OF CHANNEL TO NATURAL GROUND AND MAINTAIN A MINIMUM CHANNEL DEPTH OF "D" AS SHOWN IN THE PROFILE.

CAUTION!!
CONTRACTOR SHALL BE REQUIRED TO LOCATE ALL PUBLIC OR PRIVATE UTILITIES INCLUDING BUT NOT LIMITING TO: WATER, SEWER, TELEPHONE AND FIBER OPTIC LINES, SITE LIGHTING ELECTRIC, SECONDARY ELECTRIC, PRIMARY ELECTRICAL DUCTBANKS, LANDSCAPE IRRIGATION FACILITIES, AND GAS LINES. ANY UTILITY CONFLICTS THAT ARISE SHOULD BE COMMUNICATED TO THE ENGINEER IMMEDIATELY AND PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL CONTACT 1-800-DIG-TESS A MINIMUM OF 48 HOURS PRIOR TO THE START OF CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THE REPAIR SHALL BE AT CONTRACTOR'S SOLE EXPENSE WHETHER THE UTILITY IS SHOWN ON THESE PLANS OR NOT.

TRENCH EXCAVATION SAFETY PROTECTION:
CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/ GEOTECHNICAL/ SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND/OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

DATE: _____
NO. REVISION: _____

Jon Adame
2-6-26


PAPE-DAWSON
2000 NW LOOP 410 | SAN ANTONIO, TX 78243 | 210.375.9000
TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028800

CREEKS EDGE
SAN ANTONIO, TEXAS

DRAIN "D" ~ STA. 1+00.00 TO END
DRAIN PLAN & PROFILE


PLAT NO. 25-11800340
JOB NO. 13657-10
DATE FEBRUARY 2026
DESIGNER CB
CHECKED JA DRAWN CB
SHEET C1.04

Notes: File: 06_2026_3-50.dwg User: ID: cecaf@pape-dawson.com Date: 2/10/2026 10:00:00 AM Plot: P:\Users\CEAF\My Documents\Projects\25-11800340.dwg
THIS DOCUMENT HAS BEEN PRODUCED FROM MATERIAL THAT WAS STORED AND/OR TRANSMITTED ELECTRONICALLY AND MAY HAVE BEEN INADVERTENTLY ALTERED. RELY ONLY ON FINAL HARDCOPY MATERIALS BEARING THE CONSULTANT'S ORIGINAL SIGNATURE AND SEAL. AERIAL IMAGERY PROVIDED BY GOOGLE/UNLESS OTHERWISE NOTED. Imagery © 2016/CAPCO/DigitalGlobe, Texas Orthographic Program, USDA Farm Service Agency.

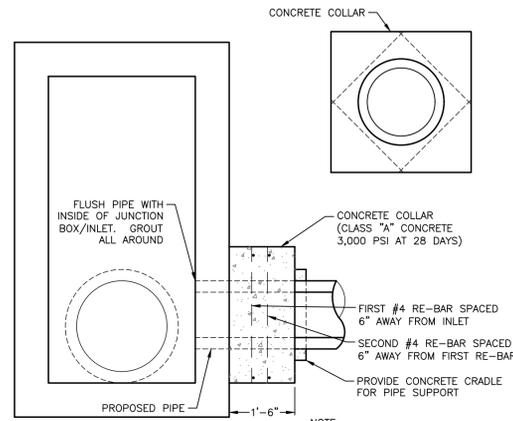

CONCRETE COLLAR DETAIL

NOT-TO-SCALE

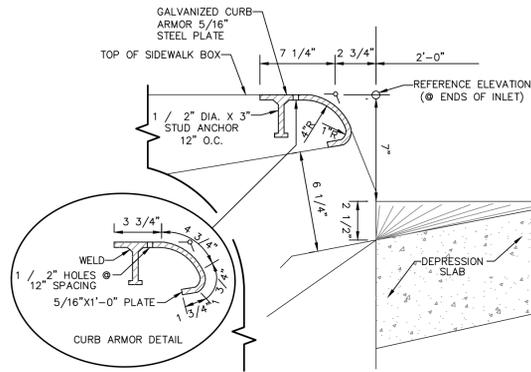


CURB ARMOR DETAIL

NOT-TO-SCALE

Table 9.3.8.1 - Retardation Class for Lining Materials
(Source TxDOT - Hydraulic Design Manual, Chapter 7, Section 3 - Roadside Channel Design)


Retardance Class	Permissible Shear Stress (t) (lbs./sq.ft.)	Cover	Condition
B	2.1	Bermuda grass	Good stand, tall (average 12 in. or 305 mm)
		Native grass mixture	Good stand, unmowed
		Little bluestem, bluestem, blue gamma, other short and long stem midwest grasses	
		Lespedeza sericea	Good stand, not woody, tall (Average 19 in. or 480mm)
		Alfalfa	Good stand, uncut (Average 11 in. or 280mm)
C	1.1	Blue gamma	Good stand, uncut (Average 11 in. or 280mm)
		Orchardgrass	Fair stand, uncut (10-to-48 in. or 55-to- 1220 mm)
		Bermuda grass	Good stand, mowed (average 6 in. or 150 mm)
		Common lespedeza	Good Stand, uncut (average 11 in. Or 280 mm)
		Grass-legume mixture: summer (orchard grass, rectorp, Italian ryegrass, and common lespedeza)	Good Stand, uncut (6-8 in. or 150-200 mm)
D	0.6	Centipede grass	Very dense cover (average 6 in. or 150 mm)
		Kentucky bluegrass	Good stand, headed (6-12 in. or 150 - 305 mm)
		Bermuda grass	Good stand, cut to 2.5 in. or 65 mm
		Common lespedeza	Excellent stand, uncut (average 4.5 in. or 115 mm)
		Buffalo grass	Good stand, uncut (3-6 in. or 75-150 mm)
E	0.35	Grass-legume mixture: fall, spring (orchard grass Italian ryegrass, and common lespedeza)	Good stand, uncut (4-5 in. or 100-125 mm)
		Lespedeza sericea	After cutting to 2 in. or 50 mm (very good before cutting)
		Bermuda grass	Good stand, cut to 1.5 in. or 40 mm
	2.5	Rbck D50 = 6 in. or 150 mm	Burned Subble
	5.0	Rbck D50 = 12 in. or 300 mm	
	2.5	Type III Quifex Soil Retention Blanket	

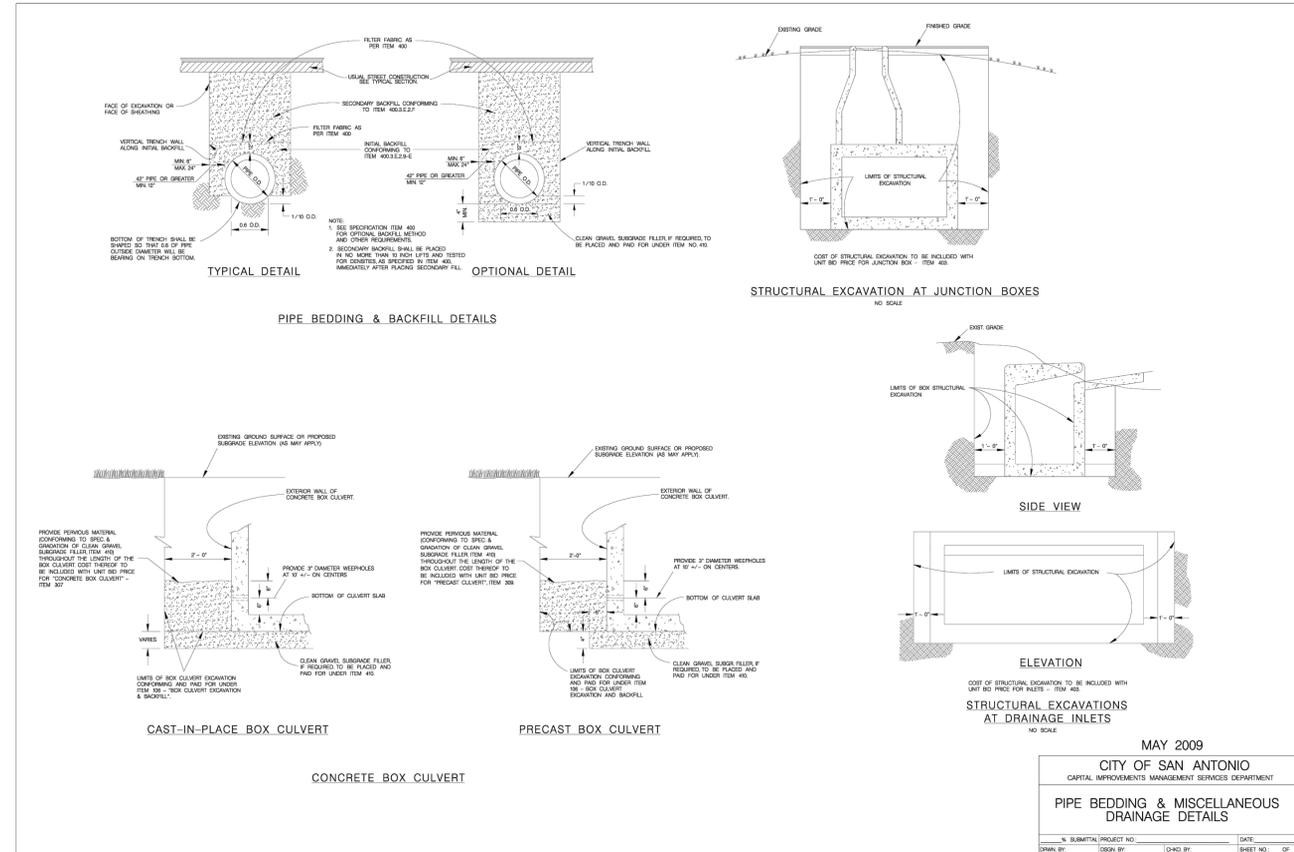

MAY 2009
CITY OF SAN ANTONIO
CAPITAL IMPROVEMENTS MANAGEMENT SERVICES DEPARTMENT
PIPE BEDDING & MISCELLANEOUS DRAINAGE DETAILS

NO. SUBMITTAL PROJECT NO. DATE
DRAWN BY: DESGN BY: CHCKD BY: SHEET NO. OF

DATE	
NO.	REVISION



PAPE-DAWSON
2000 NW LOOP 410 | SAN ANTONIO, TX 78213 | 210.375.9000
TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028800

CREEKS EDGE
SAN ANTONIO, TEXAS
DRAIN DETAILS



PLAT NO. 25-11800340
JOB NO. 13657-10
DATE NOVEMBER 2025
DESIGNER CB
CHECKED JA DRAWN CB
SHEET C1.10

Date: Nov 06, 2025, 9:26am User: ID: kfc/bz File: P:\13657\10\Design\Chal\SD1-1365710.dwg
THIS DOCUMENT HAS BEEN PRODUCED FROM MATERIAL THAT WAS STORED AND/OR TRANSMITTED ELECTRONICALLY AND MAY HAVE BEEN INADVERTENTLY ALTERED. RELY ONLY ON FINAL HARDCOPY MATERIALS BEARING THE CONSULTANT'S ORIGINAL SIGNATURE AND SEAL. AERIAL IMAGERY PROVIDED BY GOOGLE/UNLESS OTHERWISE NOTED. Imagery © 2016/CAPCOO/Digital Globe, Texas Orthology Program, USDA Farm Service Agency.

This drawing is prepared in accordance with the Texas Engineering Practice Act. No warranty of any kind is made by TCEC for any purpose whatsoever. TCEC assumes no responsibility for the construction of any structure or other facility or for the maintenance of any structure or other facility.

REQUIREMENTS FOR CULVERT PIPES AND SAFETY PIPE RUNNERS

Pipe I.D.	RCP Wall Thickness (6)	TP Wall Thickness (7)	Slope (8)	Min Length of Unit (9)	Single Pipe		Multiple Pipes		
					Pipe Runners Required	Skew	Pipe Runners Required	Skew	
12"	2"	1.15"	17.00°	3.1' 2" - 11'	4.1' 3" - 6"	≤ 45°	No	≤ 45°	No
15"	2 1/2"	1.30"	20.50°	3.1' 3" - 8"	4.1' 4" - 7"	≤ 45°	No	≤ 45°	No
18"	2 1/2"	1.60"	24.00°	3.1' 4" - 6"	4.1' 5" - 8"	≤ 45°	No	≤ 45°	No
24"	3"	1.95"	31.00°	3.1' 7" - 10"	4.1' 7" - 10"	≤ 45°	No	> 30°	Yes
30"	3 1/2"	2.65"	38.50°	3.1' 9" - 5"	4.1' 10" - 1"	≤ 15°	No	> 15°	Yes
36"	4"	2.75"	45.50°	3.1' 12" - 3"	4.1' 12" - 3"	> 0°	Yes	> 0°	Yes
42"	4 1/2"	2.7"	52.50°	3.1' 11" - 1"	4.1' 14" - 5"	> 0°	Yes	> 0°	Yes





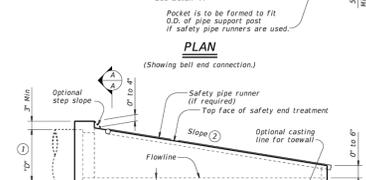
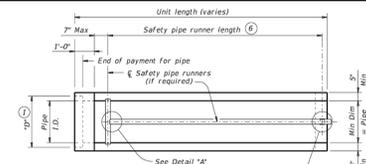


SAFETY PIPE RUNNER DIMENSIONS

Max Safety Pipe Runner Length	Required Pipe Runner Pipe Size	Pipe O.D.	Pipe I.D.
17' - 2"	3" STD	3.500"	3.068"
15' - 6"	3 1/2" STD	4.000"	3.548"
20' - 10"	4" STD	4.500"	4.026"
35' - 4"	5" STD	5.563"	5.047"

- Dimension "D" is based on reinforced concrete pipe (RCP) meeting the requirements of ASTM C-76, Class III. (RCP Wall "D" thickness). Adjust "D" for any other wall thickness used. For thermoplastic pipe (TP) take into account the annular space requirements for grouted connections.
- Slope as shown elsewhere in plans. Slope of 3:1 or flatter is required for vehicle safety.
- Toe wall to be used only when dimension is shown elsewhere in the plans.
- Fill the top 4" of void between precast end treatments with concrete riprap. Concrete riprap is considered subsidiary to the Item 402, "Safety End Treatment".
- Adjust clear distance between pipes to provide for the minimum distance between safety end treatments.
- Measured along slope.
- Provide cement stabilized bedding and backfill in accordance with the Item 400, "Excavation and Backfill for Structures". Bedding and backfill is considered subsidiary to the Item 402, "Safety End Treatment". When concrete riprap is specified around the safety end treatment, backfill as directed by Engineer.
- Thermoplastic pipe wall thickness may vary. Adjust accordingly. Thermoplastic pipe requires the safety end treatments to have a bell end for grouted connections.

GENERAL NOTES:
 Precast safety end treatment for reinforced concrete pipe (RCP), and thermoplastic pipe (TP) may be used for TYPE II end treatment as specified in Item "Safety End Treatment."
 When precast safety end treatment is used as a Contractor's alternate to mitered RCP, riprap will not be required unless noted otherwise on the plans.
 Synthetic fibers listed on the "Fibers for Concrete" Material Producer List (MPL) may be used in lieu of steel reinforcing in riprap concrete unless noted otherwise.
 Manufacture this product in accordance with Item 402, "Safety End Treatment" except as noted below:
 A. Provide minimum reinforcing of #4 @ 6" (Grade 40) or #4 @ 9" (Grade 60) each way or #4 @ 6" x #4 @ 12" or #3 @ 9" x #3 @ 12" welded wire reinforcement (WWR).
 B. For precast (steel formed) sections, provide Class "C" concrete (f'c = 3,000 psi).
 At the option and expense of the Contractor, the next larger size of safety end treatment may be furnished as long as the "D" dimension cast is that of the required size of pipe.
 Pipe runners designed for a traveling load of 1,800 lbs at yield as recommended by Research Report 280-1, "Safety Treatment of Roadside Cross-Drainage Structures", Texas Transportation Institute, March 1981.
 Provide safety pipe runners, cross pipes, pipe support posts, and pipe stubs meeting the requirements of ASTM A53 Type E or S, Grade B, or ASTM A500 (Grade B), or API 5LX52.
 Galvanize all steel components except reinforcing steel after fabrication. Repair galvanizing damaged during transport or construction in accordance with the specifications.
 Connect RCP using the Optional Joint for RCP detail shown or in accordance with Item 406 "Reinforced Concrete Pipe". Connect TP by grouting. See Pipe and Box Grouted Connections (FBGC) standard for grouted connections with TP and precast safety end treatment.

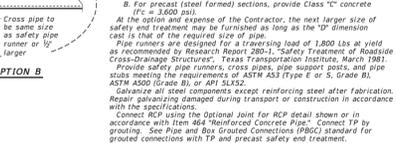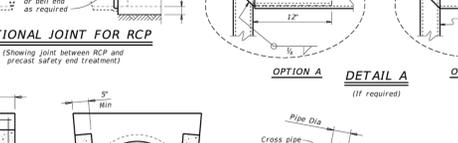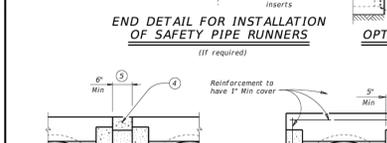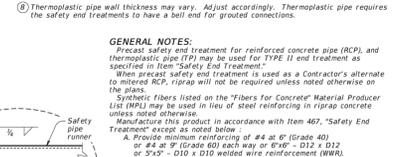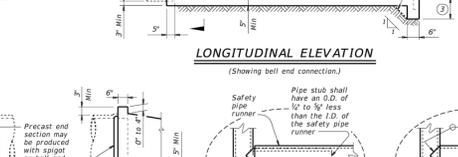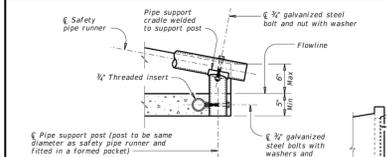

PRECAST SAFETY END TREATMENT TYPE II - CROSS DRAINAGE





PSET-SC

Texas Department of Transportation
 Bridge Division Standard

Unit	Width	Height	Area	Volume
12"	23.0"	0.1	0.2	0.2
15"	26.5"	0.2	0.2	0.3
18"	30.0"	0.2	0.2	0.3
24"	37.0"	0.3	0.3	0.5
30"	44.5"	0.3	0.4	0.6
36"	51.5"	0.4	0.5	0.7
42"	58.5"	0.5	0.6	0.8

Texas Department of Transportation
 Bridge Division Standard

This drawing is prepared in accordance with the Texas Engineering Practice Act. No warranty of any kind is made by TCEC for any purpose whatsoever. TCEC assumes no responsibility for the construction of any structure or other facility or for the maintenance of any structure or other facility.

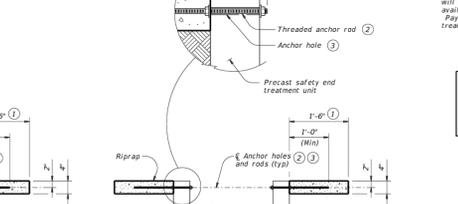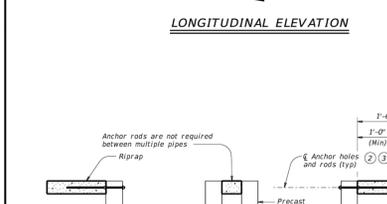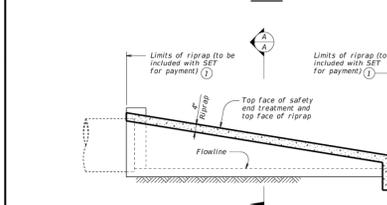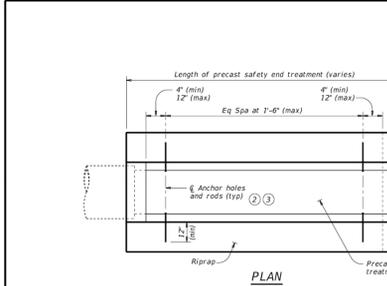

ESTIMATED CONCRETE RIPRAP QUANTITIES (CY)

Nominal Culvert (Pipe) I.D.	PSET-SC and PSET-SP Standards			PSET-RC and PSET-RP Standards		
	Unit Width	Unit Height	Unit Area	Unit Width	Unit Height	Unit Area
12"	23.0"	0.1	0.2	16.0"	0.1	0.1
15"	26.5"	0.2	0.3	19.5"	0.1	0.2
18"	30.0"	0.2	0.3	23.0"	0.2	0.3
24"	37.0"	0.3	0.5	30.0"	0.2	0.4
30"	44.5"	0.3	0.6	37.0"	0.3	0.5
36"	51.5"	0.4	0.7	44.0"	0.3	0.6
42"	58.5"	0.5	0.8	51.0"	0.4	0.7

- Riprap placed beyond the limits shown will be paid as concrete riprap in accordance with Item 432, "Riprap". When riprap is cast integrally with the precast safety end treatment, this dimension is 1'-0" minimum.
- 1/2" Dia ASTM A307 Gr A threaded anchor rod with 2 nuts and 2 washers. Galvanize all components in accordance with Item 445, "Galvanizing". Repair galvanizing that is damaged during transport or construction in accordance with the specifications.
- 3/4" through holes in walls of safety end treatment for riprap anchor rods may be drilled with rotary (core) or masonry type drilling equipment or may be formed. Do not use percussive (air) type drilling equipment. If holes are drilled, patch spalls in the inside face of the wall exceeding 1/2" from the holes.
- Provide riprap toe wall when dimension is shown elsewhere in the plans or when field conditions require a toe wall.
- Quantities shown are for one end of one reinforced concrete pipe culvert. For multiple pipe culverts, quantities will need to be adjusted. Riprap quantities are for Contractor's information only. Quantities are based on the minimum unit lengths shown on the Precast Safety End Treatment (SET) standard sheets.

MATERIAL NOTES:
 Provide Class "B" riprap in accordance with Item 432, "Riprap". Synthetic fibers listed on the "Fibers for Concrete" Material Producer List (MPL) may be used in lieu of steel reinforcing in riprap concrete unless noted otherwise. The anchor rods shown are always required.

GENERAL NOTES:
 Precast safety end treatment for reinforced concrete pipe may be used for TYPE II end treatment as specified in Item 402, "Safety End Treatment". Refer to PSET-SC or PSET-SP standard sheets for details of square safety end treatments not shown. Refer to PSET-RC or PSET-RP standard sheets for details of round safety end treatments not shown.
 For precast units with integrally cast riprap, substitute reinforcing steel in the amount of 0.26 in./ft. minimum for the threaded anchor rods shown. When requested, submit detailed engineering drawings for approval prior to construction. Shop drawings will not be required. Note that a proprietary precast unit with integral riprap is available from Precast Concrete Works, Inc. (DS95) 583-9293 or www.precast.com. Payment for riprap and toe walls is included in the price bid for each safety end treatment.

PRECAST SAFETY END TREATMENT TYPE II RIPRAP DETAILS

PSET-RR

Texas Department of Transportation
 Bridge Division Standard

Unit	Width	Height	Area	Volume
12"	23.0"	0.1	0.2	0.2
15"	26.5"	0.2	0.3	0.3
18"	30.0"	0.2	0.3	0.3
24"	37.0"	0.3	0.5	0.5
30"	44.5"	0.3	0.6	0.6
36"	51.5"	0.4	0.7	0.7
42"	58.5"	0.5	0.8	0.8

Texas Department of Transportation
 Bridge Division Standard

DATE: _____

NO. REVISION: _____

Jon D. Adame
 11-6-25

PAPE - DAWSON

2000 NW LOOP 410 | SAN ANTONIO, TX 78213 | 210.375.9000
 TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM # 10028800

CREEKS EDGE
 SAN ANTONIO, TEXAS
 DRAIN DETAILS

PLAT NO. 25-11800340
 JOB NO. 13657-10
 DATE NOVEMBER 2025
 DESIGNER -
 CHECKED - DRAWN -
 SHEET C1.12

PAVEMENT SECTION DETAIL										
STREET NAME	STATION	TYPE "D" HMAC	TYPE "C" HMAC	CONCRETE	AGGREGATE BASE	SUBGRADE	GEOGRID	STREET TYPE	CBR	STRUCTURAL NUMBER
CREEKSIDE HOLLOW	1+42.53 TO 3+88.24	1.50"	2.50"	-	18.50"	8"	NO	LOCAL B	2.0	4.99
CREEKSIDE HOLLOW	3+88.24 TO 4+27.41	2.00"	-	-	10.00"	8"	NO	LOCAL A	2.0	2.92
OAKSHADE COURT	4+27.41 TO 6+04.25	2.00"	-	-	10.00"	8"	NO	LOCAL A	2.0	2.92
PINEGROVE WAY	6+04.25 TO END	2.00"	-	-	10.00"	8"	NO	LOCAL A	2.0	2.92

*STREET TRANSITIONS FROM STREET CLASSIFICATIONS OF DIFFERING PAVEMENT WIDTHS SHALL BE CONSTRUCTED WITH PAVEMENT SECTION OF STREET CLASSIFICATION WITH WIDER PAVEMENT SECTION

GENERAL NOTES:


- CONTRACTOR SHALL REFERENCE THE PROJECT PAVEMENT DESIGN REPORT PREPARED BY INTECH, DATED MARCH 21, 2025.
- CONTRACTOR SHALL RETAIN A GEOTECHNICAL ENGINEER TO VERIFY THE SUB GRADE CONDITION PRIOR TO PLACING ANY BASE MATERIAL. GEOTECHNICAL ENGINEER SHALL DETERMINE THE SUB GRADE CONDITION AND IF LIME STABILIZATION IS REQUIRED.
- GEOTECHNICAL ENGINEER SHOULD VERIFY THE STREET SUBGRADE AT THE TIME OF CONSTRUCTION PRIOR TO PLACEMENT OF AGGREGATE BASE.
- THE FLEXIBLE BASE COURSE SHOULD BE CRUSHED LIMESTONE CONFORMING TO TxDOT STANDARD SPECIFICATIONS, ITEM 247, TYPE A, GRADES 1 OR 2.
- THE MOISTURE CONTENT OF THE FILL SHOULD BE MAINTAINED WITHIN THE RANGE OF OPTIMUM WATER CONTENT TO 3 PERCENTAGE POINTS ABOVE THE OPTIMUM WATER CONTENT UNTIL PERMANENTLY COVERED.
- IN THE EVENT THAT THE CLAY FILL USED IS DIFFERENT THAN THE EXISTING SUBGRADE, THE RECOMMENDATIONS IN THE GEOTECHNICAL REPORT COULD BE INVALIDATED AND THE DESIGN ENGINEER MUST BE CONSULTED TO DETERMINE IF ADDITIONAL CBR TESTING AND THICKER PAVEMENT SECTIONS ARE REQUIRED.
- WHERE PAVEMENT SUBGRADE IS LOCATED WITHIN 2- FEET OF THE EXISTING GROUND SURFACE (STRATUM 1 CLAYS), MOISTURE CONDITIONED SUBGRADE WILL BE REQUIRED. GEOTECHNICAL ENGINEER SHOULD VERIFY THE STREET SUBGRADE AT THE TIME OF CONSTRUCTION PRIOR TO PLACEMENT OF AGGREGATE BASE TO DETERMINE WHERE THE MOISTURE CONDITIONED SUBGRADE IS NEEDED. REFERENCE GEOTECHNICAL ENGINEERING REPORT FOR MORE INFORMATION.
- THE CONTRACTOR IS RESPONSIBLE FOR COORDINATING ALL MATERIAL TESTING WITH THE PROJECT GEOTECHNICAL ENGINEER. TESTING SHALL BE PAID FOR BY THE OWNER.
- FILL MATERIAL SHOULD BE NATIVE ON-SITE MATERIAL, FREE OF DELETERIOUS MATERIAL WITH A MINIMUM CBR VALUE OF 2.5 AND A PI WITHIN RANGE OF 5 AND 20. THE GRAVEL SIZE SHOULD NOT EXCEED 3 INCHES IN DIAMETER. LIME OR CEMENT APPLICATION RATES SHOULD BE RE-EVALUATED FOR THE FILL MATERIAL. THE MATERIAL SHOULD BE PLACED AS PER APPLICABLE CITY OR COUNTY GUIDELINES. CONTRACTOR TO VERIFY EXACT SPECIFICATIONS WITH PROJECT GEOTECHNICAL ENGINEERING REPORT.
- A BEXAR COUNTY PERMIT MUST BE OBTAINED BEFORE WORKING IN THE BEXAR COUNTY ROW. CONTRACTOR SHALL COORDINATE A TRAFFIC CONTROL PLAN FOR ALL WORK WITHIN THE ROW. ADDITIONAL WARNING SIGNS MAY BE RECOMMENDED BY THE ENGINEER ONCE THE ROADWAYS ARE CONSTRUCTED.

STREET SUBGRADE NOTES:


- IF THE STREET SUBGRADE PLASTICITY INDEX VALUE IS GREATER THAN 20, SUBGRADE STABILIZATION IS NEEDED AS PER CITY OF SAN ANTONIO REQUIREMENTS.
- IF THE SUBGRADE PLASTICITY INDEX VALUE IS 20 OR LESS, SUBGRADE STABILIZATION IS NOT NEEDED. THE SUBGRADE SHOULD BE MOISTURE CONDITIONED (COMPACTED TO A MINIMUM OF 95 PERCENT OF THE MAXIMUM DRY DENSITY AT A MINIMUM MOISTURE CONTENT OF OPTIMUM PLUS 2 PERCENT (TEX114E)).
- THE SUBGRADE SHOULD BE STABILIZED USING 7 PERCENT LIME TO A DEPTH OF 8 INCHES AS NOTED ABOVE.
- THE SUBGRADE SOILS SHOULD BE TESTED FOR SOIL SULFATE CONTENT PRIOR TO STABILIZATION. IF THE SOIL SULFATE CONTENT IS HIGH, AN ALTERNATE PROCEDURE / RECOMMENDATION WILL BE NEEDED.
- LIME APPLICATION RATE OF 41 LBS PER SQ YARD FOR 8 INCH DEPTH OF STABILIZATION IS RECOMMENDED.
- APPROVED FILL MATERIAL SHOULD BE USED TO RAISE THE GRADE, THE FILL SHOULD BE FREE OF DELETERIOUS MATERIAL WITH A MINIMUM CBR VALUE OF 2.0 AND A MAXIMUM PLASTICITY INDEX OF 50. LIME APPLICATION RATES SHOULD BE RE-EVALUATED AND TESTED FOR SULFATE CONTENT PRIOR TO USE OF THE FILL MATERIAL. THE MATERIAL SHOULD BE PLACED AS PER APPLICABLE CITY OR COUNTY GUIDELINES.
- THE SUBGRADE SHOULD BE PROOF ROLLED TO IDENTIFY SOFT AREAS BEFORE STABILIZATION.

LIME NOTES:


- FOR LIME STABILIZATION CONSTRUCTION VERIFICATION THE FOLLOWING SHALL BE CONDUCTED ON THE FIELD:
- AFTER INITIAL MIXING THE SOIL-LIME MIXTURE SHALL MELLOW FOR A PERIOD OF TWO TO THREE (2-3) DAYS. MAINTAIN MOISTURE DURING MELLOWING.
 - AFTER MELLOWING AND FINAL MIXING, THE PULVERIZATION SHALL BE CHECKED USING THE FOLLOWING CRITERIA (REMOVE NON-SLAKING AGGREGATES RETAINED ON THE 1/2 INCH SIEVE FROM THE SAMPLE):
 - MINIMUM PASSING 1/2" SIEVE 100
 - MINIMUM PASSING 3/8" SIEVE 85
 - MINIMUM PASSING NO. 4 SIEVE 60
 - SAMPLE SOIL-LIME MIXTURE FOR DETERMINATION OF MAXIMUM DRY DENSITY (MDD). IN THE LABORATORY, MDD SPECIMENS TO 95% OF MDD AT OPTIMUM MOISTURE CONTENT AND VERIFY UCS TO BE AT LEAST 150 PSI IN ACCORDANCE WITH PROCEDURE OUTLINED IN THE BEXAR COUNTY FLEXIBLE PAVEMENT DESIGN CRITERIA GUIDE FOR MIXTURE DESIGN.
 - COMPACT AND CHECK FIELD DENSITY (MINIMUM OF 95% OF MDD REQUIRED).
 - CURE FOR AN ADDITIONAL 2 TO 5 DAYS (TOTAL MELLOWING AND CURING TIME SHOULD TOTAL AT LEAST 5 DAYS).
 - VERIFY DEPTH OF LIME STABILIZED LAYER TO DEPTH AS NOTED ON PLAN TO WITHIN +/- 1.0 INCH.

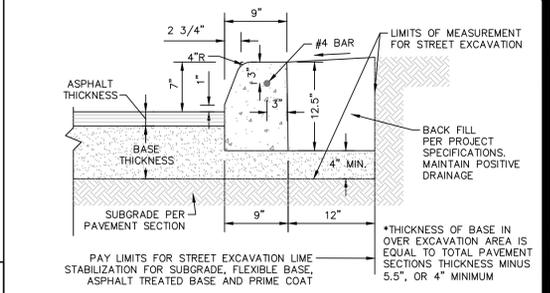


CONCRETE CURB DETAIL
NOT-TO-SCALE

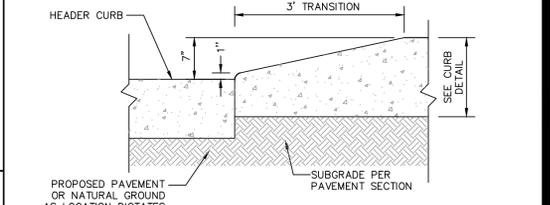


CURB TRANSITION DETAIL (FROM HEADER CURB TO STANDARD CURB)
NOT-TO-SCALE

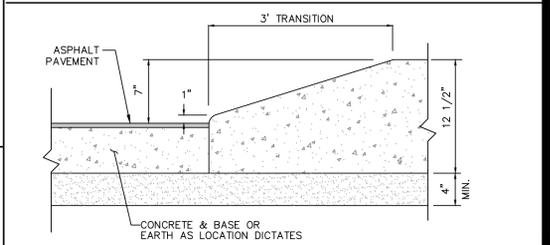


CURB TRANSITION DETAIL (FROM PAVEMENT TO STANDARD CURB)
NOT-TO-SCALE

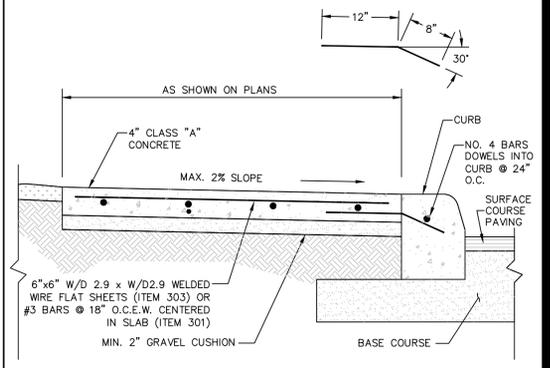


SIDEWALK DETAIL
NOT-TO-SCALE

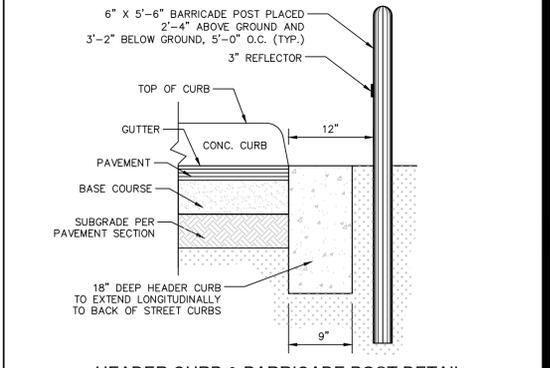


HEADER CURB & BARRICADE POST DETAIL
NOT-TO-SCALE

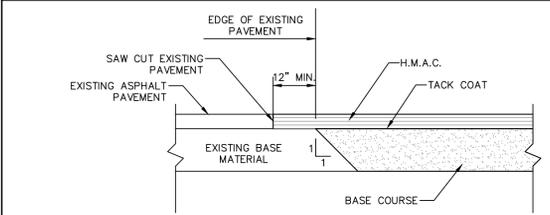


ASPHALT/ASPHALT JUNCTURE DETAIL
NOT-TO-SCALE

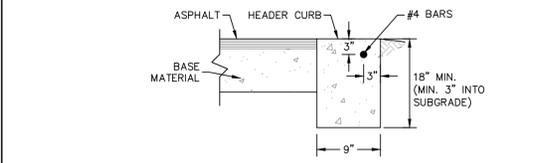


HEADER CURB DETAIL
NOT-TO-SCALE

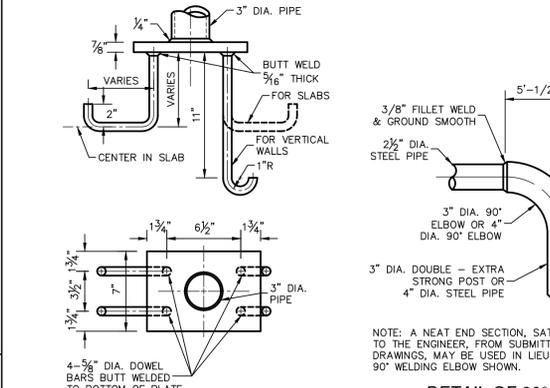


PIPE ANCHORAGE DETAIL
NOT-TO-SCALE




DETAIL OF 90° WELDING ELBOW
NOT-TO-SCALE

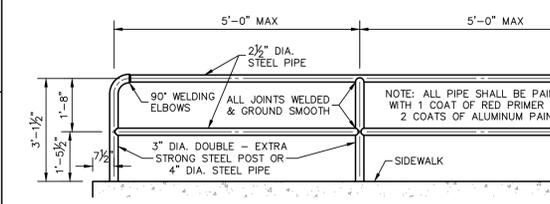

PIPE RAILING DETAIL
NOT-TO-SCALE

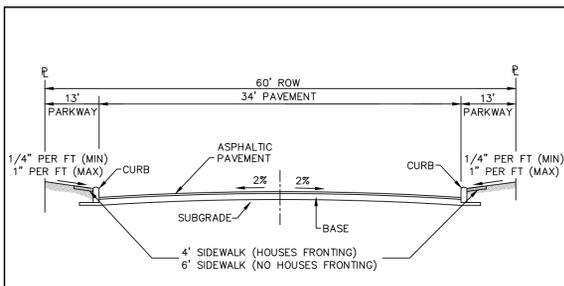


LOCAL B STREET SECTION
NOT-TO-SCALE

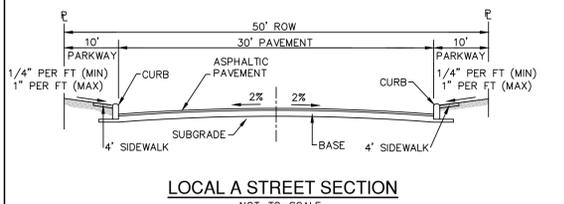

LOCAL A STREET SECTION
NOT-TO-SCALE


DATE	
NO.	
REVISION	




PAPE-DAWSON
2000 NW LOOP 410 | SAN ANTONIO, TX 78243 | 210.375.9000
TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028800

CREEKS EDGE
SAN ANTONIO, TEXAS
STREET DETAILS

PLAT NO.	25-11800340
JOB NO.	13657-10
DATE	NOVEMBER 2025
DESIGNER	CB
CHECKED	JA DRAWN CB
SHEET	C2.10

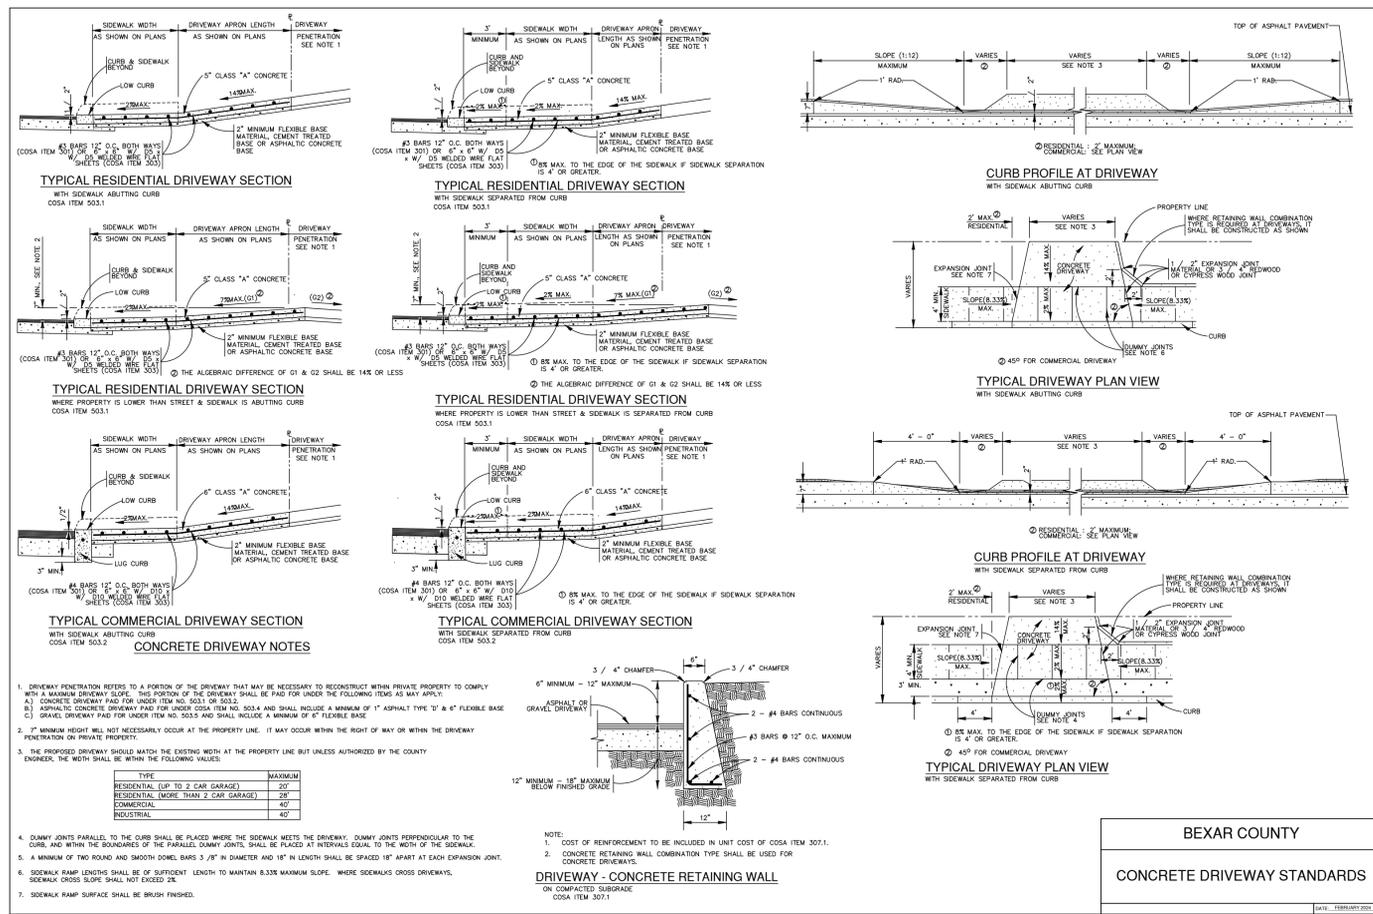

BEXAR COUNTY
CONCRETE DRIVEWAY STANDARDS
DATE: FEBRUARY 2025

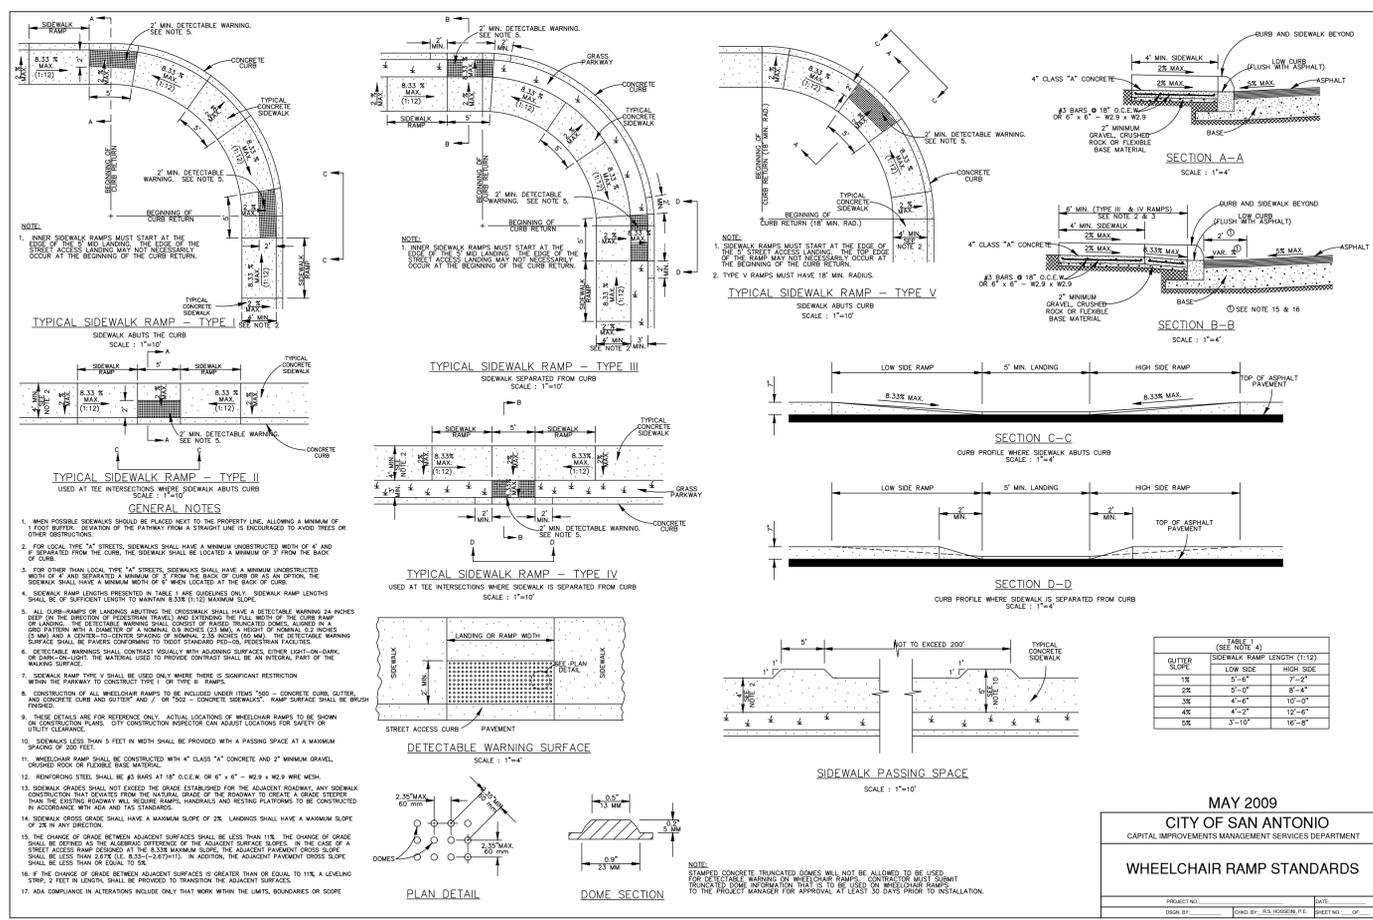

MAY 2009
CITY OF SAN ANTONIO
CAPITAL IMPROVEMENTS MANAGEMENT SERVICES DEPARTMENT
WHEELCHAIR RAMP STANDARDS
REVISION NO. _____ DATE _____
DRAWN BY: S.S. WILSON, P.E. CHECKED BY: _____

DATE: _____





NO. REVISION: _____

STATE OF TEXAS
JON D. ADAME
82567
LICENSED PROFESSIONAL ENGINEER
Jm Adame
11-6-25

PAPE-DAWSON
2000 NW LOOP 410 | SAN ANTONIO, TX 78213 | 210.375.9000
TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028600


CREEKS EDGE
SAN ANTONIO, TEXAS
STREET DETAILS

PLAT NO. 25-11800340
JOB NO. 13657-10
DATE NOVEMBER 2025
DESIGNER _____
CHECKED _____ DRAWN _____
SHEET C2.11

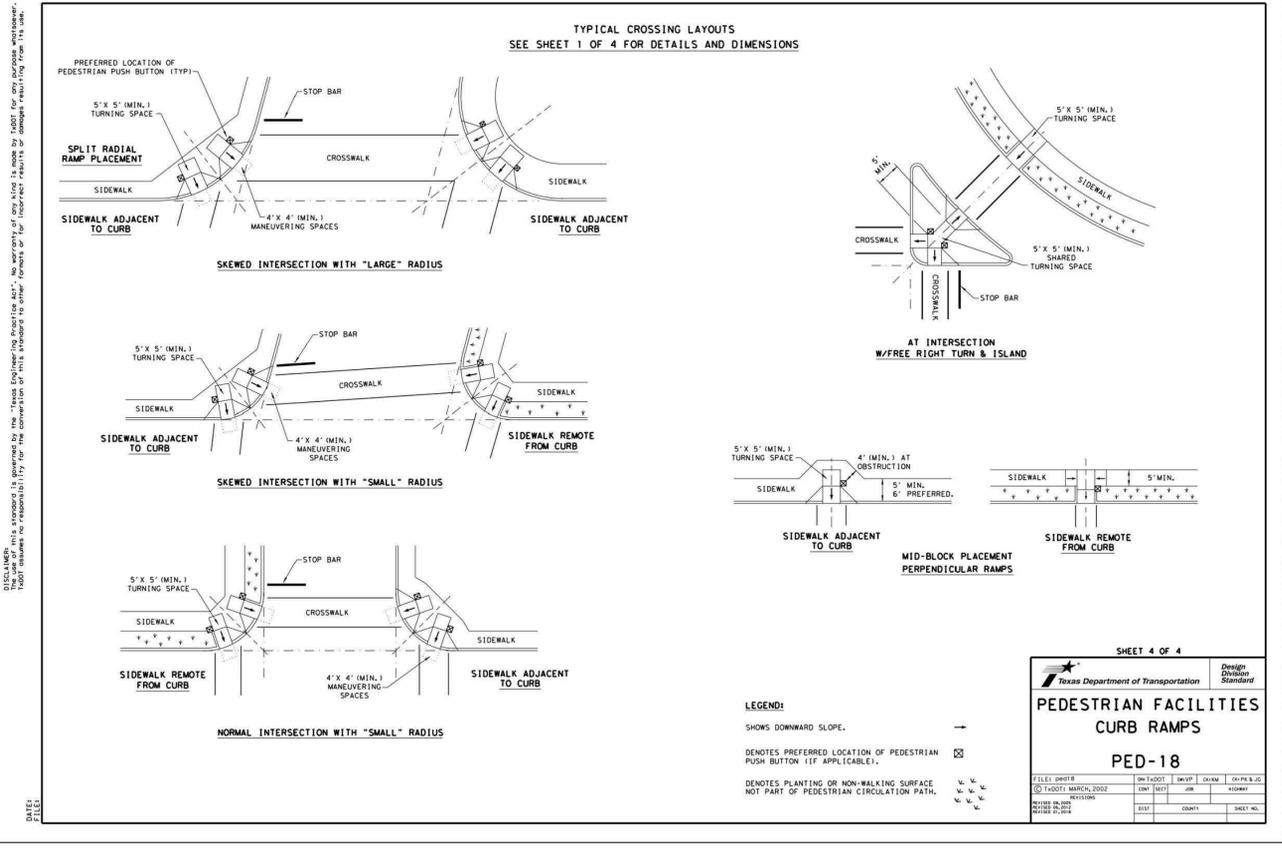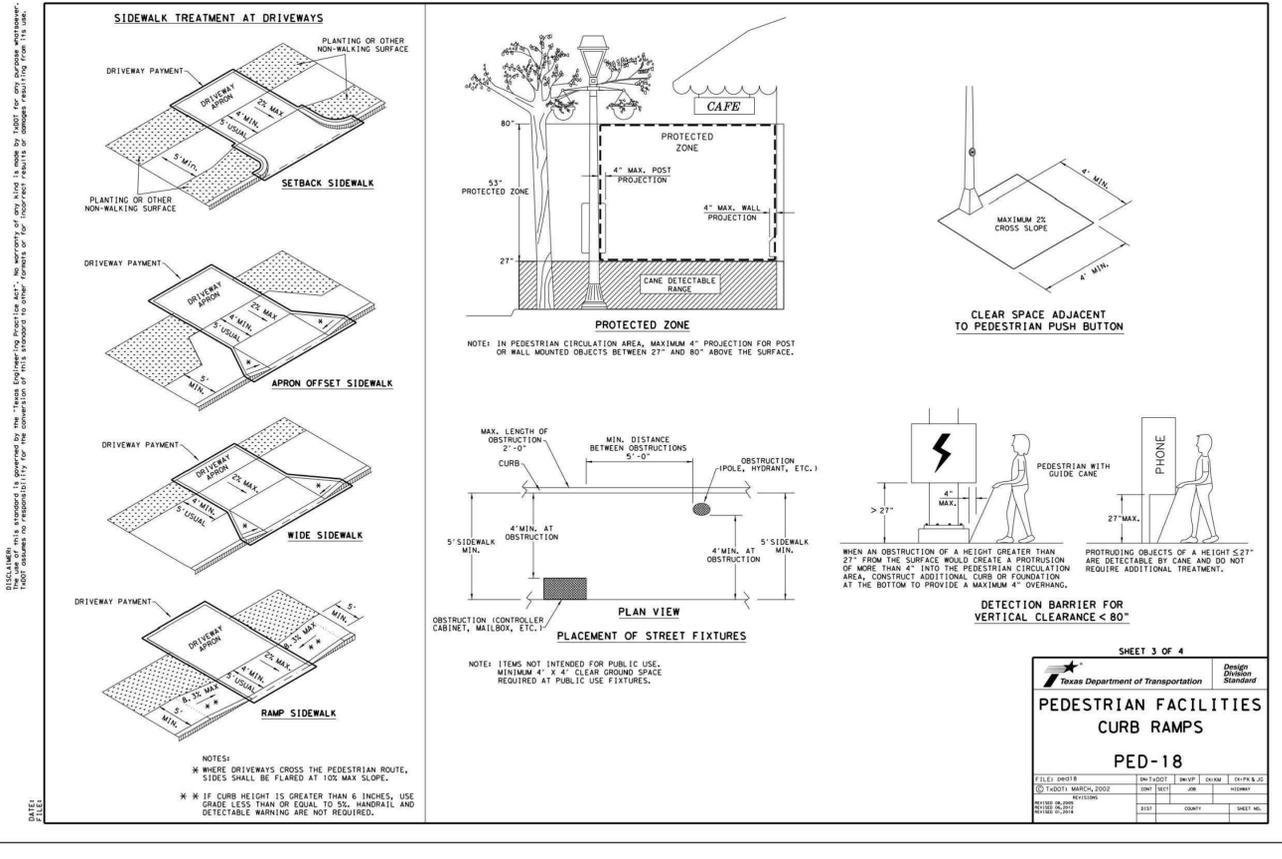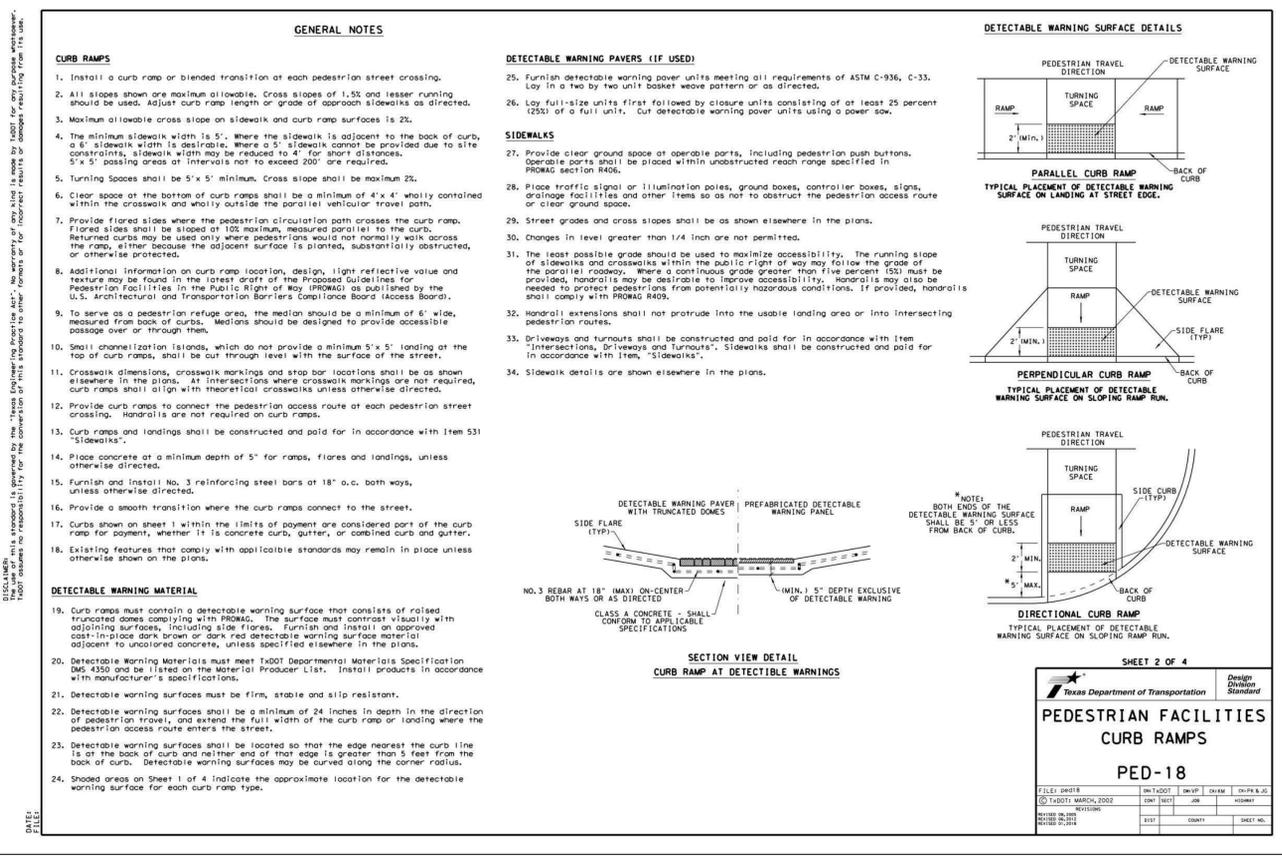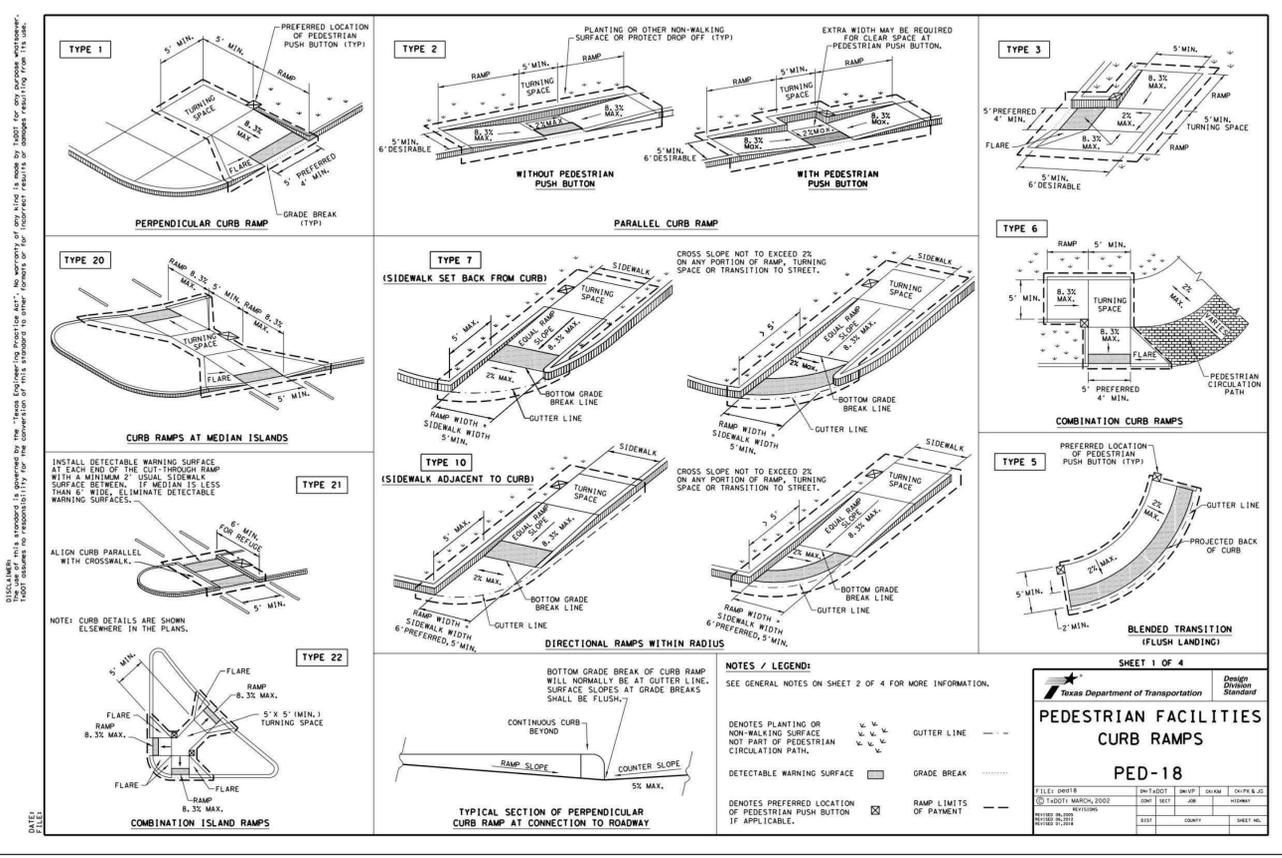

Date: Nov. 06, 2003, 9:27am, User: J. D. Adams
 File: P:\USERS\JAD\Design\CD\1510.DWG

DATE: _____
 NO. REVISION: _____



PAPE-DAWSON
 2000 NW LOOP 410 | SAN ANTONIO, TX 78243 | 210.375.9000
 TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028800

CREEKS EDGE
 SAN ANTONIO, TEXAS
 STREET DETAILS

PLAT NO. 25-11800340
 JOB NO. 13657-10
 DATE NOVEMBER 2025
 DESIGNER _____
 CHECKED _____ DRAWN _____
 SHEET C2.12

BARRICADE AND CONSTRUCTION (BC) STANDARD SHEETS GENERAL NOTES:

- The Barricade and Construction Standard Sheets (BC sheets) are intended to show typical examples for placement of temporary traffic control devices, construction pavement markings, and typical work zone signs. The information contained in these sheets meet or exceed the requirements shown in the Texas Manual on Uniform Traffic Control Devices (TMUTCD).
- The development and design of the Traffic Control Plan (TCP) is the responsibility of the Engineer.
- The Contractor may propose changes to the TCP that are signed and sealed by a licensed professional engineer for approval. The Engineer may develop, sign and seal Contractor proposed changes.
- The Contractor is responsible for installing and maintaining the traffic control devices as shown in the plans. The Contractor may not move or change the approximate location of any device without the approval of the Engineer.
- Geometric design of lane shifts and detours should, when possible, meet the applicable design criteria contained in manuals such as the American Association of State Highway and Transportation Officials (AASHTO), "A Policy on Geometric Design of Highways and Streets," the "Roadway Design Manual" or engineering judgment.
- When projects abut, the Engineer(s) may omit the END ROAD WORK, TRAFFIC FINES DOUBLE, and other advance warning signs if the signing would be redundant and the work areas appear continuous to the motorists. If the adjacent project is completed first, the Contractor shall erect the necessary warning signs as shown on these sheets, the TCP sheets or as directed by the Engineer. The BEGIN ROAD WORK NEXT X MILES sign shall be revised to show appropriate work zone distance.
- The Engineer may require duplicate warning signs on the median side of divided highways where median width will permit and traffic volumes justify the signing.
- All signs shall be constructed in accordance with the details found in the "Standard Highway Sign Designs for Texas," latest edition. Sign details not shown in this manual shall be shown in the plans or the Engineer shall provide a detail to the Contractor before the sign is manufactured.
- The temporary traffic control devices shown in the illustrations of the BC sheets are examples as necessary, the Engineer will determine the most appropriate traffic control devices to be used.
- Where highway construction or maintenance work is being undertaken, other than mobile operations as defined by the Texas Manual on Uniform Traffic Control Devices, CSJ limit signs are required. CSJ limit signs are shown on BC(2). The OBEY WARNING SIGNS STATE LAW sign, STAY ALERT TALK OR TEXT LATER and the WORK ZONE TRAFFIC FINES DOUBLE sign with plaque shall be erected in advance of the CSJ limits. The BEGIN ROAD WORK NEXT X MILES, CONTRACTOR and END ROAD WORK signs shall be erected at or near the CSJ limits. For mobile operations, CSJ limit signs are not required.
- Traffic control devices should be in place only while work is actually in progress or a definite need exists.
- The Engineer has the final decision on the location of all traffic control devices.
- Inactive equipment and work vehicles, including workers' private vehicles must be parked away from travel lanes. They should be as close to the right-of-way line as possible, or located behind a barrier or guardrail, or as approved by the Engineer.

WORKER SAFETY NOTES:

- Workers on foot who are exposed to traffic or to construction equipment within the right-of-way shall wear high-visibility safety apparel meeting the requirements of ISA "American National Standard for High-Visibility Apparel," or equivalent revisions, and labeled as ANSI 107-2004 standard performance for Class 2 or 3 risk exposure. Class 3 garments should be considered for high traffic volume work areas or night time work.
- Except in emergency situations, flagger stations shall be illuminated when flagging is used at night.

COMPLIANT WORKZONE TRAFFIC CONTROL DEVICES

- Only pre-qualified products shall be used. The "Compliant Work Zone Traffic Control Devices List" (CWZTCD) describes pre-qualified products and their sources.
- Work zone traffic control devices shall be compliant with the Manual for Assessing Safety Hardware (MASH).

THE DOCUMENTS BELOW CAN BE FOUND ON-LINE AT

COMPLIANT WORK ZONE TRAFFIC CONTROL DEVICES LIST (CWZTCD)
DEPARTMENTAL MATERIAL SPECIFICATIONS (DMS)
MATERIAL PRODUCER LIST (MPL)
ROADWAY DESIGN MANUAL - SEE "MANUALS (ONLINE MANUALS)"
STANDARD HIGHWAY SIGN DESIGNS FOR TEXAS (SHSD)
TEXAS MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (TMUTCD)
TRAFFIC ENGINEERING STANDARD SHEETS

SHEET 1 OF 12


BARRICADE AND CONSTRUCTION GENERAL NOTES AND REQUIREMENTS BC(1)-21

FILE	NO. 21-001	REV.	DATE	BY	CHKD.	APP.	DATE
01-001	November 2002						
4-03	7-13	9-07	8-14				
5-10	5-21						

TYPICAL APPLICATION OF WORK ZONE SPEED LIMIT SIGNS

Work zone speed limits shall be regulatory, established in accordance with the "Procedures for Establishing Speed Zones," and approved by the Texas Transportation Commission, or by City Ordinance when within incorporated City Limits.

Reduced speeds should only be posted in the vicinity of work activity and not throughout the entire project. Regulatory work zone speed signs (R2-1) shall be removed or covered during periods when they are not needed.

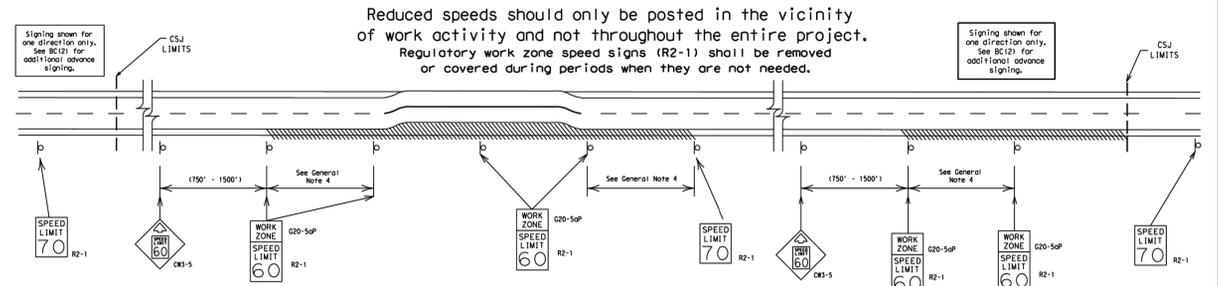

GUIDANCE FOR USE:

LONG/INTERMEDIATE TERM WORK ZONE SPEED LIMITS

This type of work zone speed limit should be included on the design of the traffic control plans when restricted geometrics with a lower design speed are present in the work zone and modification of the geometrics to a higher design speed is not feasible.

Long/Intermediate Term Work Zone Speed Limit signs, when approved as described above, should be posted and visible to the motorist when work activity is present. Work activity may also be defined as a change in the roadway that requires a reduced speed for motorists to safely negotiate the work area, including: a) rough road or damaged pavement; b) substantial alteration of roadway geometrics (diversions) c) construction detours d) grade e) width f) other conditions readily apparent to the driver. As long as any of these conditions exist, the work zone speed limit signs should remain in place.

SHORT TERM WORK ZONE SPEED LIMITS

This type of work zone speed limit may be included on the design of the traffic control plans when workers or equipment are not behind concrete barrier, when work activity is within 10 feet of the traveled way or actually in the traveled way.

Short Term Work Zone Speed Limit signs should be posted and visible to the motorists only when work activity is present. When work activity is not present, signs shall be removed or covered. (See Removing or Covering on BC(4)).

GENERAL NOTES

- Regulatory work zone speed limits should be used only for sections of construction projects where speed control is of major importance.
- Regulatory work zone speed limit signs shall be placed on supports at a 7 foot minimum mounting height.
- Speed zone signs are illustrated for one direction of travel and are normally posted for each direction of travel.
- Frequency of work zone speed limit signs should be 40 mph and greater 0.2 to 2 miles 35 mph and less 0.2 to 1 mile
- Regulatory speed limit signs shall have black legend and border on a white reflective background (see "Reflective Sheeting" on BC(4)).
- Fabrication, erection and maintenance of the ADVANCE SPEED LIMIT (CW3-5) sign, WORK ZONE (G20-5P) plaque and the "SPEED LIMIT" (R2-1) signs shall not be paid for directly, but shall be considered subsidiary to Item 502.
- Turning signs from view, laying signs over or down will not be allowed, unless as otherwise noted under "REMOVING OR COVERING" on BC(4).
- Techniques that may help reduce traffic speeds include but are not limited to: A. Low enforcement. B. Flagger stationed next to sign. C. Portable changeable message sign (PCMS). D. Low-power (dome) road transmitter. E. Speed monitor trailers or signs.
- Speeds shown on details above are for illustration only. Work Zone Speed Limits should only be posted as approved for each project.
- For more specific guidance concerning the type of work, work zone conditions and factors impacting allowable regulatory construction speed zone reduction see TxDOT form #1204 in the TxDOT e-form system.

SHEET 3 OF 12

BARRICADE AND CONSTRUCTION WORK ZONE SPEED LIMIT BC(3)-21

FILE	NO. 21-001	REV.	DATE	BY	CHKD.	APP.	DATE
01-001	November 2002						
4-03	7-13	9-07	8-14				
5-10	5-21						

TYPICAL LOCATION OF CROSSROAD SIGNS

T-INTERSECTION

CSJ LIMITS AT T-INTERSECTION

- The Engineer will determine the types and location of any additional traffic control devices, such as a flagger and accompanying signs, or other signs, that should be used when work is being performed at or near an intersection.
- If construction closes the road at a T-intersection, the Contractor shall place the "CONTRACTOR NAME" (G20-6T) sign behind the Type 3 Barricades for the road closure (see BC(1)) also. The "ROAD WORK NEXT X MILES" left arrow (G20-10L) and "ROAD WORK NEXT X MILES" right arrow (G20-10R) signs shall be replaced by the detour signing called for in the plans.

WORK AREAS IN MULTIPLE LOCATIONS WITHIN CSJ LIMITS

SAMPLE LAYOUT OF SIGNING FOR WORK BEGINNING AT THE CSJ LIMITS

SAMPLE LAYOUT OF SIGNING FOR WORK BEGINNING DOWNSTREAM OF THE CSJ LIMITS

LEGEND

- Type 3 Barricade
- Channelizing Devices
- Sign
- Truck Mounted Attenuator (TMA)
- Portable Changeable Message Sign (PCMS)
- Traffic Flow
- Flagger

NOTES

- The Contractor shall determine the appropriate distance to be placed on the G20-1 series signs and BEGIN ROAD WORK NEXT X MILES (G20-5) signs for each specific project. This distance shall require the "X" and shall be rounded to the nearest whole mile with the approval of the Engineer. No decimals shall be used.
- The "BEGIN ROAD WORK" (G20-5P) and "END ROAD WORK" (G20-2) signs shall be used as shown on the sample layout when advance signs are required outside the CSJ limits. They may be rounded to the nearest whole mile with the approval of the Engineer. No decimals shall be used.
- CSJ limit signing is required for highway construction and maintenance work, with the exception of mobile operations.
- Area for placement of "ROAD WORK AHEAD" (CW2-10) sign and other signs or devices as called for on the Traffic Control Plan.
- Contractor will install a regulatory speed limit sign at the end of the work zone.

BARRICADE AND CONSTRUCTION PROJECT LIMIT BC(2)-21

FILE	NO. 21-001	REV.	DATE	BY	CHKD.	APP.	DATE
01-001	November 2002						
4-03	7-13	9-07	8-14				
5-10	5-21						

Traffic Control Plan Lane Closures on Multi-Lane Conventional Roads TCP(2-4)-18



DATE: _____

NO. REVISION: _____

STATE OF TEXAS
JON D. ADAME
 82567
 PROFESSIONAL ENGINEER

Jonathan
 12-29-25

PAPE-DAWSON
 2000 NW LOOP 410 | SAN ANTONIO, TX 78243 | 210.375.9000
 TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM # 0028890

CREEKS EDGE
 SAN ANTONIO, TEXAS

TRAFFIC CONTROL DETAILS

PLAT NO. 25-11800340
 JOB NO. 13657-10
 DATE: DECEMBER 2025
 DESIGNER: _____
 CHECKED: _____ DRAWN: _____
 SHEET: C2.13

WORK ZONE SHORT TERM PAVEMENT MARKINGS DETAILS

SOLID LINES

- DOUBLE NO-PASSING LINE: TABS 4" to 12", Type Y-2
- SINGLE NO-PASSING LINE or CHANNELIZING LINE: TABS 4" to 12", Type Y-2 or W

BROKEN LINES

- FOR CENTER LINE OR LANE LINE: TABS 4" to 12", Type Y-2 or W

WIDE DOTTED LINES

- FOR LANE DROP LINES: TABS 12" to 6", Type W

WIDE GORE MARKINGS

- TABS 20" to 6", Type W

WORK ZONE SHORT TERM PAVEMENT MARKINGS PATTERNS

CENTER LINE & NO-PASSING ZONE BARRIER LINES FOR TWO LANE TWO-WAY HIGHWAYS

LANE LINES FOR DIVIDED HIGHWAY

LANE & CENTER LINES FOR MULTILANE UNDIVIDED HIGHWAYS

TWO-WAY LEFT TURN LANE

RAISED PAVEMENT MARKINGS

TEMPORARY FLEXIBLE REFLECTIVE ROADWAY MARKER TABS (RMTS)

DEPARTMENTAL MATERIAL SPECIFICATIONS (DMS) & MATERIAL PRODUCER LISTS (MPL)

WORK ZONE SHORT TERM PAVEMENT MARKINGS WZ(STPM)-23

Texas Department of Transportation

NEAR SIDE LANE CLOSURE

FAR SIDE RIGHT LANE CLOSURE

FAR SIDE LEFT LANE CLOSURE

OPERATIONS IN THE INTERSECTION

GENERAL NOTES

- The minimum size channelizing device is the 28" cone. 42" Two-piece cones, drums, vertical poles or barricades will be required when the device must be left unattended at night.
- Obstructions or hazards of the work area shall be clearly marked and delineated at all times.
- Flagger and Flagger Symbol (CR20-7) signs may be required according to field conditions.
- Vehicles parked in roadway shall be equipped with at least two high intensity red flashing, oscillating or strobe type lights.
- High level warning devices (flag trees) may be used at corners of the vehicle.
- When work operations are performed on existing signals, the signals may be placed in flashing red mode when approved by the engineer. If existing signals do not have power, all-way Stop (R1-1 and R1-3P) signs may be implemented when approved by the engineer.
- For Short-Term Stationary work the buffer space "B" from the above table should be used. If field conditions permit, for Short Duration (less than 1 hour) any buffer space provided will enhance the safety of the setup.
- The arrow board at this location may be omitted for Short Duration work. If the work vehicle has an arrow board in operation, as an option, the arrow board may be placed at the end of the taper in the closure lane if space is not available at the beginning of the taper.
- Signs and devices for the NEAR SIDE LANE CLOSURE may be offset for a left lane closure by using a LEFT LANE CLOSED (CR20-51L) and posting channelizing devices on the centerline to protect the work space from crossing traffic.

LEGEND

- Type 3 Barricade
- Channelizing Devices
- Truck Mounted Attenuator (TMA)
- Portable Channelizing Message Sign (PCMS)
- Sign
- Flagger
- Flagger

WORKERS IN BUCKET TRUCKS SHALL NOT WORK ABOVE OPEN LANES OF TRAFFIC.

TRAFFIC SIGNAL WORK TYPICAL DETAILS WZ(BTS-1)-13

Texas Department of Transportation

TYPICAL ADVANCE SIGNAL PROJECT SIGHTING

GENERAL NOTES FOR WORK ZONE SIGNS

- Signs shall be installed and maintained in a straight and plumb condition.
- Wooden sign posts shall be painted white.
- Barricades shall not be used as sign supports.
- Nails shall not be used to attach signs to any support.
- All signs shall be installed in accordance with the plans or as directed by the Engineer.
- The Contractor shall furnish the sign design shown in the plans or in the Standard Highway Sign Design for Texas (SHSD).
- The Contractor shall furnish sign supports and substrates listed in the "Typical Work Zone Traffic Control Devices List" (CR20-7), installed as per the manufacturer's recommendations.
- Temporary signs that have damaged or cracked substrates and/or damaged or missing reflective sheeting shall be replaced as directed by the Engineer.
- Identification markings may be shown only on the back of the sign substrate; the maximum height of letters and/or company logos used for identification shall be 1 1/2".
- Damaged wood posts shall be replaced. Splitting wood posts will not be allowed.

REFLECTIVE SHEETING

- All signs shall be retroreflective and constructed of sheeting meeting the requirements of the DMS and color usage table shown on this sheet.
- Materials used to keep signs from turning over should be sandbags filled with dry, cohesionless material.
- The sandbags will be tied shut to keep the sand from spilling and to maintain a constant weight.
- Rock, concrete, iron, steel or other solid objects will not be permitted for use as sign support weights.
- Sandbags should weigh a minimum of 35 lbs and a maximum of 50 lbs.
- Sandbags shall be made of a durable material that resists sun, weather, and impact. Rubber, such as fire inner tubes, shall not be used.
- Rubber ballasts designed for channelizing devices should not be used for ballast on portable sign supports. Sign supports designed and manufactured with rubber ballasts may be used when shown on the CR20-7 list.
- Sandbags shall only be placed along or laid over the base supports of the traffic control device and shall not be suspended above ground level or hung with rope, wire, chains or other fasteners. Sandbags shall be placed along the length of the stakes to weigh down the sign support.
- Sandbags shall not be placed under the sign and shall not be used to level sign supports placed on slopes.

LEGEND

- Sign
- Channelizing Devices
- Type 3 Barricade

DEPARTMENTAL MATERIAL SPECIFICATIONS

SIGN FACE MATERIALS	DMS-8300
FLEXIBLE ROLL-UP REFLECTIVE SIGNS	DMS-8310

REMOVING OR COVERING

- When sign messages may be confusing or do not apply, the signs shall be removed or completely covered, unless otherwise approved by the Engineer.
- When signs are covered, the material used shall be opaque, such as heavy mil sign cloth, and shall be secured with minimum 1/2" diameter eye bolts and minimum 1/2" diameter shackles. The sign shall be secured to the support without covering the sign sheeting. Burlap, or heavy material such as plywood or aluminum shall not be used to cover signs.
- Each type or other adhesive material shall not be affixed to a sign face.
- Signs and other supports shall be removed and notes book filled upon completion of the work.

TRAFFIC SIGNAL WORK BARRICADES AND SIGNS WZ(BTS-2)-13

Texas Department of Transportation

SIDEWALK DIVERSION

SIDEWALK DETOUR

CROSSWALK CLOSURES

PEDESTRIAN CONTROL

BARRIER DELINEATION WITH MODULAR GLARE SCREENS

VERTICAL PANELS & OPPOSING TRAFFIC LANE DIVIDERS SEPARATING TWO-WAY TRAFFIC ON NORMALLY DIVIDED HIGHWAYS

LEGEND

- Type 3 Barricade
- Channelizing Devices
- Truck Mounted Attenuator (TMA)
- Portable Channelizing Message Sign (PCMS)
- Sign
- Flagger

DEPARTMENTAL MATERIAL SPECIFICATIONS

SIGN FACE MATERIALS	DMS-8300
DELIMITERS AND OBJECT MARKERS	DMS-8600
MODULAR GLARE SCREENS FOR HEADLIGHT BARRIER	DMS-8610

TRAFFIC CONTROL PLAN TYPICAL DETAILS WZ(TD)-17

Texas Department of Transportation

Notes: Dec-26, 2005, 2:15pm, User: ID: csc/afg/azg, File: P:\US\TX\NO\Design\CD\WZ\WZ-13\WZ-13.dwg

THIS DOCUMENT HAS BEEN PRODUCED FROM MATERIAL THAT WAS STORED AND/OR TRANSMITTED ELECTRONICALLY AND MAY HAVE BEEN INADVERTENTLY ALTERED. RELY ONLY ON FINAL HARDCOPY MATERIALS BEARING THE CONSULTANT'S ORIGINAL SIGNATURE AND SEAL. REPRODUCTION OF THIS DOCUMENT IS PROHIBITED WITHOUT THE WRITTEN PERMISSION OF THE CONSULTANT.

DATE: _____



NO. REVISION: _____

STATE OF TEXAS
JON D. ADAME
 82567
 PROFESSIONAL ENGINEER
 Jordan Adams
 12-29-25



PAPE-DAWSON
 2000 NW LOOP 410 | SAN ANTONIO, TX 78243 | 210.375.9000
 TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028800

PLAT NO. 25-11800340
 JOB NO. 13657-10
 DATE: DECEMBER 2025
 DESIGNER: _____
 CHECKED: _____ DRAWN: _____
 SHEET: C2.14

Notes: Nov. 06, 2025, 9:27am, User: JD, 11/6/25
 File: P:\USERS\JAD\Projects\250625\250625.dwg

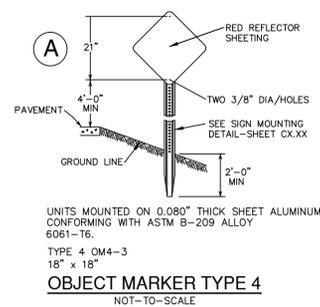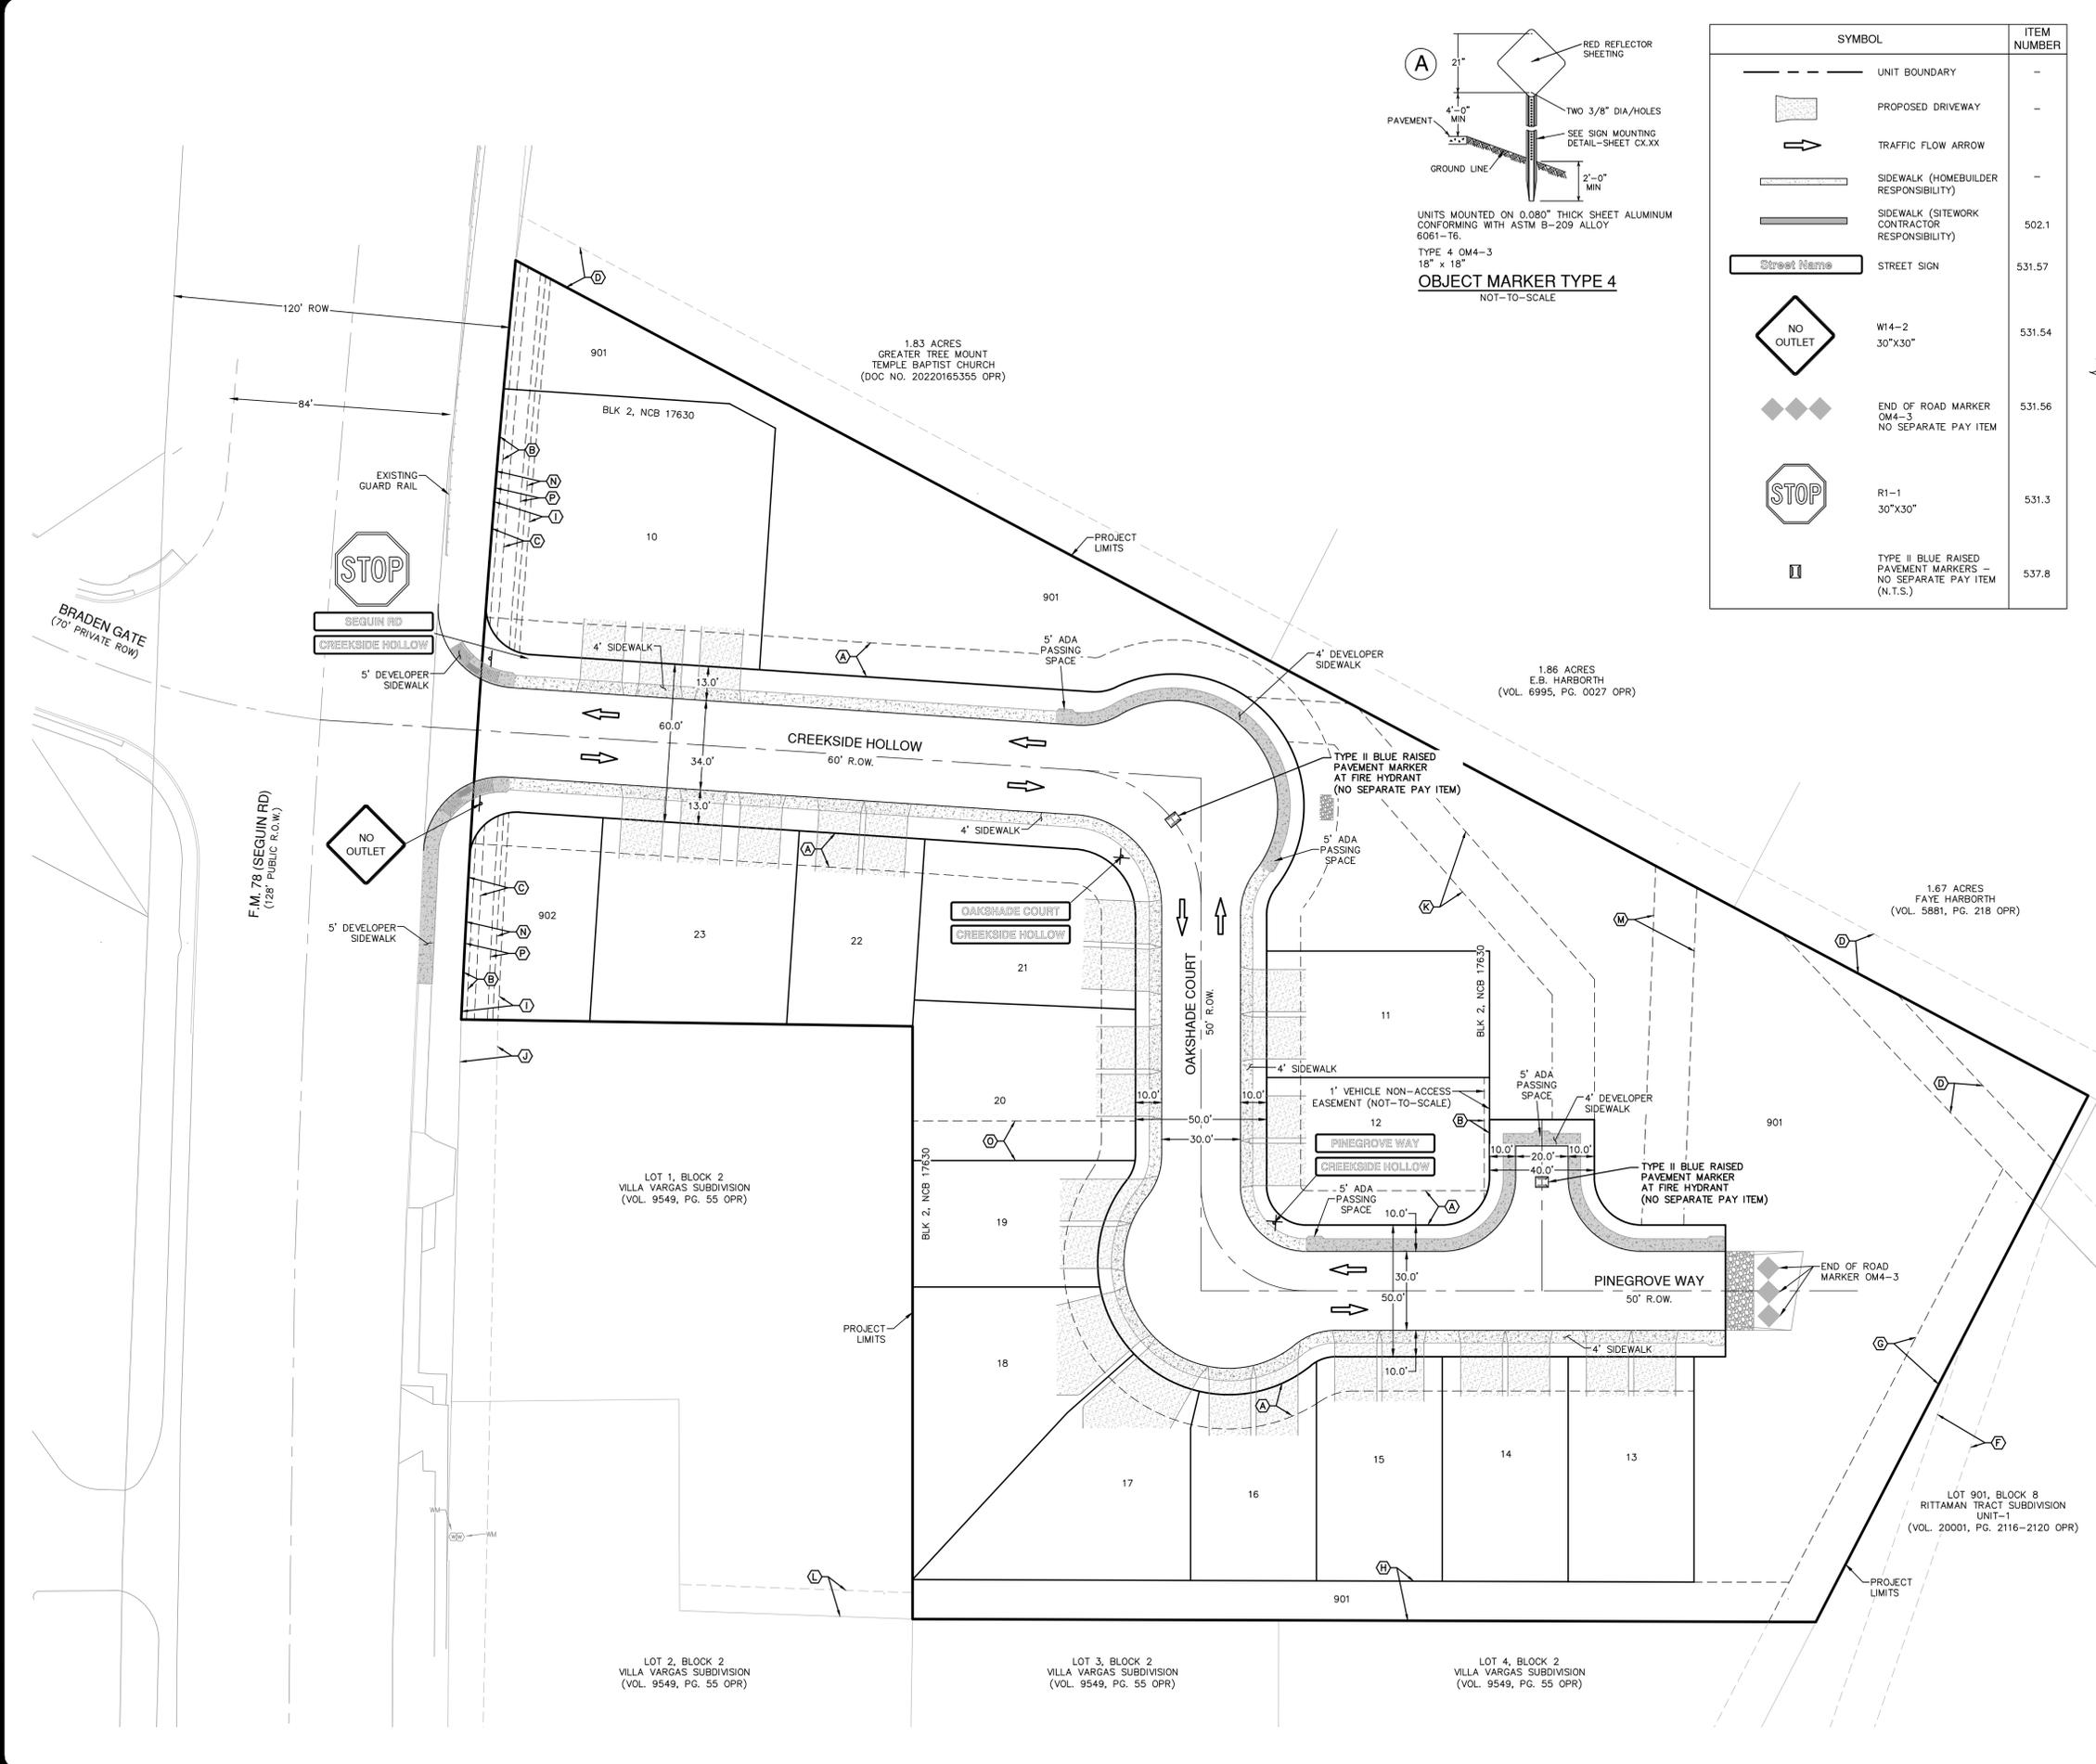

SYMBOL	ITEM NUMBER
--- UNIT BOUNDARY	-
--- PROPOSED DRIVEWAY	-
→ TRAFFIC FLOW ARROW	-
--- SIDEWALK (HOMEBUILDER RESPONSIBILITY)	-
--- SIDEWALK (SITWORK CONTRACTOR RESPONSIBILITY)	502.1
Street Name	531.57
NO OUTLET	531.54
END OF ROAD MARKER	531.56
STOP	531.3
TYPE II BLUE RAISED PAVEMENT MARKERS AT FIRE HYDRANT (NO SEPARATE PAY ITEM)	537.8

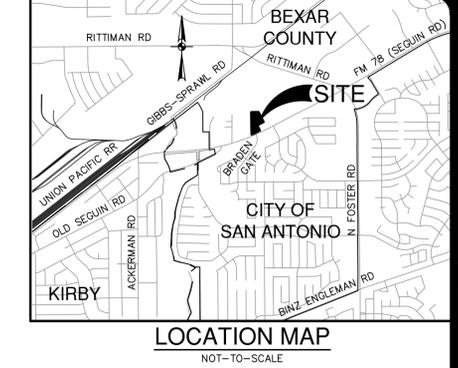

- KEY LEGEND:**
- (A) 13' ELEC., GAS, TELE, & CA. T.V. EASEMENT
 - (B) 1' VEHICLE NON-ACCESS EASEMENT (NOT-TO-SCALE)
 - (C) 5' WATER EASEMENT
 - (D) 16" SANITARY SEWER EASEMENT (VOL. 7799, PG. 551 OPR)
 - (E) 16" PRIVATE SANITARY SEWER EASEMENT (DOC. NO. 20130208512 PR)
 - (F) 16" SANITARY SEWER EASEMENT (VOL. 20001, PGS. 2116-2120 PR)
 - (G) 16" SANITARY SEWER EASEMENT (VOL. 6581, PG. 894 OPR)
 - (H) 15" SANITARY SEWER EASEMENT (VOL. 9549, PG. 55 OPR)
 - (I) 14' ELECTRIC, GAS, TEL., CATV EASEMENT
 - (J) 14' ELECTRIC, GAS, TEL., CATV EASEMENT (VOL. 9549, PG. 55 PR)
 - (K) 16" WATER EASEMENT
 - (L) 10" SANITARY SEWER EASEMENT (VOL. 9549, S. 55 PR)
 - (M) 16" SANITARY SEWER EASEMENT
 - (N) 12" WATER EASEMENT
 - (O) 15" DRAINAGE EASEMENT
 - (P) 10' PEDESTRIAN EASEMENT

TxDOT ROW NOTES:
 A TxDOT ROW PERMIT MUST BE OBTAINED BEFORE WORKING IN TxDOT ROW. CONTRACTOR SHALL COORDINATE A TRAFFIC CONTROL PLAN FOR ALL WORK WITHIN THE ROW. ADDITIONAL WARNING SIGNS MAY BE RECOMMENDED BY THE ENGINEER ONCE THE ROADWAYS ARE CONSTRUCTED.

DRIVEWAY NOTE:
 DRIVEWAYS SHOWN ON THIS PLAN ARE FOR THE SOLE PURPOSE OF INDICATING A POTENTIAL CONFLICT WITH CURB RAMP, DRAINAGE INFRASTRUCTURE, OR OTHER CONFLICT. DRIVEWAY LOCATION IS SUBJECT TO CHANGE BASED ON HOME SELECTION AND FINAL LOT DESIGN.

TRENCH EXCAVATION SAFETY PROTECTION:
 CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/ GEOTECHNICAL/ SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND /OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

DATE	NO.	REVISION

PAPE-DAWSON
 2000 NW LOOP 410 | SAN ANTONIO, TX 78213 | 210.375.9000
 TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028800

CREEKS EDGE
 SAN ANTONIO, TEXAS
 OVERALL SIGNAGE PLAN

PLAT NO.	25-11800340
JOB NO.	13657-10
DATE	NOVEMBER 2025
DESIGNER	CB
CHECKED	JA DRAWN CB
SHEET	C3.00


SIGN SUPPORT DESCRIPTIVE CODES
(Sequential codes correspond to project estimate and quantity items)

SM RD SGN ASSM TY XXXX(X)XX(X-XXXX)
 Post Type
 FFR = Fiberglass Reinforced Plastic Pipe (see SMD(FR))
 TR = Thin-Walled Tubing (see SMD(TR))
 TOWB = 10 MW Tubing (see SMD(TP-1) to (SLIP-3))
 S80 = Schedule 80 Pipe (see SMD(SLIP-1) to (SLIP-3))


Number of Posts (1 or 2)
 Anchor Type
 UA = Universal Anchor - Castored (see SMD(UA)) and (TW1)
 UA = Universal Anchor - Bolted down (see SMD(UA)) and (TW1)
 WA = Wedge Anchor Steel (see SMD(WA))
 WA = Wedge Anchor Plastic (see SMD(WA))
 SA = Sleeve - Castored (see SMD(SLIP-1) to (SLIP-3))
 SA = Sleeve - Bolted Down (see SMD(SLIP-1) to (SLIP-3))

Sign Mounting Description
 P = Prefab. "P" (see SMD(SLIP-1) to (SLIP-3)), (TW1), (FRP)
 T = Prefab. "T" (see SMD(SLIP-1) to (SLIP-3)), (TW1)
 U = Prefab. "U" (see SMD(SLIP-1) to (SLIP-3))
 EXT = Extended (see SMD(SLIP-1) to (SLIP-3)), (TW1)
 SW = Extruded Wing Beam (see SMD(SLIP-1) to (SLIP-3))
 M = 1.12 W/F/Wing Channel (see SMD(SLIP-1) to (SLIP-3))
 CAL = Extruded Aluminum Sign Panels (see SMD(SLIP-1))


REQUIRED CLEARANCE FOR BREAKAWAY SUPPORT




SIGN LOCATION




BEHIND BARRIER




BEHIND GUARDRAIL




RESTRICTED RIGHT-OF-WAY
(When 5 ft min. is not possible.)




CURB & GUTTER OR RAISED ISLAND



TRANGULAR SLIPBASE INSTALLATION GENERAL REQUIREMENTS

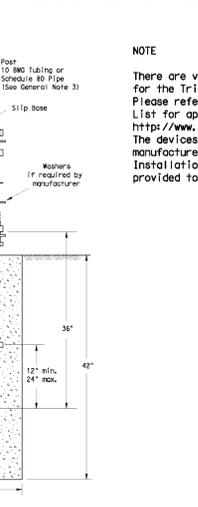

CONCRETE ANCHOR

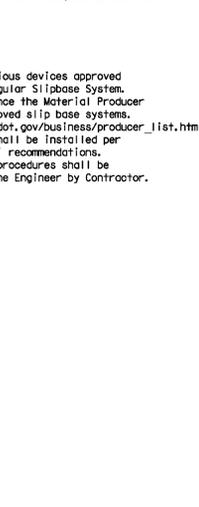

SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS TRIANGULAR SLIPBASE SYSTEM
SMD (SLIP-1) -08


GENERAL NOTES:
 1. Slip base shall be permanently marked to indicate manufacturer, method, design, and location of marking are subject to approval of the Texas Department of Transportation.
 2. Material used on post with this system shall conform to the following specifications:
 10 MW Tubing (2.875" outside diameter)
 0.124" nominal wall thickness
 Schedule 80 Pipe (2.875" outside diameter)
 0.218" nominal wall thickness
 Steel tubing per ASTM A500, Grade C
 Other steels may be used if they meet the following:
 50,000 PSI minimum yield strength
 70,000 PSI minimum tensile strength
 235 minimum elongation in 2"
 10 MW Tubing (2.875" outside diameter)
 0.124" nominal wall thickness
 Schedule 80 Pipe (2.875" outside diameter)
 0.218" nominal wall thickness
 Steel tubing per ASTM A500, Grade C
 Other steels may be used if they meet the following:
 50,000 PSI minimum yield strength
 70,000 PSI minimum tensile strength
 235 minimum elongation in 2"
 10 MW Tubing (2.875" outside diameter)
 0.124" nominal wall thickness
 Schedule 80 Pipe (2.875" outside diameter)
 0.218" nominal wall thickness
 Steel tubing per ASTM A500, Grade C
 Other steels may be used if they meet the following:
 50,000 PSI minimum yield strength
 70,000 PSI minimum tensile strength
 235 minimum elongation in 2"

ASSEMBLY PROCEDURE
 Foundation
 1. Prepare 12-inch diameter hole by 42-inch deep hole. If solid rock is encountered, the depth of the foundation may be reduced such that it is embedded a minimum of 18 inches into the solid rock. The hole may be drilled with a 12-inch diameter hole. The hole shall be drilled with a portable, motor or electric concrete mixer. For small placements less than 0.5 cubic yards, hand mixing in a suitable container may be allowed by Engineer. Concrete shall be placed in the hole in 6 lifts.
 2. Push the pipe and the slip base into the center of the concrete. Rotate the stub back and forth while pushing it down into the concrete to ensure good contact between concrete and stub. Continue to work the stub into the concrete until it is between 2 to 4 inches above the ground.
 3. Place the slab. Allow a minimum of 4 days to set. This should be directed by the Engineer.
 4. The triangular slipbase system is multifunctional and is designed to release when struck from any direction.

Support
 1. Cut support so that the bottom of the sign will be 7 to 7.5 feet above the edge of the travelway (i.e., edge of the closest lane) when slip base is below the edge of pavement or 7 to 7.5 feet above the site when the slip base is above the edge of the travelway. The cut shall be done and straight.

2. Attach sign to support using connections shown. When multiple signs are installed on the same support, ensure the minimum clearance between each sign is maintained. See SMD(SLIP-2) for clearance based on sign types.

DATE: FILED: 9-08

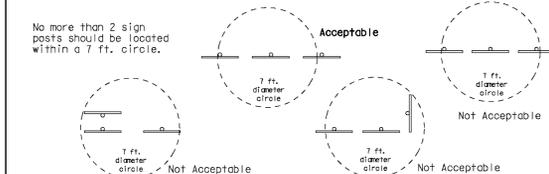


TYPICAL SIGN ATTACHMENT DETAIL

Boits used to mount sign panels to the clamp are 5/16" x 18 UNC galvanized square head with nut, nylon washer, flat washer and lock washer. The bolt length is 1 inch for aluminum.

When two sign clamps are used to mount sign back-to-back, use 5/16" x 18 UNC galvanized hex head per ASTM A307 with nut and helical-spring lock washer. The appropriate bolt lengths for various post sizes and sign clamp types are given in the table of right. The bolt length may need to be adjusted depending upon field conditions.

Sign clamps may be either the specific size clamp or the universal clamp.

Post Diameter	Approximate Bolt Length
2" nominal	3 or 3 1/2"
2 1/2" nominal	3 or 3 1/2"
3" nominal	3 1/2 or 4"
4" nominal	4 1/2"

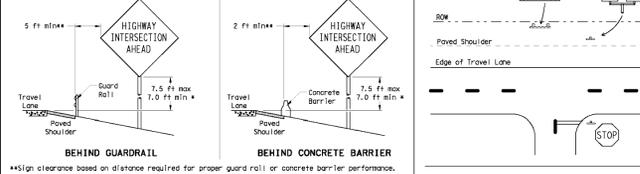


SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS GENERAL NOTES & DETAILS
SMD (GEN) -08

GENERAL NOTES:
 1. Sign supports shall be installed in accordance with the following conditions:
 (1) a minimum of 7 to a maximum of 7.5 feet above the edge of the travel lane or
 (2) a minimum of 7 to a maximum of 7.5 feet above the grade at the base of the support when sign is installed on the backstop.
 The maximum values may be increased when directed by the Engineer.
 See the Traffic Operations Division website for detailed drawings of sign clamps, triangular slipbase system components and Wedge Anchor System components.
 The website address is: <http://www.txdot.gov/publications/traffic.htm>

Right-of-way restrictions may be created by rocks, water, vegetation, fences, buildings, a narrow lane, or other factors.
 In situations where a lateral restriction prevents the minimum horizontal clearance from the edge of the travel lane, signs should be placed as far from the travel lane as practical.
 Max Post may be shorter if protected by guardrail or if Engineer determines the post could not be hit due to extreme slope.

DATE: FILED: 9-08

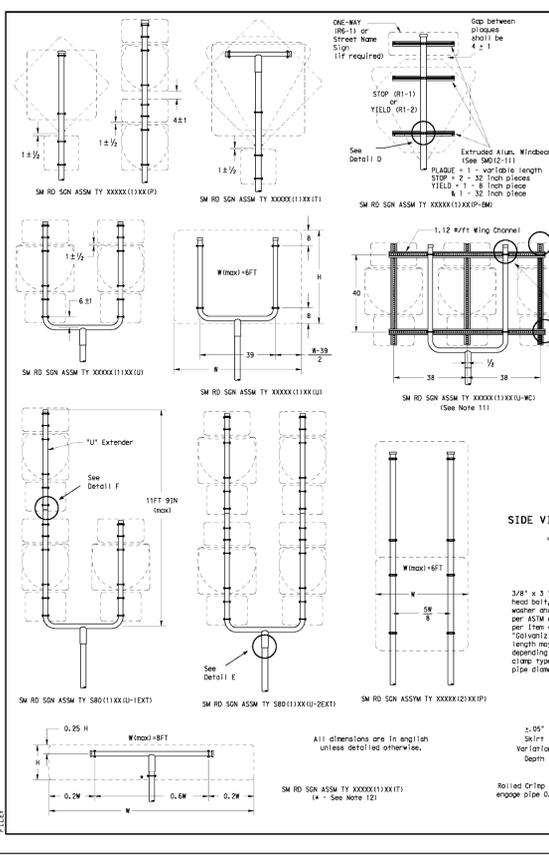


SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS TRIANGULAR SLIPBASE SYSTEM
SMD (SLIP-2) -08

GENERAL NOTES:
 1. The Engineer may require that a Schedule 80 post be used in place of a 10 MW where a sign height is abnormally high due to a fill slope.
 2. Sign supports shall not be galvanized except where shown.
 3. Aluminum sign clamps shall not be galvanized.
 4. Aluminum sign clamps shall conform to Departmental Material Specifications. All signs shall have the following minimum thicknesses: 0.080 for signs less than 18 in. high, 0.100 for signs 18 to 36 in. high, and 0.125 for signs greater than 36 in. high.
 5. Signs that require specific supports due to reasons in addition to windloading are indicated on the "REQUIRED SUPPORT" table in this sheet.
 6. For horizontal rectangular signs fabricated from flat aluminum, brackets are used for signs 24 inches or less in height. U-brackets are used for signs of greater height.
 7. When two triangular slipbase supports are used to support a single sign, they shall not be "rigidly" connected to each other except through the sign panel. This will allow each support to act independently when impacted by an errant vehicle.
 8. Signs shall be installed on a minimum of 12 inches of compacted subgrade. If the subgrade is less than 12 inches, it shall be compacted to a minimum of 12 inches.
 9. Signs shall be installed on a minimum of 12 inches of compacted subgrade. If the subgrade is less than 12 inches, it shall be compacted to a minimum of 12 inches.
 10. Additional route markers may be added vertically, provided the total sign area does not exceed the maximum allowable amount per Note 1.
 11. Additional sign clamps required on the "bracket" post for 24 inch high signs. Place the clamp 3 inches above bottom of sign when possible.
 12. Post open ends shall be fitted with Friction Caps.
 13. Sign clamps shall be the sizes and shapes shown on the plans.

Sign Description	Support
48-inch STOP sign (R1-1)	TY 10MG(1)XXX(T)
48-inch YIELD sign (R1-2)	TY 10MG(1)XXX(S)
60-inch YIELD sign (R1-2)	TY 10MG(1)XXX(S)
48x48-inch ONE-WAY sign (R6-1)	TY 10MG(1)XXX(T)
36x48, 48x36, and 48x48-inch signs	TY 10MG(1)XXX(T)
48x60-inch signs	TY S80(1)XXX(T)
48x48-inch signs (diamond or square)	TY 10MG(1)XXX(T)
48x60-inch signs	TY S80(1)XXX(T)
48-inch Advance School X-ing sign (S1-1)	TY 10MG(1)XXX(T)
48-inch School X-ing sign (S2-1)	TY 10MG(1)XXX(T)
Large Arrow sign (W-6 & W-7)	TY 10MG(1)XXX(T)

REQUIRED SUPPORT

DATE: FILED: 9-08

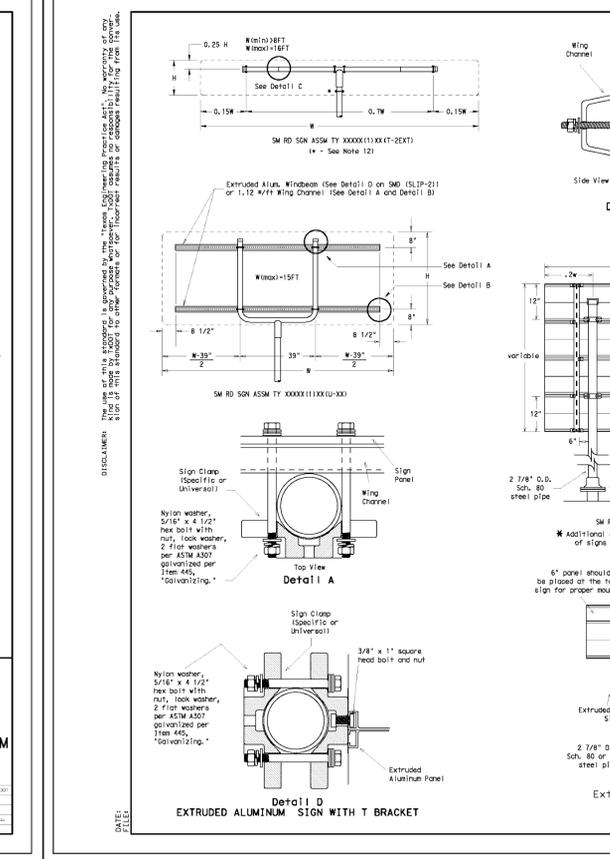

SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS TRIANGULAR SLIPBASE SYSTEM
SMD (SLIP-3) -08

GENERAL NOTES:
 1. The Engineer may require that a Schedule 80 post be used in place of a 10 MW where a sign height is abnormally high due to a fill slope.
 2. Sign supports shall not be galvanized except where shown.
 3. Aluminum sign clamps shall not be galvanized.
 4. Aluminum sign clamps shall conform to Departmental Material Specifications. All signs shall have the following minimum thicknesses: 0.080 for signs less than 18 in. high, 0.100 for signs 18 to 36 in. high, and 0.125 for signs greater than 36 in. high.
 5. Signs that require specific supports due to reasons in addition to windloading are indicated on the "REQUIRED SUPPORT" table in this sheet.
 6. For horizontal rectangular signs fabricated from flat aluminum, brackets are used for signs 24 inches or less in height. U-brackets are used for signs of greater height.
 7. When two triangular slipbase supports are used to support a single sign, they shall not be "rigidly" connected to each other except through the sign panel. This will allow each support to act independently when impacted by an errant vehicle.
 8. Signs shall be installed on a minimum of 12 inches of compacted subgrade. If the subgrade is less than 12 inches, it shall be compacted to a minimum of 12 inches.
 9. Signs shall be installed on a minimum of 12 inches of compacted subgrade. If the subgrade is less than 12 inches, it shall be compacted to a minimum of 12 inches.
 10. Additional route markers may be added vertically, provided the total sign area does not exceed the maximum allowable amount per Note 1.
 11. Additional sign clamps required on the "bracket" post for 24 inch high signs. Place the clamp 3 inches above bottom of sign when possible.
 12. Post open ends shall be fitted with Friction Caps.
 13. Sign clamps shall be the sizes and shapes shown on the plans.

Sign Description	Support
48-inch STOP sign (R1-1)	TY 10MG(1)XXX(T)
48-inch YIELD sign (R1-2)	TY 10MG(1)XXX(S)
60-inch YIELD sign (R1-2)	TY 10MG(1)XXX(S)
48x48-inch ONE-WAY sign (R6-1)	TY 10MG(1)XXX(T)
36x48, 48x36, and 48x48-inch signs	TY 10MG(1)XXX(T)
48x60-inch signs	TY S80(1)XXX(T)
48x48-inch signs (diamond or square)	TY 10MG(1)XXX(T)
48x60-inch signs	TY S80(1)XXX(T)
48-inch Advance School X-ing sign (S1-1)	TY 10MG(1)XXX(T)
48-inch School X-ing sign (S2-1)	TY 10MG(1)XXX(T)
Large Arrow sign (W-6 & W-7)	TY 10MG(1)XXX(T)

REQUIRED SUPPORT

DATE: FILED: 9-08

STATE OF TEXAS
 JON D. ADAME
 82567
 PROFESSIONAL ENGINEER
 Jim Adame
 11-6-25

PAPE - DAWSON
 2000 NW LOOP 410 | SAN ANTONIO, TX 78213 | 210.375.9000
 TEXAS ENGINEERING FIRM #471 | TEXAS SURVEYING FIRM #1028890

CREEKS EDGE
 SAN ANTONIO, TEXAS
 SIGNAGE DETAILS

PLAT NO: 25-11800340
 JOB NO: 13657-10
 DATE: NOVEMBER 2025
 DESIGNER: -
 CHECKED: - DRAWN: -
 SHEET: C3.10

OCTAGON

A	B	C
18	3	18
30	3	24
36	3	30
42	3	36

DIAMOND (A)

A	B	C	D	T
18	9	11.72	0.080	
24	12	11.72	0.080	
30	15	11.72	0.080	
36	18	11.72	0.080	
42	21	11.72	0.080	

DIAMOND (B)

A	B	C	D	T
18	9	11.72	0.080	
24	12	11.72	0.080	
30	15	11.72	0.080	
36	18	11.72	0.080	
42	21	11.72	0.080	

CIRCLE

A	B	T
18	18	0.100

PENTAGON (SCHOOL)

A	B	C	D	T
30	3	3	3	0.100
36	24	3	2.14	0.100
42	30	3	2.14	0.100
48	36	3	2.14	0.100

EQUILATERAL TRIANGLE

A	B	C	D	T
18	2	18	2	0.100
30	2	24	2	0.100
42	2	36	2	0.100
54	2	48	2	0.100
66	2	60	2	0.100

ISOSCELES TRIANGLE

A	B	C	D	E	T
40	30	7.72	10	1.78	0.080
48	36	9	12	2.14	0.080
56	42	10.8	14	2.5	0.080
64	48	12.6	16	2.86	0.080

SQUARE (A)

A	B	C	D	T
18	11.72	18	11.72	0.080
24	15.28	24	15.28	0.080
30	18.84	30	18.84	0.080
36	22.4	36	22.4	0.080
42	25.96	42	25.96	0.080

SQUARE (B)

A	B	C	D	E	F	T
36	3	3	3	3	3	0.100
42	6	6	6	6	6	0.100
48	9	9	9	9	9	0.100
54	12	12	12	12	12	0.100
60	15	15	15	15	15	0.100

HORIZONTAL RECTANGLE

A	B	C	D	E	F	T
36	24	3	18	6	24	11.72
42	24	3	18	6	24	11.72
48	24	3	18	6	24	11.72
54	24	3	18	6	24	11.72
60	24	3	18	6	24	11.72
66	24	3	18	6	24	11.72
72	24	3	18	6	24	11.72
78	24	3	18	6	24	11.72
84	24	3	18	6	24	11.72
90	24	3	18	6	24	11.72

VERTICAL/HORIZONTAL RECTANGLE

A	B	C	D	E	F	G	T
12	18	11.72	15	11.72	11.72	9	0.080
12	36	3	30	11.72	11.72	9	0.080
18	24	11.72	21	11.72	11.72	15	0.080
24	30	3	24	11.72	3	18	0.080
24	36	3	30	11.72	3	18	0.080
24	42	6	36	11.72	3	18	0.080
30	36	3	30	11.72	3	24	0.080
36	42	3	30	11.72	3	24	0.080
42	60	3	30	11.72	3	24	0.080

VERTICAL RECTANGLE

A	B	C	D	E	T
48	60	6	48	9	30
60	72	6	48	9	30
72	84	6	48	9	30
84	96	6	48	9	30
96	108	6	48	9	30

GENERAL NOTES:

- ALL BLANKS TO BE ALUMINUM ALLOY NO. 5052-H38.
- "T" DENOTES THICKNESS OF SIGN BLANKS.
- ALL HOLES SHALL BE 3/8" DIAMETER DRILLED OR PUNCHED AS SHOWN ON EACH BLANK DETAIL AND SHALL BE FREE OF BURRS AND ROUGH EDGES.
- SIGN BLANK CORNERS TO BE ROUNDED AS SHOWN ON EACH DETAIL.
- ALL SIGN BLANKS TO BE ETCHED, DEGRADED, AND HAVE AN ALUMINE FINISH PRIOR TO APPLICATION OF LEGENDS.
- ALL DETAILS ARE NOT TO SCALE.
- ALL DIMENSIONS ARE IN INCHES.
- *HOLE PLACEMENT AS INDICATED ON THE PLANS.

SEPTEMBER 2024
CITY OF SAN ANTONIO
PUBLIC WORKS DEPARTMENT
TRAFFIC ENGINEERING AND OPERATIONS STANDARDS
BLANK SIGN
DETAILS
SHEET 03 OF 04
SM(3)-24

9" D3 - STREET NAME SIGN

9" D3 WITH DEAD END OR NO OUTLET SIGNAGE

TABLE - D3 SIGNS

A	B	C	D	E	F	T
24"	9"	1 1/2"	1 1/2"	8"	12"	1/8"
30"	9"	1 1/2"	1 1/2"	8"	15"	1/8"
36"	9"	1 1/2"	1 1/2"	8"	18"	1/8"
42"	9"	1 1/2"	1 1/2"	8"	21"	1/8"
48"	9"	1 1/2"	1 1/2"	8"	24"	1/8"
54"	9"	1 1/2"	1 1/2"	8"	27"	1/8"

D3 SIGN TO POLE INSTALLATION

GENERAL NOTES:

- "9-INCH STREET NAME" SIGN (1-EA) INCLUDES THE INSTALLATION OF (2) ONE-SIDED D3 SIGNS. THIS SHALL BE FULL COMPENSATION FOR MATERIALS AND LABOR AS DESCRIBED IN C.O.S.A. STANDARD SPECIFICATIONS AND GROUND SIGN MOUNTING STANDARD DETAIL.
- "9-INCH STREET NAME PLATE" (1-EA) INCLUDES THE INSTALLATION OF (2) ONE-SIDED D3 SIGNS ON TOP OF EXISTING SIGN (I.E. STOP SIGN OR YIELD SIGN). EXTRA LENGTH HOLE AND APPURTENANCES REQUIRED TO MEET SPECIFICATIONS.

SEPTEMBER 2024
CITY OF SAN ANTONIO
PUBLIC WORKS DEPARTMENT
TRAFFIC ENGINEERING AND OPERATIONS STANDARDS
D3 STREET NAME SIGN MOUNTING
SHEET 02 OF 02
SM(2)-24



Wedge Anchor Steel System

Wedge Anchor High Density Polyethylene (HDPE) System

Sign Installation Using a Prefabricated T-Bracket for Thin-Wall Tubing Post

GENERAL NOTES:

- The Wedge Anchor System and the Universal Anchor System with thin wall tubing post may be used to support up to 10 square feet of sign area.
- The fabric of the wedge and anchor (concrete) shall be permanently marked to indicate manufacturer, method, design, and location of marking are subject to the approval of the local Traffic Operations Division.
- Except for parts (1) (3) (4) (5) (6) (7) (8) (9) (10) (11) (12) (13) (14) (15) (16) (17) (18) (19) (20) (21) (22) (23) (24) (25) (26) (27) (28) (29) (30) (31) (32) (33) (34) (35) (36) (37) (38) (39) (40) (41) (42) (43) (44) (45) (46) (47) (48) (49) (50) (51) (52) (53) (54) (55) (56) (57) (58) (59) (60) (61) (62) (63) (64) (65) (66) (67) (68) (69) (70) (71) (72) (73) (74) (75) (76) (77) (78) (79) (80) (81) (82) (83) (84) (85) (86) (87) (88) (89) (90) (91) (92) (93) (94) (95) (96) (97) (98) (99) (100) (101) (102) (103) (104) (105) (106) (107) (108) (109) (110) (111) (112) (113) (114) (115) (116) (117) (118) (119) (120) (121) (122) (123) (124) (125) (126) (127) (128) (129) (130) (131) (132) (133) (134) (135) (136) (137) (138) (139) (140) (141) (142) (143) (144) (145) (146) (147) (148) (149) (150) (151) (152) (153) (154) (155) (156) (157) (158) (159) (160) (161) (162) (163) (164) (165) (166) (167) (168) (169) (170) (171) (172) (173) (174) (175) (176) (177) (178) (179) (180) (181) (182) (183) (184) (185) (186) (187) (188) (189) (190) (191) (192) (193) (194) (195) (196) (197) (198) (199) (200) (201) (202) (203) (204) (205) (206) (207) (208) (209) (210) (211) (212) (213) (214) (215) (216) (217) (218) (219) (220) (221) (222) (223) (224) (225) (226) (227) (228) (229) (230) (231) (232) (233) (234) (235) (236) (237) (238) (239) (240) (241) (242) (243) (244) (245) (246) (247) (248) (249) (250) (251) (252) (253) (254) (255) (256) (257) (258) (259) (260) (261) (262) (263) (264) (265) (266) (267) (268) (269) (270) (271) (272) (273) (274) (275) (276) (277) (278) (279) (280) (281) (282) (283) (284) (285) (286) (287) (288) (289) (290) (291) (292) (293) (294) (295) (296) (297) (298) (299) (300) (301) (302) (303) (304) (305) (306) (307) (308) (309) (310) (311) (312) (313) (314) (315) (316) (317) (318) (319) (320) (321) (322) (323) (324) (325) (326) (327) (328) (329) (330) (331) (332) (333) (334) (335) (336) (337) (338) (339) (340) (341) (342) (343) (344) (345) (346) (347) (348) (349) (350) (351) (352) (353) (354) (355) (356) (357) (358) (359) (360) (361) (362) (363) (364) (365) (366) (367) (368) (369) (370) (371) (372) (373) (374) (375) (376) (377) (378) (379) (380) (381) (382) (383) (384) (385) (386) (387) (388) (389) (390) (391) (392) (393) (394) (395) (396) (397) (398) (399) (400) (401) (402) (403) (404) (405) (406) (407) (408) (409) (410) (411) (412) (413) (414) (415) (416) (417) (418) (419) (420) (421) (422) (423) (424) (425) (426) (427) (428) (429) (430) (431) (432) (433) (434) (435) (436) (437) (438) (439) (440) (441) (442) (443) (444) (445) (446) (447) (448) (449) (450) (451) (452) (453) (454) (455) (456) (457) (458) (459) (460) (461) (462) (463) (464) (465) (466) (467) (468) (469) (470) (471) (472) (473) (474) (475) (476) (477) (478) (479) (480) (481) (482) (483) (484) (485) (486) (487) (488) (489) (490) (491) (492) (493) (494) (495) (496) (497) (498) (499) (500) (501) (502) (503) (504) (505) (506) (507) (508) (509) (510) (511) (512) (513) (514) (515) (516) (517) (518) (519) (520) (521) (522) (523) (524) (525) (526) (527) (528) (529) (530) (531) (532) (533) (534) (535) (536) (537) (538) (539) (540) (541) (542) (543) (544) (545) (546) (547) (548) (549) (550) (551) (552) (553) (554) (555) (556) (557) (558) (559) (560) (561) (562) (563) (564) (565) (566) (567) (568) (569) (570) (571) (572) (573) (574) (575) (576) (577) (578) (579) (580) (581) (582) (583) (584) (585) (586) (587) (588) (589) (590) (591) (592) (593) (594) (595) (596) (597) (598) (599) (600) (601) (602) (603) (604) (605) (606) (607) (608) (609) (610) (611) (612) (613) (614) (615) (616) (617) (618) (619) (620) (621) (622) (623) (624) (625) (626) (627) (628) (629) (630) (631) (632) (633) (634) (635) (636) (637) (638) (639) (640) (641) (642) (643) (644) (645) (646) (647) (648) (649) (650) (651) (652) (653) (654) (655) (656) (657) (658) (659) (660) (661) (662) (663) (664) (665) (666) (667) (668) (669) (670) (671) (672) (673) (674) (675) (676) (677) (678) (679) (680) (681) (682) (683) (684) (685) (686) (687) (688) (689) (690) (691) (692) (693) (694) (695) (696) (697) (698) (699) (700) (701) (702) (703) (704) (705) (706) (707) (708) (709) (710) (711) (712) (713) (714) (715) (716) (717) (718) (719) (720) (721) (722) (723) (724) (725) (726) (727) (728) (729) (730) (731) (732) (733) (734) (735) (736) (737) (738) (739) (740) (741) (742) (743) (744) (745) (746) (747) (748) (749) (750) (751) (752) (753) (754) (755) (756) (757) (758) (759) (760) (761) (762) (763) (764) (765) (766) (767) (768) (769) (770) (771) (772) (773) (774) (775) (776) (777) (778) (779) (780) (781) (782) (783) (784) (785) (786) (787) (788) (789) (790) (791) (792) (793) (794) (795) (796) (797) (798) (799) (800) (801) (802) (803) (804) (805) (806) (807) (808) (809) (810) (811) (812) (813) (814) (815) (816) (817) (818) (819) (820) (821) (822) (823) (824) (825) (826) (827) (828) (829) (830) (831) (832) (833) (834) (835) (836) (837) (838) (839) (840) (841) (842) (843) (844) (845) (846) (847) (848) (849) (850) (851) (852) (853) (854) (855) (856) (857) (858) (859) (860) (861) (862) (863) (864) (865) (866) (867) (868) (869) (870) (871) (872) (873) (874) (875) (876) (877) (878) (879) (880) (881) (882) (883) (884) (885) (886) (887) (888) (889) (890) (891) (892) (893) (894) (895) (896) (897) (898) (899) (900) (901) (902) (903) (904) (905) (906) (907) (908) (909) (910) (911) (912) (913) (914) (915) (916) (917) (918) (919) (920) (921) (922) (923) (924) (925) (926) (927) (928) (929) (930) (931) (932) (933) (934) (935) (936) (937) (938) (939) (940) (941) (942) (943) (944) (945) (946) (947) (948) (949) (950) (951) (952) (953) (954) (955) (956) (957) (958) (959) (960) (961) (962) (963) (964) (965) (966) (967) (968) (969) (970) (971) (972) (973) (974) (975) (976) (977) (978) (979) (980) (981) (982) (983) (984) (985) (986) (987) (988) (989) (990) (991) (992) (993) (994) (995) (996) (997) (998) (999) (1000) (1001) (1002) (1003) (1004) (1005) (1006) (1007) (1008) (1009) (1010) (1011) (1012) (1013) (1014) (1015) (1016) (1017) (1018) (1019) (1020) (1021) (1022) (1023) (1024) (1025) (1026) (1027) (1028) (1029) (1030) (1031) (1032) (1033) (1034) (1035) (1036) (1037) (1038) (1039) (1040) (1041) (1042) (1043) (1044) (1045) (1046) (1047) (1048) (1049) (1050) (1051) (1052) (1053) (1054) (1055) (1056) (1057) (1058) (1059) (1060) (1061) (1062) (1063) (1064) (1065) (1066) (1067) (1068) (1069) (1070) (1071) (1072) (1073) (1074) (1075) (1076) (1077) (1078) (1079) (1080) (1081) (1082) (1083) (1084) (1085) (1086) (1087) (1088) (1089) (1090) (1091) (1092) (1093) (1094) (1095) (1096) (1097) (1098) (1099) (1100) (1101) (1102) (1103) (1104) (1105) (1106) (1107) (1108) (1109) (1110) (1111) (1112) (1113) (1114) (1115) (1116) (1117) (1118) (1119) (1120) (1121) (1122) (1123) (1124) (1125) (1126) (1127) (1128) (1129) (1130) (1131) (1132) (1133) (1134) (1135) (1136) (1137) (1138) (1139) (1140) (1141) (1142) (1143) (1144) (1145) (1146) (1147) (1148) (1149) (1150) (1151) (1152) (1153) (1154) (1155) (1156) (1157) (1158) (1159) (1160) (1161) (1162) (1163) (1164) (1165) (1166) (1167) (1168) (1169) (1170) (1171) (1172) (1173) (1174) (1175) (1176) (1177) (1178) (1179) (1180) (1181) (1182) (1183) (1184) (1185) (1186) (1187) (1188) (1189) (1190) (1191) (1192) (1193) (1194) (1195) (1196) (1197) (1198) (1199) (1200) (1201) (1202) (1203) (1204) (1205) (1206) (1207) (1208) (1209) (1210) (1211) (1212) (1213) (1214) (1215) (1216) (1217) (1218) (1219) (1220) (1221) (1222) (1223) (1224) (1225) (1226) (1227) (1228) (1229) (1230) (1231) (1232) (1233) (1234) (1235) (1236) (1237) (1238) (1239) (1240) (1241) (1242) (1243) (1244) (1245) (1246) (1247) (1248) (1249) (1250) (1251) (1252) (1253) (1254) (1255) (1256) (1257) (1258) (1259) (1260) (1261) (1262) (1263) (1264) (1265) (1266) (1267) (1268) (1269) (1270) (1271) (1272) (1273) (1274) (1275) (1276) (1277) (1278) (1279) (1280) (1281) (1282) (1283) (1284) (1285) (1286) (1287) (1288) (1289) (1290) (1291) (1292) (1293) (1294) (1295) (1296) (1297) (1298) (1299) (1300) (1301) (1302) (1303) (1304) (1305) (1306) (1307) (1308) (1309) (1310) (1311) (1312) (1313) (1314) (1315) (1316) (1317) (1318) (1319) (1320) (1321) (1322) (1323) (1324) (1325) (1326) (1327) (1328) (1329) (1330) (1331) (1332) (1333) (1334) (1335) (1336) (1337) (1338) (1339) (1340) (1341) (1342) (1343) (1344) (1345) (1346) (1347) (1348) (1349) (1350) (1351) (1352) (1353) (1354) (1355) (1356) (1357) (1358) (1359) (1360) (1361) (1362) (1363) (1364) (1365) (1366) (1367) (1368) (1369) (1370) (1371) (1372) (1373) (1374) (1375) (1376) (1377) (1378) (1379) (1380) (1381) (1382) (1383) (1384) (1385) (1386) (1387) (1388) (1389) (1390) (1391) (1392

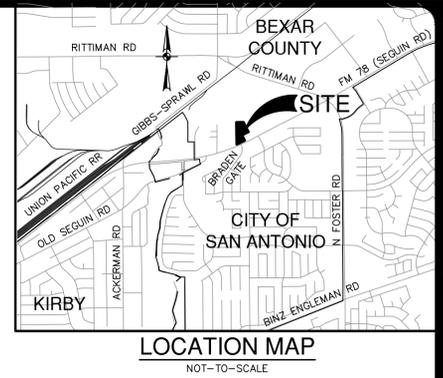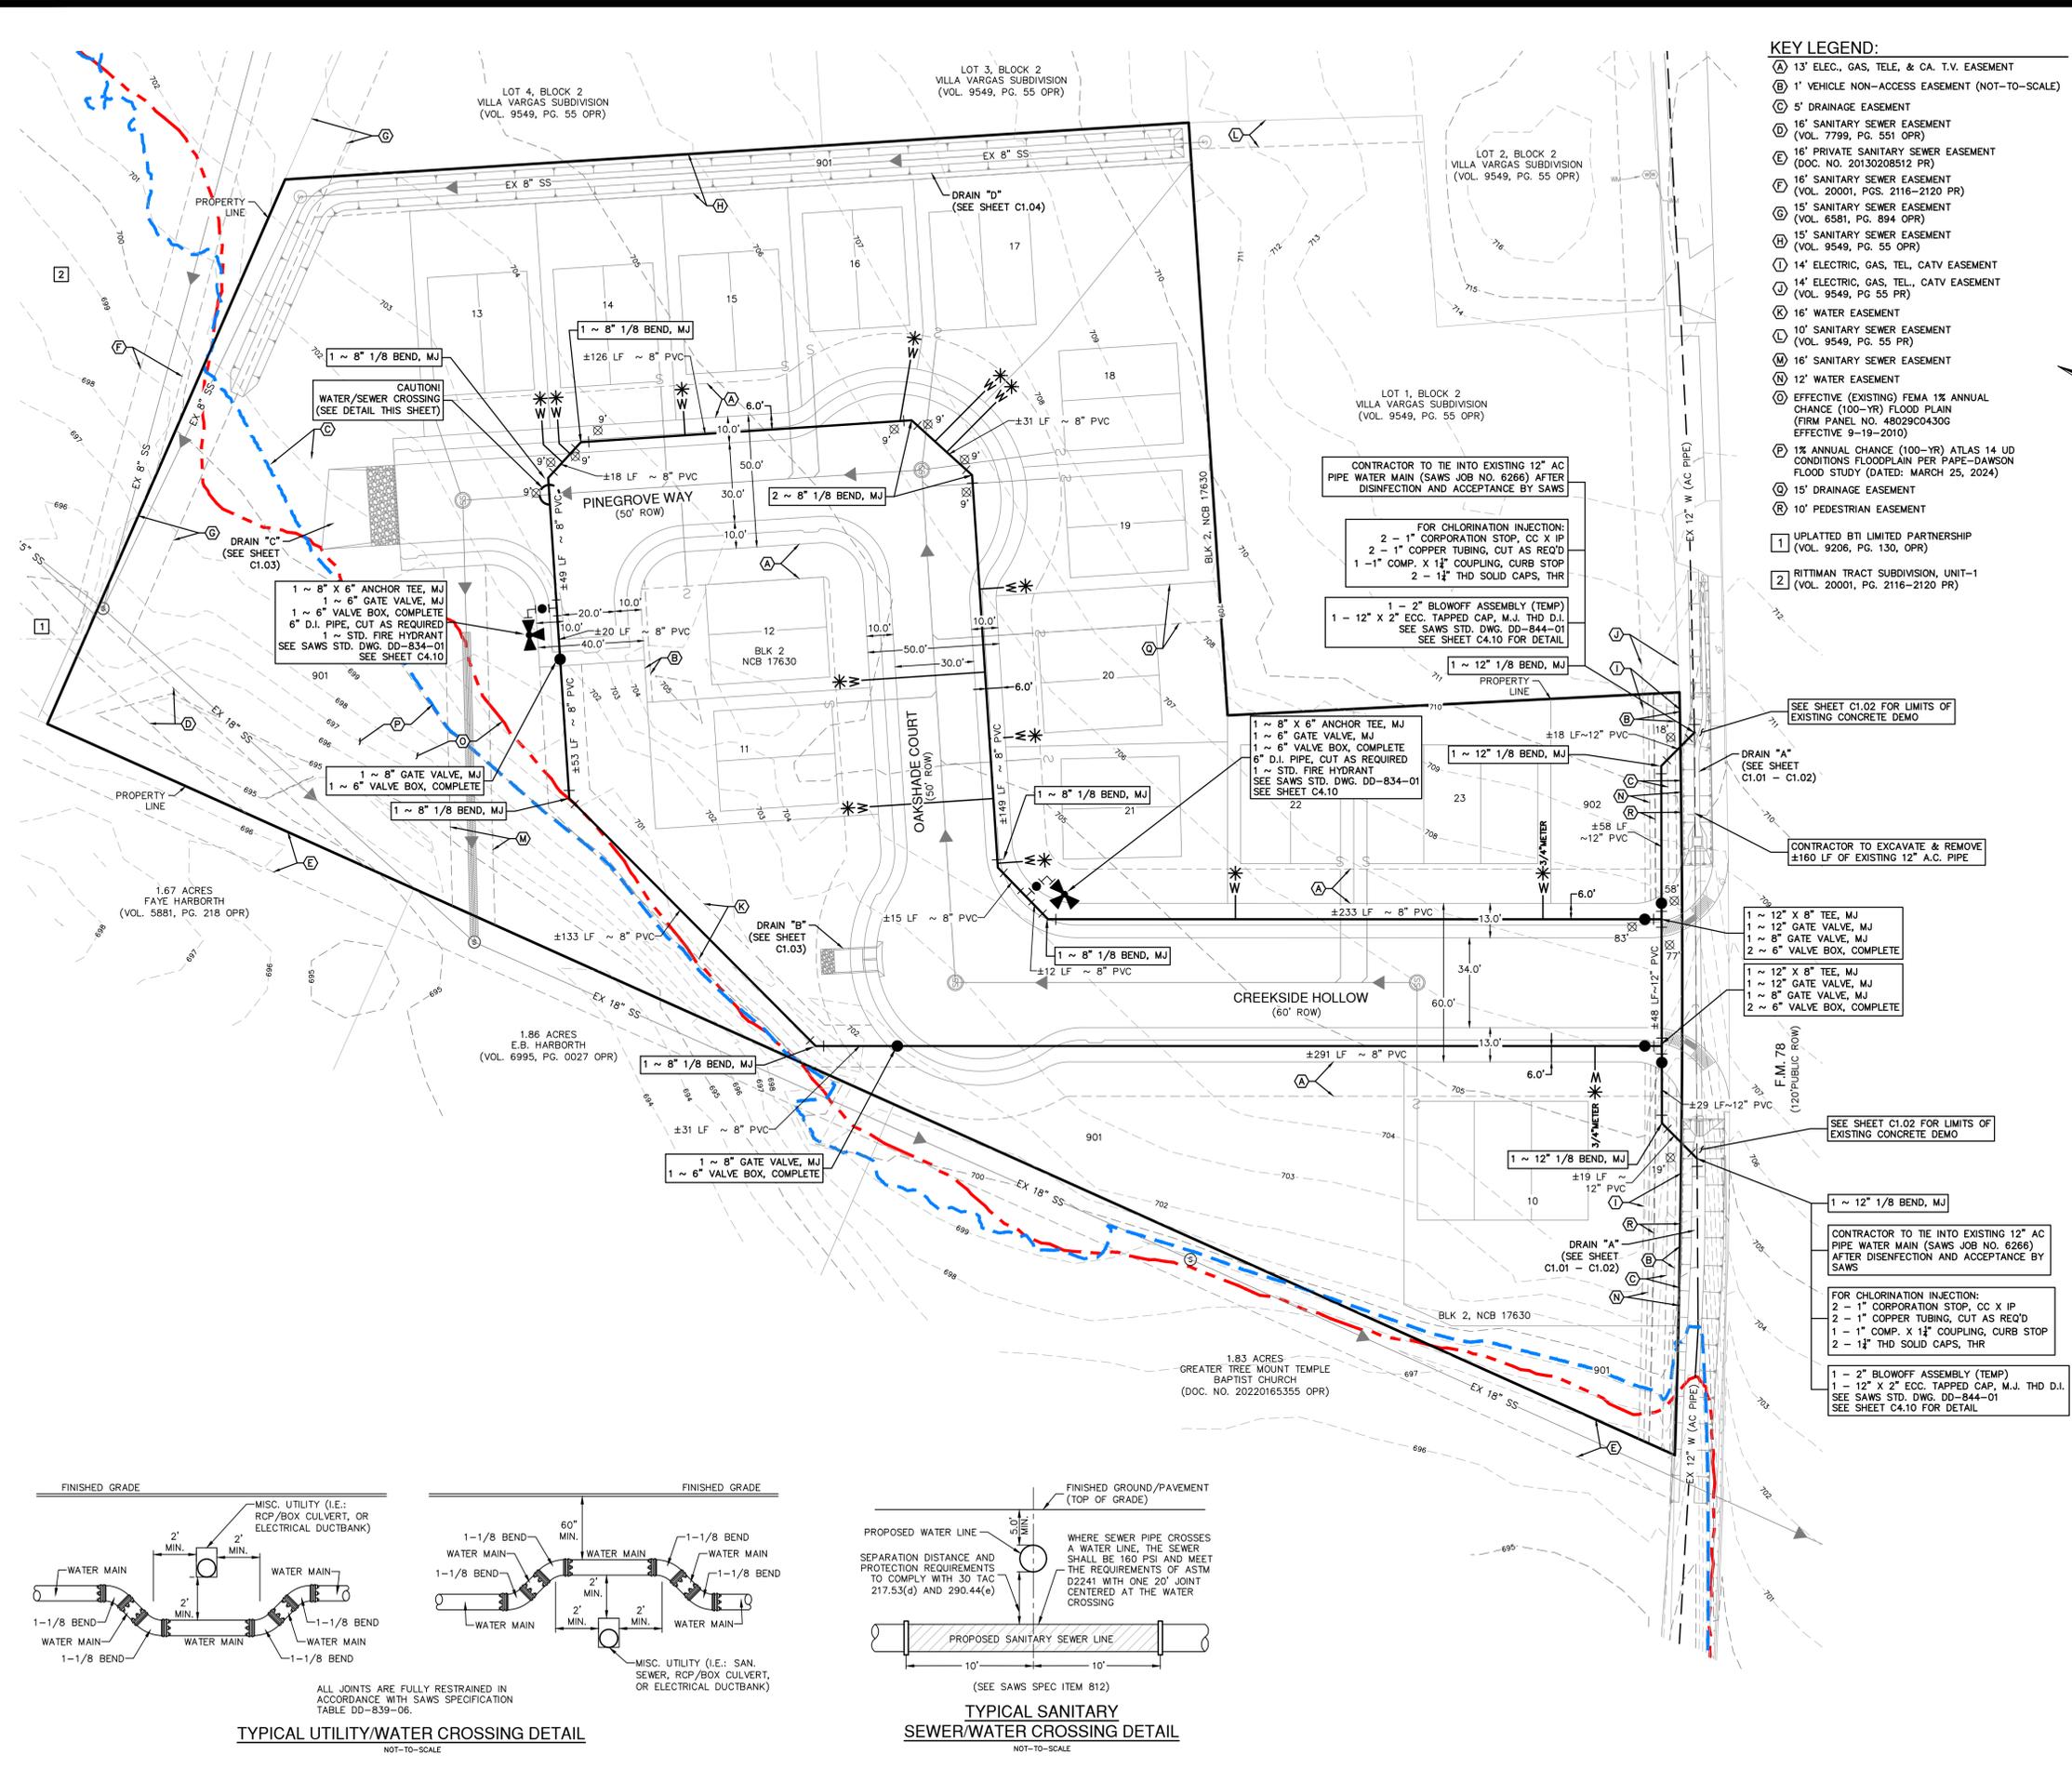



DATE	
NO. REVISION	

STATE OF TEXAS
 JON D. ADAME
 82567
 LICENSED PROFESSIONAL ENGINEER
 Jon Adame
 1-8-26





PAPE-DAWSON
 2000 NW LOOP 410 | SAN ANTONIO, TX 78243 | 210.375.9000
 TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028890

CREEKS EDGE
 SAN ANTONIO, TEXAS

OVERALL WATER DISTRIBUTION PLAN

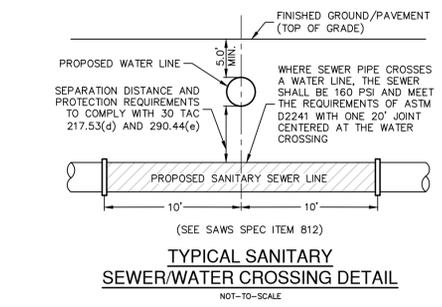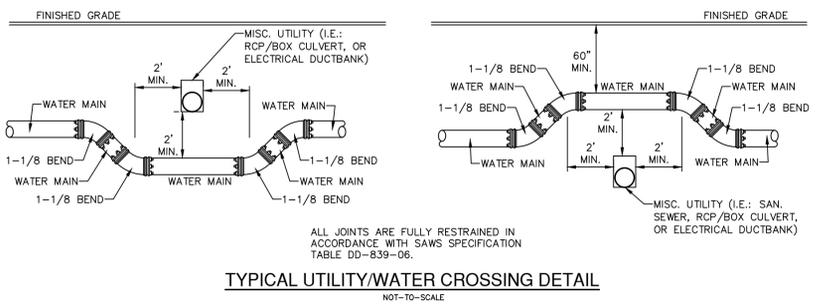

Notes: See also 25-11800340, 25-11800341, 25-11800342, 25-11800343, 25-11800344, 25-11800345, 25-11800346, 25-11800347, 25-11800348, 25-11800349, 25-11800350, 25-11800351, 25-11800352, 25-11800353, 25-11800354, 25-11800355, 25-11800356, 25-11800357, 25-11800358, 25-11800359, 25-11800360, 25-11800361, 25-11800362, 25-11800363, 25-11800364, 25-11800365, 25-11800366, 25-11800367, 25-11800368, 25-11800369, 25-11800370, 25-11800371, 25-11800372, 25-11800373, 25-11800374, 25-11800375, 25-11800376, 25-11800377, 25-11800378, 25-11800379, 25-11800380, 25-11800381, 25-11800382, 25-11800383, 25-11800384, 25-11800385, 25-11800386, 25-11800387, 25-11800388, 25-11800389, 25-11800390, 25-11800391, 25-11800392, 25-11800393, 25-11800394, 25-11800395, 25-11800396, 25-11800397, 25-11800398, 25-11800399, 25-11800400, 25-11800401, 25-11800402, 25-11800403, 25-11800404, 25-11800405, 25-11800406, 25-11800407, 25-11800408, 25-11800409, 25-11800410, 25-11800411, 25-11800412, 25-11800413, 25-11800414, 25-11800415, 25-11800416, 25-11800417, 25-11800418, 25-11800419, 25-11800420, 25-11800421, 25-11800422, 25-11800423, 25-11800424, 25-11800425, 25-11800426, 25-11800427, 25-11800428, 25-11800429, 25-11800430, 25-11800431, 25-11800432, 25-11800433, 25-11800434, 25-11800435, 25-11800436, 25-11800437, 25-11800438, 25-11800439, 25-11800440, 25-11800441, 25-11800442, 25-11800443, 25-11800444, 25-11800445, 25-11800446, 25-11800447, 25-11800448, 25-11800449, 25-11800450, 25-11800451, 25-11800452, 25-11800453, 25-11800454, 25-11800455, 25-11800456, 25-11800457, 25-11800458, 25-11800459, 25-11800460, 25-11800461, 25-11800462, 25-11800463, 25-11800464, 25-11800465, 25-11800466, 25-11800467, 25-11800468, 25-11800469, 25-11800470, 25-11800471, 25-11800472, 25-11800473, 25-11800474, 25-11800475, 25-11800476, 25-11800477, 25-11800478, 25-11800479, 25-11800480, 25-11800481, 25-11800482, 25-11800483, 25-11800484, 25-11800485, 25-11800486, 25-11800487, 25-11800488, 25-11800489, 25-11800490, 25-11800491, 25-11800492, 25-11800493, 25-11800494, 25-11800495, 25-11800496, 25-11800497, 25-11800498, 25-11800499, 25-11800500, 25-11800501, 25-11800502, 25-11800503, 25-11800504, 25-11800505, 25-11800506, 25-11800507, 25-11800508, 25-11800509, 25-11800510, 25-11800511, 25-11800512, 25-11800513, 25-11800514, 25-11800515, 25-11800516, 25-11800517, 25-11800518, 25-11800519, 25-11800520, 25-11800521, 25-11800522, 25-11800523, 25-11800524, 25-11800525, 25-11800526, 25-11800527, 25-11800528, 25-11800529, 25-11800530, 25-11800531, 25-11800532, 25-11800533, 25-11800534, 25-11800535, 25-11800536, 25-11800537, 25-11800538, 25-11800539, 25-11800540, 25-11800541, 25-11800542, 25-11800543, 25-11800544, 25-11800545, 25-11800546, 25-11800547, 25-11800548, 25-11800549, 25-11800550, 25-11800551, 25-11800552, 25-11800553, 25-11800554, 25-11800555, 25-11800556, 25-11800557, 25-11800558, 25-11800559, 25-11800560, 25-11800561, 25-11800562, 25-11800563, 25-11800564, 25-11800565, 25-11800566, 25-11800567, 25-11800568, 25-11800569, 25-11800570, 25-11800571, 25-11800572, 25-11800573, 25-11800574, 25-11800575, 25-11800576, 25-11800577, 25-11800578, 25-11800579, 25-11800580, 25-11800581, 25-11800582, 25-11800583, 25-11800584, 25-11800585, 25-11800586, 25-11800587, 25-11800588, 25-11800589, 25-11800590, 25-11800591, 25-11800592, 25-11800593, 25-11800594, 25-11800595, 25-11800596, 25-11800597, 25-11800598, 25-11800599, 25-11800600, 25-11800601, 25-11800602, 25-11800603, 25-11800604, 25-11800605, 25-11800606, 25-11800607, 25-11800608, 25-11800609, 25-11800610, 25-11800611, 25-11800612, 25-11800613, 25-11800614, 25-11800615, 25-11800616, 25-11800617, 25-11800618, 25-11800619, 25-11800620, 25-11800621, 25-11800622, 25-11800623, 25-11800624, 25-11800625, 25-11800626, 25-11800627, 25-11800628, 25-11800629, 25-11800630, 25-11800631, 25-11800632, 25-11800633, 25-11800634, 25-11800635, 25-11800636, 25-11800637, 25-11800638, 25-11800639, 25-11800640, 25-11800641, 25-11800642, 25-11800643, 25-11800644, 25-11800645, 25-11800646, 25-11800647, 25-11800648, 25-11800649, 25-11800650, 25-11800651, 25-11800652, 25-11800653, 25-11800654, 25-11800655, 25-11800656, 25-11800657, 25-11800658, 25-11800659, 25-11800660, 25-11800661, 25-11800662, 25-11800663, 25-11800664, 25-11800665, 25-11800666, 25-11800667, 25-11800668, 25-11800669, 25-11800670, 25-11800671, 25-11800672, 25-11800673, 25-11800674, 25-11800675, 25-11800676, 25-11800677, 25-11800678, 25-11800679, 25-11800680, 25-11800681, 25-11800682, 25-11800683, 25-11800684, 25-11800685, 25-11800686, 25-11800687, 25-11800688, 25-11800689, 25-11800690, 25-11800691, 25-11800692, 25-11800693, 25-11800694, 25-11800695, 25-11800696, 25-11800697, 25-11800698, 25-11800699, 25-11800700, 25-11800701, 25-11800702, 25-11800703, 25-11800704, 25-11800705, 25-11800706, 25-11800707, 25-11800708, 25-11800709, 25-11800710, 25-11800711, 25-11800712, 25-11800713, 25-11800714, 25-11800715, 25-11800716, 25-11800717, 25-11800718, 25-11800719, 25-11800720, 25-11800721, 25-11800722, 25-11800723, 25-11800724, 25-11800725, 25-11800726, 25-11800727, 25-11800728, 25-11800729, 25-11800730, 25-11800731, 25-11800732, 25-11800733, 25-11800734, 25-11800735, 25-11800736, 25-11800737, 25-11800738, 25-11800739, 25-11800740, 25-11800741, 25-11800742, 25-11800743, 25-11800744, 25-11800745, 25-11800746, 25-11800747, 25-11800748, 25-11800749, 25-11800750, 25-11800751, 25-11800752, 25-11800753, 25-11800754, 25-11800755, 25-11800756, 25-11800757, 25-11800758, 25-11800759, 25-11800760, 25-11800761, 25-11800762, 25-11800763, 25-11800764, 25-11800765, 25-11800766, 25-11800767, 25-11800768, 25-11800769, 25-11800770, 25-11800771, 25-11800772, 25-11800773, 25-11800774, 25-11800775, 25-11800776, 25-11800777, 25-11800778, 25-11800779, 25-11800780, 25-11800781, 25-11800782, 25-11800783, 25-11800784, 25-11800785, 25-11800786, 25-11800787, 25-11800788, 25-11800789, 25-11800790, 25-11800791, 25-11800792, 25-11800793, 25-11800794, 25-11800795, 25-11800796, 25-11800797, 25-11800798, 25-11800799, 25-11800800, 25-11800801, 25-11800802, 25-11800803, 25-11800804, 25-11800805, 25-11800806, 25-11800807, 25-11800808, 25-11800809, 25-11800810, 25-11800811, 25-11800812, 25-11800813, 25-11800814, 25-11800815, 25-11800816, 25-11800817, 25-11800818, 25-11800819, 25-11800820, 25-11800821, 25-11800822, 25-11800823, 25-11800824, 25-11800825, 25-11800826, 25-11800827, 25-11800828, 25-11800829, 25-11800830, 25-11800831, 25-11800832, 25-11800833, 25-11800834, 25-11800835, 25-11800836, 25-11800837, 25-11800838, 25-11800839, 25-11800840, 25-11800841, 25-11800842, 25-11800843, 25-11800844, 25-11800845, 25-11800846, 25-11800847, 25-11800848, 25-11800849, 25-11800850, 25-11800851, 25-11800852, 25-11800853, 25-11800854, 25-11800855, 25-11800856, 25-11800857, 25-11800858, 25-11800859, 25-11800860, 25-11800861, 25-11800862, 25-11800863, 25-11800864, 25-11800865, 25-11800866, 25-11800867, 25-11800868, 25-11800869, 25-11800870, 25-11800871, 25-11800872, 25-11800873, 25-11800874, 25-11800875, 25-11800876, 25-11800877, 25-11800878, 25-11800879, 25-11800880, 25-11800881, 25-11800882, 25-11800883, 25-11800884, 25-11800885, 25-11800886, 25-11800887, 25-11800888, 25-11800889, 25-11800890, 25-11800891, 25-11800892, 25-11800893, 25-11800894, 25-11800895, 25-11800896, 25-11800897, 25-11800898, 25-11800899, 25-11800900, 25-11800901, 25-11800902, 25-11800903, 25-11800904, 25-11800905, 25-11800906, 25-11800907, 25-11800908, 25-11800909, 25-11800910, 25-11800911, 25-11800912, 25-11800913, 25-11800914, 25-11800915, 25-11800916, 25-11800917, 25-11800918, 25-11800919, 25-11800920, 25-11800921, 25-11800922, 25-11800923, 25-11800924, 25-11800925, 25-11800926, 25-11800927, 25-11800928, 25-11800929, 25-11800930, 25-11800931, 25-11800932, 25-11800933, 25-11800934, 25-11800935, 25-11800936, 25-11800937, 25-11800938, 25-11800939, 25-11800940, 25-11800941, 25-11800942, 25-11800943, 25-11800944, 25-11800945, 25-11800946, 25-11800947, 25-11800948, 25-11800949, 25-11800950, 25-11800951, 25-11800952, 25-11800953, 25-11800954, 25-11800955, 25-11800956, 25-11800957, 25-11800958, 25-11800959, 25-11800960, 25-11800961, 25-11800962, 25-11800963, 25-11800964, 25-11800965, 25-11800966, 25-11800967, 25-11800968, 25-11800969, 25-11800970, 25-11800971, 25-11800972, 25-11800973, 25-11800974, 25-11800975, 25-11800976, 25-11800977, 25-11800978, 25-11800979, 25-11800980, 25-11800981, 25-11800982, 25-11800983, 25-11800984, 25-11800985, 25-11800986, 25-11800987, 25-11800988, 25-11800989, 25-11800990, 25-11800991, 25-11800992, 25-11800993, 25-11800994, 25-11800995, 25-11800996, 25-11800997, 25-11800998, 25-11800999, 25-11801000, 25-11801001, 25-11801002, 25-11801003, 25-11801004, 25-11801005, 25-11801006, 25-11801007, 25-11801008, 25-11801009, 25-11801010, 25-11801011, 25-11801012, 25-11801013, 25-11801014, 25-11801015, 25-11801016, 25-11801017, 25-11801018, 25-11801019, 25-11801020, 25-11801021, 25-11801022, 25-11801023, 25-11801024, 25-11801025, 25-11801026, 25-11801027, 25-11801028, 25-11801029, 25-11801030, 25-11801031, 25-11801032, 25-11801033, 25-11801034, 25-11801035, 25-11801036, 25-11801037, 25-11801038, 25-11801039, 25-11801040, 25-11801041, 25-11801042, 25-11801043, 25-11801044, 25-11801045, 25-11801046, 25-11801047, 25-11801048, 25-11801049, 25-11801050, 25-11801051, 25-11801052, 25-11801053, 25-11801054, 25-11801055, 25-11801056, 25-11801057, 25-11801058, 25-11801059, 25-11801060, 25-11801061, 25-11801062, 25-11801063, 25-11801064, 25-11801065, 25-11801066, 25-11801067, 25-11801068, 25-11801069, 25-11801070, 25-11801071, 25-11801072, 25-11801073, 25-11801074, 25-11801075, 25-11801076, 25-11801077, 25-11801078, 25-11801079, 25-11801080, 25-11801081, 25-11801082, 25-11801083, 25-11801084, 25-11801085, 25-11801086,

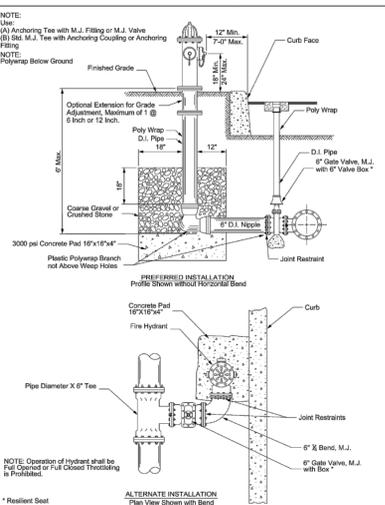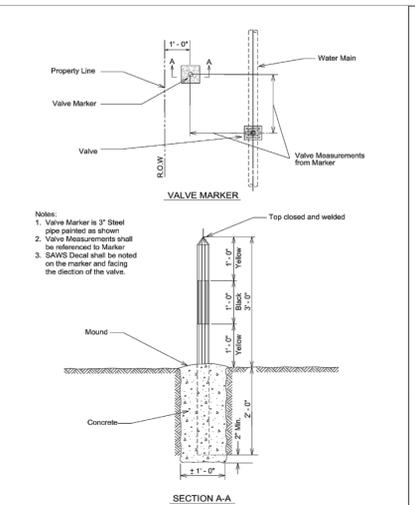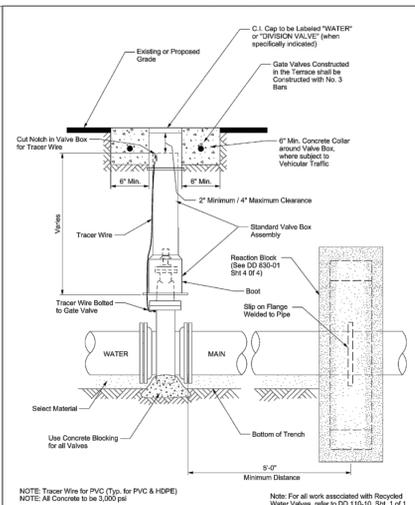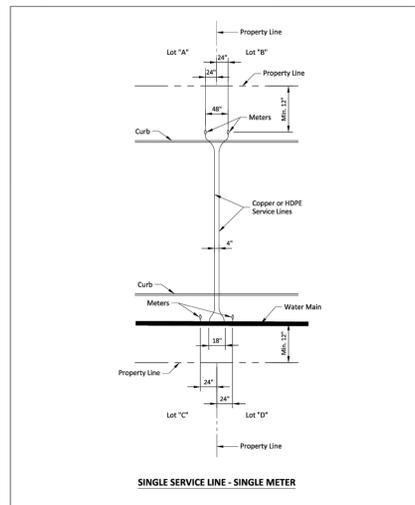

PROPERTY OF	TYPICAL	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	NEW DEVELOPMENT SERVICE ARRANGEMENT	MARCH 2008	DECEMBER 2018
SAN ANTONIO, TEXAS		DD-824-05	SHEET 1 OF 3

PROPERTY OF	INSTALLATION OF NON-GEARED GATE VALVE WITH VALVE BOX AND EXTENSION	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM		MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS		DD 828-01	SHEET 1 OF 1

PROPERTY OF	VALVE MARKER	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM		MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS		DD-828-04	SHEET 1 OF 1

PROPERTY OF	FIRE HYDRANT INSTALLATION (JOINT RESTRAINT)	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM		MAY 2013	AUG 2019
SAN ANTONIO, TEXAS		DD-834-01	SHEET 1 OF 3

RESTRAINED LENGTH FOR TEES

PIPE SIZE (INCH)	BRANCH SIZE (INCH)	LENGTH OF RUN (FT)	RESTRAINED LENGTH IN FEET WHEN TEST PRESSURE = 200 psi	RESTRAINED LENGTH IN FEET WHEN TEST PRESSURE = 150 psi
6	4	0	42	31
6	4	5	7	1
6	4	10	69	44
6	6	5	35	2
6	6	10	11	1
6	4	0	42	31
6	4	5	1	1
6	6	5	29	13
6	6	10	7	1
6	8	5	53	34
6	8	10	30	11
6	8	15	5	1

RESTRAINED LENGTH DESIGN

Restrained length calculations are for P.V.C. pipe bedded in compacted granular material extending to the top of the pipe. The native soil material is assumed to be inorganic clay of high plasticity. Depth of bury is assumed to be 4 feet.

Note: These calculations are provided for reference. The restrained length shall be designed based upon the conditions encountered during the installation.

RESTRAINED LENGTH DESIGN

Restrained length calculations are for P.V.C. pipe bedded in compacted granular material extending to the top of the pipe. The native soil material is assumed to be inorganic clay of high plasticity. Depth of bury is assumed to be 4 feet.

Note: These calculations are provided for reference. The restrained length shall be designed based upon the conditions encountered during the installation.

RESTRAINED LENGTH DESIGN

Restrained length calculations are for P.V.C. pipe bedded in compacted granular material extending to the top of the pipe. The native soil material is assumed to be inorganic clay of high plasticity. Depth of bury is assumed to be 4 feet.

Note: These calculations are provided for reference. The restrained length shall be designed based upon the conditions encountered during the installation.

RESTRAINED LENGTH DESIGN







Restrained length calculations are for P.V.C. pipe bedded in compacted granular material extending to the top of the pipe. The native soil material is assumed to be inorganic clay of high plasticity. Depth of bury is assumed to be 4 feet.

Note: These calculations are provided for reference. The restrained length shall be designed based upon the conditions encountered during the installation.

RESTRAINED LENGTH DESIGN

Restrained length calculations are for P.V.C. pipe bedded in compacted granular material extending to the top of the pipe. The native soil material is assumed to be inorganic clay of high plasticity. Depth of bury is assumed to be 4 feet.

Note: These calculations are provided for reference. The restrained length shall be designed based upon the conditions encountered during the installation.

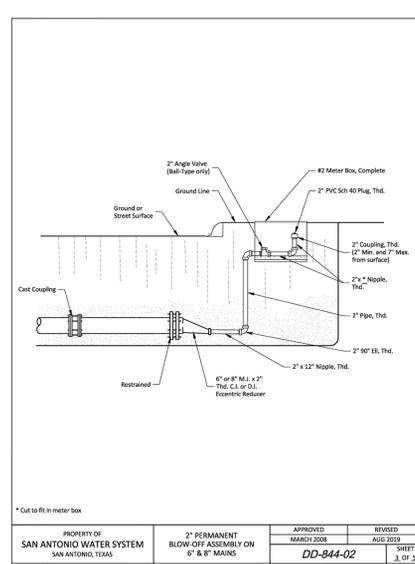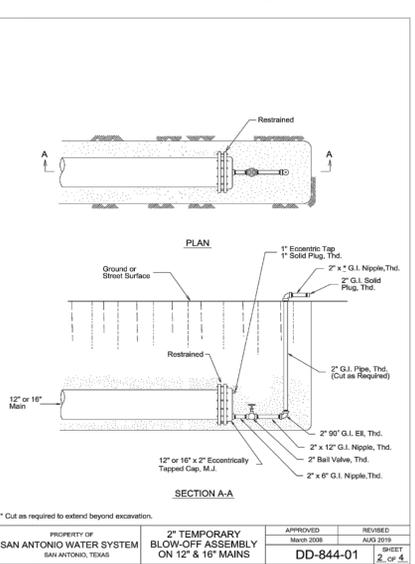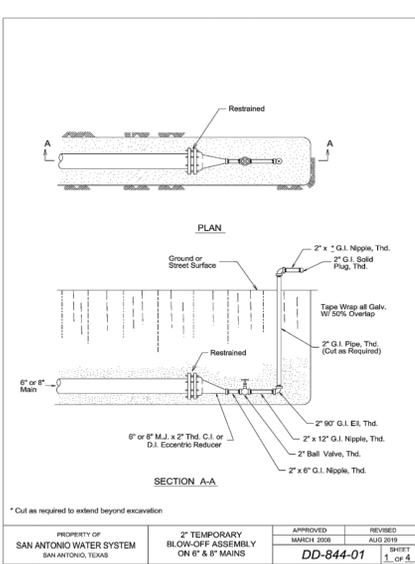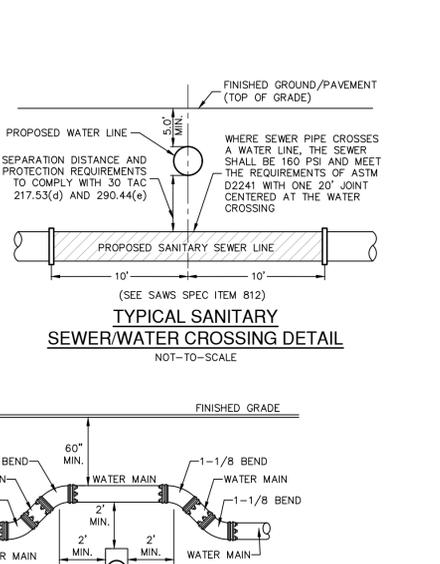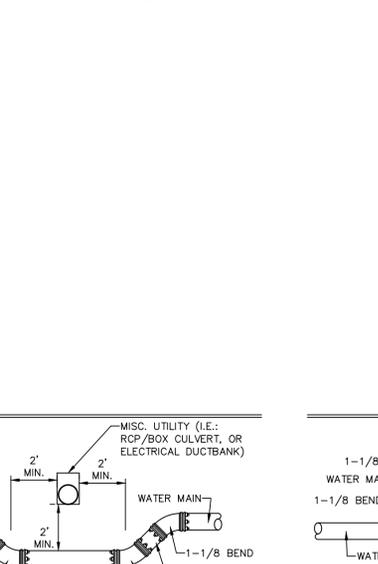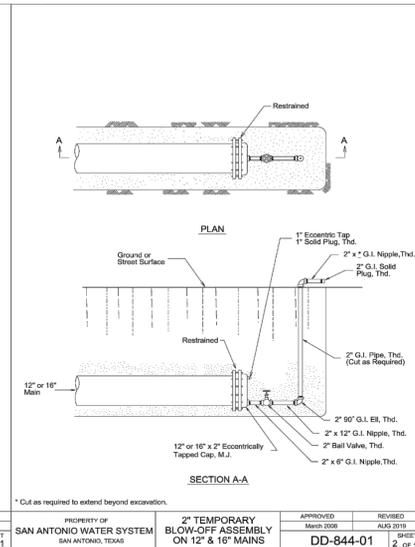

PROPERTY OF	RESTRAINED LENGTHS FOR TEES	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM		MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS		DD-839-04	SHEET 1 OF 2

PROPERTY OF	RESTRAINED LENGTHS FOR DEAD ENDS/IN-LINE VALVES	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM		MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS		DD-839-05	SHEET 1 OF 1

PROPERTY OF	RESTRAINED LENGTHS VERTICAL OFFSETS	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM		MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS		DD-839-06	SHEET 1 OF 1

PROPERTY OF	RESTRAINED LENGTHS FOR REDUCERS	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM		MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS		DD-839-07	SHEET 1 OF 1

PROPERTY OF	RESTRAINED LENGTHS FOR HORIZONTAL BENDS	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM		MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS		DD-839-08	SHEET 1 OF 1

PROPERTY OF	2\"/>	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM		MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS		DD-844-01	SHEET 2 OF 4

PROPERTY OF	2\"/>	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM		MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS		DD-844-01	SHEET 2 OF 4

PROPERTY OF	2\"/>	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM		MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS		DD-844-01	SHEET 2 OF 4

PROPERTY OF	2\"/>	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM		MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS		DD-844-01	SHEET 2 OF 4

PROPERTY OF	2\"/>	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM		MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS		DD-844-01	SHEET 2 OF 4

PROPERTY OF	2\"/>	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM		MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS		DD-844-02	SHEET 3 OF 3

PROPERTY OF	2\"/>	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM		MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS		DD-844-02	SHEET 3 OF 3

DATE: _____

NO. REVISION: _____

Jon Adame
11-24-25

PAPE-DAWSON

2000 NW LOOP 410 | SAN ANTONIO, TX 78243 | 210.375.9000

TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #1002860

CREEKS EDGE

SAN ANTONIO, TEXAS

WATER DISTRIBUTION PLAN DETAILS

PLAT NO. 25-11800340

JOB NO. 13657-10

DATE NOVEMBER 2025

DESIGNER CR

CHECKED JA DRAWN JF

SHEET C4.10

Date: Nov 24, 2025, 1:55pm User: jf_06467042z
 Plot: P:\USERS\JF_06467042\Design\Creek Edge\DD-844-01.dwg

SAWS CONSTRUCTION NOTES

(LAST REVISED JANUARY 2022)

SAWS GENERAL SECTION

1. ALL MATERIALS AND CONSTRUCTION PROCEDURES WITHIN THE SCOPE OF THIS CONTRACT SHALL BE APPROVED BY THE SAN ANTONIO WATER SYSTEM (SAWS) AND COMPLY WITH THE PLANS, SPECIFICATIONS, GENERAL CONDITIONS AND WITH THE FOLLOWING AS APPLICABLE:

- A. CURRENT TEXAS COMMISSION ON ENVIRONMENTAL QUALITY (TCEQ) "DESIGN CRITERIA FOR DOMESTIC WASTEWATER SYSTEM" TEXAS ADMINISTRATIVE CODE (TAC) TITLE 30 PART 1 CHAPTER 217 AND "PUBLIC DRINKING WATER"; TAC TITLE 30 PART 1 CHAPTER 290.
B. CURRENT TXDOT "STANDARD SPECIFICATIONS FOR CONSTRUCTION OF HIGHWAYS, STREETS AND DRAINAGE".
C. CURRENT "SAN ANTONIO WATER SYSTEM STANDARD SPECIFICATIONS FOR WATER AND SANITARY SEWER CONSTRUCTION".
D. CURRENT CITY OF SAN ANTONIO "STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION".
E. CURRENT CITY OF SAN ANTONIO "UTILITY EXCAVATION CRITERIA MANUAL" (UECM).

2. THE CONTRACTOR SHALL NOT PROCEED WITH ANY PIPE INSTALLATION WORK UNTIL THEY OBTAIN A COPY OF THE APPROVED COUNTER PERMIT OR GENERAL CONSTRUCTION PERMIT (GCP) FROM THE CONSULTANT AND HAS BEEN NOTIFIED BY SAWS CONSTRUCTION INSPECTION DIVISION TO PROCEED WITH THE WORK AND HAS ARRANGED A MEETING WITH THE INSPECTOR AND CONSULTANT FOR THE WORK REQUIREMENTS. WORK COMPLETED BY THE CONTRACTOR WITHOUT AN APPROVED COUNTER PERMIT AND/OR A GCP WILL BE SUBJECT TO REMOVAL AND REPLACEMENT AT THE EXPENSE OF THE CONTRACTORS AND/OR THE DEVELOPER.

3. THE CONTRACTOR SHALL OBTAIN THE SAWS STANDARD DETAILS FROM THE SAWS WEBSITE, HTTP://WWW.SAWS.ORG/BUSINESS_CENTER/SPECS. UNLESS OTHERWISE NOTED WITHIN THE DESIGN PLANS.

4. THE CONTRACTOR IS TO MAKE ARRANGEMENTS WITH THE SAWS CONSTRUCTION INSPECTION DIVISION AT (210) 233-2973, ON NOTIFICATION PROCEDURES THAT WILL BE USED TO NOTIFY AFFECTED HOME RESIDENTS AND/OR PROPERTY OWNERS 48 HOURS PRIOR TO BEGINNING ANY WORK.

5. LOCATION AND DEPTH OF EXISTING UTILITIES AND SERVICE LATERALS SHOWN ON THE PLANS ARE UNDERSTOOD TO BE APPROXIMATE. ACTUAL LOCATIONS AND DEPTHS MUST BE FIELD VERIFIED BY THE CONTRACTOR AT LEAST 1 WEEK PRIOR TO CONSTRUCTION. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO LOCATE UTILITY SERVICE LINES AS REQUIRED FOR CONSTRUCTION AND TO PROTECT THEM DURING CONSTRUCTION AT NO COST TO SAWS.

6. THE CONTRACTOR SHALL VERIFY THE EXACT LOCATION OF UNDERGROUND UTILITIES AND DRAINAGE STRUCTURES AT LEAST 1-2 WEEKS PRIOR TO CONSTRUCTION WHETHER SHOWN ON PLANS OR NOT. PLEASE ALLOW UP TO 7 BUSINESS DAYS FOR LOCATES. REQUESTING PIPES LOCATION MARKERS ON SAWS FACILITIES. THE FOLLOWING CONTACT INFORMATION ARE SUPPLIED FOR VERIFICATION PURPOSES:

- SAWS UTILITY LOCATES: HTTP://WWW.SAWS.ORG/SERVICE/LOCATES
COSA DRAINAGE (210) 207-0724 OR (210) 207-6026
COSA TRAFFIC SIGNAL OPERATIONS (210) 206-8480
COSA TRAFFIC SIGNAL DAMAGES (210) 207-3951
TEXAS STATE WIDE ONE CALL LOCATOR 1-800-545-6005 OR 811

7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR RESTORING EXISTING FENCES, CURBS, STREETS, DRIVEWAYS, SIDEWALKS, LANDSCAPING AND STRUCTURES TO ITS ORIGINAL OR BETTER CONDITION IF DAMAGES ARE MADE AS A RESULT OF THE PROJECT'S CONSTRUCTION.

8. ALL WORK IN TEXAS DEPARTMENT OF TRANSPORTATION (TXDOT) AND/OR BEXAR COUNTY RIGHT-OF-WAY SHALL BE DONE IN ACCORDANCE WITH RESPECTIVE CONSTRUCTION SPECIFICATIONS AND PERMIT REQUIREMENTS.

9. THE CONTRACTOR SHALL COMPLY WITH CITY OF SAN ANTONIO OR OTHER GOVERNING MUNICIPALITY'S TREE ORDINANCES WHEN EXCAVATING NEAR TREES.

10. THE CONTRACTOR SHALL NOT PLACE ANY WASTE MATERIALS IN THE 100-YEAR FLOOD PLAIN WITHOUT FIRST OBTAINING AN APPROVED FLOOD PLAIN PERMIT.

HOLIDAY WORK: CONTRACTORS WILL NOT BE ALLOWED TO PERFORM SAWS WORK ON SAWS RECOGNIZED HOLIDAYS. REQUEST SHOULD BE SENT TO CONSTWKRREQ@SAWS.ORG.

WEEKEND WORK: CONTRACTORS ARE REQUIRED TO NOTIFY THE SAWS INSPECTION CONSTRUCTION DEPARTMENT 48 HOURS IN ADVANCE TO REQUEST WEEKEND WORK. REQUEST SHOULD BE SENT TO CONSTWKRREQ@SAWS.ORG.

11. ANY AND ALL SAWS UTILITY WORK INSTALLED WITHOUT HOLIDAY/WEEKEND APPROVAL WILL BE SUBJECT TO BE UNCOVERED FOR PROPER INSPECTION.

12. COMPACTION NOTE (ITEM 804): THE CONTRACTOR SHALL BE RESPONSIBLE FOR MEETING THE COMPACTION REQUIREMENTS ON ALL TRENCH BACKFILL AND FOR PAYING FOR THE TESTS PERFORMED BY A THIRD PARTY. COMPACTION TESTS WILL BE DONE AT ONE LOCATION POINT RANDOMLY SELECTED, OR AS INDICATED BY THE SAWS INSPECTOR AND/OR THE TEST ADMINISTRATOR, PER EACH 12-INCH LOOSE LIFT PER 400 LINEAR FEET AT A MINIMUM. THIS PROJECT WILL NOT BE ACCEPTED AND FINALIZED BY SAWS WITHOUT THIS REQUIREMENT BEING MET AND VERIFIED BY PROVIDING ALL NECESSARY DOCUMENTED TEST RESULTS.

13. A COPY OF ALL TESTING REPORTS SHALL BE FORWARDED TO SAWS CONSTRUCTION INSPECTION DIVISION.

SAWS WATER NOTES

1. PRIOR TO TIE-INS, ANY SHUTDOWNS OF EXISTING MAINS OF ANY SIZE MUST BE COORDINATED WITH THE SAWS CONSTRUCTION INSPECTION DIVISION AT LEAST ONE WEEK IN ADVANCE OF THE SHUTDOWN. THE CONTRACTOR MUST ALSO PROVIDE A SEQUENCE OF WORK AS RELATED TO THE TIE-INS. THIS IS AT NO ADDITIONAL COST TO SAWS OR THE PROJECT AND IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO SEQUENCE THE WORK ACCORDINGLY.

- FOR WATER MAINS 12" OR HIGHER: SAWS EMERGENCY OPERATIONS CENTER (210) 233-2014

2. ASBESTOS CEMENT (AC) PIPE, ALSO KNOWN AS TRANSITE PIPE WHICH IS KNOWN TO CONTAIN ASBESTOS- CONTAINING MATERIAL (ACM), MAY BE LOCATED WITHIN THE PROJECT LIMITS. SPECIAL WASTE MANAGEMENT PROCEDURES AND HEALTH AND SAFETY REQUIREMENTS WILL BE APPLICABLE WHEN REMOVAL AND/OR DISTURBANCE OF THIS PIPE OCCURS. SUCH WORK IS TO BE MADE UNDER SPECIAL SPECIFICATION ITEM NO. 3000, "SPECIAL SPECIFICATION FOR HANDLING ASBESTOS CEMENT PIPE".

3. VALVE REMOVAL: WHERE THE CONTRACTOR IS TO ABANDON A WATER MAIN, THE CONTROL VALVE LOCATED ON THE ABANDONING BRANCH WILL BE REMOVED AND REPLACED WITH A CAP/PLUG. (NSP)

4. SUITABLE ANCHORAGE/THRUST BLOCKING OR JOINT RESTRAINT SHALL BE PROVIDED AT ALL OF THE FOLLOWING MAIN LOCATIONS: DEAD ENDS, PLUGS, CAPS, TEES, CROSSES, VALVES, AND BENDS. IN ACCORDANCE WITH THE STANDARD DRAWINGS DD-839 SERIES AND ITEM NO. 839, IN THE SAWS STANDARD SPECIFICATIONS FOR CONSTRUCTION.

5. ALL VALVES SHALL READ "OPEN RIGHT".

6. PRVS REQUIRED: CONTRACTOR TO VERIFY THAT NO PORTION OF THE TRACT IS BELOW GROUND ELEVATION OF 745 FEET WHERE THE STATIC PRESSURE WILL NORMALLY EXCEED 80 PSI. AT ALL SUCH LOCATIONS WHERE THE GROUND LEVEL IS BELOW 745 FEET, THE DEVELOPER OR BUILDER SHALL INSTALL AT EACH LOT, ON THE CUSTOMER'S SIDE OF THE METER, AN APPROVED TYPE PRESSURE REGULATOR IN CONFORMANCE WITH THE PLUMBING CODE OF THE CITY OF SAN ANTONIO. NO DUAL SERVICES ALLOWED FOR ANY LOT(S) IF "PRV IS/ARE REQUIRED FOR SUCH LOT(S)", ONLY SINGLE SERVICE CONNECTIONS SHALL BE ALLOWED. *NOTE: A PRESSURE REGULATOR IS ALSO KNOWN AS A PRESSURE REDUCING VALVE (PRV).

7. PIPE DISINFECTION WITH DRY HTH FOR PROJECTS LESS THAN 800 LINEAR FEET. (ITEM NO. 847.3): MAINS SHALL BE DISINFECTED WITH DRY HTH WHERE SHOWN IN THE CONTRACT DOCUMENTS OR AS DIRECTED BY THE INSPECTOR, AND SHALL NOT EXCEED A TOTAL LENGTH OF 800 FEET. THIS METHOD OF DISINFECTION WILL ALSO BE FOLLOWED FOR MAIN REPAIRS. THE CONTRACTOR SHALL UTILIZE ALL APPROPRIATE SAFETY MEASURE TO PROTECT HIS PERSONNEL DURING DISINFECTION OPERATIONS.

8. BACKFLOW PREVENTION DEVICES:

- ALL IRRIGATION SERVICES WITHIN RESIDENTIAL AREAS ARE REQUIRED TO HAVE BACKFLOW PREVENTION DEVICES.
ALL COMMERCIAL BACKFLOW PREVENTION DEVICES MUST BE APPROVED BY SAWS PRIOR TO INSTALLATION.

9. FINAL CONNECTION TO THE EXISTING WATER MAIN SHALL NOT BE MADE UNTIL THE WATER MAIN HAS BEEN PRESSURE TESTED, CHLORINATED, AND SAWS HAS RELEASED THE MAIN FOR TIE-IN AND USE.

10. DIVISION VALVES: DIVISION VALVES SHOWN ON PLANS OR NOT SHOWN ON PLANS BUT FOUND IN THE FIELD SHALL ONLY BE OPERATED BY SAWS DISTRIBUTION AND COLLECTION STAFF AND ONLY WITH PRIOR WRITTEN APPROVAL OF THE SAWS DIRECTOR OF PRODUCTION AND OPERATIONS AND PROPER COORDINATION WITH ALL SAWS DEPARTMENTS. CONTRACTOR SHALL PROVIDE WRITTEN NOTIFICATION TO THE INSPECTOR A MINIMUM OF TWO WEEKS IN ADVANCE TO START THE COORDINATION PROCESS AND WILL BE INFORMED BY THE INSPECTOR WHEN THE DIVISION VALVE WILL BE OPERATED BY THE SAWS DISTRIBUTION AND COLLECTION STAFF. THE DIVISION VALVE CAN ONLY BE OPERATED BY SAWS DISTRIBUTION AND COLLECTION STAFF MEMBER NOT THE INSPECTOR OR THE CONTRACTOR. OPERATION OF A DIVISION VALVE WITHOUT THE EXPRESS PRIOR WRITTEN APPROVAL OF THE SAWS DISTRIBUTION AND COLLECTION STAFF WILL CONSTITUTE A MATERIAL BREACH OF ANY WRITTEN SAWS CONTRACT OR PERMIT IN ADDITION TO SUBJECTING THE CONTRACTOR TO LIABILITY FOR ANY AND ALL FINES, FEES, OR OTHER DAMAGES, DIRECT OR CONSEQUENTIAL, THAT MAY ARISE FROM OR BE CAUSED BY THE OPERATION OF THE VALVE WITHOUT PRIOR WRITTEN PERMISSION. PLEASE BE INFORMED THAT THE APPROVAL OF THE OPERATION OR OPENING OR CLOSING OF A DIVISION VALVE CAN TAKE SEVERAL WEEKS FOR APPROVAL. DIVISION VALVES WILL ALSO HAVE A VALVE LID LABELED DIVISION VALVE AND A LOCKING MECHANISM INSTALLED WITH A KEY. THE LOCK AND KEY MECHANISM WILL BE PAID FOR BY THE CONTRACTOR BUT WILL BE INSTALLED BY SAWS DISTRIBUTION AND COLLECTION STAFF.

PROJECT WATER NOTES

1. MACHINE CHLORINATION BY THE S.A.W.S.

2. ALL 8", 12" AND 16" PIPE SHALL BE P.V.C. C-900 CLASS 235 DR 18.

3. ALL MAINS SHALL BE HYDROSTATICALLY TESTED BY THE CONTRACTOR, AS PROVIDED FOR IN THE SPECIAL CONDITIONS.

4. THE WATER LINES WILL BE SET FROM THE STREET HUBS BEFORE THIS CONTRACT BEGINS. STREET CUT SHEETS WILL BE SUPPLIED TO THE CONTRACTOR. THERE SHOULD BE NO ADDITIONAL STAKES REQUIRED, AND IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO INSPECT THE SITE AND VERIFY THAT ALL STAKES REQUIRED FOR HIS WORK ARE IN PLACE AT THE TIME THE CONSTRUCTION BEGINS. IF ANY STAKES ARE MISSING THE ENGINEER SHOULD BE NOTIFIED IMMEDIATELY. AFTER CONSTRUCTION BEGINS, ALL CONSTRUCTION STAKES, MARKS, ETC., SHALL BE CAREFULLY PRESERVED BY THE CONTRACTOR, AND IN CASE OF DESTRUCTION OR REMOVAL BY THE CONTRACTOR, HIS EMPLOYEE OR ANY OTHER MEANS, SUCH STAKES, MARKS, ETC., SHALL BE REPLACED AT THE CONTRACTOR'S EXPENSE.

5. THE CONTRACTOR SHALL FURNISH THE ENGINEER WITH ALL THE FINAL MEASUREMENTS, TAPS AND LENGTH OF SERVICE CONNECTIONS.

6. THE LOT CORNERS WILL BE SET BY THE ENGINEER FOR INSTALLATION OF ALL WATER SERVICES. THESE LOT CORNERS SHALL BE CAREFULLY PRESERVED BY THE CONTRACTOR SO THE METER BOXES CAN BE SET IN PHASE II. ANY LOT CORNER DESTROYED OR REMOVED BY THE CONTRACTOR, HIS EMPLOYEES, OR BY ANY OTHER MEANS SHALL BE REPLACED AT THE CONTRACTOR'S EXPENSE.

7. STREETS WILL HAVE BEEN EXCAVATED DOWN TO SUBGRADE AND THE PARKWAY WILL BE CUT DOWN TO TOP OF CURB BY THE STREET CONTRACTOR, PRIOR TO CONSTRUCTION OF THE WATER MAINS. IT WILL BE THE UTILITY CONTRACTOR'S RESPONSIBILITY TO PROVIDE A PAD FOR HIS EQUIPMENT.

8. WATER METER BOXES IF APPLICABLE SHALL BE INSTALLED NINE FEET FROM FACE OF CURB TO CENTER OF THE METER BOX.

9. ALL GARBAGE OR SPOIL MATERIAL FROM THIS WORK SHALL BE REMOVED FROM THE SITE BY THE CONTRACTOR, AT HIS EXPENSE.

10. FINAL CONNECTION TO THE EXISTING WATER MAIN SHALL NOT BE MADE UNTIL WATER MAIN HAS BEEN PRESSURE TESTED, CHLORINATED AND THE S.A.W.S. RELEASES THE MAIN FOR TIE-IN AND USE.

11. UNIT PRICE BID FOR "STANDARD FIRE HYDRANT ASSEMBLY" SHALL INCLUDE FIRE HYDRANT, 6-INCH GATE VALVE AND 6-INCH VALVE BOX COMPLETE, ANCHOR BEND, AND ALL 6-INCH DI PIPE REQUIRED (DI PIPE REQUIRED SHALL INCLUDE ALL PIPE FROM THE TEE ON THE MAIN LINE TO THE FIRE HYDRANT).

12. WHEN SEWER LINES ARE INSTALLED IN THE VICINITY OF WATER MAINS, SUCH INSTALLATION SHALL BE IN STRICT ACCORDANCE WITH THE TEXAS NATURAL RESOURCE CONSERVATION COMMISSION "RULES AND REGULATIONS FOR PUBLIC WATER SYSTEMS" (1988 OR ANY REVISIONS THERETO).

13. A CLEAR SPACE SHALL BE PROVIDED AROUND ALL FIRE HYDRANTS. THIS AREA SHOULD HAVE A MINIMUM DIAMETER OF 3.0' AND BE CLEAN OF VERTICAL OBSTRUCTIONS, VALVES, AND METER BOXES.


14. SAWS REQUIRES LEAD FREE (< 0.25%) FIRE HYDRANTS.

15. UNLESS OTHERWISE NOTED ALL SERVICES SHALL BE 3/4" WITH 5/8" METER.

WATER (SAWS PRESSURE ZONE 4)

DEVELOPER'S NAME: S A PARTNERS INVESTMENT, LLC
ADDRESS: 7623 LOST CREEK GAP
CITY: BOERNE STATE: TEXAS ZIP: 78015
PHONE# (210)-771-0861 FAX#
SAWS BLOCK MAP# 200598 TOTAL EDU'S 15 TOTAL ACREAGE 3.978
TOTAL LINEAR FOOTAGE OF PIPE: 172 LF 8" PIPE PLAT NO. 25-11800340
NUMBER OF LOTS 14 SAWS JOB NO. 25-1080

Table with columns for DATE, NO., and REVISION.




PAPE-DAWSON
2000 NW LOOP 410 | SAN ANTONIO, TX 78213 | 210.375.9000
TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM # 10028800

CREEKS EDGE
SAN ANTONIO, TEXAS
WATER DISTRIBUTION PLAN NOTES




PLAT NO. 25-11800340
JOB NO. 13657-10
DATE NOVEMBER 2025
DESIGNER CR
CHECKED JA DRAWN JF
SHEET C4.11

Date: Nov 24, 2025, 1:55pm User: jdc@papadawson.com
 Plot: P:\1800340\Overall Sewer\Overall Sewer.dwg

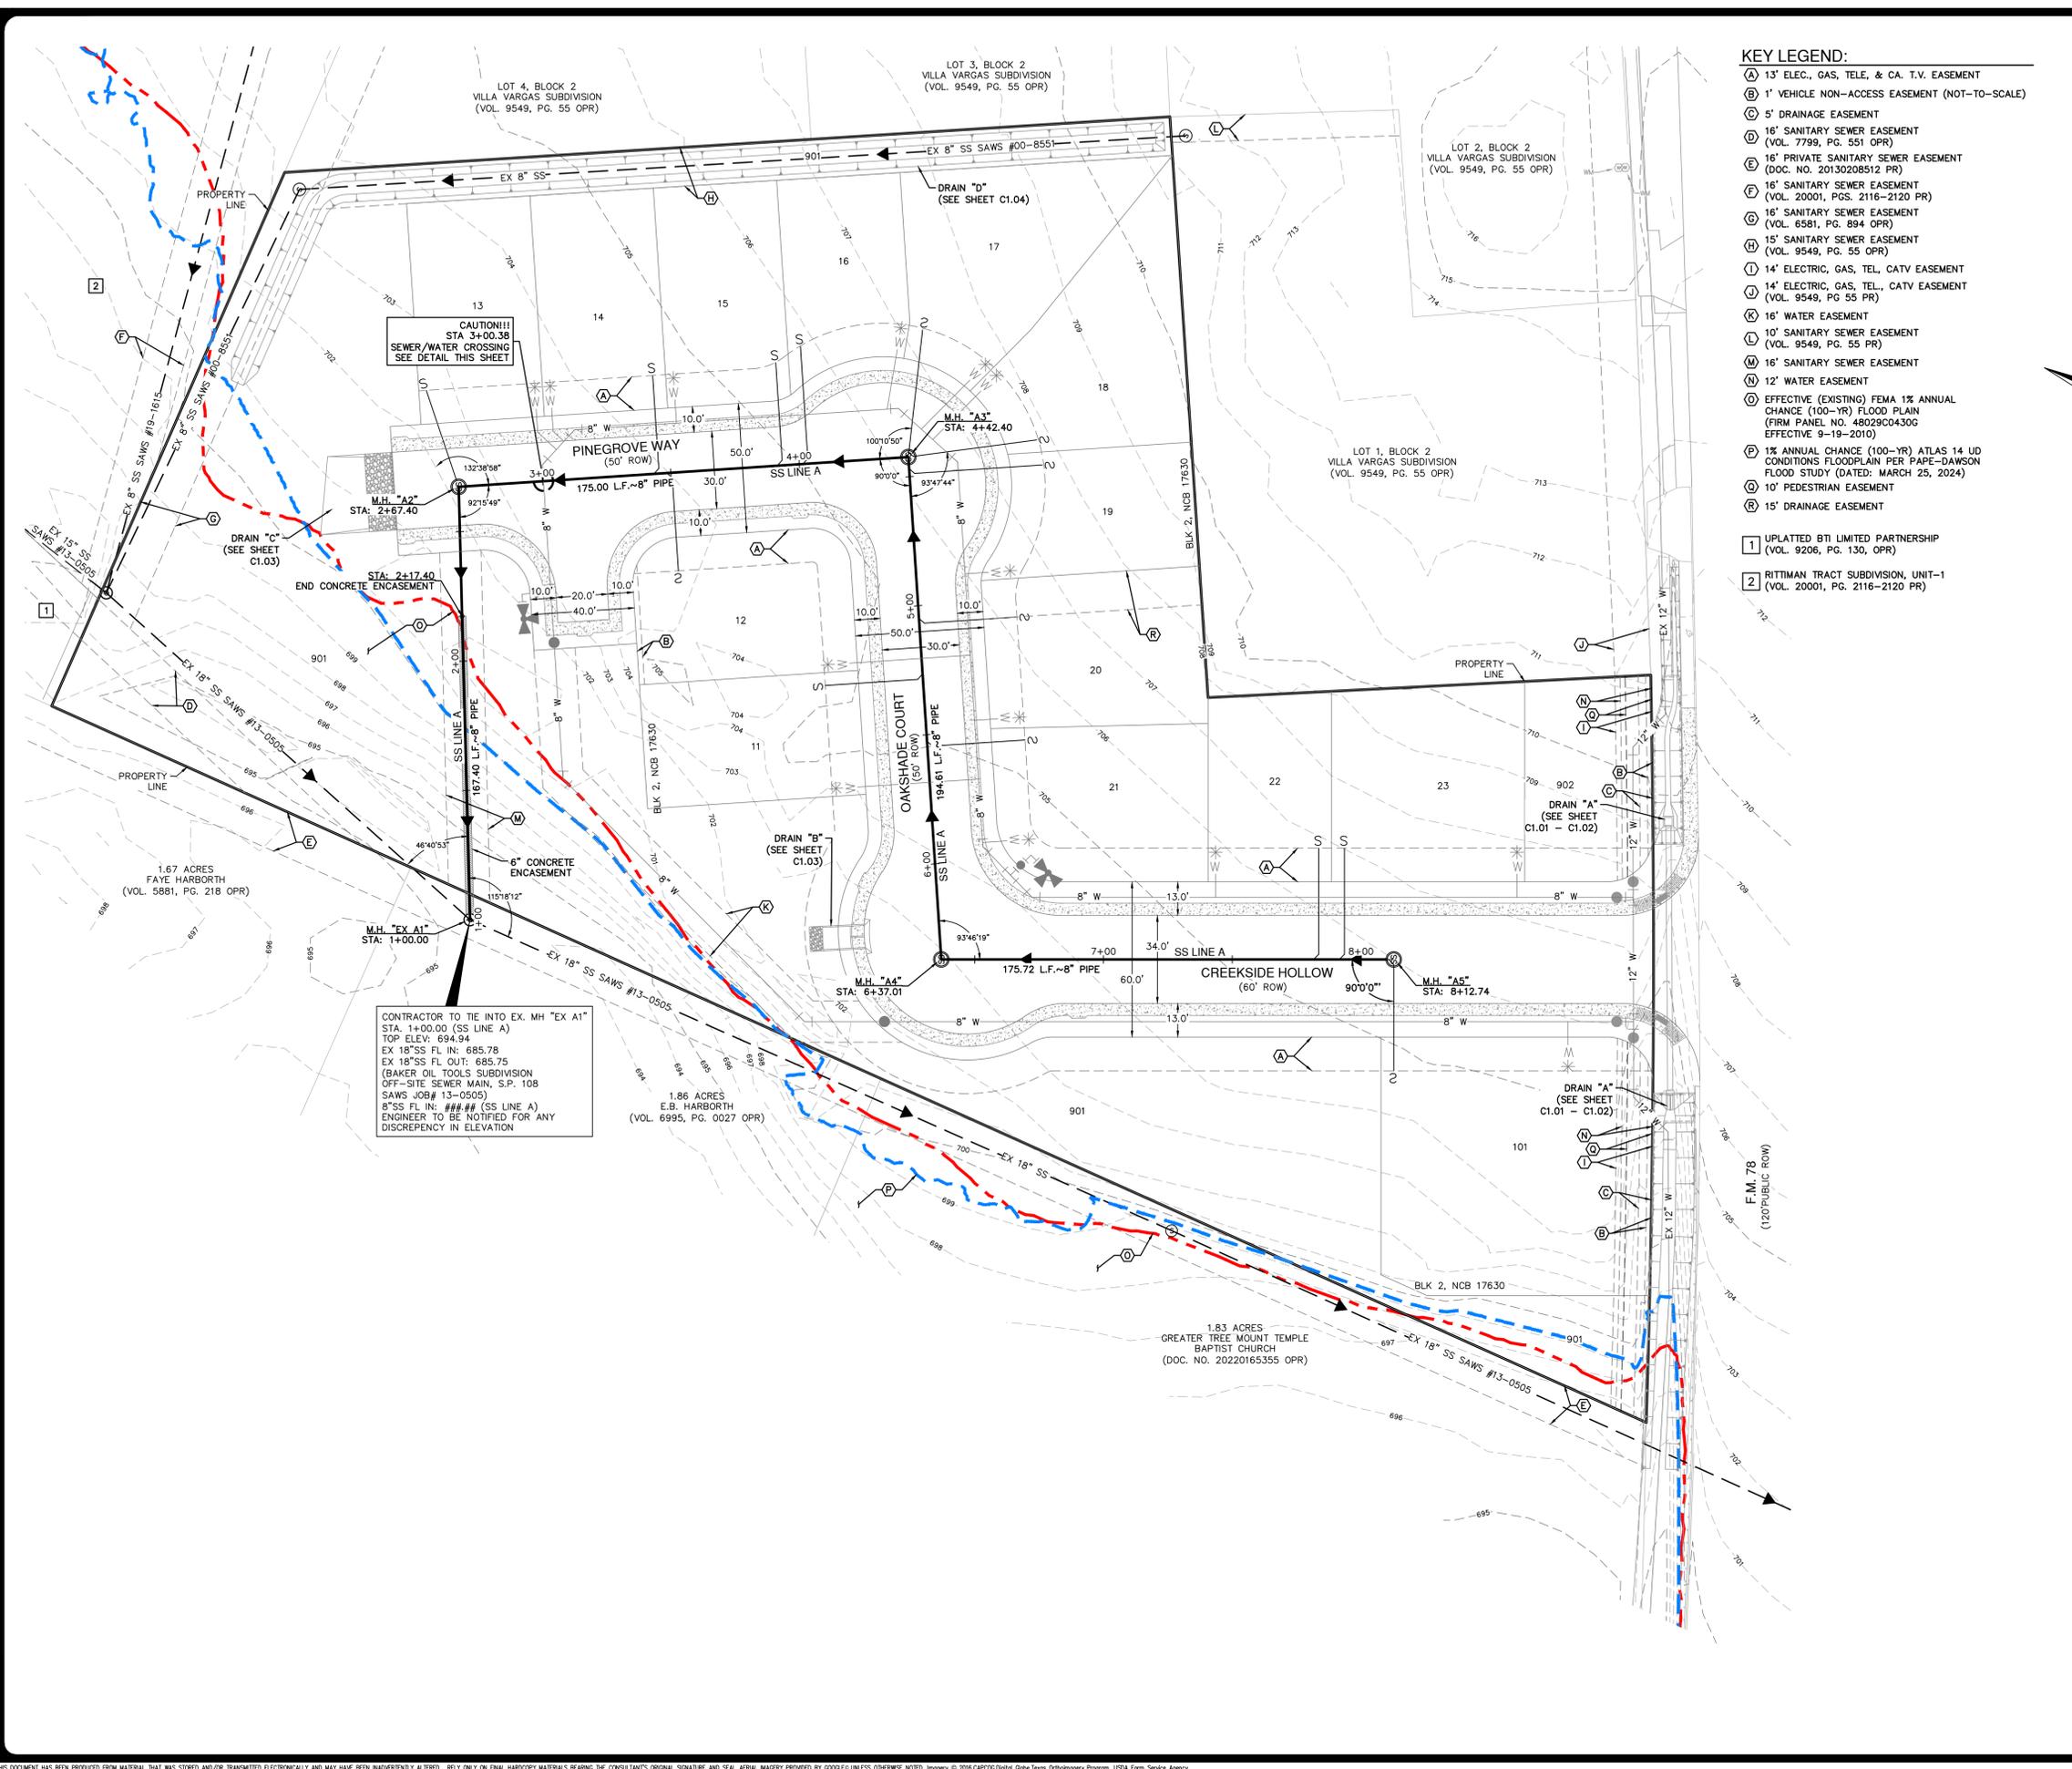

- KEY LEGEND:**
- (A) 13' ELEC., GAS, TELE, & CA. T.V. EASEMENT
 - (B) 1' VEHICLE NON-ACCESS EASEMENT (NOT-TO-SCALE)
 - (C) 5' DRAINAGE EASEMENT
 - (D) 16' SANITARY SEWER EASEMENT (VOL. 7799, PG. 551 OPR)
 - (E) 16' PRIVATE SANITARY SEWER EASEMENT (DOC. NO. 20130208512 PR)
 - (F) 16' SANITARY SEWER EASEMENT (VOL. 20001, PGS. 2116-2120 PR)
 - (G) 16' SANITARY SEWER EASEMENT (VOL. 6581, PG. 894 OPR)
 - (H) 15' SANITARY SEWER EASEMENT (VOL. 9549, PG. 55 OPR)
 - (I) 14' ELECTRIC, GAS, TEL, CATV EASEMENT (VOL. 9549, PG. 55 PR)
 - (J) 14' ELECTRIC, GAS, TEL, CATV EASEMENT (VOL. 9549, PG. 55 PR)
 - (K) 16' WATER EASEMENT
 - (L) 10' SANITARY SEWER EASEMENT (VOL. 9549, PG. 55 PR)
 - (M) 16' SANITARY SEWER EASEMENT
 - (N) 12' WATER EASEMENT
 - (O) EFFECTIVE (EXISTING) FEMA 1% ANNUAL CHANCE (100-YR) FLOOD PLAIN (FIRM PANEL NO. 48029C0430G EFFECTIVE 9-19-2010)
 - (P) 1% ANNUAL CHANCE (100-YR) ATLAS 14 UD CONDITIONS FLOODPLAIN PER PAPE-DAWSON FLOOD STUDY (DATED: MARCH 25, 2024)
 - (Q) 10' PEDESTRIAN EASEMENT
 - (R) 15' DRAINAGE EASEMENT

- 1 UPPLATED BTI LIMITED PARTNERSHIP (VOL. 9206, PG. 130, OPR)
- 2 RITTIMAN TRACT SUBDIVISION, UNIT-1 (VOL. 20001, PG. 2116-2120 PR)

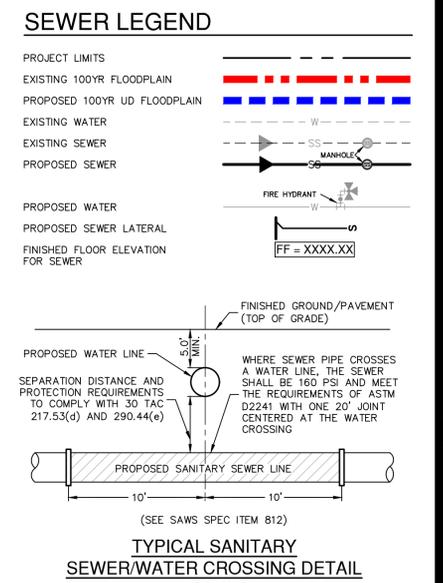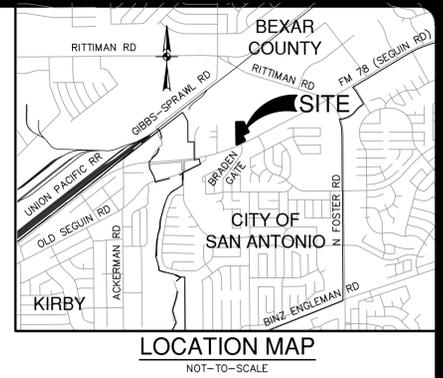

FINISHED FLOOR NOTES:

- THE FINISHED FLOOR ELEVATIONS (FF) REPRESENT THE MINIMUM POSSIBLE FLOOR ELEVATION TO PROVIDE SANITARY SEWER SERVICE TO EACH LOT. ACTUAL FINISHED FLOOR ELEVATIONS FOR EACH LOT ARE TO BE DETERMINED BY THE BUILDER AND SHALL TAKE INTO CONSIDERATION AS-BUILT CONDITIONS FOR FOUND SEWER SERVICES AND ACTUAL LATERAL PLACEMENT. IT IS THE BUILDER'S SOLE RESPONSIBILITY TO DETERMINE ACTUAL FINISHED FLOOR ELEVATIONS FOR EACH LOT PRIOR TO THE START OF HOME FOUNDATION CONSTRUCTION TAKING INTO CONSIDERATION SITE DRAINAGE, STREET ACCESS AND SANITARY SEWER SERVICE ELEVATIONS.
- THE MINIMUM SANITARY SEWER LATERAL GRADES WERE BASED UPON THE MINIMUM FINISHED FLOOR ELEVATIONS FOR THE LOTS LOCATED ON THE DOWNHILL SIDES OF THE PROPOSED ROADWAYS.

CAUTION!!

CONTRACTOR SHALL BE REQUIRED TO LOCATE ALL PUBLIC OR PRIVATE UTILITIES INCLUDING BUT NOT LIMITING TO: WATER, SEWER, TELEPHONE AND FIBER OPTIC LINES, SITE LIGHTING ELECTRIC, SECONDARY ELECTRIC, PRIMARY ELECTRICAL DUCTBANKS, LANDSCAPE IRRIGATION FACILITIES, AND GAS LINES. ANY UTILITY CONFLICTS THAT ARISE SHOULD BE COMMUNICATED TO THE ENGINEER IMMEDIATELY AND PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL CONTACT 1-800-DIG-TESS A MINIMUM OF 48 HOURS PRIOR TO THE START OF CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THE REPAIR SHALL BE AT CONTRACTOR'S SOLE EXPENSE WHETHER THE UTILITY IS SHOWN ON THESE PLANS OR NOT.

TRENCH EXCAVATION SAFETY PROTECTION:

CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/ GEOTECHNICAL/ SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

SEWERSHED - EAST
 WASTEWATER TREATMENT PLANT: SALADO CREEK

DEVELOPER'S NAME: S. A PARTNERS INVESTMENT, LLC
ADDRESS: 7823 LOST CREEK GAP
CITY: BOERNE STATE: TEXAS ZIP: 78015
PHONE# (210)-771-0861 FAX#
SAWS BLOCK MAP# 200598 TOTAL EDU'S 15 TOTAL ACREAGE 3.979
TOTAL LINEAR FOOTAGE OF PIPE: 8" 713 LF PLAT NO 25-11800340
NUMBER OF LOTS 14 SAWS JOB NO. 25-1587

DATE	
NO. REVISION	
Jon Adams 11-24-25	


PAPE-DAWSON
 2000 NW LOOP 410 | SAN ANTONIO, TX 78243 | 210.375.9000
 TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028890

CREEKS EDGE
 SAN ANTONIO, TEXAS
 OVERALL SANITARY SEWER PLAN

PLAT NO.	25-11800340
JOB NO.	13657-10
DATE	NOVEMBER 2025
DESIGNER	CB
CHECKED	JA DRAWN CB
SHEET	C5.00


Date: Nov 24, 2025, 4:56pm User: jrc/af/101
 File: P:\136571\101\Design\CA\SSA1-1562710.dwg

THIS DOCUMENT HAS BEEN PRODUCED FROM MATERIAL THAT WAS STORED AND/OR TRANSMITTED ELECTRONICALLY AND MAY HAVE BEEN INADVERTENTLY ALTERED. RELY ONLY ON FINAL HARDCOPY MATERIALS BEARING THE CONSULTANT'S ORIGINAL SIGNATURE AND SEAL. AERIAL IMAGERY PROVIDED BY GOOGLE/ESRI UNLESS OTHERWISE NOTED. Imagery © 2016, CAPOCO, DigitalGlobe, Terra, OrthoImage, Program, USDA Farm Service Agency.

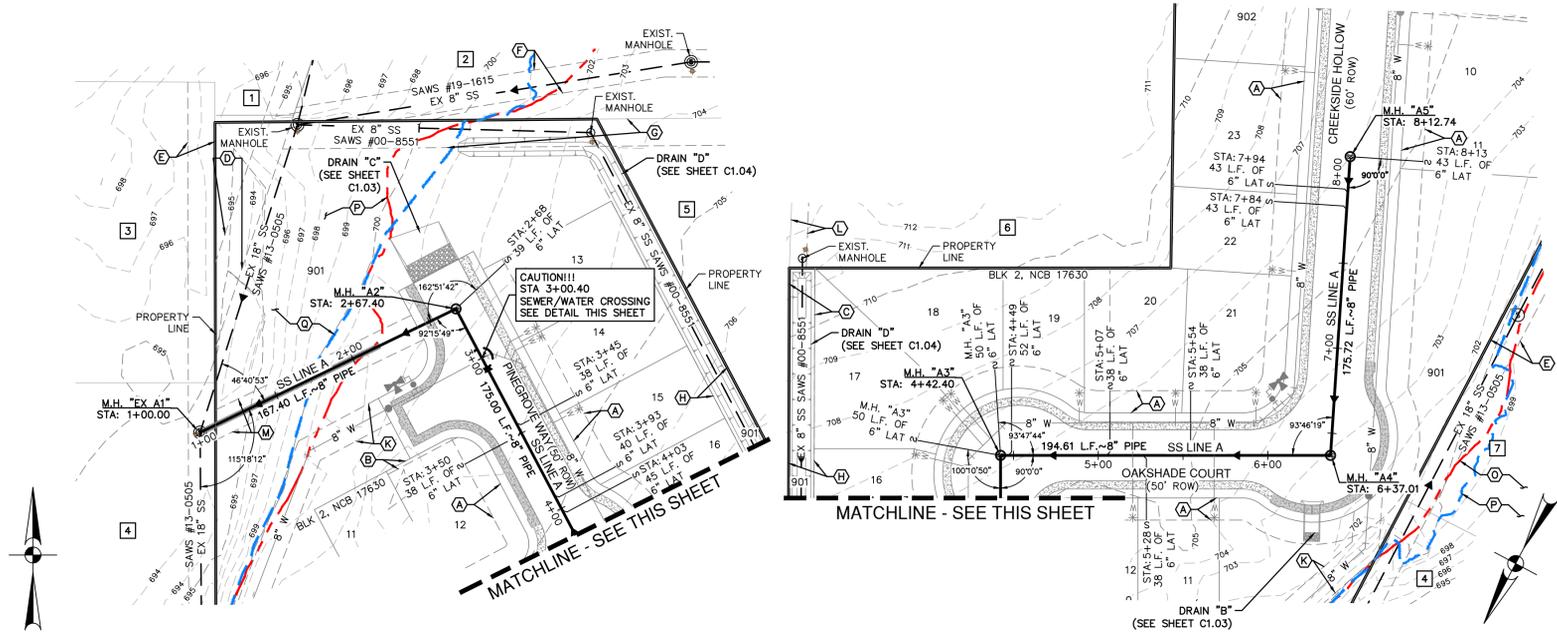


- KEY LEGEND:**
- (A) 13' ELEC., GAS, TELE, & CA. T.V. EASEMENT
 - (B) 1' VEHICLE NON-ACCESS EASEMENT (NOT-TO-SCALE)
 - (C) 5' DRAINAGE EASEMENT
 - (D) 16' SANITARY SEWER EASEMENT (VOL. 7799, PG. 551 OPR)
 - (E) 16' PRIVATE SANITARY SEWER EASEMENT (DOC. NO. 20130208512 PR)
 - (F) 16' SANITARY SEWER EASEMENT (VOL. 20001, PGS. 2116-2120 PR)
 - (G) 15' SANITARY SEWER EASEMENT (VOL. 6581, PG. 894 OPR)
 - (H) 15' SANITARY SEWER EASEMENT (VOL. 9549, PG. 55 OPR)
 - (I) NOT USED
 - (J) 14' ELECTRIC, GAS, TEL., CATV EASEMENT (VOL. 9549, PG. 55 PR)
 - (K) 16' WATER EASEMENT
 - (L) 10' SANITARY SEWER EASEMENT (VOL. 9549, PG. 55 PR)
 - (M) 16' SANITARY SEWER EASEMENT
 - (N) NOT USED
 - (O) EFFECTIVE (EXISTING) FEMA 1% ANNUAL CHANCE (100-YR) FLOOD PLAIN (FIRM PANEL NO. 4802900430G EFFECTIVE: 9-19-2010)
 - (P) 1% ANNUAL CHANCE (100-YR) ATLAS 14 UD CONDITIONS FLOODPLAIN PER PAPE-DAWSON FLOOD STUDY (DATED: MARCH 25, 2024)



- 1 UPLATED BTI LIMITED PARTNERSHIP (VOL. 9206, PG. 130, OPR)
- 2 RITTIMAN TRACT SUBDIVISION, UNIT-1 (VOL. 20001, PG. 2116-2120 PR)
- 3 1.67 ACRES FAYE HARBORTH (VOL. 5881, PG. 218 OPR)
- 4 1.86 ACRES E.B. HARBORTH (VOL. 6995, PG. 0027 OPR)
- 5 LOT 4, BLOCK 2, VILLA VARGAS SUBDIVISION (VOL. 9549, PG. 55 OPR)
- 6 LOT 1, BLOCK 2, VILLA VARGAS SUBDIVISION (VOL. 9549, PG. 55 OPR)
- 7 1.83 ACRES GREATER TREE MOUNT TEMPLE BAPTIST CHURCH (DOC. NO. 20220165355 OPR)



SEWER LEGEND

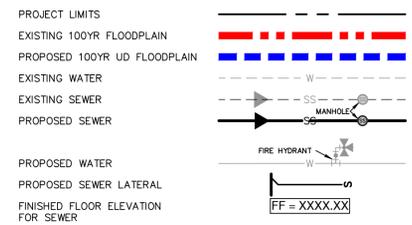

SS LINE "A" ~ STA. 1+00.00 TO END
 VERTICAL SCALE: 1" = 5'
 HORIZONTAL SCALE: 1" = 50'

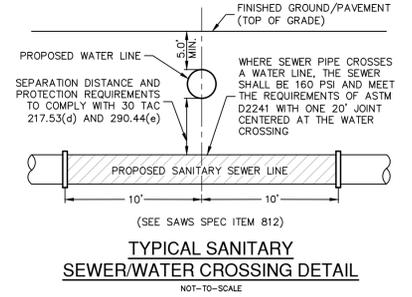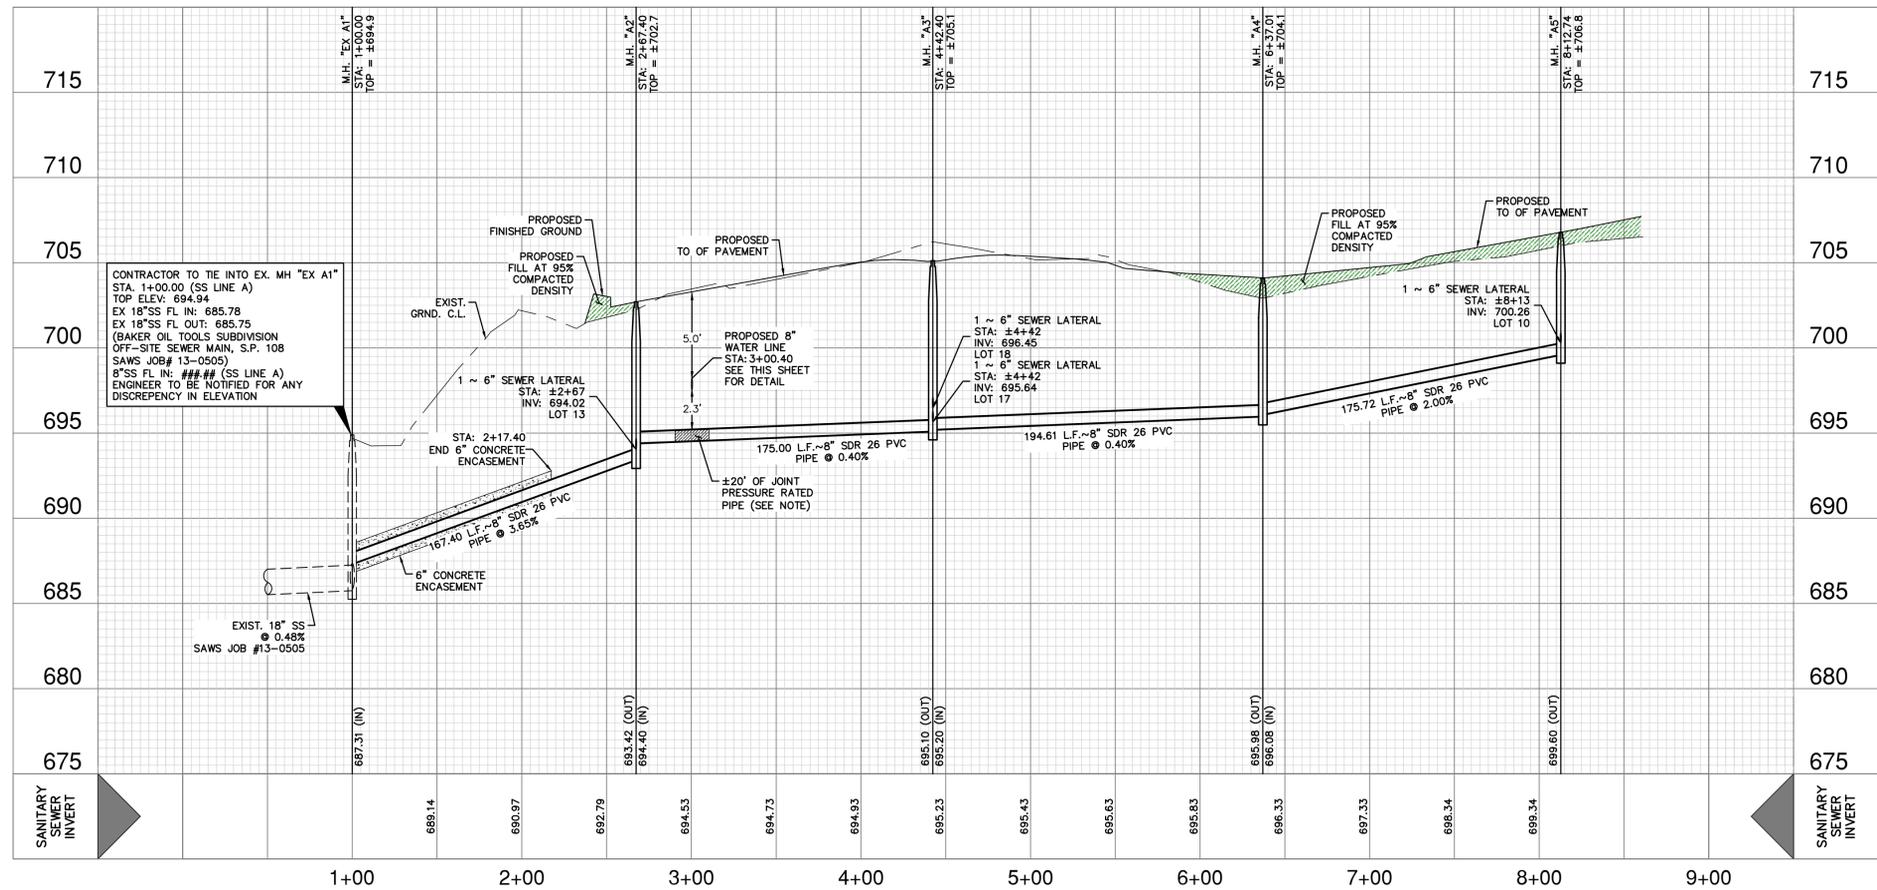

CAUTION!!
 CONTRACTOR SHALL BE REQUIRED TO LOCATE ALL PUBLIC OR PRIVATE UTILITIES INCLUDING BUT NOT LIMITING TO: WATER, SEWER, TELEPHONE AND FIBER OPTIC LINES, SITE LIGHTING ELECTRIC, SECONDARY ELECTRIC, PRIMARY ELECTRICAL DUCTBANKS, LANDSCAPE IRRIGATION FACILITIES, AND GAS LINES. ANY UTILITY CONFLICTS THAT ARISE SHOULD BE COMMUNICATED TO THE ENGINEER IMMEDIATELY AND PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL CONTACT 1-800-DIG-TESS A MINIMUM OF 48 HOURS PRIOR TO THE START OF CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THE REPAIR SHALL BE AT CONTRACTOR'S SOLE EXPENSE WHETHER THE UTILITY IS SHOWN ON THESE PLANS OR NOT.

TRENCH EXCAVATION SAFETY PROTECTION:
 CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/ GEOTECHNICAL/ SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND /OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

**SEWERSHED - EAST
 WASTEWATER TREATMENT PLANT: SALADO CREEK**

DEVELOPER'S NAME: S A PARTNERS INVESTMENT, LLC
 ADDRESS: 7623 LOST CREEK GAP
 CITY: BOERNE STATE: TEXAS ZIP: 78015
 PHONE# (210)-771-0861 FAX#
 SAWS BLOCK MAP# 200598 TOTAL EDU'S 15 TOTAL ACREAGE 3.978
 TOTAL LINEAR FOOTAGE OF PIPE: 8" 713 LF PLAT NO. 25-11800340
 NUMBER OF LOTS 14 SAWS JOB NO. 25-1587

DATE _____

NO. REVISION _____


Jon Adams
 11-24-25

PAPE-DAWSON
 2000 NW LOOP 410 | SAN ANTONIO, TX 78213 | 210.375.9000
 TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM # 0028800


CREEKS EDGE
 SAN ANTONIO, TEXAS

SS LINE "A" ~ STA. 1+00.00 TO END
 SANITARY SEWER PLAN & PROFILE


PLAT NO. 25-11800340
 JOB NO. 13657-10
 DATE NOVEMBER 2025
 DESIGNER CB
 CHECKED JA DRAWN CB
 SHEET C5.01

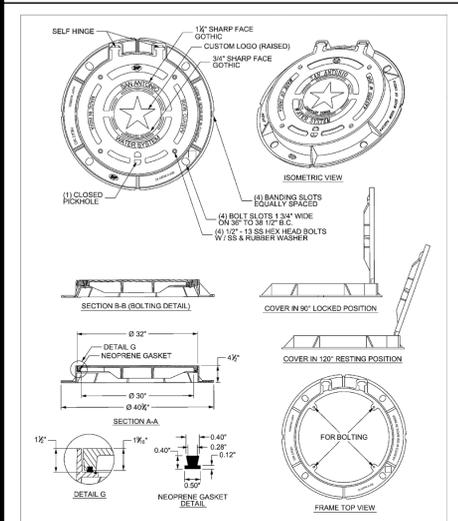


PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS	DD 852-07	1 OF 5

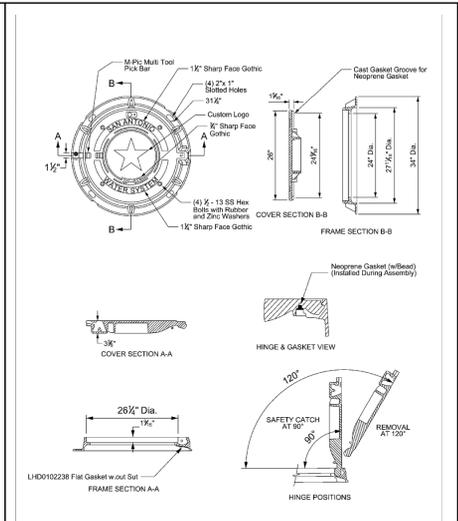


PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS	DD 852-07	2 OF 5

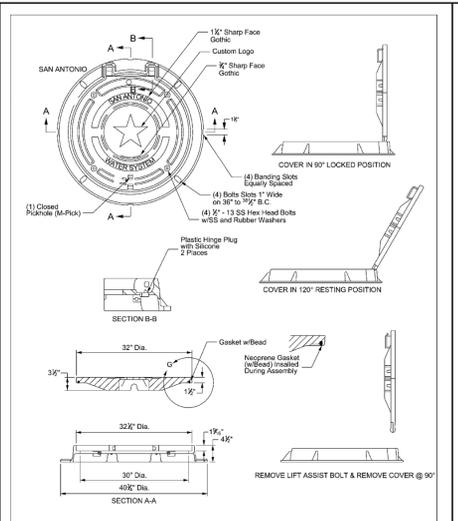


PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS	DD 852-07	3 OF 5

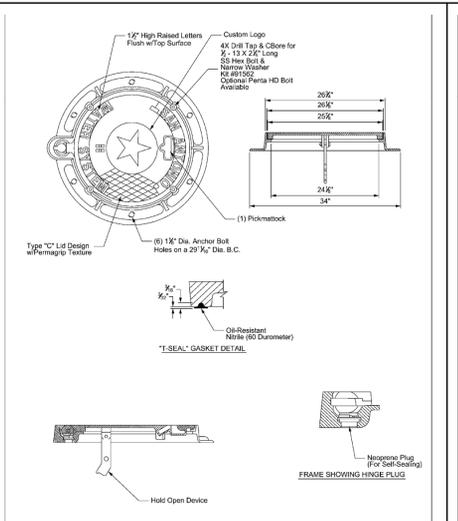


PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS	DD 852-07	4 OF 5

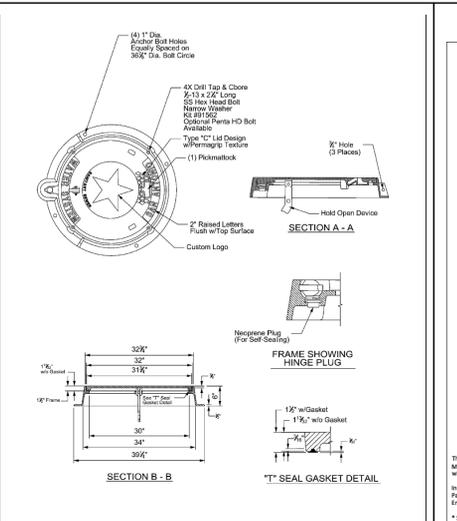


PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS	DD 852-07	5 OF 5

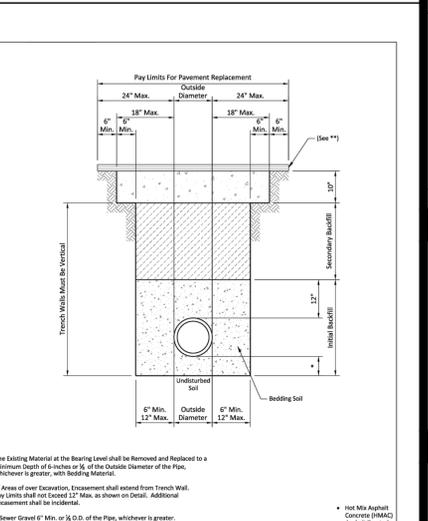

PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS	DD-804-01	1 OF 1

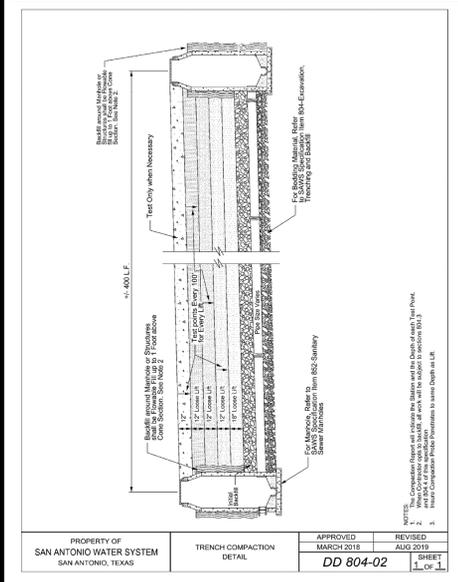


PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MARCH 2018	AUG 2019
SAN ANTONIO, TEXAS	DD 804-02	1 OF 1

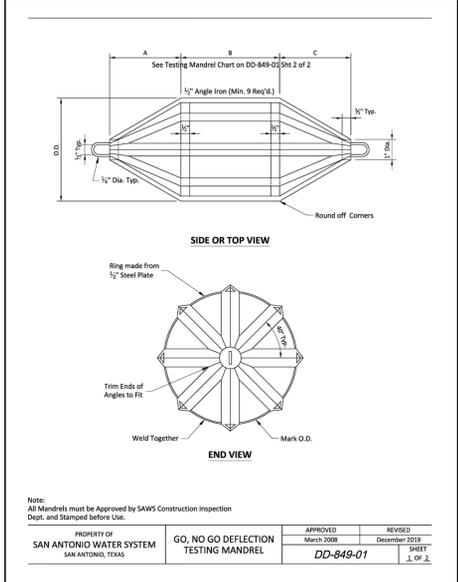


PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MARCH 2008	DECEMBER 2019
SAN ANTONIO, TEXAS	DD-849-01	1 OF 2

SIZE	A	B*	PVC (SDR -26)	PVC (SDR -26)
6"	4.0"	4.5"	5.50	4.79
8"	5.5"	6"	7.37	6.66
10"	7.0"	7.5"	9.21	8.50
12"	8.0"	9"	10.96	10.35
15"	10.0"	11"	13.42	12.71
18"	12.0"	13.5"		
21"	14.0"	16"		
24"	16.0"	18"		
27"	18.0"	20"		


PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MARCH 2008	DECEMBER 2019
SAN ANTONIO, TEXAS	DD-849-01	2 OF 2

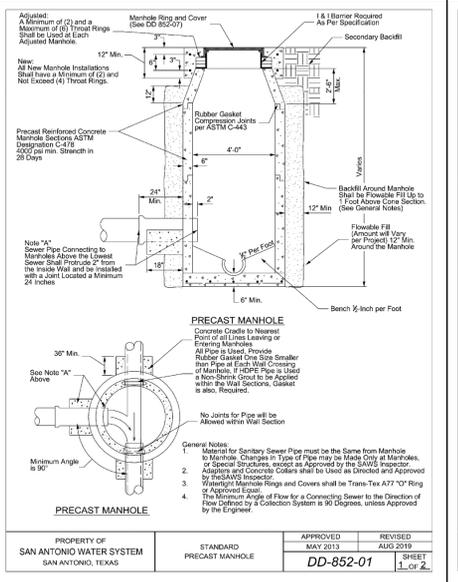


PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MAY 2013	AUG 2019
SAN ANTONIO, TEXAS	DD-852-01	1 OF 2

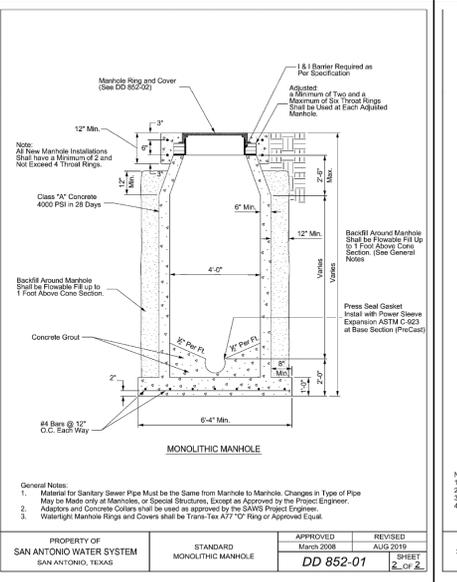


PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS	DD 852-01	2 OF 2

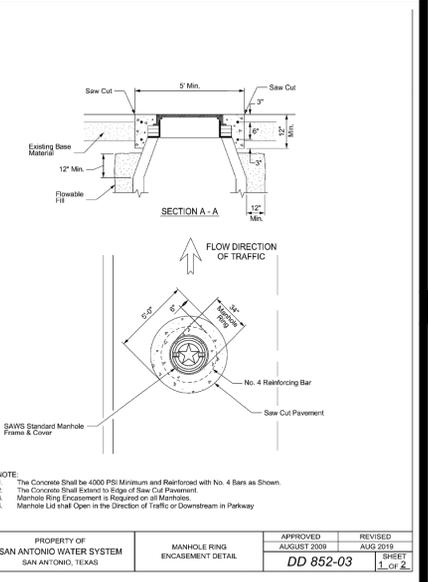


PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS	DD 852-03	1 OF 2

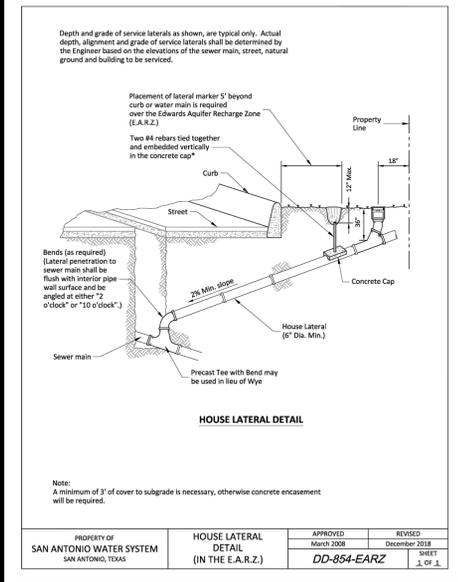


PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MARCH 2008	DECEMBER 2018
SAN ANTONIO, TEXAS	DD-854-EARZ	1 OF 1

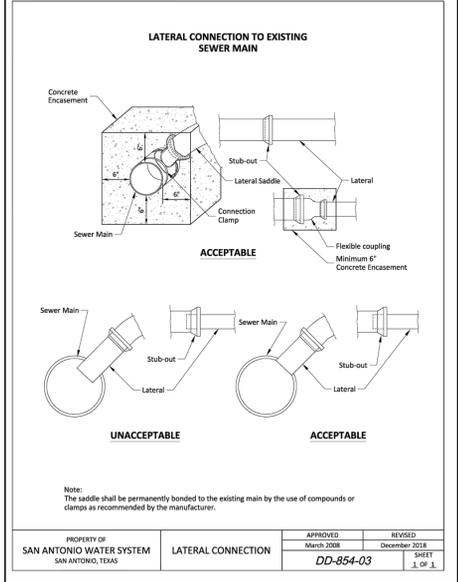


PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MARCH 2008	DECEMBER 2018
SAN ANTONIO, TEXAS	DD-854-03	1 OF 1

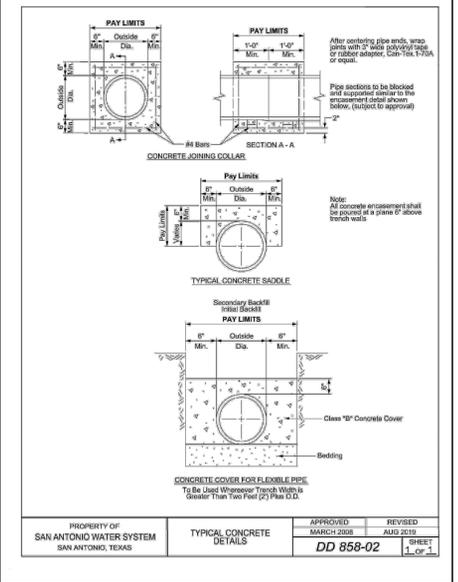


PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS	DD 858-02	1 OF 1

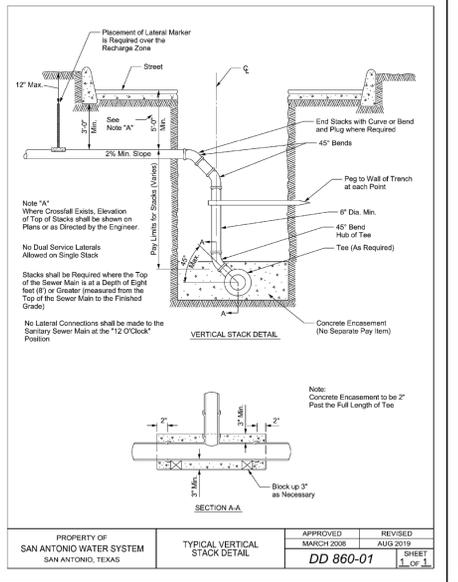

PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS	DD 860-01	1 OF 1

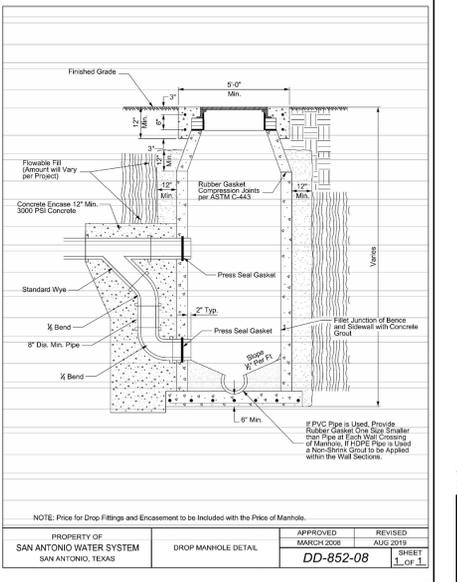

PROPERTY OF	APPROVED	REVISED
SAN ANTONIO WATER SYSTEM	MARCH 2008	AUG 2019
SAN ANTONIO, TEXAS	DD-852-08	1 OF 1

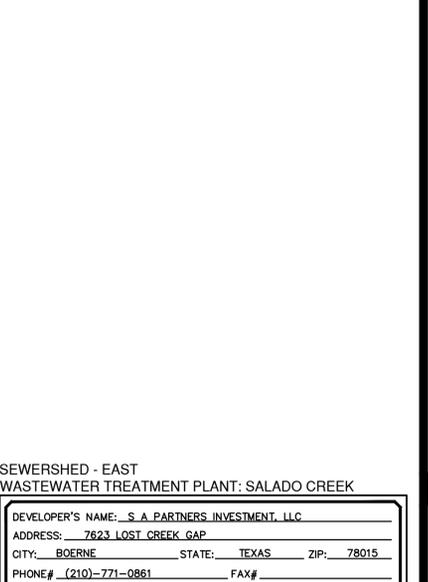

DEVELOPER'S NAME:	S A PARTNERS INVESTMENT, LLC
ADDRESS:	7623 LOST CREEK GAP
CITY:	BOERNE TEXAS ZIP: 78015
PHONE# (210)-771-0861	FAX#
SAWS BLOCK MAP# 200598	TOTAL EDU'S 15 TOTAL ACREAGE 3.978
TOTAL LINEAR FOOTAGE OF PIPE: 8" 713 LF	PLAT NO 25-11800349
NUMBER OF LOTS 14	SAWS JOB NO. 25-1587

DATE

NO. REVISION

STATE OF TEXAS
 JON D. ADAMS
 82567
 PROFESSIONAL ENGINEER
 Jon Adams
 11-24-25

PAPE-DAWSON
 2000 NW LOOP 410 | SAN ANTONIO, TX 78213 | 210.375.9000
 TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM # 10028800

CREEKS EDGE
 SAN ANTONIO, TEXAS
 SANITARY SEWER DETAILS

PLAT NO. 25-11800340
 JOB NO. 13657-10
 DATE NOVEMBER 2025
 DESIGNER
 CHECKED - DRAWN -
 SHEET C5.10

SAWS CONSTRUCTION NOTES
(LAST REVISED JANUARY 2022)

SAWS GENERAL SECTION

1. ALL MATERIALS AND CONSTRUCTION PROCEDURES WITHIN THE SCOPE OF THIS CONTRACT SHALL BE APPROVED BY THE SAN ANTONIO WATER SYSTEM (SAWS) AND COMPLY WITH THE PLANS, SPECIFICATIONS, GENERAL CONDITIONS AND WITH THE FOLLOWING AS APPLICABLE:

- A. CURRENT TEXAS COMMISSION ON ENVIRONMENTAL QUALITY (TCEQ) "DESIGN CRITERIA FOR DOMESTIC WASTEWATER SYSTEMS"; TEXAS ADMINISTRATIVE CODE (TAC) TITLE 30 PART 1 CHAPTER 217 AND "PUBLIC DRINKING WATER"; TAC TITLE 30 PART 1 CHAPTER 290.
- B. CURRENT TXDOT STANDARD SPECIFICATIONS FOR CONSTRUCTION OF HIGHWAYS, STREETS AND DRAINAGE.
- C. CURRENT "SAN ANTONIO WATER SYSTEM STANDARD SPECIFICATIONS FOR WATER AND SANITARY SEWER CONSTRUCTION".
- D. CURRENT CITY OF SAN ANTONIO "STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION".
- E. CURRENT CITY OF SAN ANTONIO "UTILITY EXCAVATION CRITERIA MANUAL" (UECM).

2. THE CONTRACTOR SHALL NOT PROCEED WITH ANY PIPE INSTALLATION WORK UNTIL THEY OBTAIN A COPY OF THE APPROVED COUNTER PERMIT OR GENERAL CONSTRUCTION PERMIT (GCP) FROM THE CONSULTANT AND HAS BEEN NOTIFIED BY SAWS CONSTRUCTION INSPECTION DIVISION TO PROCEED WITH THE WORK AND HAS ARRANGED A MEETING WITH THE INSPECTOR AND CONSULTANT FOR THE WORK REQUIREMENTS. WORK COMPLETED BY THE CONTRACTOR WITHOUT AN APPROVED COUNTER PERMIT AND/OR A GCP WILL BE SUBJECT TO REMOVAL AND REPLACEMENT AT THE EXPENSE OF THE CONTRACTORS AND/OR THE DEVELOPER.

3. THE CONTRACTOR SHALL OBTAIN THE SAWS STANDARD DETAILS FROM THE SAWS WEBSITE, [HTTP://WWW.SAWS.ORG/BUSINESS_CENTER/SPECS](http://www.saws.org/business_center/specs). UNLESS OTHERWISE NOTED WITHIN THE DESIGN PLANS.

4. THE CONTRACTOR IS TO MAKE ARRANGEMENTS WITH THE SAWS CONSTRUCTION INSPECTION DIVISION AT (210) 233-2973, ON NOTIFICATION PROCEDURES THAT WILL BE USED TO NOTIFY AFFECTED HOME RESIDENTS AND/OR PROPERTY OWNERS 48 HOURS PRIOR TO BEGINNING ANY WORK.

5. LOCATION AND DEPTH OF EXISTING UTILITIES AND SERVICE LATERALS SHOWN ON THE PLANS ARE UNDERSTOOD TO BE APPROXIMATE. ACTUAL LOCATIONS AND DEPTHS MUST BE FIELD VERIFIED BY THE CONTRACTOR AT LEAST 1 WEEK PRIOR TO CONSTRUCTION. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO LOCATE UTILITY SERVICE LINES AS REQUIRED FOR CONSTRUCTION AND TO PROTECT THEM DURING CONSTRUCTION AT NO COST TO SAWS.

6. THE CONTRACTOR SHALL VERIFY THE EXACT LOCATION OF UNDERGROUND UTILITIES AND DRAINAGE STRUCTURES AT LEAST 1-2 WEEKS PRIOR TO CONSTRUCTION WHETHER SHOWN ON PLANS OR NOT. PLEASE ALLOW UP TO 7 BUSINESS DAYS FOR LOCATES REQUESTING PIPE LOCATION MARKERS ON SAWS FACILITIES. THE FOLLOWING CONTACT INFORMATION ARE SUPPLIED FOR VERIFICATION PURPOSES:

- SAWS UTILITY LOCATES: [HTTP://WWW.SAWS.ORG/SERVICE/LOCATES](http://www.saws.org/service/locates)
- COSA DRAINAGE (210) 207-0724 OR (210) 207-6026
- COSA TRAFFIC SIGNAL OPERATIONS (210) 206-8480
- COSA TRAFFIC SIGNAL DAMAGES (210) 207-3951
- TEXAS STATE WIDE ONE CALL LOCATOR 1-800-545-6005 OR 811

7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR RESTORING EXISTING FENCES, CURBS, STREETS, DRIVEWAYS, SIDEWALKS, LANDSCAPING AND STRUCTURES TO ITS ORIGINAL OR BETTER CONDITION IF DAMAGES ARE MADE AS A RESULT OF THE PROJECT'S CONSTRUCTION.

8. ALL WORK IN TEXAS DEPARTMENT OF TRANSPORTATION (TXDOT) AND/OR BEXAR COUNTY RIGHT-OF-WAY SHALL BE DONE IN ACCORDANCE WITH RESPECTIVE CONSTRUCTION SPECIFICATIONS AND PERMIT REQUIREMENTS.

9. THE CONTRACTOR SHALL COMPLY WITH CITY OF SAN ANTONIO OR OTHER GOVERNING MUNICIPALITY'S TREE ORDINANCES WHEN EXCAVATING NEAR TREES.

10. THE CONTRACTOR SHALL NOT PLACE ANY WASTE MATERIALS IN THE 100-YEAR FLOOD PLAIN WITHOUT FIRST OBTAINING AN APPROVED FLOOD PLAIN PERMIT.

11. HOLIDAY WORK: CONTRACTORS WILL NOT BE ALLOWED TO PERFORM SAWS WORK ON SAWS RECOGNIZED HOLIDAYS. REQUEST SHOULD BE SENT TO CONSTWORKREQ@SAWS.ORG.

WEEKEND WORK: CONTRACTORS ARE REQUIRED TO NOTIFY THE SAWS INSPECTION CONSTRUCTION DEPARTMENT 48 HOURS IN ADVANCE TO REQUEST WEEKEND WORK. REQUEST SHOULD BE SENT TO CONSTWORKREQ@SAWS.ORG.

ANY AND ALL SAWS UTILITY WORK INSTALLED WITHOUT HOLIDAY/WEEKEND APPROVAL WILL BE SUBJECT TO BE UNCOVERED FOR PROPER INSPECTION.

12. COMPACTION NOTE (ITEM 804): THE CONTRACTOR SHALL BE RESPONSIBLE FOR MEETING THE COMPACTION REQUIREMENTS ON ALL TRENCH BACKFILL AND FOR PAYING FOR THE TESTS PERFORMED BY A THIRD PARTY. COMPACTION TESTS WILL BE DONE AT ONE LOCATION POINT RANDOMLY SELECTED, OR AS INDICATED BY THE SAWS INSPECTOR AND/OR THE TEST ADMINISTRATOR. PER EACH 12-INCH LOOSE LIFT PER 400 LINEAR FEET AT A MINIMUM. THIS PROJECT WILL NOT BE ACCEPTED AND FINALIZED BY SAWS WITHOUT THIS REQUIREMENT BEING MET AND VERIFIED BY PROVIDING ALL NECESSARY DOCUMENTED TEST RESULTS.

13. A COPY OF ALL TESTING REPORTS SHALL BE FORWARDED TO SAWS CONSTRUCTION INSPECTION DIVISION.

SAWS SEWER NOTES

1. THE CONTRACTOR IS RESPONSIBLE FOR ENSURING THAT NO SANITARY SEWER OVERFLOW (SSO) OCCURS AS A RESULT OF THEIR WORK. ALL CONTRACTOR PERSONNEL RESPONSIBLE FOR SSO PREVENTION AND CONTROL SHALL BE TRAINED ON PROPER RESPONSE. SHOULD AN SSO OCCUR, THE CONTRACTOR SHALL:

- A. IDENTIFY THE SOURCE OF THE SSO AND NOTIFY SAWS EMERGENCY OPERATIONS CENTER (EOC) IMMEDIATELY AT (210) 233-2014. PROVIDE THE ADDRESS OF THE SPILL AND AN ESTIMATED VOLUME OR FLOW.
- B. ATTEMPT TO ELIMINATE THE SOURCE OF THE SSO.
- C. CONTAIN SEWAGE FROM THE SSO TO THE EXTENT OF PREVENTING A POSSIBLE CONTAMINATION OF WATERWAYS.
- D. CLEAN UP SPILL SITE (RETURN CONTAINED SEWAGE TO THE COLLECTION SYSTEM IF POSSIBLE) AND PROPERLY DISPOSE OF CONTAMINATED SOIL/MATERIALS.
- E. CLEAN THE AFFECTED SEWER MAINS AND REMOVE ANY DEBRIS.
- F. MEET ALL POST-SSO REQUIREMENTS AS PER THE EPA CONSENT DECREE, INCLUDING LINE CLEANING AND TELEVISIONING THE AFFECTED SEWER MAINS (AT SAWS DIRECTION) WITHIN 24 HOURS.

SHOULD THE CONTRACTOR FAIL TO ADDRESS AN SSO IMMEDIATELY AND TO SAWS SATISFACTION, THEY WILL BE RESPONSIBLE FOR ALL COSTS INCURRED BY SAWS, INCLUDING ANY FINES FROM EPA, TCEQ AND/OR ANY OTHER FEDERAL, STATE OR LOCAL AGENCIES.

NO SEPARATE MEASUREMENT OR PAYMENT SHALL BE MADE FOR THIS WORK. ALL WORK SHALL BE DONE ACCORDING TO GUIDELINES SET BY THE TCEQ AND SAWS.

2. IF BYPASS PUMPING IS REQUIRED, THE CONTRACTOR SHALL PERFORM SUCH WORK IN ACCORDANCE WITH SAWS STANDARD SPECIFICATION FOR WATER AND SANITARY SEWER CONSTRUCTION, ITEM NO. 864, "BYPASS PUMPING".

3. PRIOR TO TIE-INS, ANY SHUTDOWNS OF EXISTING FORCE MAINS OF ANY SIZE MUST BE COORDINATED WITH THE SAWS CONSTRUCTION INSPECTION DIVISION AT (210) 233-2973 AT LEAST ONE WEEK IN ADVANCE OF THE SHUTDOWN. THE CONTRACTOR MUST ALSO PROVIDE A SEQUENCE OF WORK AS RELATED TO THE TIE-INS; THIS IS AT NO ADDITIONAL COST TO SAWS OR THE PROJECT AND IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO SEQUENCE THE WORK ACCORDINGLY.

4. SEWER PIPE WHERE WATER LINE CROSSES SHALL BE 160 PSI AND MEET THE REQUIREMENTS OF ASTM D2241, TAC 217.53 AND TCEQ 290.14C(1)(E). CONTRACTOR SHALL CENTER A JOINT OF 160 PSI PRESSURE RATED PVC AT THE PROPOSED WATER CROSSING.

5. ELEVATIONS POSTED FOR TOP OF MANHOLES ARE FOR REFERENCE ONLY; IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO MAKE ALLOWANCES AND ADJUSTMENTS FOR TOP OF MANHOLES TO MATCH THE FINISHED GRADE OF THE PROJECT'S IMPROVEMENTS. (NSPI)

6. SPILLS, OVERFLOWS, OR DISCHARGES OF WASTEWATER: ALL SPILLS, OVERFLOWS, OR DISCHARGES OF WASTEWATER, RECYCLED WATER, PETROLEUM PRODUCTS, OR CHEMICALS MUST BE REPORTED IMMEDIATELY TO THE SAWS INSPECTOR ASSIGNED TO THE COUNTER PERMIT OR GENERAL CONSTRUCTION PERMIT (GCP). THIS REQUIREMENT APPLIES TO EVERY SPILL, OVERFLOW, OR DISCHARGE REGARDLESS OF SIZE.

7. MANHOLE AND ALL PIPE TESTING (INCLUDING THE TV INSPECTION) MUST BE PERFORMED AND PASSED PRIOR TO FINAL FIELD ACCEPTANCE BY SAWS CONSTRUCTION INSPECTION DIVISION, AS PER THE SAWS SPECIFICATIONS FOR WATER AND SANITARY SEWER CONSTRUCTION.

8. ALL PVC PIPE OVER 14 FEET OF COVER SHALL BE EXTRA STRENGTH WITH MINIMUM PIPE STIFFNESS OF 115 PSI.

PROJECT SEWER NOTES

1. ALL RESIDENTIAL SEWER SERVICE LATERALS ARE 6" DIA. AND SHALL BE EXTENDED TO 10' PAST THE PROPERTY LINE AND CAPPED AND SEALED. CONTRACTOR SHALL INSTALL A 2' X 4' STAKE, FOUR (4) FEET LONG, TWO (2) FEET DEEP INTO THE GROUND AT THE END OF EACH SERVICE. NO SEPARATE PAY ITEM.

2. CONTRACTOR TO INSTALL CLEANOUTS AT THE END OF ALL SEWER LATERALS, PER LATERAL DETAIL SHEET **CX.XX**.

3. NO VERTICAL STACKS ALLOWED FOR ANY LOTS UNLESS OTHERWISE SPECIFIED BY THE ENGINEER.

4. ALL 6" SEWER LATERALS WILL BE SET AT 2% GRADE FROM THE MAIN TO THE PROPERTY LINE.

5. WHEN HORIZONTAL DISTANCE BETWEEN SEWER PIPES AND WATER MAIN IS LESS THAN 9 FOOT OF SEPARATION, SEWER MAIN SHALL BE INSTALLED WITH 150 PSI (MIN) PRESSURE PIPE AND FITTINGS IN ACCORDANCE WITH SAWS CONSTRUCTION CRITERIA FOR CONSTRUCTION OF SEWER MAINS IN THE VICINITY OF WATER MAINS.

6. CONTRACTOR SHALL ENSURE THAT MANHOLES OUTSIDE OF PAVED AREAS ARE SET WITH TOP ELEVATIONS 6" ABOVE FINISHED GRADE WITH CONCRETE RING ENCASEMENT.

7. ALL SEWER PIPES SHALL BE 8" PVC (SDR 26), UNLESS OTHERWISE NOTED.

8. CONTRACTOR IS TO VERIFY EXISTING INVERT OF EXISTING SANITARY SEWER MAINS AND ALERT ENGINEER IMMEDIATELY OF ANY DIFFERENCE FROM INVERT SHOWN ON PLANS.

9. CONTRACTOR SHALL PROTECT ALL EXISTING FENCES. ANY FENCE DAMAGED BY THE CONTRACTOR SHALL BE REPAIRED BY THE CONTRACTOR AT THEIR EXPENSE.

10. THE CONTRACTOR WILL BE RESPONSIBLE FOR DETERMINING EXACT LOCATION OF ALL UTILITIES AND DRAINAGE STRUCTURES WHETHER SHOWN ON THE PLANS OR NOT. THE CONTRACTOR SHALL UNCOVER EXISTING UTILITIES PRIOR TO CONSTRUCTION TO VERIFY SIZE, GRADE, AND LOCATION. THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY OF ANY DEVIATIONS FROM PLANS PRIOR TO BEGINNING CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES, WHETHER SHOWN ON THE PLANS OR NOT, SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO REPAIR, AT HIS EXPENSE.

11. CONCRETE RING ENCASEMENT TO BE INSTALLED ON ALL MANHOLES AND, WITHIN LIMITS OF PAVEMENT, BE INSTALLED TO THE TOP OF THE BASE LAYER WITH A MINIMUM OF 2" OF ASPHALT ON TOP OF THE RING ENCASEMENT.

12. MANHOLE OPENING INCREASED TO 30" AS PER TAC CHAPTER 217.55.

13. ALL SEWER PIPE LATERALS SHALL BE SDR 26 (CLASS 160) PVC PIPE.


14. IF THE GIVEN TOP OF MANHOLE ELEVATION DOES NOT AGREE ON ACTUAL GROUND SURFACE OR FINISH PAVEMENT, THE CONTRACTOR SHALL ADJUST ELEVATIONS SUCH THAT THE TOP OF MANHOLE SHALL BE 0.5' ABOVE EXISTING GROUND, OR FLUSH TO FINISH ASPHALT PAVEMENT.

15. ALL MANHOLES CONSTRUCTED OVER THE EDWARDS AQUIFER RECHARGE ZONE SHOULD BE WATERTIGHT.

SEWERSHED - EAST
WASTEWATER TREATMENT PLANT: SALADO CREEK

DEVELOPER'S NAME: S. A PARTNERS INVESTMENT, LLC
ADDRESS: 7623 LOST CREEK GAP
CITY: BOERNE STATE: TEXAS ZIP: 78015
PHONE# (210)-771-0861 FAX#
SAWS BLOCK MAP# 200598 TOTAL EDU'S 15 TOTAL ACREAGE 3.979
TOTAL LINEAR FOOTAGE OF PIPE: 8" 713 LF PLAT NO. 25-11800340
NUMBER OF LOTS 14 SAWS JOB NO. 25-1587

DATE	NO.	REVISION




PAPE-DAWSON
2000 NW LOOP 410 | SAN ANTONIO, TX 78213 | 210.375.9000
TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM # 10028800

CREEKS EDGE
SAN ANTONIO, TEXAS
SANITARY SEWER NOTES




PLAT NO.	25-11800340
JOB NO.	13657-10
DATE	NOVEMBER 2025
DESIGNER	-
CHECKED	- DRAWN -
SHEET	C5.11

Date: Nov 24, 2025, 4:56pm User: jrc@pape-dawson.com
 File: P:\156571\15657100\Design\Civil\Utility\04-15657100.dwg

THIS DOCUMENT HAS BEEN PRODUCED FROM MATERIAL THAT WAS STORED AND/OR TRANSMITTED ELECTRONICALLY AND MAY HAVE BEEN INADVERTENTLY ALTERED. RELY ONLY ON FINAL HARDCOPY MATERIALS BEARING THE CONSULTANT'S ORIGINAL SIGNATURE AND SEAL. AERIAL IMAGERY PROVIDED BY GOOGLE/UNLESS OTHERWISE NOTED. Imagery © 2016, CAPOCO, Digital Globe, Texas Orthology Program, USDA Farm Service Agency.

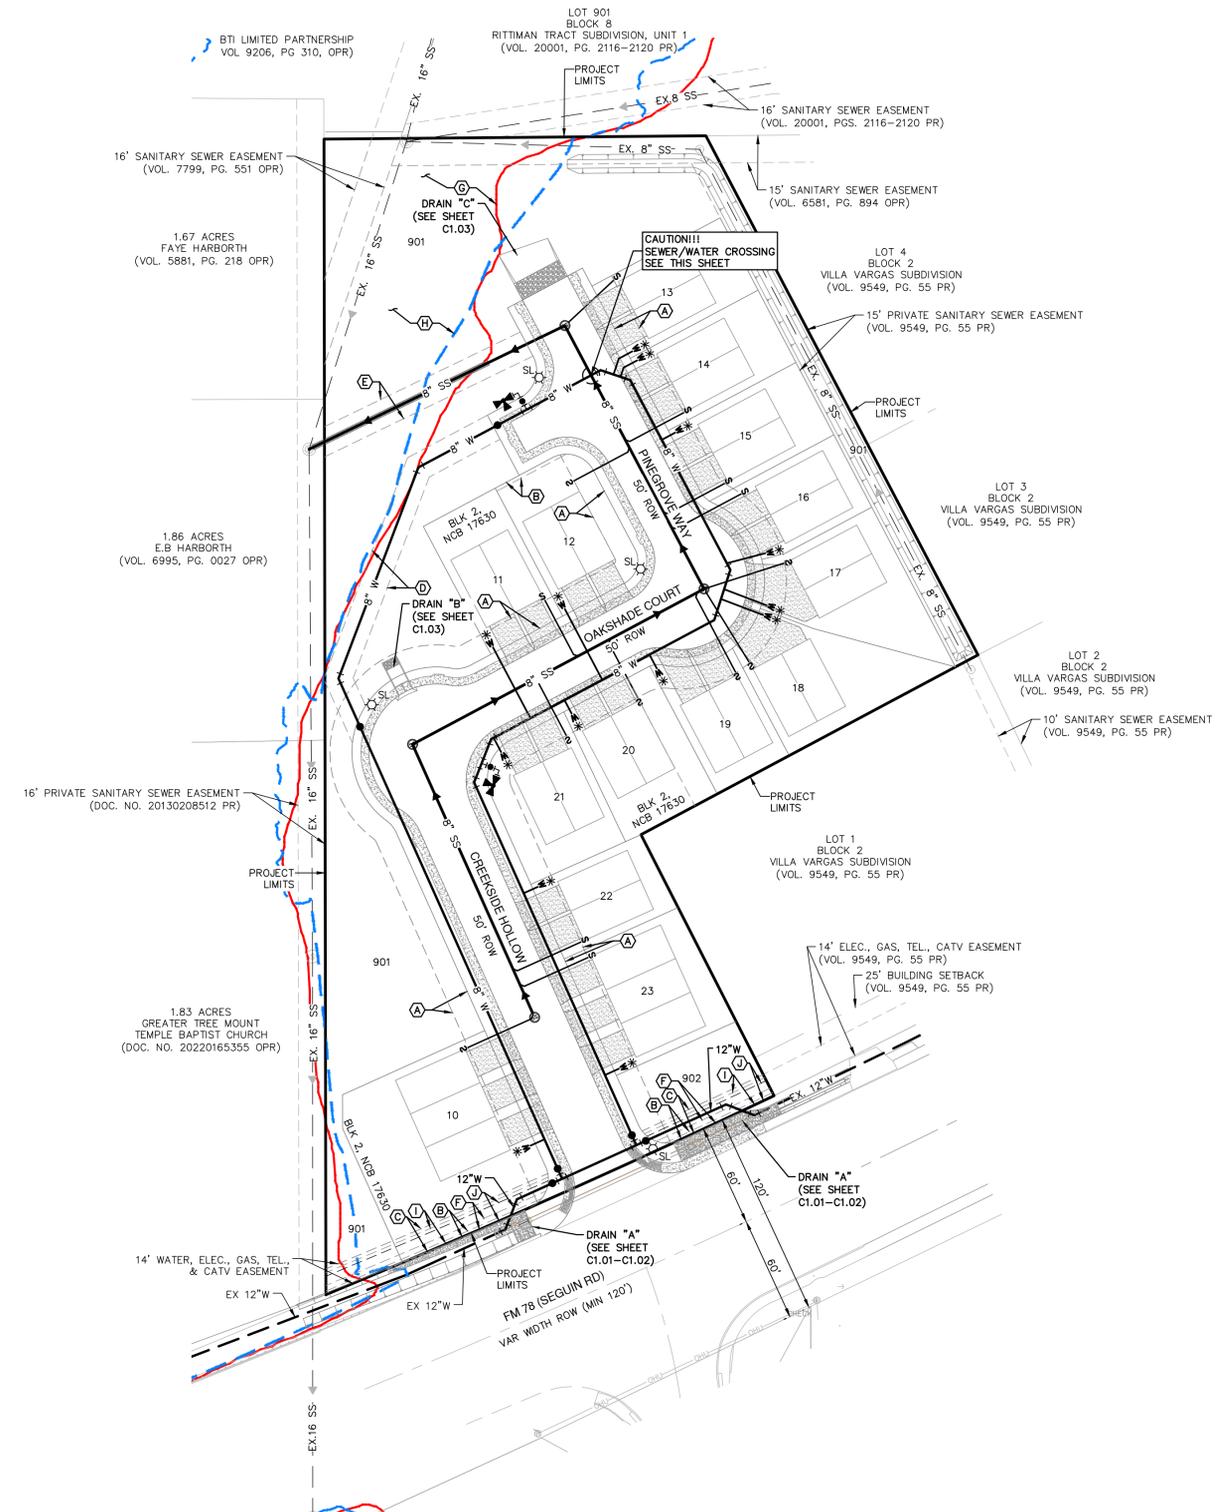


- KEY LEGEND:**
- (A) 13' ELEC., GAS, TELE. & CATV EASEMENT
 - (B) 1' VEHICLE NON-ACCESS EASEMENT (NOT-TO-SCALE)
 - (C) 14' ELEC., GAS, TELE. & CATV EASEMENT
 - (D) 16' WATER EASEMENT
 - (E) 16' SANITARY SEWER EASEMENT
 - (F) 5' DRAINAGE EASEMENT
 - (G) EFFECTIVE (EXISTING) FEMA 1% ANNUAL CHANCE (100-YR) FLOOD PLAIN (FIRM PANEL NO. 48029C0430G EFFECTIVE 9-19-2010)
 - (H) 1% ANNUAL CHANCE (100-YR) ATLAS 14 UD CONDITIONS FLOODPLAIN PER PAPE-DAWSON FLOOD STUDY (DATED: MARCH 25, 2024)
 - (I) 12" WATER EASEMENT
 - (J) 10' PEDESTRIAN EASEMENT

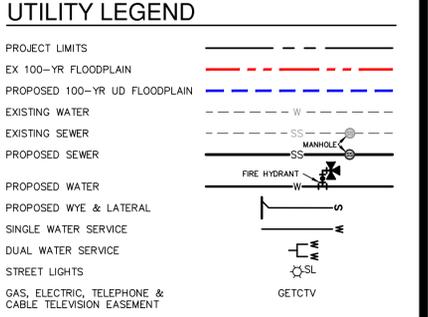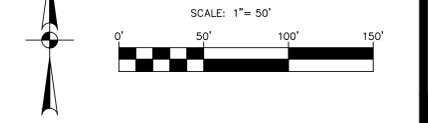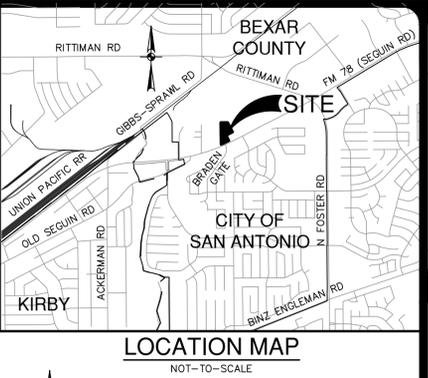

- CONDUIT NOTES:**
- CONTRACTOR SHALL INSTALL PERMANENT MARKERS IN PROPOSED CURB WHERE CONDUITS CROSS THE ROADWAY (BOTH SIDES).
 - CONDUITS SHALL BE PVC WITH MINIMUM BURY OF 36 INCHES BELOW PROPOSED FINISHED GRADE. SCHEDULE 80 TO BE USED FOR GFS CONDUITS, ALL OTHER CONDUITS ARE SCHEDULE 40.
 - ALL CONDUITS SHALL BE EXTENDED BEHIND CURBS OR PROPOSED SIDEWALKS A MINIMUM OF 3 FEET AND CAPPED FOR FUTURE USE.
 - ALL CONDUIT SLEEVES TO BE USED FOR ELECTRIC, GAS, OR TELECOMMUNICATION UTILITY CROSSINGS SHALL BE INSTALLED TO MEET OR EXCEED DESIGN REQUIREMENTS FOR THE UTILITY AGENCY WHICH THEY ARE SERVING, INCLUDING BUT NOT LIMITED TO THE DEPTH, TRENCH PLACEMENT, AND PROXIMITY TO OTHER UTILITIES. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR VERIFYING AND INSTALLING THE CONDUIT SLEEVES TO MEET THESE SPECIFICATIONS INCLUDING COORDINATING WITH THE UTILITY AGENCY FOR ANY REQUIRED INSPECTIONS.

TRENCH EXCAVATION SAFETY PROTECTION:
 CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/ GEOTECHNICAL/ SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES, WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND/OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

CAUTION!!
 CONTRACTOR SHALL BE REQUIRED TO LOCATE ALL PUBLIC OR PRIVATE UTILITIES INCLUDING BUT NOT LIMITING TO: WATER, SEWER, TELEPHONE AND FIBER OPTIC LINES, SITE LIGHTING ELECTRIC, SECONDARY ELECTRIC, PRIMARY ELECTRICAL DUCTBANKS, LANDSCAPE IRRIGATION FACILITIES, AND GAS LINES. ANY UTILITY CONFLICTS THAT ARISE SHOULD BE COMMUNICATED TO THE ENGINEER IMMEDIATELY AND PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL CONTACT 1-800-DIG-TESS A MINIMUM OF 48 HOURS PRIOR TO THE START OF CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THE REPAIR SHALL BE AT CONTRACTOR'S SOLE EXPENSE WHETHER THE UTILITY IS SHOWN ON THESE PLANS OR NOT.

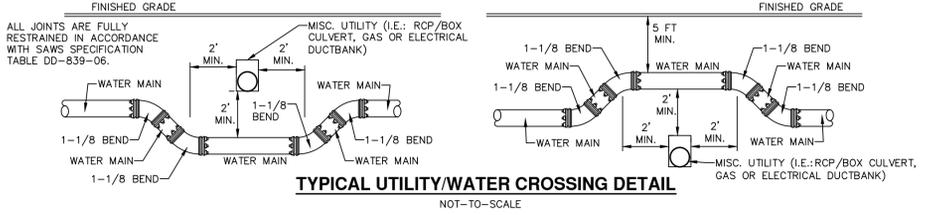

DATE	
NO.	
REVISION	


PAPE-DAWSON
 2000 NW LOOP 410 | SAN ANTONIO, TX 78213 | 210.375.9000
 TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028800

CREEKS EDGE
 SAN ANTONIO, TEXAS
 OVERALL UTILITY PLAN



PLAT NO.	25-11800340
JOB NO.	13657-10
DATE	NOVEMBER 2025
DESIGNER	JF
CHECKED	JA DRAWN JF
SHEET	C6.00

Date: Nov 06, 2025, 9:29am User: J. Adame
Plot: P:\US\2511800340\Drawings\Civil\Grading\2511800340.dwg

THIS DOCUMENT HAS BEEN PRODUCED FROM MATERIAL THAT WAS STORED AND/OR TRANSMITTED ELECTRONICALLY AND MAY HAVE BEEN INADVERTENTLY ALTERED. RELY ONLY ON FINAL HARDCOPY MATERIALS BEARING THE CONSULTANT'S ORIGINAL SIGNATURE AND SEAL. IMAGERY PROVIDED BY GOOGLE; UNLESS OTHERWISE NOTED. Imagery © 2016, CAPOCO, DigitalGlobe, Terra, GeoEye, OrthoEngine, USDA Farm Service Agency.

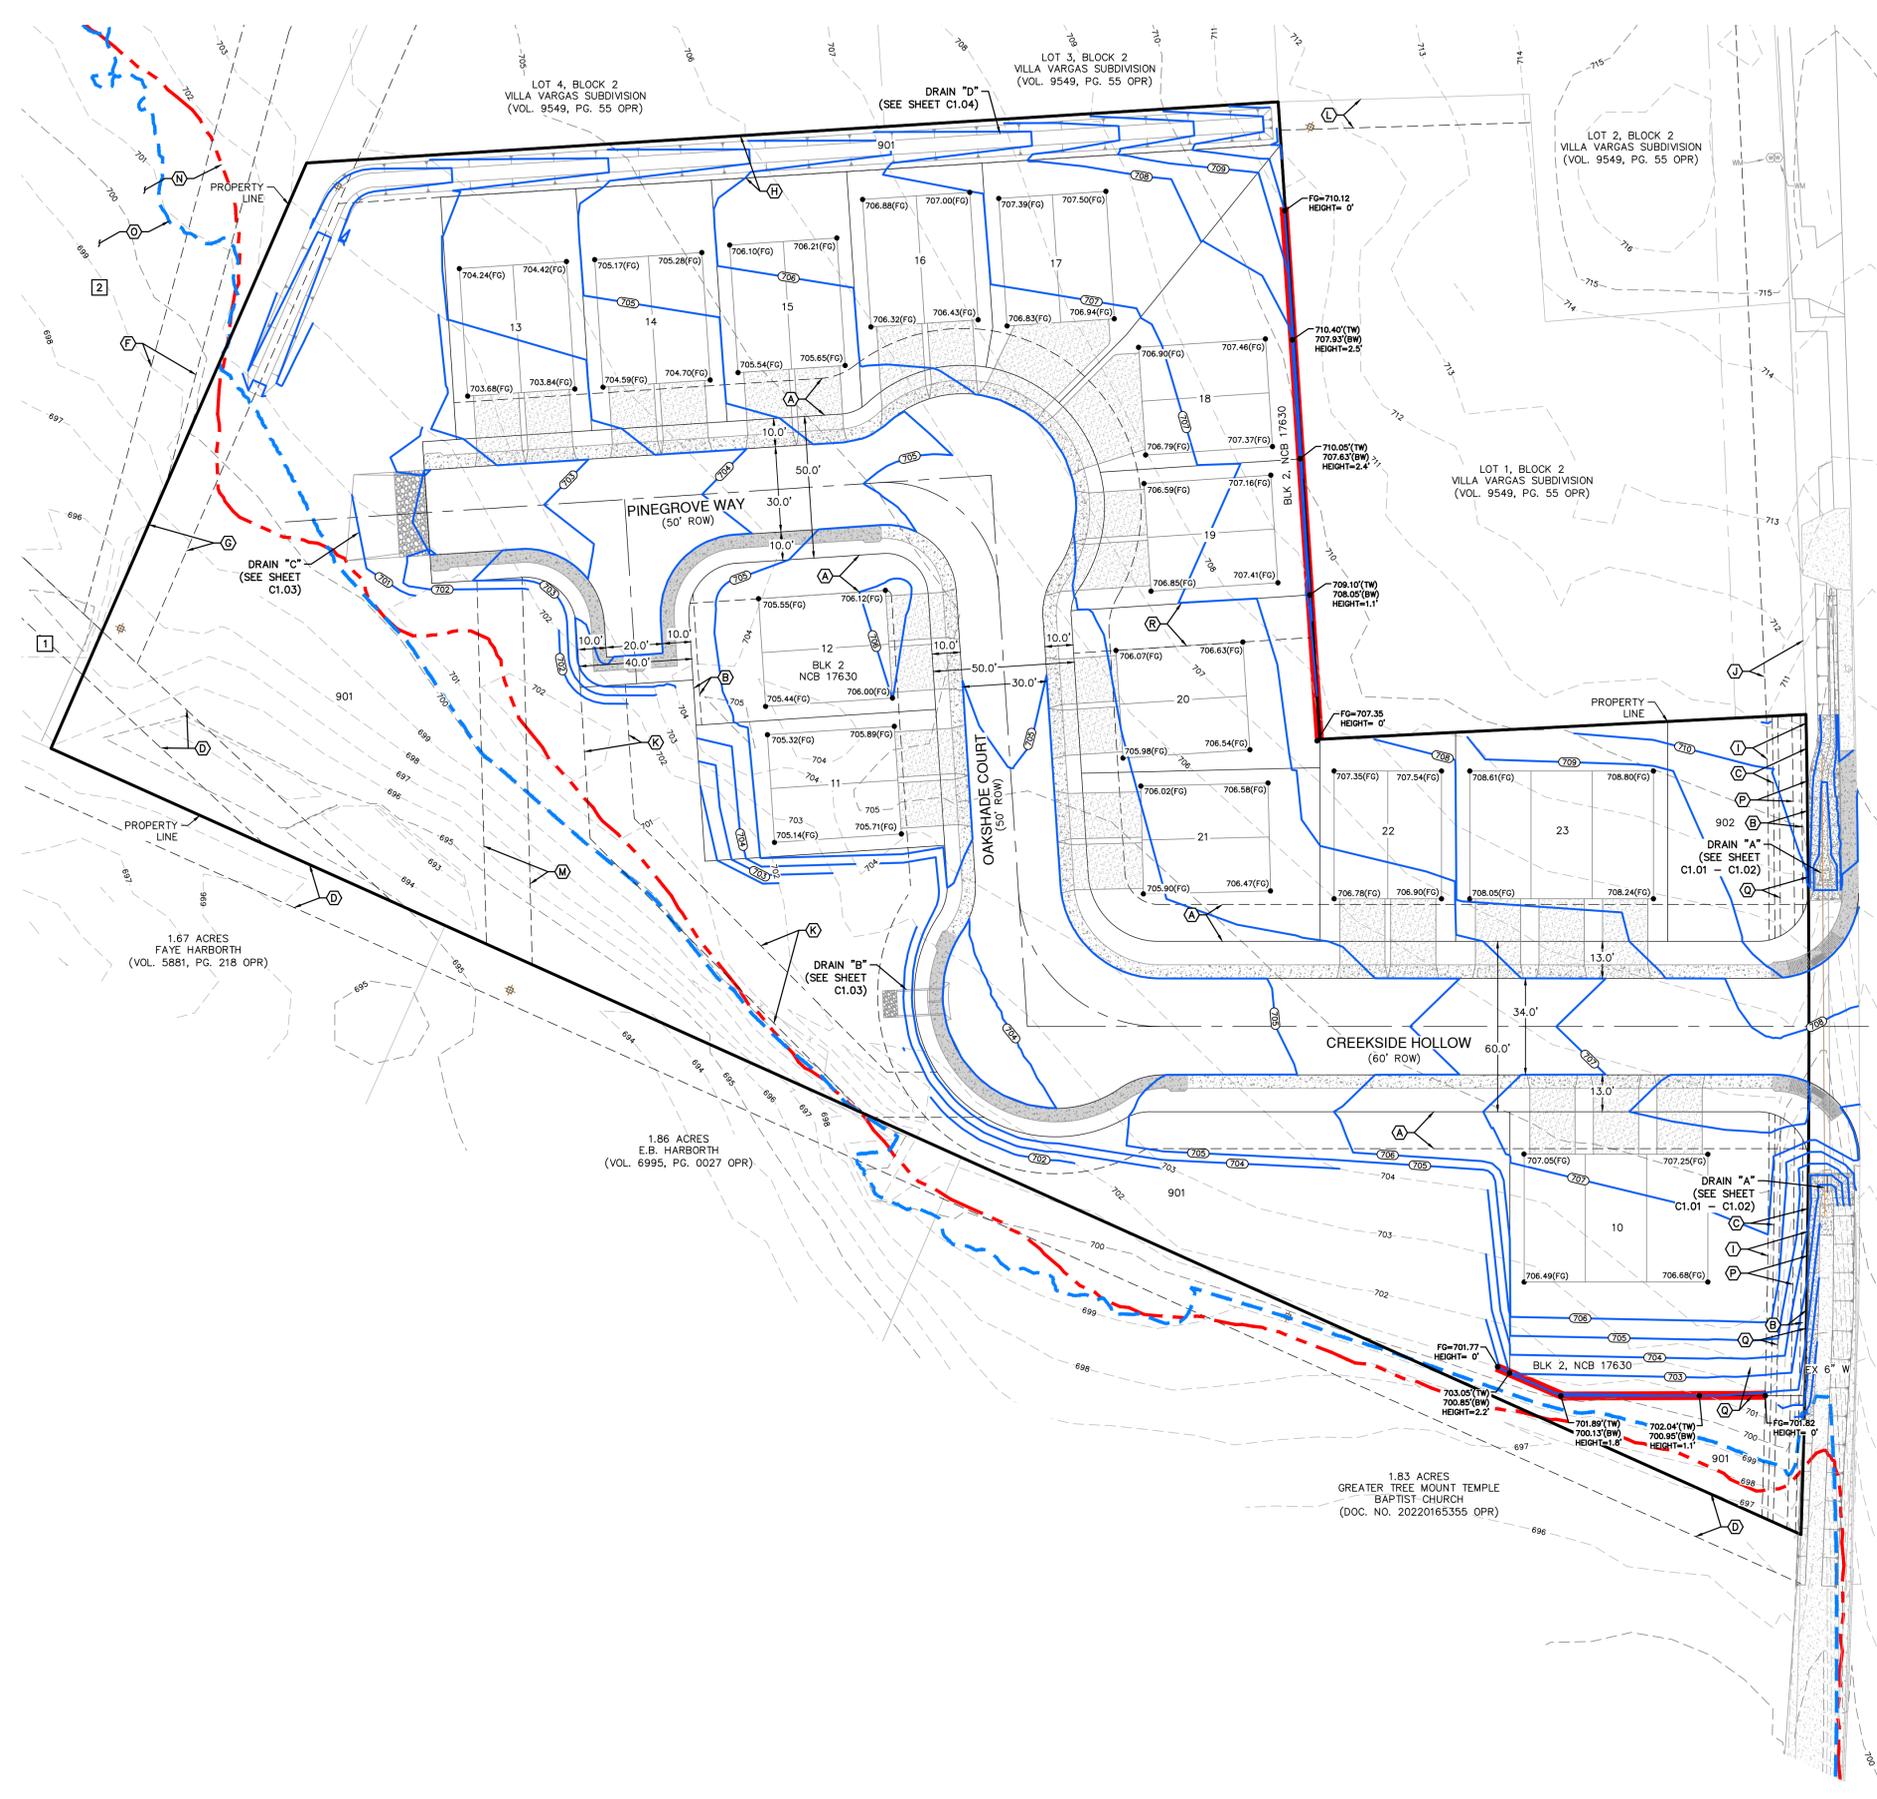

- KEY LEGEND:**
- (A) 13' ELEC., GAS, TELE. & CA. T.V. EASEMENT
 - (B) 1' VEHICLE NON-ACCESS EASEMENT (NOT-TO-SCALE)
 - (C) 12' WATER EASEMENT
 - (D) 16' SANITARY SEWER EASEMENT (VOL. 7799, PG. 551 OPR)
 - (E) 16' PRIVATE SANITARY SEWER EASEMENT (DOC. NO. 20130208512 PR)
 - (F) 16' SANITARY SEWER EASEMENT (VOL. 20001, PGS. 2116-2120 PR)
 - (G) 15' SANITARY SEWER EASEMENT (VOL. 6581, PG. 894 OPR)
 - (H) 15' SANITARY SEWER EASEMENT (VOL. 9549, PG. 55 OPR)
 - (I) 14' ELECTRIC, GAS, TEL., CATV EASEMENT
 - (J) 14' ELECTRIC, GAS, TEL., CATV EASEMENT (VOL. 9549, PG. 55 PR)
 - (K) 16' WATER EASEMENT
 - (L) 10' SANITARY SEWER EASEMENT (VOL. 9549, PG. 55 PR)
 - (M) 16' SANITARY SEWER EASEMENT
 - (N) EFFECTIVE (EXISTING) FEMA 1% ANNUAL CHANCE (100-YR) FLOOD PLAIN (FIRM PANEL NO. 4802900430G EFFECTIVE 9-19-2010)
 - (O) 1% ANNUAL CHANCE (100-YR) ATLAS 14 UD CONDITIONS FLOOD PLAIN (PAPE-DAWSON FLOOD STUDY)
 - (P) 5' DRAINAGE EASEMENT
 - (Q) 10' PEDESTRIAN EASEMENT
 - (R) 15' DRAINAGE EASEMENT
 - 1 UPLATTED BTI LIMITED PARTNERSHIP (VOL. 9206, PG. 130, OPR)
 - 2 RITTIMAN TRACT SUBDIVISION, UNIT-1 (VOL. 20001, PG. 2116-2120 PR)

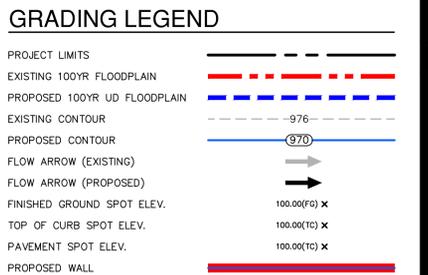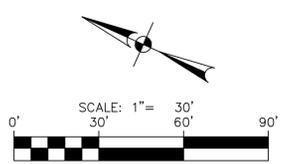

- GRADING NOTES:**
1. ALL MATERIALS AND CONSTRUCTION PROCEDURES WITHIN THIS SCOPE OF WORK WHERE NOT SPECIFICALLY COVERED IN THE SPECIFICATIONS OR GEOTECHNICAL REPORT SHALL CONFORM TO ALL APPLICABLE CITY, COUNTY AND TxDOT STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (LATEST EDITION).
 2. SITE PREPARATION, GRADING, EXCAVATION AND FILL SHALL BE PERFORMED IN ACCORDANCE WITH THE PROJECT GEOTECHNICAL REPORT AND SPECIFICATIONS.
 3. ALL SELECT FILL MATERIAL PROVIDED SHALL BE APPROVED BY THE GEOTECHNICAL ENGINEER PRIOR TO PLACING AND COMPACTING.
 4. ALL ELEVATIONS AND PROPOSED CONTOURS SHOWN ON THIS GRADING PLAN REFLECT FINISHED GRADES. THE THICKNESS OF DRAWINGS, BASE, GRASS, TOPSOIL, AND MULCH MUST BE SUBTRACTED TO OBTAIN SUBGRADE ELEVATIONS.
 5. THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE ENGINEER OF ANY QUESTIONS THAT MAY ARISE CONCERNING THE INTENT, PLACEMENT, OR LIMITS OF DIMENSIONS OR GRADES NECESSARY FOR CONSTRUCTION OF THIS PROJECT.
 6. THE CONTRACTOR SHALL VERIFY THE SUITABILITY OF ALL EXISTING AND PROPOSED SITE CONDITIONS INCLUDING GRADES AND DIMENSIONS BEFORE COMMENCEMENT OF CONSTRUCTION. THE ENGINEER SHALL BE NOTIFIED IMMEDIATELY OF ANY DISCREPANCIES.
 7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ACQUIRING ALL PERMITS, TESTS, APPROVALS AND ACCEPTANCES REQUIRED TO COMPLETE CONSTRUCTION OF THIS PROJECT.
 8. THE CONTRACTOR SHALL REMOVE TOP SOIL, GRASS, ROOTS, DEBRIS, ETC. AND DISPOSE OFF SITE THOSE MATERIALS NOT SUITABLE FOR EMBANKMENT AND TOPSOIL CLEAN STRIPPINGS AND TOPSOIL MAY BE STOCKPILED ON SITE FOR REUSE IN A LOCATION SPECIFIED BY THE OWNER.
 9. THE SITE CONTRACTOR SHALL BE RESPONSIBLE FOR SITE STABILIZATION. ALL DISTURBED AREAS SHALL BE REVEGETATED IN ACCORDANCE WITH PROJECT SPECIFICATIONS AND TPDES/SWPPP REQUIREMENTS. REFERENCE THE LANDSCAPE ARCHITECT'S PLAN, IF APPLICABLE.
 10. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS (USE OF SILT FENCES, ETC.) TO KEEP DRAINAGE AND SILT FROM WASHING ONTO ADJACENT PROPERTY, STREETS, OR DRAINAGE WAYS. CONTRACTOR SHALL IMMEDIATELY REMOVE SILT/DEBRIS WHICH WASHES OFFSITE OR INTO EXISTING STORM DRAIN SYSTEMS. (SEE SWPPP PLANS & TPDES BOOK).
 11. THE CONTRACTOR SHALL OBTAIN GRADES SHOWN HEREON WITHIN +/- ONE-TENTH (0.10) FOOT.
 12. IN PROPOSED PAVING AREAS, STREET DESIGN PLANS SHALL CONTROL. ALL EARTHEN SLOPES SHALL BE A MAXIMUM OF 3:1 AND A MINIMUM OF 1.0% UNLESS OTHERWISE SHOWN.
 13. THE CONTRACTOR SHALL PROVIDE A SMOOTH TRANSITION BETWEEN EXISTING SITE AND PROPOSED IMPROVEMENTS.
 14. THE CONTRACTOR SHALL BE RESPONSIBLE FOR RESTORING TO ITS ORIGINAL, OR BETTER, CONDITION ANY DAMAGE DONE TO EXISTING TREES, BUILDINGS, UTILITIES, FENCES, PAVEMENT, CURBS, OR DRIVEWAYS (NO SEPARATE PAY ITEMS).
 15. THE CONTRACTOR SHALL EXERCISE EXTREME CAUTION IN WORKING NEAR UTILITIES, GAS LINES, SEWER, OR EXISTING APPURTENANCES. PRIOR TO PERFORMING ANY EXCAVATION, CONTRACTOR SHALL CONTACT ALL UTILITY COMPANIES AND ASSURE HIMSELF THAT ALL UTILITIES HAVE BEEN ADEQUATELY LOCATED AND IDENTIFIED. THE ENGINEER SHALL BE NOTIFIED IF ANY UTILITY CONFLICTS ARE DISCOVERED.
 16. UTILITIES SHOWN ON THE PLANS ARE FROM INFORMATION SOURCES AVAILABLE AT THE TIME OF DESIGN BUT MAY NOT REPRESENT ALL EXISTING UTILITIES ON SITE. THE CONTRACTOR WILL BE RESPONSIBLE FOR DETERMINING EXACT LOCATION OF ALL UTILITIES WHETHER SHOWN ON THE PLANS OR NOT. THE CONTRACTOR SHALL UNCOVER EXISTING UTILITIES PRIOR TO CONSTRUCTION AND VERIFY SIZE, GRADE AND LOCATION. THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY OF ANY DEVIATIONS FROM PLANS PRIOR TO BEGINNING CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES, WHETHER SHOWN ON THE PLANS OR NOT, SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO REPAIR, AT HIS OWN EXPENSE.
 17. POSITIVE DRAINAGE SHALL BE MAINTAINED THROUGHOUT THE SCOPE OF THE PROJECT. DRAINAGE SHALL BE DIRECTED AWAY FROM ALL BUILDING FOUNDATIONS. CONTRACTOR SHOULD TAKE PRECAUTIONS NOT TO ALLOW ANY PONDING OF WATER.
 18. FOR FILL PLACEMENT ON HILL SIDES OR STEEP SLOPE AREAS, THE CONTRACTOR SHALL REFERENCE THE PROJECT SPECIFICATIONS AND GEOTECHNICAL REPORT FOR SPECIAL INSTRUCTIONS REGARDING BENCHING.
 19. NO WORK SHALL BE PERFORMED IN A PUBLIC RIGHT-OF-WAY WITHOUT A PERMIT.

DATE: _____

NO. REVISION: _____

STATE OF TEXAS
JON D. ADAME
 82567
 LICENSED PROFESSIONAL ENGINEER
Jon Adame
 11-6-25


PAPE-DAWSON
 2000 NW LOOP 410 | SAN ANTONIO, TX 78213 | 210.375.9000
 TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028800

CREEKS EDGE
 SAN ANTONIO, TEXAS
 OVERALL GRADING PLAN


PLAT NO. 25-11800340
 JOB NO. 13657-10
 DATE NOVEMBER 2025
 DESIGNER CB
 CHECKED JA_DRAWN_CB
 SHEET C7.00

Notes: Nov. 08, 2025, 9:29am, User: J. Adams, Plot: P:\A\152710\Design\Civil\SWP3-152710.dwg



THIS DOCUMENT HAS BEEN PRODUCED FROM MATERIAL THAT WAS STORED AND/OR TRANSMITTED ELECTRONICALLY AND MAY HAVE BEEN INADVERTENTLY ALTERED. RELY ONLY ON FINAL HARDCOPY MATERIALS BEARING THE CONSULTANT'S ORIGINAL SIGNATURE AND SEAL. IMAGERY PROVIDED BY GOOGLE® UNLESS OTHERWISE NOTED. Imagery © 2016, CAPOOL Digital Globe, Texas Orthology Program, USDA Farm Service Agency.

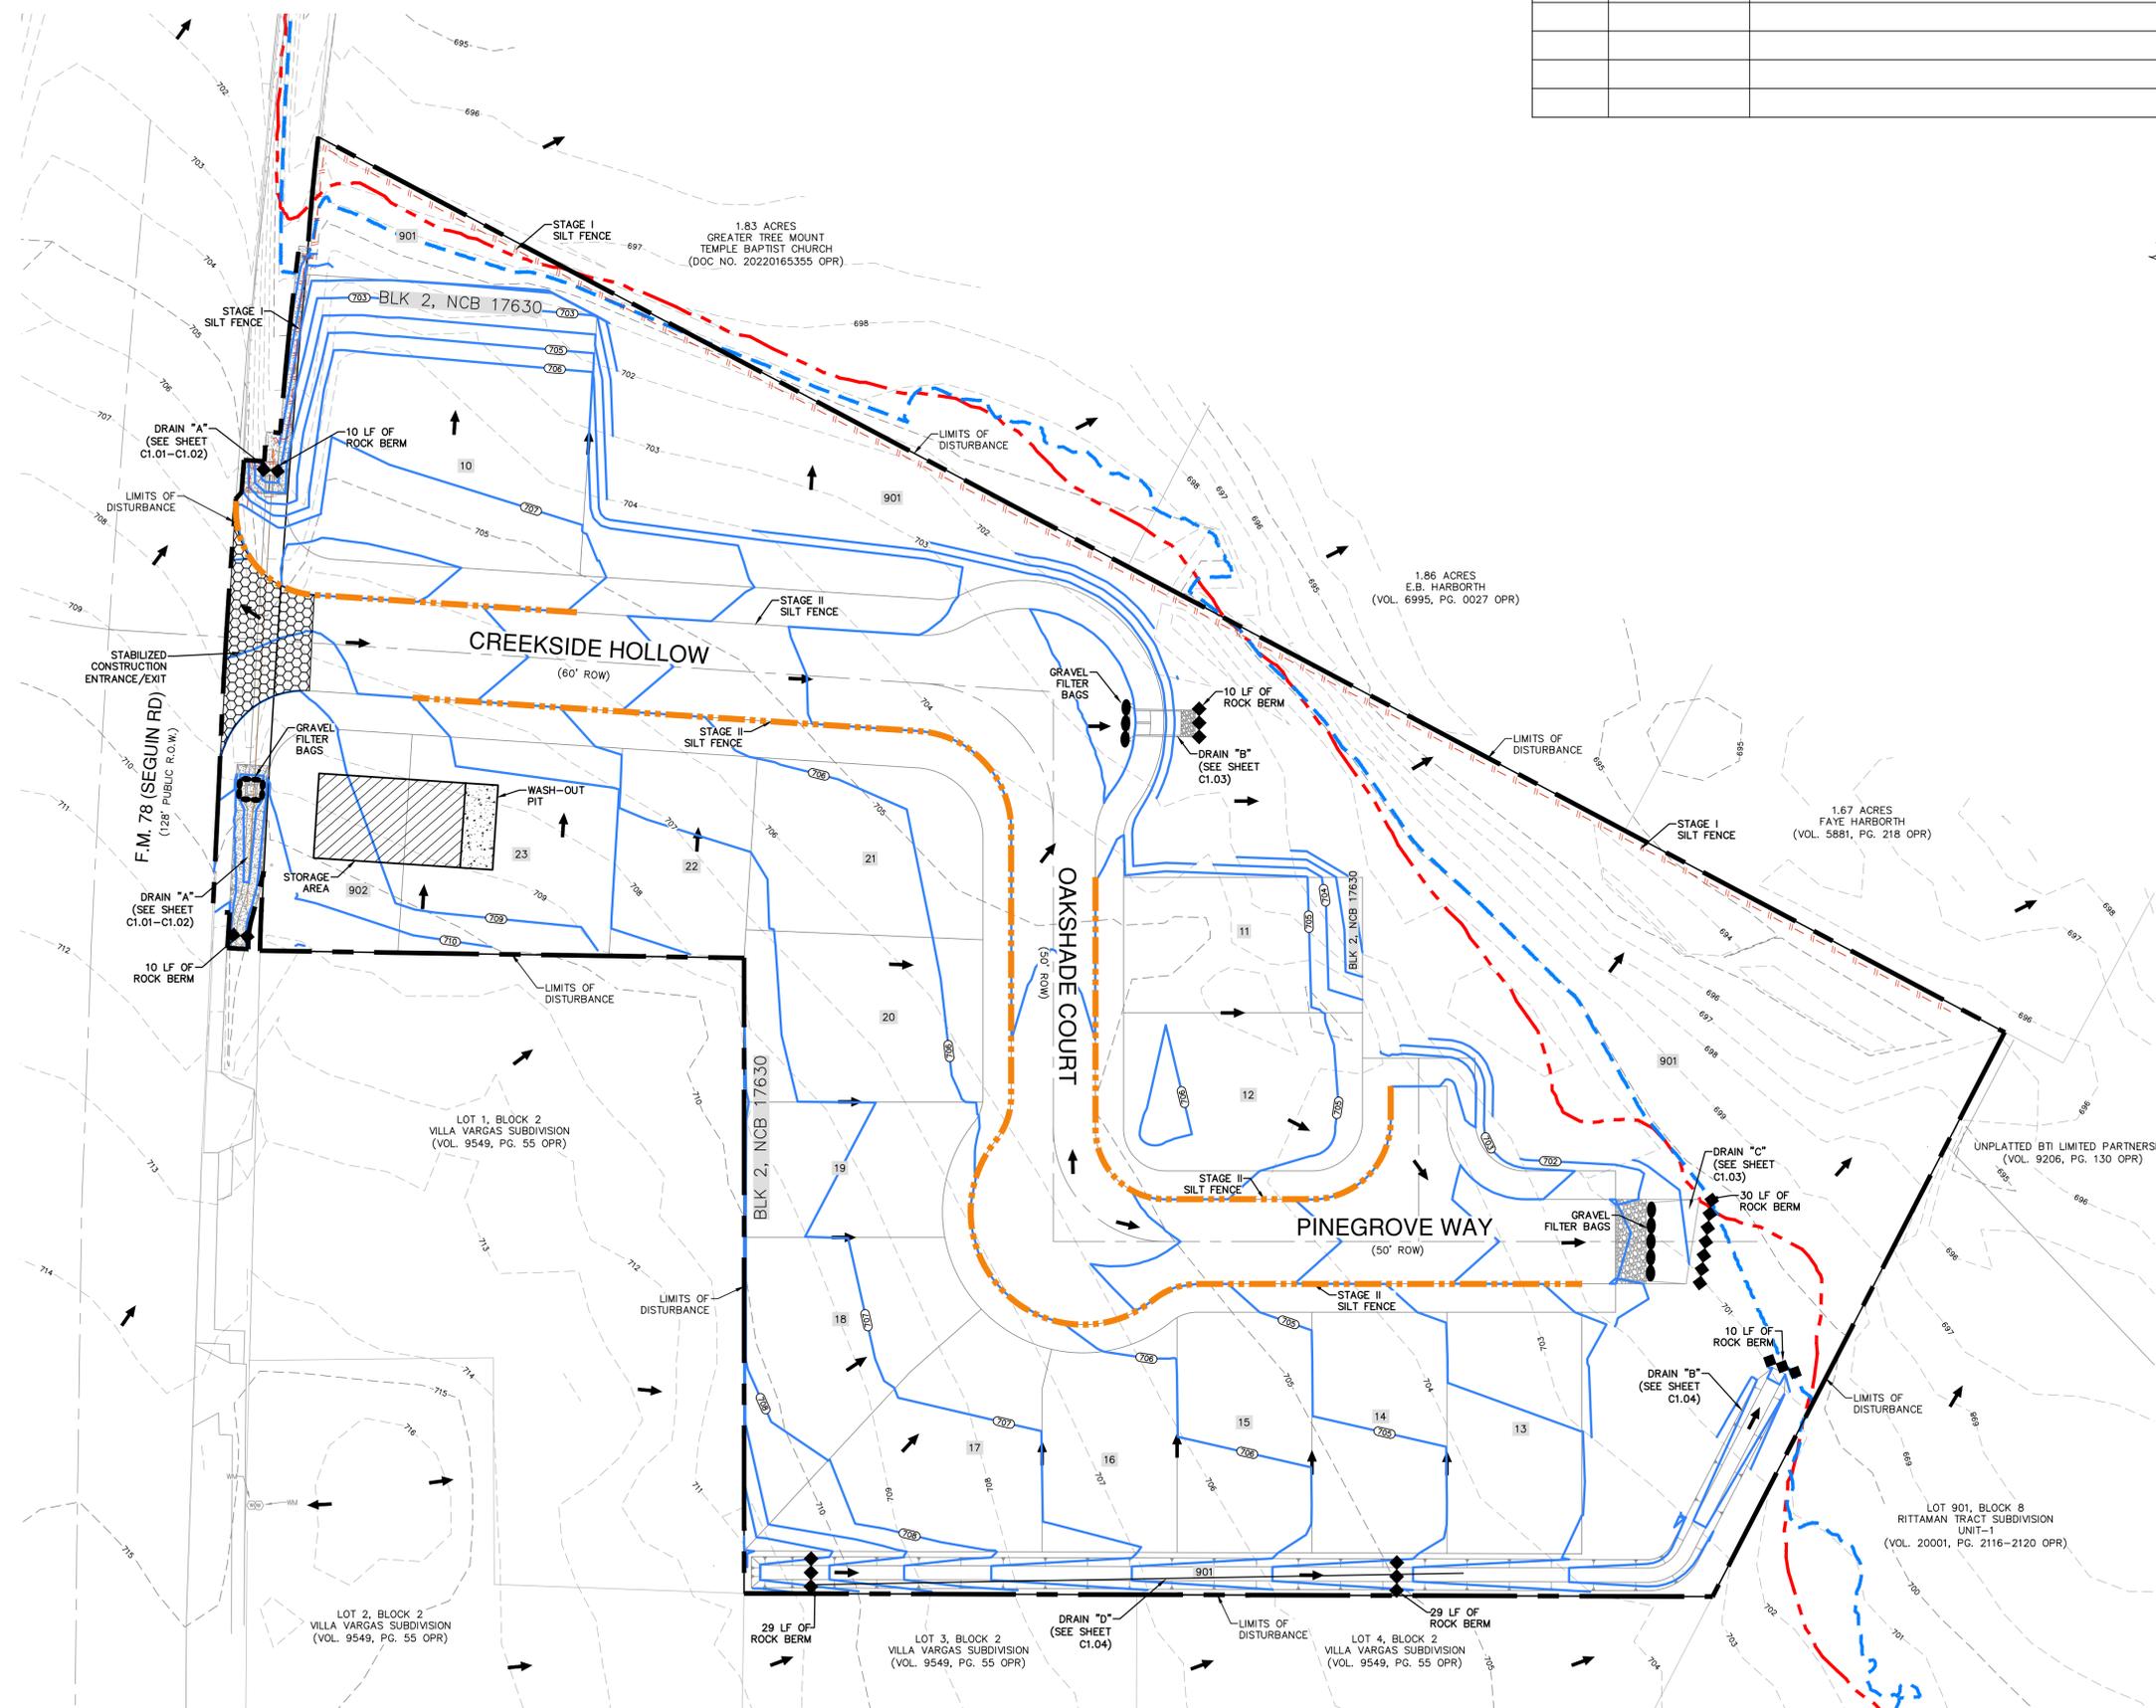

SWP3 MODIFICATIONS		
DATE	SIGNATURE	DESCRIPTION

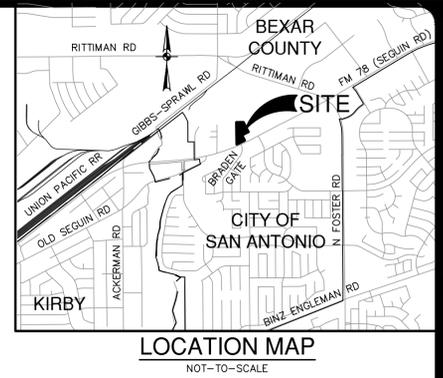

NO.	REVISION	DATE

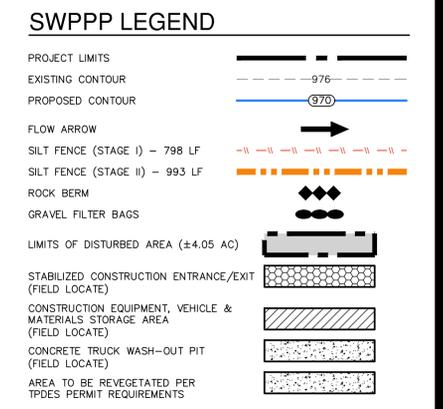

- ### GENERAL NOTES
- DO NOT DISTURB VEGETATED AREAS (TREES, GRASS, WEEDS, BRUSH, ETC.) ANY MORE THAN NECESSARY FOR CONSTRUCTION.
 - CONSTRUCTION ENTRANCE/EXIT LOCATION, CONCRETE WASH-OUT PIT, AND CONSTRUCTION EQUIPMENT AND MATERIAL STORAGE YARD TO BE DETERMINED IN THE FIELD.
 - STORM WATER POLLUTION PREVENTION CONTROLS MAY NEED TO BE MODIFIED IN THE FIELD TO ACCOMPLISH THE DESIRED EFFECT. ALL MODIFICATIONS ARE TO BE NOTED ON THIS EXHIBIT AND SIGNED AND DATED BY THE RESPONSIBLE PARTY.
 - RESTRICT ENTRY/EXIT TO THE PROJECT SITE TO DESIGNATED LOCATIONS BY USE OF ADEQUATE FENCING, IF NECESSARY.
 - ALL STORM WATER POLLUTION PREVENTION CONTROLS ARE TO BE MAINTAINED AND IN WORKING CONDITIONS AT ALL TIMES.
 - FOR A COMPLETE LISTING OF TEMPORARY STORM WATER POLLUTION PREVENTION CONTROLS REFER TO THE TPDES STORM WATER POLLUTION PREVENTION PLAN.
 - STORM WATER POLLUTION PREVENTION STRUCTURES SHOULD BE CONSTRUCTED WITHIN THE SITE BOUNDARIES. SOME OF THESE FEATURES MAY BE SHOWN OUTSIDE THE SITE BOUNDARIES ON THIS PLAN FOR VISUAL CLARITY.
 - AS SOON AS PRACTICAL, ALL DISTURBED SOIL THAT WILL NOT BE COVERED BY IMPERVIOUS COVER SUCH AS PARKWAY AREAS, EASEMENT AREAS, EMBANKMENT SLOPES, ETC. WILL BE STABILIZED PER APPLICABLE PROJECT SPECIFICATIONS.
 - BEST MANAGEMENT PRACTICES MAY BE INSTALLED IN STAGES TO COINCIDE WITH THE DISTURBANCE OF UPGRADIENT AREAS.
 - BEST MANAGEMENT PRACTICES MAY BE REMOVED IN STAGES ONCE THE WATERSHED FOR THAT PORTION CONTROLLED BY THE BEST MANAGEMENT PRACTICES HAS BEEN STABILIZED IN ACCORDANCE WITH TPDES REQUIREMENTS.
 - UPON COMPLETION OF THE PROJECT, INCLUDING SITE STABILIZATION, AND BEFORE FINAL PAYMENT IS ISSUED, CONTRACTOR SHALL REMOVE ALL SEDIMENT AND EROSION CONTROL MEASURES, PAYING SPECIAL ATTENTION TO ROCK BERMS IN DRAINAGE FEATURES.
 - WHERE VEGETATED FILTER STRIPS ARE INDICATED, CONTRACTOR SHALL VERIFY THAT SUFFICIENT VEGETATION EXISTS, OTHERWISE CONTRACTOR SHALL PLACE SILT FENCING IN LIEU OF VEGETATED FILTER STRIP.
 - SHADED AREA DENOTES LIMITS OF DISTURBED AREAS. OTHER AREAS WITHIN THE PROJECT LIMITS WITH THE EXCEPTION OF A CONSTRUCTION EQUIPMENT AND MATERIAL STORAGE YARD, ARE NOT A PART OF THIS TPDES STORM WATER POLLUTION PREVENTION PLAN (SWP3) AND WILL NOT BE DISTURBED BY CIVIL CONSTRUCTION ACTIVITIES. HOUSE CONSTRUCTION ACTIVITIES WILL REQUIRE A SEPARATE STORM WATER POLLUTION PREVENTION PLAN.
 - PRIOR TO BEGINNING CONSTRUCTION, CONTRACTOR SHALL COORDINATE PLACEMENT OF TEMPORARY BEST MANAGEMENT PRACTICES WITHIN 'XDOT RIGHT-OF-WAY WITH XDOT.
 - CPS ENERGY WILL FUNCTION AS A SECONDARY OPERATOR ON THIS PROJECT AND WILL BE INSTALLING ELECTRIC UTILITIES FOR ON-SITE CONSTRUCTION AND OFF-SITE FEED TO THE PROJECT.

THE ENGINEERING SEAL HAS BEEN AFFIXED TO THIS SHEET ONLY FOR THE PURPOSE OF DEMONSTRATING COMPLIANCE WITH THE TPDES-STORM WATER POLLUTION PREVENTION PLAN (SWP3) REGULATIONS.


THIS SHEET HAS BEEN PREPARED FOR PURPOSES OF THE SWP3 ONLY. ALL OTHER CIVIL ENGINEERING RELATED INFORMATION SHOULD BE ACQUIRED FROM THE APPROPRIATE SHEET IN THE CIVIL IMPROVEMENT PLANS.

EXHIBIT 2

PAPE-DAWSON
 2000 NW LOOP 410 | SAN ANTONIO, TX 78213 | 210.375.9000
 TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028800

CREEKS EDGE
 SAN ANTONIO, TEXAS
 STORM WATER POLLUTION PREVENTION PLAN

PLAT NO.	25-11800340
JOB NO.	13657-10
DATE	NOVEMBER 2025
DESIGNER	CB
CHECKED	JA_DRAWN_CB
SHEET	C8.00

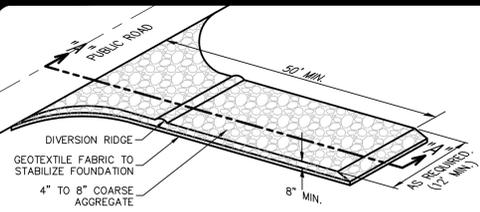

SCHEMATIC OF TEMPORARY CONSTRUCTION ENTRANCE/EXIT

MATERIALS


1. THE AGGREGATE SHOULD CONSIST OF 4-INCH TO 8-INCH WASHED STONE OVER A STABLE FOUNDATION AS SPECIFIED IN THE PLAN.
2. THE AGGREGATE SHOULD BE PLACED WITH A MINIMUM THICKNESS OF 8-INCHES.
3. THE GEOTEXTILE FABRIC SHOULD BE DESIGNED SPECIFICALLY FOR USE AS A SOIL FILTRATION MEDIA WITH AN APPROXIMATE WEIGHT OF 6 OZ/YD², A MULLEN BURST RATING OF 140 LB/IN², AND AN EQUIVALENT OPENING SIZE GREATER THAN A NUMBER 50 SIEVE.
4. IF A WASHING FACILITY IS REQUIRED, A LEVEL AREA WITH A MINIMUM OF 4-INCH DIAMETER WASHED STONE OR COMMERCIAL ROCK SHOULD BE INCLUDED IN THE PLANS. DIVERT WASTEWATER TO A SEDIMENT TRAP OR BASIN.

INSTALLATION

1. AVOID CURVES ON PUBLIC ROADS AND STEEP SLOPES. REMOVE VEGETATION AND OTHER OBJECTIONABLE MATERIAL FROM THE FOUNDATION AREA. GRADE CROWN FOUNDATION FOR POSITIVE DRAINAGE.
2. THE MINIMUM WIDTH OF THE ENTRANCE/EXIT SHOULD BE 12 FEET OR THE FULL WIDTH OF EXIT ROADWAY, WHICHEVER IS GREATER.
3. THE CONSTRUCTION ENTRANCE SHOULD BE AT LEAST 50 FEET LONG.
4. IF THE SLOPE TOWARD THE ROAD EXCEEDS 2%, CONSTRUCT A RIDGE, 6-INCHES TO 8-INCHES HIGH WITH 3:1 (H:V) SIDE SLOPES, ACROSS THE FOUNDATION APPROXIMATELY 15 FEET FROM THE ENTRANCE TO DIVERT RUNOFF AWAY FROM THE PUBLIC ROAD.
5. PLACE GEOTEXTILE FABRIC AND GRADE FOUNDATION TO IMPROVE STABILITY, ESPECIALLY WHERE WET CONDITIONS ARE ANTICIPATED.
6. PLACE STONE TO DIMENSIONS AND GRADE SHOWN ON PLANS. LEAVE SURFACE SMOOTH AND SLOPE FOR DRAINAGE.
7. DIVERT ALL SURFACE RUNOFF AND DRAINAGE FROM THE STONE PAD TO A SEDIMENT TRAP OR BASIN.
8. INSTALL PIPE UNDER PAD AS NEEDED TO MAINTAIN PROPER PUBLIC ROAD DRAINAGE.

STABILIZED CONSTRUCTION ENTRANCE/EXIT DETAIL

NOT-TO-SCALE




SECTION "A-A" OF A CONSTRUCTION ENTRANCE/EXIT

COMMON TROUBLE POINTS

1. INADEQUATE RUNOFF CONTROL—SEDIMENT WASHES ONTO PUBLIC ROAD.
2. STONE TOO SMALL OR GEOTEXTILE FABRIC ABSENT, RESULTS IN MUDDY CONDITION AS STONE IS PRESSED INTO SOIL.
3. PAD TOO SHORT FOR HEAVY CONSTRUCTION TRAFFIC—EXTEND PAD BEYOND THE MINIMUM 50-FOOT LENGTH AS NECESSARY.
4. PAD NOT FLARED SUFFICIENTLY AT ROAD SURFACE, RESULTS IN MUD BEING TRACKED ON TO ROAD AND POSSIBLE DAMAGE TO ROAD.
5. UNSTABLE FOUNDATION—USE GEOTEXTILE FABRIC UNDER PAD AND/OR IMPROVE FOUNDATION DRAINAGE.

INSPECTION AND MAINTENANCE GUIDELINES

1. THE ENTRANCE SHOULD BE MAINTAINED IN A CONDITION, WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT.
2. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY SHOULD BE REMOVED IMMEDIATELY BY CONTRACTOR.
3. WHEN NECESSARY, WHEELS SHOULD BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHT-OF-WAY.
4. WHEN WASHING IS REQUIRED, IT SHOULD BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE THAT DRAINS INTO AN APPROVED SEDIMENT TRAP OR SEDIMENT BASIN.
5. ALL SEDIMENT SHOULD BE PREVENTED FROM ENTERING ANY STORM DRAIN, DITCH OR WATER COURSE BY USING APPROVED METHODS.

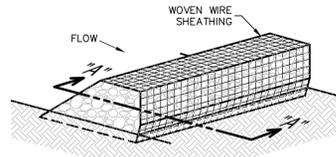


ISOMETRIC PLAN VIEW

ROCK BERMS

THE PURPOSE OF A ROCK BERM IS TO SERVE AS A CHECK DAM IN AREAS OF CONCENTRATED FLOW, TO INTERCEPT SEDIMENT-LADEN RUNOFF, DETAIN THE SEDIMENT AND RELEASE THE WATER IN SHEET FLOW. THE ROCK BERM SHOULD BE USED WHEN THE CONTRIBUTING DRAINAGE AREA IS LESS THAN 5 ACRES. ROCK BERMS ARE USED IN AREAS WHERE THE VOLUME OF RUNOFF IS TOO GREAT FOR A SILT FENCE TO CONTAIN. THEY ARE LESS EFFECTIVE FOR SEDIMENT REMOVAL THAN SILT FENCES, PARTICULARLY FOR FINE PARTICLES, BUT ARE ABLE TO WITHSTAND HIGHER FLOWS THAN A SILT FENCE. AS SUCH, ROCK BERMS ARE OFTEN USED IN AREAS OF CHANNEL FLOWS (DITCHES, GULLIES, ETC.). ROCK BERMS ARE MOST EFFECTIVE AT REDUCING BERM LOAD IN CHANNELS AND SHOULD NOT BE SUBSTITUTED FOR OTHER EROSION AND SEDIMENT CONTROL MEASURES FURTHER UP THE WATERSHED.

INSPECTION AND MAINTENANCE GUIDELINES

1. INSPECTION SHOULD BE MADE WEEKLY AND AFTER EACH RAINFALL BY THE RESPONSIBLE PARTY. FOR INSTALLATIONS IN STREAMBEDS, ADDITIONAL DAILY INSPECTIONS SHOULD BE MADE.
2. REMOVE SEDIMENT AND OTHER DEBRIS WHEN BUILDUP REACHES 6 INCHES AND DISPOSE OF THE ACCUMULATED SILT IN AN APPROVED MANNER THAT WILL NOT CAUSE ANY ADDITIONAL SILTATION.
3. REPAIR ANY LOOSE WIRE SHEATHING.
4. THE BERM SHOULD BE RESHAPED AS NEEDED DURING INSPECTION.
5. THE BERM SHOULD BE REPLACED WHEN THE STRUCTURE CEASES TO FUNCTION AS INTENDED DUE TO SILT ACCUMULATION AMONG THE ROCKS, WASHOUT, CONSTRUCTION TRAFFIC DAMAGE, ETC.
6. THE ROCK BERM SHOULD BE LEFT IN PLACE UNTIL ALL UPSTREAM AREAS ARE STABILIZED AND ACCUMULATED SILT REMOVED.

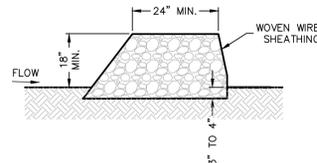

SECTION "A-A"

MATERIALS

1. THE BERM STRUCTURE SHOULD BE SECURED WITH A WOVEN WIRE SHEATHING HAVING MAXIMUM OPENING OF 1 INCH AND A MINIMUM WIRE DIAMETER OF 20 GAUGE GALVANIZED AND SHOULD BE SECURED WITH SHOOT RINGS.
2. CLEAN, OPEN GRADED 3-INCH TO 5-INCH DIAMETER ROCK SHOULD BE USED, EXCEPT IN AREAS WHERE HIGH VELOCITIES OR LARGE VOLUMES OF FLOW ARE EXPECTED, WHERE 5-INCH TO 8-INCH DIAMETER ROCKS MAY BE USED.

INSTALLATION


1. LAY OUT THE WOVEN WIRE SHEATHING PERPENDICULAR TO THE FLOW LINE. THE SHEATHING SHOULD BE 20 GAUGE WOVEN WIRE MESH WITH 1 INCH OPENINGS.
2. BERM SHOULD HAVE A TOP WIDTH OF 2 FEET MINIMUM WITH SIDE SLOPES BEING 2:1 (H:V) OR FLATTER.
3. PLACE THE ROCK ALONG THE SHEATHING AS SHOWN IN THE DIAGRAM TO A HEIGHT NOT LESS THAN 18".
4. WRAP THE WIRE SHEATHING AROUND THE ROCK AND SECURE WITH THE WIRE SO THAT THE ENDS OF THE SHEATHING OVERLAP AT LEAST 2 INCHES, AND THE BERM RETAINS ITS SHAPE WHEN WALKED UPON.
5. BERM SHOULD BE BUILT ALONG THE CONTOUR AT ZERO PERCENT GRADE OR AS NEAR AS POSSIBLE.
6. THE ENDS OF THE BERM SHOULD BE TIED INTO EXISTING UPSLOPE GRADE AND THE BERM SHOULD BE BURIED IN A TRENCH APPROXIMATELY 3 TO 4 INCHES DEEP TO PREVENT FAILURE OF THE CONTROL.

COMMON TROUBLE POINTS


1. INSUFFICIENT BERM HEIGHT OR LENGTH (RUNOFF QUICKLY ESCAPES OVER THE TOP OR AROUND THE SIDES OF BERM).
2. BERM NOT INSTALLED PERPENDICULAR TO FLOW LINE (RUNOFF ESCAPING AROUND ONE SIDE).

ROCK BERM DETAIL

NOT-TO-SCALE

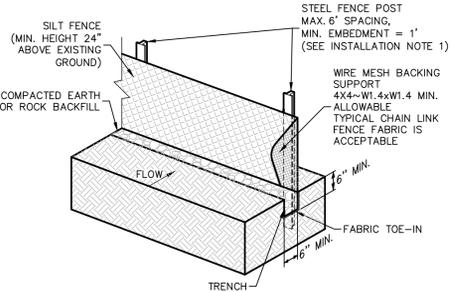

ISOMETRIC PLAN VIEW




LAY SOD IN A STAGGERED PATTERN, BUTT THE STRIPS TIGHTLY AGAINST EACH OTHER. DO NOT LEAVE SPACES AND DO NOT OVERLAP. A SHARPENED MASON'S TROWEL IS A HANDY TOOL FOR TUCKING DOWN THE ENDS AND TRIMMING PIECES.

BUTTING—ANGLED ENDS CAUSED BY THE AUTOMATIC SOD CUTTER MUST BE MATCHED CORRECTLY.




APPEARANCE OF GOOD SOD


1. ROLL SOD IMMEDIATELY TO ACHIEVE FIRM CONTACT WITH THE SOIL.
2. WATER TO A DEPTH OF 4" AS NEEDED. WATER WELL AS SOON AS THE SOD IS LAID.
3. MOW WHEN THE SOD IS ESTABLISHED—IN 2-3 WEEKS. SET THE MOWER HIGH (2"-3").



SOD INSTALLATION



USE PEGS OR STAPLES TO FASTEN SOD FIRMLY—AT THE ENDS OF STRIPS AND IN THE CENTER, OR EVERY 3-4 FEET IF THE STRIPS ARE LONG. WHEN READY TO MOW, DRIVE PEGS OR STAPLES FLUSH WITH THE GRASS.



IN CRITICAL AREAS, SECURE SOD WITH NETTING. USE STAPLES.

MATERIALS

1. SOD SHOULD BE MACHINE CUT AT A UNIFORM SOIL THICKNESS OF 3/4" INCH (± 1/4" INCH) AT THE TIME OF CUTTING. THIS THICKNESS SHOULD EXCLUDE SHOOT GROWTH AND THATCH.
2. PIECES OF SOD SHOULD BE CUT TO THE SUPPLIER'S STANDARD WIDTH AND LENGTH, WITH A MAXIMUM ALLOWABLE DEVIATION IN ANY DIMENSION OF 5% TORN OR UNEVEN PADS SHOULD NOT BE ACCEPTABLE.
3. STANDARD SIZE SECTIONS OF SOD SHOULD BE STRONG ENOUGH TO SUPPORT THEIR OWN WEIGHT AND REMAIN THEIR SIZE AND SHAPE WHEN SUSPENDED FROM A FIRM GRASP ON ONE END OF THE SECTION.
4. SOD SHOULD BE HARVESTED, DELIVERED, AND INSTALLED WITHIN A PERIOD OF 36 HOURS.

SITE PREPARATION

1. PRIOR TO SOD PREPARATION, AREAS TO BE SODDED SHOULD BE BROUGHT TO FINAL GRADE IN ACCORDANCE WITH THE APPROVED PLAN.
2. THE SURFACE SHOULD BE CLEARED OF ALL TRASH, DEBRIS AND OF ALL ROOTS, BRUSH, WIRE, GRADE STAKES AND OTHER OBJECTS THAT WOULD INTERFERE WITH PLANTING, FERTILIZING OR MAINTENANCE OPERATIONS.
3. FERTILIZE ACCORDING TO SOIL TESTS. FERTILIZER NEEDS CAN BE DETERMINED BY A SOIL TESTING LABORATORY OR REGIONAL RECOMMENDATIONS CAN BE MADE BY COUNTY AGRICULTURAL EXTENSION AGENTS. FERTILIZER SHOULD BE WORKED INTO THE SOIL TO A DEPTH OF 3 INCHES WITH A DISC, SPRINGTOOTH HARROW OR OTHER SUITABLE EQUIPMENT ON SLOPING LAND, THE FINAL HARROWING OR DISCING OPERATION SHOULD BE ON THE CONTOUR.

INSTALLATION IN CHANNELS

1. SOD STRIPS IN WATERWAYS SHOULD BE LAID PERPENDICULAR TO THE DIRECTION OF FLOW. CARE SHOULD BE TAKEN TO BUTT ENDS OF STRIPS TIGHTLY (SEE FIGURE ABOVE).
2. AFTER ROLLING OR TAMPING, SOD SHOULD BE PEGGED OR STAPLED TO RESIST WASHOUT DURING THE ESTABLISHMENT PERIOD. MESH OR OTHER NETTING MAY BE PEGGED OVER THE SOD FOR EXTRA PROTECTION IN CRITICAL AREAS.

SOD INSTALLATION DETAIL

NOT-TO-SCALE

GENERAL INSTALLATION (VA. DEPT. OF CONSERVATION, 1992)

1. SOD SHOULD NOT BE CUT OR LAID IN EXCESSIVELY WET OR DRY WEATHER. SOD ALSO SHOULD NOT BE LAID ON SOIL SURFACES THAT ARE FROZEN.
2. DURING PERIODS OF HIGH TEMPERATURE, THE SOIL SHOULD BE LIGHTLY IRRIGATED IMMEDIATELY PRIOR TO LAYING THE SOD, TO COOL THE SOIL AND REDUCE ROOT BURNING AND DIEBACK.
3. THE FIRST ROW OF SOD SHOULD BE LAID IN A STRAIGHT LINE WITH SUBSEQUENT ROWS PLACED PARALLEL TO AND BUTTING TIGHTLY AGAINST EACH OTHER. LATERAL JOINTS SHOULD BE STAGGERED TO PROMOTE MORE UNIFORM GROWTH AND STRENGTH. CARE SHOULD BE EXERCISED TO ENSURE THAT SOD IS NOT STRETCHED OR OVERLAPPED AND THAT ALL JOINTS ARE BUTTED TIGHT IN ORDER TO PREVENT VOIDS WHICH WOULD CAUSE DRYING OF THE ROOTS (SEE FIGURE ABOVE).
4. ON SLOPES 3:1 OR GREATER, OR WHEREVER EROSION MAY BE A PROBLEM, SOD SHOULD BE LAID WITH STAGGERED JOINTS AND SECURED BY STAPLING OR OTHER APPROVED METHODS. SOD SHOULD BE INSTALLED WITH THE LENGTH PERPENDICULAR TO THE SLOPE (ON CONTOUR).
5. AS SODDING OF CLEARLY DEFINED AREAS IS COMPLETED, SOD SHOULD BE ROLLED OR TAMPED TO PROVIDE FIRM CONTACT BETWEEN ROOTS AND SOIL.
6. AFTER ROLLING, SOD SHOULD BE IRRIGATED TO A DEPTH SUFFICIENT THAT THE UNDERSIDE OF THE SOD PAD AND THE SOIL 4 INCHES BELOW THE SOD IS THOROUGHLY WET.
7. UNTIL SUCH TIME A GOOD ROOT SYSTEM BECOMES DEVELOPED, IN THE ABSENCE OF ADEQUATE RAINFALL, WATERING SHOULD BE PERFORMED AS OFTEN AS NECESSARY TO MAINTAIN MOIST SOIL TO A DEPTH OF AT LEAST 4 INCHES.
8. THE FIRST MOWING SHOULD NOT BE ATTEMPTED UNTIL THE SOD IS FIRMLY ROOTED, USUALLY 2-3 WEEKS. NOT MORE THAN ONE THIRD OF THE GRASS LEAF SHOULD BE REMOVED AT ANY ONE CUTTING.

INSPECTION AND MAINTENANCE GUIDELINES

1. SOD SHOULD BE INSPECTED WEEKLY AND AFTER EACH RAIN EVENT TO LOCATE AND REPAIR ANY DAMAGE.
2. DAMAGE FROM STORMS OR NORMAL CONSTRUCTION ACTIVITIES SUCH AS TIRE RUTS OR DISTURBANCE OF SWALE STABILIZATION SHOULD BE REPAIRED AS SOON AS PRACTICAL.

SILT FENCE

A SILT FENCE IS A BARRIER CONSISTING OF GEOTEXTILE FABRIC SUPPORTED BY METAL POSTS TO PREVENT SOIL AND SEDIMENT LOSS FROM A SITE. WHEN PROPERLY USED, SILT FENCES CAN BE HIGHLY EFFECTIVE AT CONTROLLING SEDIMENT FROM DISTURBED AREAS. THEY CAUSE RUNOFF TO POND, ALLOWING HEAVIER SOLIDS TO SETTLE OUT. IF NOT PROPERLY INSTALLED, SILT FENCES ARE NOT LIKELY TO BE EFFECTIVE.

THE PURPOSE OF A SILT FENCE IS TO INTERCEPT AND DETAIN WATER-BORN SEDIMENT FROM UNPROTECTED AREAS OF A LIMITED EXTENT. SILT FENCE IS USED DURING THE PERIOD OF CONSTRUCTION NEAR THE PERIMETER OF A DISTURBED AREA TO INTERCEPT SEDIMENT WHILE ALLOWING WATER TO PERCOLATE THROUGH. THIS FENCE SHOULD REMAIN IN PLACE UNTIL THE DISTURBED AREA IS PERMANENTLY STABILIZED. SILT FENCE SHOULD NOT BE USED WHERE THERE IS A CONCENTRATION OF WATER IN A CHANNEL OR DRAINAGE WAY. IF CONCENTRATED FLOW OCCURS AFTER INSTALLATION, CORRECTIVE ACTION MUST BE TAKEN SUCH AS PLACING A ROCK BERM IN THE AREAS OF CONCENTRATED FLOW.

SILT FENCING WITHIN THE SITE MAY BE TEMPORARILY MOVED DURING THE DAY TO ALLOW CONSTRUCTION ACTIVITY PROVIDED IT IS REPLACED AND PROPERLY ANCHORED TO THE GROUND AT THE END OF THE DAY. SILT FENCES ON THE PERIMETER OF THE SITE OR AROUND DRAINAGE WAYS SHOULD NOT BE MOVED AT ANY TIME.

MATERIALS


1. SILT FENCE MATERIAL SHOULD BE POLYPROPYLENE, POLYETHYLENE, OR POLYAMIDE WOVEN OR NONWOVEN FABRIC. THE FABRIC SHOULD BE 36 INCHES, WITH A MINIMUM UNIT WEIGHT OF 4.5 OZ/YD, MULLEN BURST STRENGTH EXCEEDING 190 LB/IN², ULTRAVIOLET STABILITY EXCEEDING 70%, AND MINIMUM APPARENT OPENING SIZE OF U.S. SIEVE NUMBER 30.
2. FENCE POSTS SHOULD BE MADE OF HOT ROLLED STEEL, AT LEAST 4 FEET LONG WITH TEE OR Y-BAR CROSS SECTION, SURFACE PAINTED OR GALVANIZED, MINIMUM WEIGHT 1.25 LB/FT, AND BRINDELL HARDNESS EXCEEDING 40.
3. WOVEN WIRE BACKING TO SUPPORT THE FABRIC SHOULD BE GALVANIZED 2" X 4" WELDED WIRE, 12 GAUGE MINIMUM.

INSTALLATION


1. STEEL POSTS, WHICH SUPPORT THE SILT FENCE, SHOULD BE INSTALLED ON A SLIGHT ANGLE TOWARD THE ANTICIPATED RUNOFF SOURCE. POSTS MUST BE EMBEDDED A MINIMUM OF 1-FOOT DEEP AND SPACED NOT MORE THAN 8 FEET ON CENTER. WHERE WATER CONCENTRATES, THE MAXIMUM SPACING SHOULD BE 6 FEET.
2. LAY OUT FENCING DOWN-SLOPE OF DISTURBED AREA, FOLLOWING THE CONTOUR AS CLOSELY AS POSSIBLE. THE FENCE SHOULD BE SITED SO THAT THE MAXIMUM DRAINAGE AREA IS ¼ ACRE/100 FEET OF FENCE.

SILT FENCE DETAIL

NOT-TO-SCALE

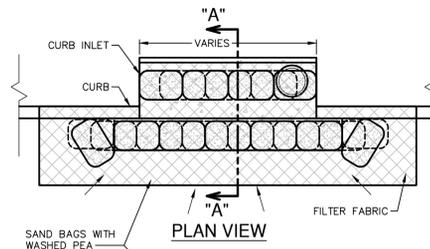

PLAN VIEW

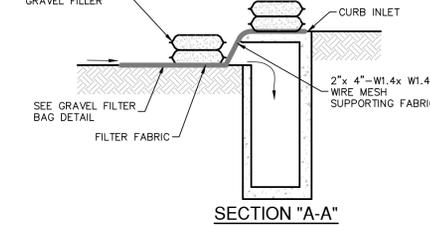

SECTION "A-A"

GENERAL NOTES


1. CONTRACTOR TO INSTALL 2"x4"-W1.4xW1.4 WIRE MESH SUPPORTING FILTER FABRIC OVER THE INLET OPENING. FABRIC MUST BE SECURED TO WIRE BACKING WITH CLIPS OR WIRE TIES AT THIS LOCATION. SAND BAGS FILLED WITH WASHED PEA GRAVEL SHOULD BE PLACED ON TOP OF WIRE MESH ON TOP OF THE INLET AS SHOWN ON THIS DETAIL TO HOLD WIRE MESH IN PLACE. SANDBAGS FILLED WITH WASHED PEA GRAVEL SHOULD ALSO BE PLACED ALONG THE CUTTER AS SHOWN ON THIS DETAIL TO HOLD WIRE MESH IN PLACE. SAND BAGS TO BE STACKED TO FORM A CONTINUOUS BARRIER AROUND INLETS.
2. THE BAGS SHOULD BE TIGHTLY ABUTTED AGAINST EACH OTHER TO PREVENT RUNOFF FROM FLOWING BETWEEN THE BAGS.

INSPECTION AND MAINTENANCE GUIDELINES


1. INSPECTION SHOULD BE MADE WEEKLY AND AFTER EACH RAINFALL. REPAIR OR REPLACEMENT SHOULD BE MADE PROMPTLY AS NEEDED BY THE CONTRACTOR.
2. REMOVE SEDIMENT WHEN BUILDUP REACHES A DEPTH OF 3 INCHES. REMOVED SEDIMENT SHOULD BE DEPOSITED IN A SUITABLE AREA AND IN SUCH A MANNER THAT IT WILL NOT ERODE.
3. CHECK PLACEMENT OF DEVICE TO PREVENT GAPS BETWEEN DEVICE AND CURB.
4. INSPECT FILTER FABRIC AND PATCH OR REPLACE IF TORN OR MISSING.
5. STRUCTURES SHOULD BE REMOVED AND THE AREA STABILIZED ONLY AFTER THE REMAINING DRAINAGE AREA HAS BEEN PROPERLY STABILIZED.

BAGGED GRAVEL CURB INLET PROTECTION DETAIL

NOT-TO-SCALE

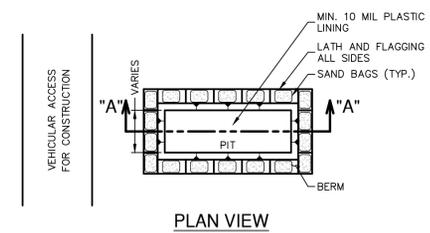

PLAN VIEW



SECTION "A-A"

GENERAL NOTES

1. DETAIL ABOVE ILLUSTRATES MINIMUM DIMENSIONS. PIT CAN BE INCREASED IN SIZE DEPENDING ON EXPECTED FREQUENCY OF USE.
2. WASHOUT PIT SHALL BE LOCATED IN AN AREA EASILY ACCESSIBLE TO CONSTRUCTION TRAFFIC.
3. WASHOUT PIT SHALL NOT BE LOCATED IN AREAS SUBJECT TO INUNDATION FROM STORM WATER RUNOFF.
4. LOCATE WASHOUT AREA AT LEAST 50 FEET FROM SENSITIVE FEATURES, STORM DRAINS, OPEN DITCHES OR WATER BODIES.
5. TEMPORARY CONCRETE WASHOUT FACILITY SHOULD BE CONSTRUCTED WITH SUFFICIENT QUANTITY AND VOLUME TO CONTAIN ALL LIQUID AND CONCRETE WASTE GENERATED BY WASHOUT OPERATIONS.

MATERIALS


PLASTIC LINING MATERIAL SHOULD BE A MINIMUM OF 10 MIL IN POLYETHYLENE SHEETING AND SHOULD BE FREE OF HOLES, TEARS, OR OTHER DEFECTS THAT COMPROMISE THE IMPERMEABILITY OF THE MATERIAL.

MAINTENANCE


1. WHEN TEMPORARY CONCRETE WASHOUT FACILITIES ARE NO LONGER REQUIRED FOR THE WORK, THE HARDENED CONCRETE SHOULD BE REMOVED AND DISPOSED OF.
2. MATERIALS USED TO CONSTRUCT TEMPORARY CONCRETE WASHOUT FACILITIES SHOULD BE REMOVED FROM THE SITE OF THE WORK AND DISPOSED OF.
3. HOLES, DEPRESSIONS OR OTHER GROUND DISTURBANCES CAUSED BY THE REMOVAL OF THE TEMPORARY CONCRETE WASHOUT FACILITIES SHOULD BE BACKFILLED AND REPAIRED.

CONCRETE TRUCK WASHOUT PIT DETAIL


NOT-TO-SCALE

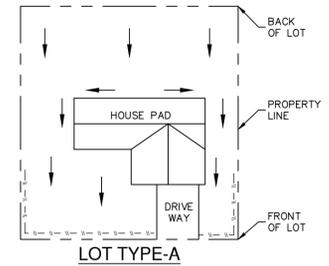

LOT TYPE-A

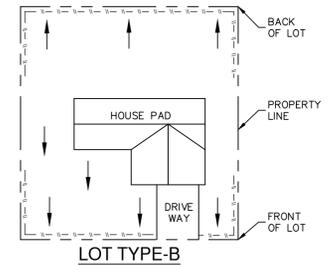

LOT TYPE-B

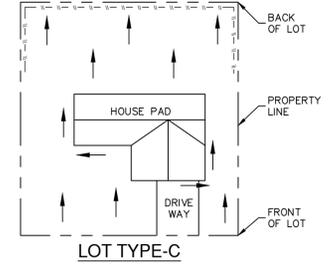

LOT TYPE-C


NOTE: SILT FENCE TO BE INSTALLED PER THESE DETAILS AND LOCATED ON THE DOWNGRADIENT SIDE OF EACH LOT LINE OR LIMITS OF CLEARING AS GENERALLY SHOWN ON THE OVERALL SITE PLAN.

LEGEND

--- SILT FENCE
--- DRAINAGE FLOW

TYPICAL HOUSE LOT LAYOUTS

NOT-TO-SCALE

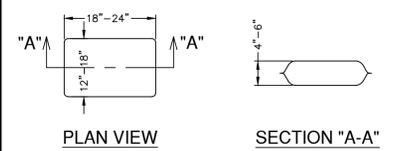

PLAN VIEW


SECTION "A-A"

NOTES:
1. THE FILTER BAG MATERIAL SHALL BE MADE OF POLYPROPYLENE, POLYETHYLENE OR POLYAMIDE WOVEN FABRIC, MIN. UNIT WEIGHT OF 4 OUNCES/SY, HAVE A MULLEN BURST STRENGTH EXCEEDING 300 PSI AND ULTRAVIOLET STABILITY EXCEEDING 70%.

2. THE FILTER BAG SHALL BE FILLED WITH CLEAN, MEDIUM WASHED PEA GRAVEL TO COARSE GRAVEL (0.31 TO 0.75 INCH DIAMETER).
3. SAND SHALL NOT BE USED TO FILL THE FILTER BAGS.

GRAVEL FILTER BAG DETAIL

NOT-TO-SCALE

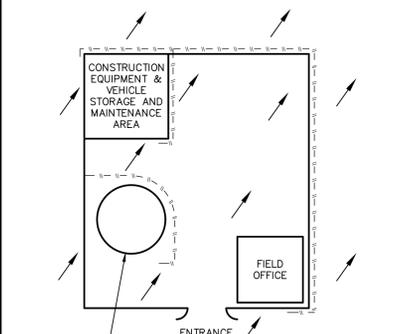

CONSTRUCTION STAGING AREA

NOT-TO-SCALE

LEGEND
--- SILT FENCE
--- FLOW ARROWS

CONSTRUCTION STAGING AREA

THIS SHEET HAS BEEN PREPARED FOR PURPOSES OF THE SWP3 ONLY. ALL OTHER CIVIL ENGINEERING RELATED INFORMATION SHOULD BE ACQUIRED FROM THE APPROPRIATE SHEET IN THE CIVIL IMPROVEMENT PLANS.

EXHIBIT 3

DATE	
NO.	
REVISION	



PAPE-DAWSON
2000 NW LOOP 410 | SAN ANTONIO, TX 78213 | 210.375.9000
TEXAS ENGINEERING FIRM #470 | TEXAS SURVEYING FIRM #10028800

CREEKS EDGE
SAN ANTONIO, TEXAS

STORM WATER POLLUTION PREVENTION PLAN DETAILS

PLAT NO.	25-11800340
JOB NO.	13657-10
DATE	NOVEMBER 2025
DESIGNER	
CHECKED	
DRAWN	
SHEET	C8.10