TABLE OF CONTENTS	
Sheet Number	Sheet Title
C0.00	GENERAL NOTES
STORMWATER POLLUTION PREVENTION PLAN	
C1.00	STORM WATER POLLUTION PREVENTION PLAN
C1.D1	STORM WATER POLLUTION PREVENTION DETAILS*
GRADING CONSTRUCTION PLANS	
C2.00	GRADING PLAN
UTILITY CONSTRUCTION PLANS	
C3.00	UTILITY LAYOUT PLAN
SANITARY SEWER CONSTRUCTION PLANS	
C4.00	SANITARY SEWER MASTER PLAN
C4.01	SANITARY SEWER PLAN & PROFILE - LINE 'P'
C4.02	SANITARY SEWER PLAN & PROFILE - LINE 'Q'
C4.03	SANITARY SEWER PLAN & PROFILE - LINE 'R'
C4.D1	SANITARY SEWER STANDARD NOTES AND DETAILS*
C4.D2	SANITARY SEWER STANDARD NOTES AND DETAILS*
WATER DISTRIBUTION CONSTRUCTION PLANS	
C5.00	WATER DISTRIBUTION PLAN
C5.D1	WATER DISTRIBUTION STANDARD NOTES AND DETAILS*
C5.D2	WATER DISTRIBUTION STANDARD NOTES AND DETAILS*
DRAINAGE CONSTRUCTION PLANS	
C6.00	DRAINAGE MASTER PLAN - ULTIMATE CONDITIONS
C6.01	OVERALL DRAINAGE MASTER PLAN CALCULATIONS
C6.02	DRAINAGE PLAN & PROFILE - DRAIN '7A'
C6.03	DRAINAGE PLAN & PROFILE - DRAIN '7B'
C6.D1	CONCRETE RIPRAP AND INLET DETAILS*
C6.D2	JUNCTION BOX AND INLET DETAILS*
STREET CONSTRUCTION PLANS	
C7.00	STREET PLAN & PROFILE - DALLOWAY BLVD.
C7.01	STREET PLAN & PROFILE - PENHOLLOW DR. AND MOONWOOD AVE.
C7.02	STREET PLAN & PROFILE - FRASER RIDGE
C7.03	STREET PLAN & PROFILE - BLYTHE AVE.
C7.D1	STANDARD STREET DETAILS*
C7.D2	STANDARD STREET DETAILS*
C7.D3	STANDARD STREET DETAILS*
C7.D4	STANDARD STREET DETAILS*
TRAFFIC CONSTRUCTION PLANS	
C8.00	TRAFFIC SIGNAGE PLAN
C8.D1	TRAFFIC PLAN SIGNAGE DETAILS*
C8.D2	TRAFFIC PLAN SIGNAGE DETAILS*

* DENOTES STANDARD DETAILS ADOPTED FOR USE ON THIS PROJECT

LOCATION MAP



VICINITY MAP

GRACE VALLEY RANCH
PHASE 7

CONSTRUCTION PLANS

DEVELOPER:

LENNAR HOMES OF TEXAS LAND AND CONSTRUCTION, LTD.
CONTACT: RICHARD MOTT, P.E.
100 NE LOOP 410, SUITE 1155
SAN ANTONIO, TEXAS 78216
TEL: (210) 403-6282

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

DRAWN BY	DATE	PLAT NO.
AR/JF/RB	10/15/2025	
CHECKED BY	**PROJECT NO.**	**CUDE ENGINEERS**
KYLE HUDEK, P.E.	03499.009	TBPE No. 455 TBPLS No. 10048500

I HAVE REVIEWED THIS PLAN SET FOR QUALITY ASSURANCE AND QUALITY CONTROL PURPOSES.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER

10/15/2025

THIS PLAN SET HAS BEEN PREPARED, DESIGNED AND REVIEWED UNDER MY DIRECT SUPERVISION.

STREET AND DRAINAGE GENERAL NOTES:

1. ALL WORK IS TO BE INSTALLED IN ACCORDANCE WITH STANDARDS OF THE CITY OF SANTA CLARA MATERIALS AND CONSTRUCTION PROCEDURES WITHIN THE SCOPE OF THIS CONTRACT WILL CONFORM TO APPLICABLE CITY OF SANTA CLARA SUBDIVISION REGULATIONS AND, STANDARD SPECIFICATIONS AND DETAILS.

2. FOR ALL REFERENCES TO THE TEXAS DEPARTMENT OF TRANSPORTATION (TXDOT), THE CONTRACTOR SHALL SEE THEIR CURRENT STANDARD SPECIFICATIONS FOR CONSTRUCTION AND MAINTENANCE OF HIGHWAYS, STREETS, AND BRIDGES, WHICH IS ALSO LOCATED AT WWW.TXDOT.GOV.

3. ALL CONCRETE SHALL BE AS DETAILED ON THE PLAN SHEETS AND MEET MATERIAL REQUIREMENTS OF THE CITY OF SANTA CLARA.

4. ALL REINFORCING STEEL SHALL BE GRADE 60, MEET THE MATERIAL AND CONSTRUCTION REQUIREMENTS OF THE CITY OF SANTA CLARA.

5. CONCRETE CURING SHALL BE WITH AN IMPERVIOUS MEMBRANE APPLICATION AND SHALL MEET THE MATERIAL AND APPLICATION REQUIREMENTS OF THE CITY OF SAN ANTONIO'S "MEMBRANE CURING" AND BE LISTED ON THE GUADALUPE COUNTY APPROVED LIST OF SUPPLIERS IN ADDITION TO THE CONTRACTOR APPLYING THE CURING COMPOUND THEY ARE TO INSTALL CONTRACTION/EXPANSION JOINTS ON CONCRETE WORK.

6. ALL CONCRETE CONSTRUCTION AND FINISHING SHALL MEET THE REQUIREMENTS OF THE CITY OF SANTA CLARA.

7. PRIOR TO THE COMMENCEMENT OF ANY WORK, THE COUNTY SHALL ATTEND A PRECONSTRUCTION MEETING INCLUDING (BUT NOT LIMITED TO: THE CITY, ENGINEER, CONTRACTOR, DEVELOPER'S INSPECTION REPRESENTATIVE, AND DEVELOPER'S CONSTRUCTION MATERIAL TESTING REPRESENTATIVE.

8. DURING CONSTRUCTION, NOTIFY THE COUNTY AT CONSTRUCTION@CO.GUADALUPE.TX.US AT LEAST **48 HOURS** IN ADVANCE OF ANY WORK TO BE PERFORMED AFFECTING SUBGRADE, BASE, OR PAVEMENT INCLUDING BACKFILL OF ANY PROPOSED UTILITIES UNDERNEATH THE PAVEMENT AND FILL AREAS UPON WHICH PAVEMENT IS PROPOSED TO BE PLACED. SUCH NOTIFICATION IS ALSO REQUIRED BEFORE IMPLEMENTING ANY APPROVED TRAFFIC CONTROL PLANS ON EXISTING COUNTY MAINTAINED ROADS. FULL CLOSURE OF COUNTY ROADS REQUIRES AT LEAST **ONE MONTH** ADVANCE NOTICE AND IS SUBJECT TO THE DISCRETION OF THE COUNTY ENGINEER AND POSSIBLE APPROVAL BY GUADALUPE COUNTY COMMISSIONERS COURT PER TRANSPORTATION CODE, CHAPTER 251.

9. DURING CONSTRUCTION, PROVIDE ALL INSPECTION AND TESTING REPORTS TO THE COUNTY AT CONSTRUCTION@CO.GUADALUPE.TX.US AS SOON AS AVAILABLE FOR IDENTIFICATION AND CORRECTION OF ANY EMERGING DEFICIENCIES.

10. PROVIDE AS-BUILT DRAWINGS WITHIN **10 BUSINESS DAYS** OF THE COMPLETION OF CONSTRUCTION.

11. GUADALUPE COUNTY DOES NOT MAINTAIN SIDEWALKS, CURB AND GUTTER, CURB RAMPS, PAVERS, LUMINAIRES, STORM SEWER OR DETENTION APPURTENANCES.

12. MANHOLES SHALL BE BROKEN BELOW THE FINISH GRADE LEVEL UNTIL THE BASE IS COMPLETED AND THEN RESTORED.

13. THE ENGINEER WILL STAKE THE STREET ONE TIME ONLY AND FURNISH CUT SHEETS TO THE STREET CONTRACTOR: ANY CONSTRUCTION STAKES REMOVED OR DESTROYED BY THE CONTRACTOR OR HIS EMPLOYEES WILL BE REPLACED AT THE CONTRACTOR'S EXPENSE.

14. AN INDEPENDENT TESTING LABORATORY APPROVED BY THE CITY OF SANTA CLARA SHALL PERFORM ALL "FIELD AND LABORATORY TESTING." THE CITY REQUIRES ALL INSPECTION AND/OR TESTING FIRMS TO BE ACCREDITED, QUALIFIED, AND IN COMPLIANCE WITH THE REQUIREMENTS OF ASTM E329, "STANDARD SPECIFICATION FOR AGENCIES ENGAGED IN CONSTRUCTION INSPECTION AND/OR TESTING." FIRMS MUST PRESENT A COPY OF THEIR CURRENT, OFFICIAL ACCREDITATION BY THE AMERICAN ASSOCIATION FOR LABORATORY ACCREDITATION (A2LA) OR THE AMERICAN ASSOCIATION OF STATE HIGHWAY AND TRANSPORTATION OFFICIALS (AASHTO) AND CURRENT AMRL AND CCRL PROFICIENCY RESULTS. THE FIRMS SHALL BE ACCREDITED IN ALL MATERIAL TEST PROCEDURES REQUIRED TO BE PERFORMED FOR EACH PROJECT.

15. THE DEVELOPER WILL HIRE A THIRD PARTY FOR CONSTRUCTION MATERIAL TESTING IN WHICH THE CONTRACTOR WILL REQUIRE TO COORDINATE AND PROVIDE NECESSARY INFORMATION TO THEM.THE FOLLOWING TEST SCHEDULE SHALL BE ADHERE TO:

    A. ALL IMPORT FILL PLACED IN THE STREET'S SUBGRADE SHALL BE SELECT MATERIAL, WITH A PLASTICITY INDEX LESS THAN TWENTY (20), AND COMPACTED IN MAXIMUM EIGHT (8) INCH LIFTS TO 98% DENSITY OF TXDOTS TEST METHOD TEX 113-E PROVIDE TESTING ON EACH EIGHT (8) INCH COMPACTED LIFT. SUBGRADE MOISTURE DENSITY TESTING SHALL BE AT THE MINIMUM FREQUENCY OF THREE (3) PER BLOCK AND SHALL NOT TO EXCEED ONE-HUNDRED AND TWENTY (120) FOOT SPACING.

    B. FLEXIBLE BASE TESTING SHALL INCLUDE - P.I., LL, GRADATION, AND WET BALL MILL OF MATERIAL SHALL BE TESTED UPON DELIVERY TO THE PROJECT AND AS DIRECTED BY THE CITY. MOISTURE DENSITY TESTING SHALL BE AT THE MINIMUM RATE OF THREE (3) PER BLOCK AND SHALL NOT TO EXCEED FIVE HUNDRED (500) FOOT SPACING. THE QUALITY CONTROL TEST ON THE MATERIALS SHALL BE PERFORMED BY THE CONTRACTOR'S CITY APPROVED TESTING FIRM. IN-PLACE DENSITY SHALL MEET THE REQUIREMENTS DETAILED IN THE CITY'S SUBDIVISION REGULATIONS.

    C. HOT AND WARM MIX ASPHALTIC CONCRETE (HMAC/WMAC) DENSITY - IN PLACE DENSITY TESTING SHALL RESULT BETWEEN 92% AND 97% OF THE MAXIMUM THEORETICAL GRAVITY PER TEX 207-F. A SET OF TWO (2) CORES SHALL BE RANDOMLY SAMPLED AT A DISTANCE NOT TO EXCEED FIVE HUNDRED (500) FOOT SPACING PER BLOCK. ALL QUALITY CONTROL NUCLEAR TESTING OF THE IN-PLACE HMAC/WMAC IS FOR QUALITY CONTROL INFORMATION ONLY. THE HMAC/WMAC THICKNESS IS REQUIRED TO BE MEASUREMENT BY CORE. FIELD QUALITY CONTROL PERSONNEL SHALL BE TXDOT LEVEL IB CERTIFIED AND BE PRESENT AT START AND THROUGH THE DURATION OF THE PLACEMENT OPERATIONS OF THE HMAC/WMAC TO DOCUMENT DENSITY, THICKNESS. AND COMPACTION AND PI ACEMENT OPERATIONS. THE CITY OF SANTA CLARA WILL DETERMINE THE REMOVAL AND REPLACEMENT OF ALL FAILED PRODUCTION AND PLACEMENT HMAC/WMAC TEST RESULTS.

    D. RECYCLED ASPHALT SHINGLES (RAS) AND RECYCLED ASPHALT PAVEMENT (RAP) SHALL NOT BE USED IN ANY HMAC OR WMAC MIXES.

    E. CONCRETE STRUCTURES - A MINIMUM OF ONE (1) SET OF COMPRESSIVE CONCRETE STRENGTH TEST OF 4, SIX (6) INCH DIAMETER CYLINDERS EACH WILL BE TESTED PER EACH STRUCTURE AND THE FREQUENCY SHALL BE NO LESS THAN ONE (1) SET PER SIXTY (60) CUBIC YARDS OF CONCRETE PLACED AND AT LEAST ONE (1) SET PER DAY.

    F. CONCRETE CURB AND SIDEWALK - PROVIDE ONE (1) SET OF FOUR (4), SIX (6) INCH DIAMETER CYLINDERS PER EACH 500 LINEAR FEET OF CURB AND/OR SI DEW ALK AND AT LEAST ONE (1) SET PER DA Y.

    G. THE CONTRACTOR SHALL SUBMIT CONCRETE, WMAC, AND HMAC DESIGNS A MINIMUM OF 2 WEEKS PRIOR TO THE PLACEMENT OF THE MATERIAL.

16. PROOF ROLLING - ALL SUBGRADE AND EACH LIFT OF BASE MATERIAL SHALL BE PROOF-ROLLED TO THE SATISFACTION OF THE CITY. THE CONTRACTOR SHALL PROVIDE THE NECESSARY EQUIPMENT AND OPERATORS FOR PROOF- ROLLING AS DIRECTED BY THE CITY. SOFT AND YIELDING AREAS DISCOVERED SHALL BE CORRECTED BY THE CONTRACTOR AT THEIR EXPENSE .

17. SURFACE STRUCTURES SUCH AS MAILBOXES, STREET SIGNS, FENCES, DRIVEWAYS, SIDEWALKS, LANDSCAPING, CONCRETE ISLANDS, CURBS OR CONCRETE DRIVEWAYS, ETC., VISIBLE AT THE TIME OF THE SURVEY ARE SHOWN ON THE PLANS. IT IS THE CONTRACTOR'S RESPONSIBILITY TO SAFEGUARD AND MAINTAIN ANY AND ALL SURFACE STRUCTURES DURING THE COURSE OF WORK AND TO REPLACE OR REPAIR THOSE ITEMS WHICH ARE DAMAGED BY THE CONTRACTOR WITH LIKE OR BETTER QUALITY AND SHALL BE RESPONSIBLE FOR RESTORING TO ITS ORIGINAL OR BETTER CONDITION (NO SEPARATE PAY ITEM).

18. LOCATIONS AND DEPTHS OF EXISTING UTILITIES SHOWN ON THE PLANS ARE UNDERSTOOD TO BE APPROXIMATE. ACTUAL LOCATIONS MUST BE FIELD VERIFIED BY THE CONTRACTOR AT LEAST 48 HOURS PRIOR TO CONSTRUCTION. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO LOCATE ALL UTILITIES, PROTECT THEM DURING CONSTRUCTION AND REPAIR ANY DAMAGE TO OTHER UTILITIES AT NO COST TO THE CITY OF SANTA CLARA.

19. IT IS THE CONTRACTOR'S RESPONSIBILITY TO SEE THAT ALL SIGNS AND BARRICADES ARE PROPERLY INSTALLED AND MAINTAINED. ALL LOCATIONS AND DISTANCES WILL BE DECIDED UPON IN THE FIELD BY THE CONTRACTOR, USING THE TEXAS MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES. THE CITY'S CONSTRUCTION INSPECTOR/TRAFFIC ENGINEERING REPRESENTATIVE WILL ONLY BE RESPONSIBLE TO INSPECT BARRICADES AND SIGNS. IF IN THE OPINION OF THE TRAFFIC ENGINEERING REPRESENTATIVE/ CONSTRUCTION INSPECTOR, THE TRAFIC CONTROL DEVICES DO NOT CONFORM TO ESTABLISHED STANDARDS, ARE INCORRECTLY PLACED OR INSUFFICIENT IN QUANTITY TO PROTECT THE TRAVELING GENERAL PUBLIC. THE CONSTRUCTION INSPECTOR WILL HAVE THE OPTION OF STOPPING THE OPERATIONS UNTIL SUCH TIME AS THE CONDITIONS ARE CORRECTED AT NO EXPENSE TO THE CITY OF SANTA CLARA.

20. DEVELOPER/CONTRACTOR TO INSTALL ALL STREET NAME SIGNS, STOP SIGNS, SPEED LIMIT, YIELD SIGNS, ETC. SIGNS AND STREET NAMES SHALL MEET TEXAS MUTCD STANDARDS.

21. THE STREET CONTRACTOR IS REQUIRED TO ADJUST ALL EXISTING MANHOLES (SEE "ADJUSTING EXISTING MANHOLES" OF THE SPECIFICATION) AND WATER VALVES TO MATCH THE GRADE OF THE STREET SECTION OR THE ELEVATION SPECIFIED ON THE PLANS OR AS DIRECTED BY THE ENGINEER.

22. DUE TO FEDERAL REGULATIONS TITLE 49, PART 192.181 ACCESS TO GAS VALVES MUST BE MAINTAINED AT ALL TIMES. THE CONTRACTOR MUST PROTECT AND WORK AROUND ANY GAS VALVES THAT ARE IN THE PROJECT AREA.

23. CONTRACTOR SHALL VERIFY THE EXACT LOCATION OF UNDERGROUND UTILITIES AND OTHER UNDERGROUND STRUCTURES WHETHER SHOWN ON THE PLANS OR NOT. CONTRACTOR WILL NOTIFY ALL UTILITY COMPANIES AT LEAST 72 HOURS PRIOR TO EXCAVATION.

CITY OF SANTA CLARA	
GVSUD	
GVTC	
GVEC	1-800-401-8845
DIG TEST	1-800-344-8377
TEXAS STATE WIDE ONE CALL LOCATORS	1-800-545-6005 OR 811
TIME WARNER CABLE	
AT&T	
MCI	
VERIZON	

24. CONCRETE CURB SHALL BE CONSTRUCTED WITH A MAXIMUM OF EIGHTY (80) FEET BETWEEN EXPANSION JOINTS AND MARKED AT TEN (10) FOOT INTERVALS WITH APPROVED STEEL MARKING TOOLS. EXPANSION JOINTS SHALL BE PLACED AT THE BEGINNING OF ALL RADII AND AT A MAXIMUM OF EIGHTY (80) FOOT INTERVALS AS DIRECTED BY THE ENGINEER.

25. THE CONTRACTOR SHALL NOTIFY THE CITY OF SANTA CLARA PLANNING AND ENGINEERING DEPARTMENT PRIOR TO PLACING BACKFILL OR CONCRETE AND PRIOR TO ANY TESTING. CONTRACTOR SHALL REQUEST INSPECTIONS A MINIMUM OF 24 HOURS IN ADVANCE. NO INSPECTIONS ARE AVAILABLE BETWEEN 12:00 P.M. AND 1:00 P.M. OR AFTER 4:00 PM DAILY, ON WEEKENDS, OR ON CITY HOLIDAYS.

26. CONCRETE SIDEWALKS SHALL HAVE TOOLED WEAKENED PLANE JOINTS EVERY FOUR (4) FEET AND DOWELED EXPANSION JOINT WITH ONE QUARTER INCH (1/4) BITUMASTIC MATERIAL ON CENTER AND ABUTTING EXISTING STRUCTURES.

27. ALL WORKMANSHIP AND MATERIAL SHALL CONFORM TO THE CITY OF SANTA CLARA ORDINANCES FOR PUBLIC WORKS CONSTRUCTION.

28. CONTRACTOR SHALL INSTALL CURB FOR HANDICAP RAMPS AS SHOWN ON THE PLANS AND ADA STANDARD PLAN SHEETS.

29. CONTRACTOR SHALL PROVIDE BRASS KEYS TO BE USED TO OPEN LOCKING MANHOLE COVERS ON DRAINAGE STRUCTURES DURING PRELIMINARY INSPECTION FOR ACCEPTANCE OF PROJECT.

30. EXISTING STREETS TRENCHES ARE TO BE BACKFILLED WITH FLOWABLE FILL FROM THE TOP OF THE BEDDING MATERIAL TO WITHIN TWO (2) INCHES OF THE FINISHED GRADE ALLOWING FOR THE SURFACE HMAC/WMAC.

31. REMOVE EXISTING CURB ON ALL NEW DRIVEWAYS AND PLACE THE COMPLETE PAVEMENT THICKNESS WITH A MINIMUM OF FIVE (5) INCHES THICKNESS ON RESIDENTIAL AND SIX (6) INCHES MINIMUM ON COMMERCIAL; DEPENDING ON TRAFFIC WEIGHT.

32. CONCRETE PLACED IN NEW DRIVEWAYS INCLUDING ALLEYS SHALL MEET A MINIMUM 3,000 PSI COMPRESSIVE STRENGTH AT 28 DAYS.

33. EXCESS MATERIAL IS TO BE EMBANKED AND COMPACTED TO FINAL GRADE FOR FUTURE PHASES. NO EXCESS MATERIAL SHALL BE DUMPED OR ALLOWED TO ENTER ANY WATERWAY, CULVERT OR OTHER DRAINAGE STRUCTURE. THE CONTRACTOR SHALL NOT PLACE ANY MATERIAL IN THE 100-YEAR FLOODPLAIN WITHOUT OBTAINING AN APPROVED FLOOD PLAIN PERMIT.

34. ANY WORK COMPLETED WITHOUT PRIOR AUTHORIZATION WHETHER INCLUDED IN THE PLANS AND SPECIFICATIONS OR NOT. SHALL NOT BE COMPENSATED BY THE CITY OF SANTA CLARA.

MISCELLANEOUS NOTES:

1. ACCESS TO THIS SITE IS PROVIDED THROUGH TWO PROPOSED DRIVEWAYS ALONG WEIL RD.

2. DRIVEWAYS ARE SHOWN FOR ILLUSTRATIVE PURPOSES ONLY TO DENOTE A POTENTIAL CONFLICT WITH DRAINAGE FACILITY AND/OR ADA RAMP. ALL DRIVEWAYS WILL BE BUILT WITH HOMEBUILDING.

3. ALL REQUIRED ADA RAMPS ARE SHOWN ON THE PLANS. ONLY ADA RAMPS WITHOUT RESIDENTIAL LOT FRONTAGE SHALL BE BUILT WITH THE STREET INFRASTRUCTURE.

4. CONTRACTOR SHALL REFERENCE TREE PLAN AND PRIVATE GRADING PLAN FOR CLEARING AND GRADING LIMITS.

5. PRIOR TO THE INSTALLATION OF STREET BASE MATERIAL, CONTRACTOR SHALL COORDINATE WITH ENGINEER AND UTILITY PROVIDERS TO INSTALL NECESSARY CONDUITS FOR UTILITY INSTALLATION.

6. CONTRACTOR IS RESPONSIBLE FOR ENSURING POSITIVE SITE DRAINAGE AT ALL TIMES DURING AND UPON COMPLETION OF INFRASTRUCTURE.

7. CONTRACTOR IS REQUIRED TO NOTIFY ENTERPRISE UTILITIES WHEN ENCROACHING UPON THE EXISTING GAS EASEMENT ON SITE.

CONSTRUCTION SEQUENCING: (LIST PROCESS ON CONSTRUCTION PLAN SET)

1. CALL THE PLANNING AND ENGINEERING DEPARTMENT 48 HOURS PRIOR TO BEGINNING ANY WORK AND SCHEDULE A RECONSTRUCTION MEETING WITH THE CITY AND ALL AFFECTED UTILITY PROVIDERS, THE GENERAL CONTRACTOR, THE DEVELOPER AND THE DEVELOPER'S ENGINEER.

2. OBTAIN A SITE DEVELOPMENT PERMIT FROM THE PLANNING AND ENGINEERING DEPARTMENT.

3. PROVIDE THE PLANNING AND ENGINEERING DEPARTMENT WITH EVIDENCE ALL TCEQ LICENSES AND REQUIREMENTS ARE UP TO DATE.

4. INSTALL TEMPORARY EROSION CONTROLS AND TREE PROTECTION FENCING PRIOR TO ANY CLEARING AND GRUBBING. NOTIFY THE CITY WHEN INSTALLED.

5. ROUGH-CUT ALL REQUIRED OR NECESSARY PONDS. EITHER THE PERMANENT OUTLET STRUCTURE OR A TEMPORARY OUTLET MUST BE CONSTRUCTED DURING DEVELOPMENT OF ANY EMBANKMENT OR EXCAVATION THAT LEADS TO PONDING CONDITIONS. THE OUTLET SYSTEM MUST CONSIST OF A LOW-LEVEL OUTLET AND AN EMERGENCY OVERFLOW MEETING THE REQUIREMENTS OF THE UDC. THE OUTLET SYSTEM SHALL BE PROTECTED FROM EROSION AND SHALL BE MAINTAINED THROUGHOUT THE COURSE OF CONSTRUCTION UNTIL FINAL RESTORATION IS ACHIEVED.

6. DELIVER APPROVED ROUGH CUT SHEETS TO THE CITY ENGINEER PRIOR TO CLEARING AND GRUBBING.

7. ROUGH GRADE STREETS. NO DEVELOPMENT OF EMBANKMENT WILL BE PERMITTED AT THIS TIME.

8. INSTALL ALL UTILITIES TO BE LOCATED UNDER THE PROPOSED PAVEMENT OR WITHIN THE ROAD RIGHT-OF-WAY.

9. DELIVER STORM SEWER CUT SHEETS TO THE CITY ENGINEER.

10. BEGIN INSTALLATION OF STORM SEWER LINES. UPON COMPLETION, RESTORE AS MUCH DISTURBED AREA AS POSSIBLE, PARTICULARLY CHANNELS AND LARGE OPEN AREAS.

11. DELIVER FINAL GRADE CUT SHEETS TO THE CITY ENGINEER.

12. RE-GRADE STREETS TO SUB-GRADE.

13. ENSURE THAT UNDERGROUND UTILITY CROSSINGS ARE COMPLETED. LAY 1ST COURSE BASE MATERIAL ON STREETS.

14. INSTALL CURB AND GUTTER.

15. LAY FINAL BASE COURSE ON ALL STREETS.

16. LAY ASPHALT.

17. COMPLETE FINAL GRADING AND RESTORATION OF DETENTION, SEDIMENTATION / FILTRATION PONDS.

18. COMPLETE PERMANENT EROSION CONTROL AND RESTORATION OF SITE VEGETATION.

19. REMOVE AND DISPOSE OF TEMPORARY EROSION CONTROLS.

20. COMPLETE ANY NECESSARY FINAL DRESS UP OF AREAS DISTURBED.

CITY OF SANTA CLARA NOTES:

1. ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE CITY OF SANTA CLARA DESIGN AND CONSTRUCTION MANUAL AND THE UNIFIED DEVELOPMENT CODE, HERE AFTER REFERRED TO THE UDC.

2. APPROVAL OF THESE CONSTRUCTION PLANS BY THE CITY OF SANTA CLARA DOES NOT CONSTITUTE A VERIFICATION OF ALL DATA, INFORMATION AND CALCULATIONS SUPPLIED BY THE APPLICANT. THE ENGINEER OF RECORD IS SOLELY RESPONSIBLE FOR THE COMPLETENESS, ACCURACY AND ADEQUACY OF HIS/HER SUBMITTAL WHETHER OR NOT THE APPLICATION IS REVIEWED FOR CODE COMPLIANCE BY THE CITY ENGINEER.

3. ALL RESPONSIBILITY FOR THE ADEQUACY OF THESE PLANS REMAINS WITH THE ENGINEER WHO PREPARED THEM. IN APPROVING THESE PLANS, THE CITY OF SANTA CLARA MUST RELY ON THE ADEQUACY OF THE WORK OF THE ENGINEER.

4. DESIGN PROCEDURES ARE IN COMPLETE COMPLIANCE WITH THE CITY OF SANTA CLARA DESIGN AND CONSTRUCTION MANUAL. IT IS THE RESPONSIBILITY OF THE ENGINEER TO REQUEST A WAIVER FROM ANY ASPECT OF THESE PLANS THAT DO NOT COMPLY WITH THE UDC.

5. A MINIMUM OF TWO EXISTING BENCH MARKS TIED TO CITY OF SANTA CLARA GRID SHOULD BE SHOWN ON THE PLANS. IN ADDITION TWO PERMANENT BENCHMARKS PER SUBDIVISION SHALL BE INSTALLED IN EACH SUBDIVISION TO INCLUDE DESCRIPTION, LOCATION, AND ELEVATION AND TIE TO CITY OF SANTA CLARA STANDARDS WHEN POSSIBLE.

6. CAST BRONZE SURVEY MARKERS SHALL BE PLACED IN CONCRETE IN PERMANENT, ACCESSIBLE LOCATIONS AT THE TIME OF CONSTRUCTION. THE LOCATIONS OF THE MARKERS SHALL BE INDICATED ON THE CONSTRUCTION PLANS. A MINIMUM OF ONE MARKER SHALL BE PLACED FOR EACH 20 ACRES OF THE PROJECT.

7. PRIOR TO BEGINNING CONSTRUCTION, THE OWNER OR HIS AUTHORIZED REPRESENTATIVE SHALL CONVENE A PRE-CONSTRUCTION CONFERENCE BETWEEN THE CITY OF SANTA CLARA, CONSULTING ENGINEER, CONTRACTOR, GUADALUPE COUNTY AND ANY OTHER AFFECTED PARTIES. NOTIFY THE CITY OF SANTA CLARA AT LEAST 48 HOURS PRIOR TO THE TIME OF THE CONFERENCE AND 48 HOURS PRIOR TO THE BEGINNING OF CONSTRUCTION.

8. THE CONTRACTOR SHALL GIVE THE CITY OF SANTA CLARA AND GUADALUPE COUNTY A MINIMUM OF 48 HOURS NOTICE BEFORE BEGINNING EACH PHASE OF CONSTRUCTION.

9. BARRICADES, BUILT TO CITY OF SANTA CLARA SPECIFICATIONS, SHALL BE CONSTRUCTED ON ALL DEAD-END STREETS AND AS NECESSARY DURING CONSTRUCTION TO MAINTAIN JOB SAFETY. (STREETS, ETC. MAY BE LISTED IN ADDITION TO OR INSTEAD OF NOTE.)

10. IF BLASTING IS PLANNED BY THE CONTRACTOR, A BLASTING PERMIT MUST BE SECURED PRIOR TO COMMENCEMENT OF ANY BLASTING.

11. ANY EXISTING PAVEMENT, CURBS, AND/ OR SIDEWALKS DAMAGED OR REMOVED WILL BE REPAIRED BY THE CONTRACTOR AT HIS EXPENSE BEFORE ACCEPTANCE OF THE SUBDIVISION.

12. THE LOCATION OF ANY WATER AND / OR WASTEWATER LINES SHOWN ON THE PLANS MUST BE VERIFIED BY THE CITY OF SANTA CLARA PUBLIC WORKS DEPARTMENT.

13. USE ONE CALL UTILITY SYSTEM: DIAL 1-800-344-8377, 48 HOURS BEFORE YOU DIG.

14. ALL STORM SEWER PIPES TO BE CLASS III RCP UNLESS NOTED OTHERWISE.

CERTIFICATE OF APPROVAL BY CITY ENGINEER:

APPROVED ON THIS THE ____ DAY OF _____, 20 ____, BY THE CITY ENGINEER, CITY OF SANTA CLARA, TEXAS.

_____

CITY ENGINEER, CITY OF SANTA CLARA

"RELEASE OF THIS APPLICATION DOES NOT CONSTITUTE A VERIFICATION OF ALL DATA, INFORMATION AND CALCULATIONS SUPPLIED BY THE APPLICANT. THE ENGINEER OF RECORD IS SOLELY RESPONSIBLE FOR THE COMPLETENESS, ACCURACY AND ADEQUACY OF HIS/HER SUBMITTAL, WHETHER OR NOT THE APPLICATION IS REVIEWED FOR CODE COMPLIANCE BY THE CITY ENGINEER."

"ALL RESPONSIBILITY FOR THE ADEQUACY OF THESE PLANS REMAINS WITH THE ENGINEER WHO PREPARED THEM. IN APPROVING THESE PLANS, THE CITY OF SANTA CLARA MUST RELY UPON THE ADEQUACY OF THE WORK OF THE DESIGN ENGINEER."

CUDEENGINEERS.COM

CUDE ENGINEERS EST. 1980

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

GENERAL NOTES

DATE
10/15/2025

PROJECT NO.
03499.009

DRAWN BY
AR/JF/RB

CHECKED BY
KMH

REVISIONS

1.
2.
3.
4.
5.
6.
7.
8.
9.


STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
10/15/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C0.00

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.


P:\03499\009\2-DWG\Plans\03499.009.GENERAL NOTES.dwg 2025/10/15 10:05:10am jfarris

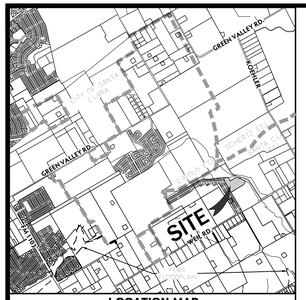

LOCATION MAP N.T.S.

KEYNOTES


1. 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
2. 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
1. EXISTING 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE (CONCURRENT GRACE VALLEY RANCH PHASE 6)
2. EXISTING 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE (CONCURRENT GRACE VALLEY RANCH PHASE 6)



TYPICAL LOT SITE PLAN
N.T.S.

NOTE:

1. ALL SILT FENCES AND/OR ROCK BERMS AND TEMPORARY CONSTRUCTION ENTRANCES/EXITS SHALL BE PLACED AT THE MOST DOWN-GRADIENT POINT OF CONSTRUCTION AS SHOWN ON THIS SITE PLAN. CONTRACTOR SHALL TAKE INTO CONSIDERATION ANY PROPOSED CONSTRUCTION THAT MAY TAKE PLACE AT THESE LOCATIONS. ANY RELOCATION OF SILT FENCE, ROCK BERMS AND/OR TEMPORARY CONSTRUCTION ENTRANCES/EXITS SHALL BE AT THE CONTRACTOR'S EXPENSE.
2. AREA OF SOIL DISTURBANCES INCLUDE STREET RIGHT-OF-WAYS, UTILITY EASEMENTS & LOTS.
3. THERE WILL NOT BE STORMWATER DISCHARGES INTO THE FEMA FLOOD PLAIN.
4. THE CONTRACTOR IS REQUIRED TO MAINTAIN EROSION CONTROLS THROUGHOUT THE DURATION OF THE PROJECT.
5. THE CITY INSPECTOR HAS THE AUTHORITY TO HAVE THE CONTRACTOR MODIFY THE EROSION CONTROLS AT THE DEVELOPER'S EXPENSE. THE DEVELOPER SHALL BE NOTIFIED OF THESE MODIFICATIONS PRIOR TO COMMENCEMENT OF MODIFICATIONS.

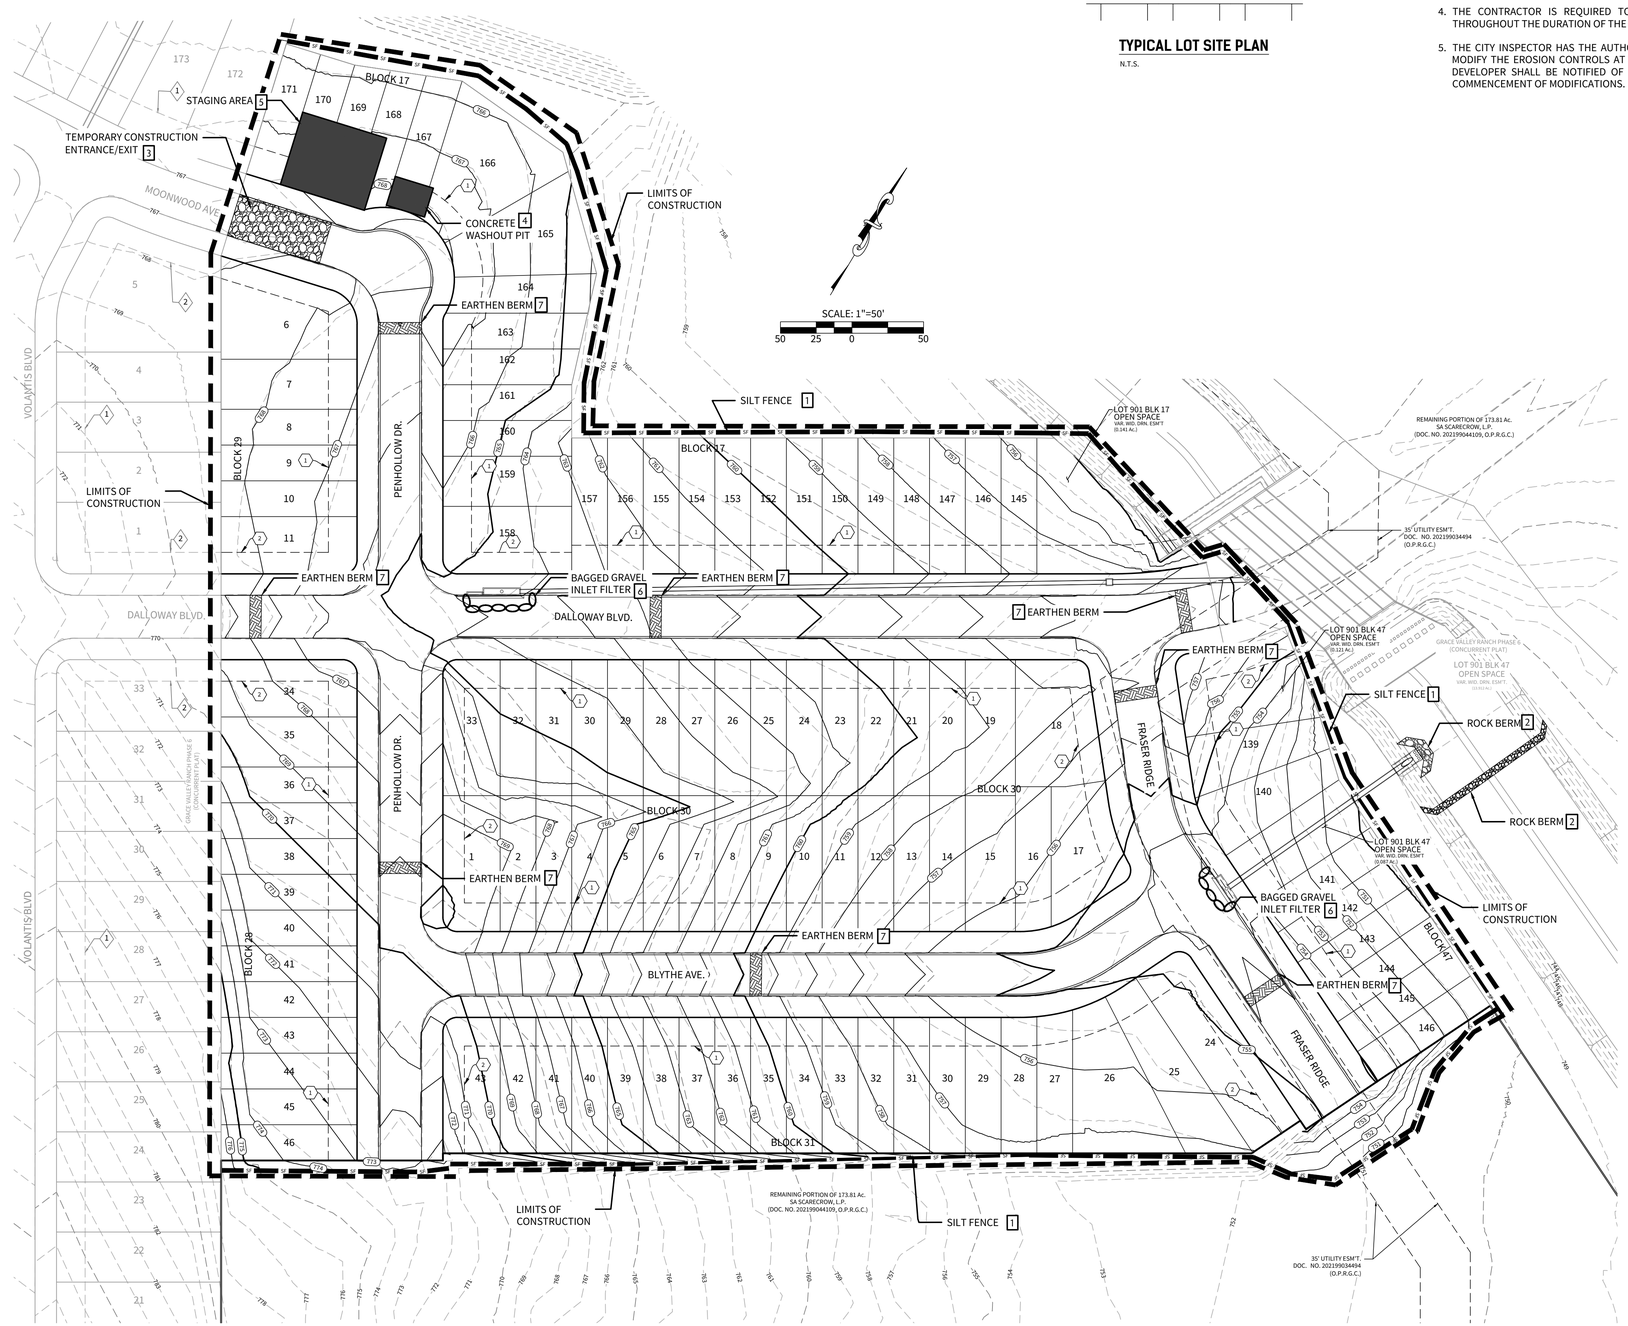

LEGEND

- PROPERTY LINE
- LIMITS OF CONSTRUCTION
- PROPOSED CONTOURS 930
- EXISTING CONTOURS 930
- BMP ITEM NUMBER 1
- TEMPORARY CONSTRUCTION ENTRANCE/EXIT
- EXISTING SANITARY SEWER SS
- FLOW ARROW
- STAGING AREA
- CONCRETE WASHOUT PIT
- PROPOSED ROCK BERM
- BAGGED GRAVEL INLET FILTER
- EARTHEN BERM

CUDEENGINEERS.COM

CUDE ENGINEERS EST. 1980

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

STORM WATER POLLUTION PREVENTION PLAN

DATE 11/04/2025

PROJECT NO. 03499.009

DRAWN BY AR/JF/RB

CHECKED BY KMH

REVISIONS

1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER


11/04/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C1.00

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

P:\03499\009\2-DWG\Ar\Plans\C1.00 SWPPP PLAN.dwg 10/31/11:04:3 Sapp Hammie

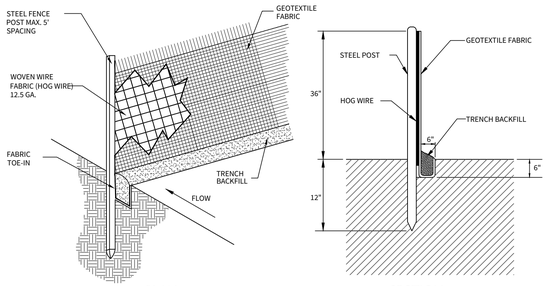


NOTES:

1. SILT FENCE MATERIAL SHOULD BE POLYPROPYLENE, POLYETHYLENE OR POLYAMIDE WOVEN OR NON WOVEN FABRIC. THE FABRIC WIDTH SHOULD BE 36 INCHES, WITH A MINIMUM UNIT WEIGHT OF 4.5 OZ/YD, MULLEN BURST STRENGTH EXCEEDING 190 LB/IN 2 , ULTRAVIOLET STABILITY EXCEEDING 70%, AND MINIMUM APPARENT OPENING SIZE OF U.S. SIEVE NO. 30.
2. FENCE POSTS SHOULD BE MADE OF HOT ROLLED STEEL, AT LEAST 4 FEET LONG WITH TEE OR Y-BAR CROSS SECTION, SURFACE PAINTED OR GALVANIZED, MINIMUM NOMINAL WEIGHT 1.25 LB/FT 2 , AND BRINDELL HARDNESS EXCEEDING 140.
3. WOVEN WIRE BACKING TO SUPPORT THE FABRIC SHOULD BE GALVANIZED 2" X 4" WELDED WIRE, 12.5 GAUGE MINIMUM.
4. STEEL POSTS, WHICH SUPPORT THE SILT FENCE, SHOULD BE INSTALLED ON A SLIGHT ANGLE TOWARD THE ANTICIPATED RUNOFF SOURCE. POST MUST BE EMBEDDED A MINIMUM OF 1 FOOT DEEP AND SPACED NOT MORE THAN 5 FEET ON CENTER.
5. LAY OUT FENCING DOWN-SLOPE OF DISTURBED AREA, FOLLOWING THE CONTOUR AS CLOSELY AS POSSIBLE. THE FENCE SHOULD BE SITED SO THAT THE MAXIMUM DRAINAGE AREA IS ¼ ACRE/100 FEET OF FENCE.
6. THE TOE OF THE SILT FENCE SHOULD BE TRENCHED IN WITH A SPADE OR MECHANICAL TRENCHER, SO THAT THE DOWN-SLOPE FACE OF THE TRENCH IS FLAT AND PERPENDICULAR TO THE LINE OF FLOW. WHERE FENCE CANNOT BE TRENCHED IN (E.G., PAVEMENT OR ROCK OUTCROP), WEIGHT FABRIC FLAP WITH 3 INCHES OF PEA GRAVEL ON UPHILL SIDE TO PREVENT FLOW FROM SEEPING UNDER FENCE.
7. THE TRENCH MUST BE A MINIMUM OF 6 INCHES DEEP AND 6 INCHES WIDE TO ALLOW FOR THE SILT FENCE FABRIC TO BE LAID IN THE GROUND AND BACKFILLED WITH COMPACTED MATERIAL.
8. SILT FENCE SHOULD BE SECURELY FASTENED TO EACH STEEL SUPPORT POST OR TO WOVEN WIRE, WHICH IS IN TURN ATTACHED TO THE STEEL FENCE POST. THERE SHOULD BE A 3-FOOT OVERLAP, SECURELY FASTENED WHERE ENDS OF FABRIC MEET.
9. SILT FENCE SHOULD BE REMOVED WHEN THE SITE IS COMPLETELY STABILIZED SO AS NOT TO BLOCK OR IMPEDE STORM FLOW OR DRAINAGE.
10. REMOVE SEDIMENT WHEN BUILDUP REACHES 6 INCHES, OR INSTALL A SECOND LINE OF FENCING PARALLEL TO THE OLD FENCE.
11. REPLACE ANY TORN FABRIC OR INSTALL A SECOND LINE OF FENCING PARALLEL TO THE TORN SECTION.
12. REPLACE OR REPAIR ANY SECTIONS CRUSHED OR COLLAPSED IN THE COURSE OF CONSTRUCTION ACTIVITY. IF A SECTION OF FENCE IS OBSTRUCTING VEHICULAR ACCESS, CONSIDER RELOCATING IT TO A SPOT WHERE IT WILL PROVIDE EQUAL PROTECTION, BUT WILL NOT OBSTRUCT VEHICLES. A TRIANGULAR FILTER DIKE MAY BE PREFERABLE TO A SILT FENCE AT COMMON VEHICLE ACCESS POINTS.

1 SILT FENCE DETAIL

SCALE: NONE

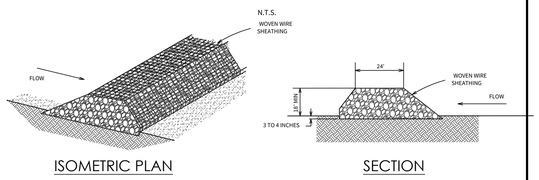


NOTES:

1. THE BERM STRUCTURE SHOULD BE SECURED WITH A WOVEN WIRE SHEATHING HAVING MAXIMUM OPENING OF 1 INCH AND A MINIMUM WIRE DIAMETER OF 20 GAUGE GALVANIZED AND SHOULD BE SECURED WITH SHOAT RINGS.
2. CLEAN, OPEN GRADED 3 TO 5-INCH DIAMETER ROCK SHOULD BE USED, EXCEPT IN AREAS WHERE HIGH VELOCITIES OR LARGE VOLUMES OF FLOW ARE EXPECTED, WHERE 5-TO 8-INCH DIAMETER ROCKS MAY BE USED.
3. LAY OUT THE WOVEN WIRE SHEATHING PERPENDICULAR TO THE FLOW LINE.
4. BERM SHOULD HAVE A TOP WIDTH OF 2 FEET MINIMUM WITH SIDE SLOPES BEING 2:1 (H:V) OR FLATTER.
5. PLACE THE ROCK ALONG THE SHEATHING TO A HEIGHT NOT LESS THAN 18".
6. WRAP THE WIRE SHEATHING AROUND THE ROCK AND SECURE WITH TIE WIRE SO THAT THE ENDS OF THE SHEATHING OVERLAP AT LEAST 2 INCHES, AND THE BERM RETAINS ITS SHAPE WHEN WALKED UPON.
7. BERM SHOULD BE BUILT ALONG THE CONTOUR AT ZERO PERCENT GRADE OR AS NEAR AS POSSIBLE.
8. THE ENDS OF THE BERM SHOULD BE TIED INTO EXISTING UPSLOPE GRADE AND THE BERM SHOULD BE BURIED IN A TRENCH APPROXIMATELY 3 TO 4 INCHES DEEP TO PREVENT FAILURE OF THE CONTROL.
9. INSPECTION SHOULD BE MADE WEEKLY AND AFTER EACH RAINFALL BY THE RESPONSIBLE PARTY. FOR INSTALLATIONS IN STREAMBEDS, ADDITIONAL DAILY INSPECTIONS SHOULD BE MADE. THE BERM SHOULD BE RESHAPED AS NEEDED DURING INSPECTION.
10. REMOVE SEDIMENT AND OTHER DEBRIS WHEN BUILDUP REACHES 6 INCHES AND DISPOSE OF THE ACCUMULATED SILT OF IN AN APPROVED MANNER AND REPAIR ANY LOOSE WIRE SHEATHING.
11. THE BERM SHOULD BE REPLACED WHEN THE STRUCTURE CEASES TO FUNCTION AS INTENDED DUE TO SILT ACCUMULATION AMONG THE ROCKS, WASHOUT, CONSTRUCTION TRAFFIC DAMAGE, ETC.
12. THE ROCK BERM SHOULD BE LEFT IN PLACE UNTIL ALL UPSTREAM AREAS ARE STABILIZED AND ACCUMULATED SILT REMOVED.

2 ROCK BERM DETAIL

SCALE: NONE

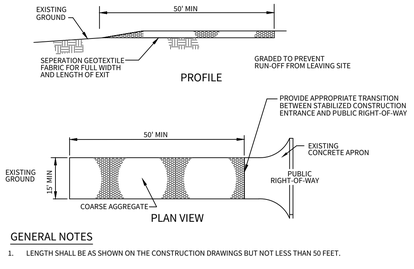

GENERAL NOTES


1. LENGTH SHALL BE AS SHOWN ON THE CONSTRUCTION DRAWINGS BUT NOT LESS THAN 50 FEET.
2. THICKNESS SHALL BE NOT LESS THAN 8 INCHES.
3. WIDTH SHALL BE NOT LESS THAN FULL WIDTH OF ALL POINTS OF INGRESS OR EGRESS.
4. STABILIZED AREA MAY BE WIDENED OR LENGTHENED TO ACCOMODATE A TRUCK WASHING AREA WHEN SHOWN ON THE CONSTRUCTION DRAWING. AN OUTLET SEDIMENT TRAP MUST BE PROVIDED FOR THE TRUCK WASHING AREA.
5. STONE MATERIAL SHALL CONSIST OF 3 TO 5 INCH OPEN GRADED ROCK AND SHALL BE PLACED IN A LAYER OF AT LEAST 8 INCHES THICKNESS.

NOTES:

1. THE AGGREGATE SHOULD CONSIST OF 4 TO 8 INCH WASHED STONE OVER A STABLE FOUNDATION.
2. THE AGGREGATE SHOULD BE PLACED WITH A MINIMUM THICKNESS OF 8 INCHES.
3. THE GEOTEXTILE FABRIC SHOULD BE DESIGNED SPECIFICALLY FOR USE AS A SOIL FILTRATION MEDIA WITH AN APPROXIMATE WEIGHT OF 6 OZ/YD 2 , A MULLEN BURST RATING OF 140 LB/IN 2, AND AN EQUIVALENT OPENING SIZE GREATER THAN A NUMBER 50 SIEVE.
4. AVOID CURVES ON PUBLIC ROADS AND STEEP SLOPES. REMOVE VEGETATION AND OTHER OBJECTIONABLE MATERIAL FROM THE FOUNDATION AREA. GRADE CROWN FOUNDATION FOR POSITIVE DRAINAGE.
5. THE MINIMUM WIDTH OF THE ENTRANCE/EXIT SHOULD BE 12 FEET OR THE FULL WIDTH OF EXIT ROADWAY, WHICHEVER IS GREATER.
6. THE CONSTRUCTION ENTRANCE SHOULD BE AT LEAST 50 FEET LONG.
7. PLACE GEOTEXTILE FABRIC AND GRADE FOUNDATION TO IMPROVE STABILITY, ESPECIALLY WHERE WET CONDITIONS ARE ANTICIPATED.
8. PLACE STONE TO DIMENSIONS AND GRADE SHOWN. LEAVE SURFACE SMOOTH AND SLOPE FOR DRAINAGE.
9. THE ENTRANCE SHOULD BE MAINTAINED IN A CONDITION, WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT.
10. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ON TO PUBLIC RIGHTS-OF-WAY SHOULD BE REMOVED IMMEDIATELY BY CONTRACTOR.
11. WHEN NECESSARY, WHEELS SHOULD BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHT-OF-WAY.
12. WHEN WASHING IS REQUIRED, IT SHOULD BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE THAT DRAINS INTO AN APPROVED SEDIMENT TRAP OR SEDIMENT BASIN.
13. ALL SEDIMENT SHOULD BE PREVENTED FROM ENTERING ANY STORM DRAIN, DITCH OR WATER COURSE.

3 TEMPORARY CONSTRUCTION ENTRANCE / EXIT

SCALE: NONE




NOTES:

1. DETAIL ABOVE ILLUSTRATES MINIMUM DIMENSIONS. PIT CAN BE INCREASED IN SIZE DEPENDING ON EXPECTED FREQUENCY OF USE.
2. WASHOUT PIT SHALL BE LOCATED IN AN AREA EASILY ACCESSIBLE TO CONSTRUCTION TRAFFIC.
3. WASHOUT PIT SHALL NOT BE LOCATED IN AREAS SUBJECT TO INUNDATION FROM STORM WATER RUNOFF.

4 CONCRETE TRUCK WASHOUT PIT


SCALE: NONE

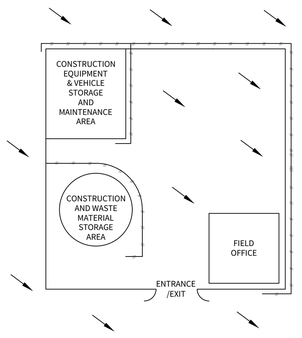

NOTE: CONTRACTOR SHALL ADJUST STORM WATER POLLUTION PREVENTION PLAN CONTROLS AS NECESSARY TO PROMOTE EROSION CONTROL IN AND AROUND DESIGNATED STAGING AREA.

5 TYP. CONSTRUCTION STAGING AREA

SCALE: NONE

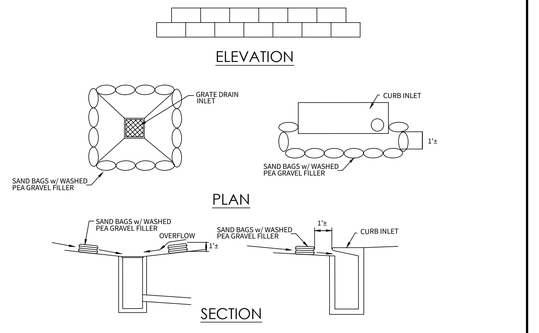


BAGGED GRAVEL INLET FILTER NOTES

1. THE GRAVEL BAG MATERIAL SHOULD BE POLYPROPYLENE, POLYETHYLENE, POLYAMIDE OR COTTON BURLAP WOVEN FABRIC, MINIMUM UNIT WEIGHT 4 OZ/YD 2 , MULLEN BURST STRENGTH EXCEEDING 300 PSI AND ULTRAVIOLET STABILITY EXCEEDING 70 PERCENT.
2. THE BAG LENGTH SHOULD BE 24 INCHES, WIDTH SHOULD BE 18 INCHES AND THICKNESS SHOULD BE 6 INCHES.
3. THE GRAVEL BAGS SHOULD BE FILLED WITH ¾" GRAVEL. .
4. WHEN A GRAVEL BAG IS FILLED WITH GRAVEL, THE OPEN END OF THE GRAVEL BAG SHOULD BE STAPLED OR TIED WITH NYLON OR POLY CORD.
5. THE GRAVEL BAGS SHOULD BE PLACED AS SHOWN ON THE DETAIL. THE GRAVEL BAGS SHALL BE STACKED TO FORM A CONTINUOUS BARRIER AROUND THE INLETS. THE BAGS SHOULD BE TIGHTLY ABUTTED AGAINST EACH OTHER TO PREVENT RUNOFF FROM FLOWING BETWEEN THE BAGS.
6. INSPECTION SHOULD BE MADE WEEKLY AND AFTER EACH RAINFALL. REPAIR OR REPLACEMENT SHOULD BE MADE PROMPTLY AS NEEDED BY THE CONTRACTOR.
7. CHECK PLACEMENT OF DEVICE TO PREVENT GAPS BETWEEN DEVICE AND CURB.
8. REMOVE SEDIMENT WHEN BUILDUP REACHES A DEPTH OF 3 INCHES. REMOVED SEDIMENT SHOULD BE DEPOSITED IN A SUITABLE AREA AND IN SUCH A MANNER THAT IT WILL NOT ERODE.
9. STRUCTURES SHOULD BE REMOVED AND THE AREA STABILIZED ONLY AFTER THE REMAINING DRAINAGE AREA HAS BEEN PROPERLY STABILIZED.

6 BAGGED GRAVEL INLET FILTER

SCALE: NONE

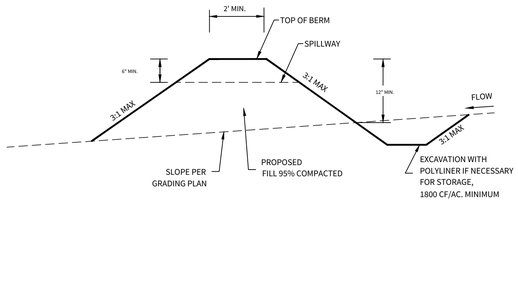

NOTE:

1. EARTHEN BERMS ARE TO SPAN ACROSS PROPOSED STREET SECTION (APPROX. 30-FEET WIDE) FROM CURB TO CURB.

7 EARTHEN BERM W/ POLYLINER AND SPILLWAY

SCALE: NONE

CUDEENGINEERS.COM

EST. 1980 CUDE ENGINEERS

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 8

STORM WATER POLLUTION PREVENTION DETAILS

DATE
10/15/2025

PROJECT NO.
03499.010

DRAWN BY
JK/AR/JF/RB

CHECKED BY
KMH

REVISIONS

1.
2.
3.
4.
5.
6.
7.
8.
9.


STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
10/15/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C1.D1

P:\03499\2025\2-Docs\4-Plans\CAD Sheet Files\L-Dwg 2025\10\15 Stormwater.dwg

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

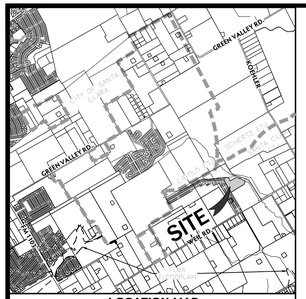

LOCATION MAP N.T.S.

LEGEND

- PROPOSED CONTOUR 1000
- EXISTING CONTOUR 1000
- BUILDING SETBACK
- GRADE BREAK GRADE BREAK
- EXISTING SANITARY SEWER SS
- KEYNOTE (1)


KEYNOTES

(1) 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE

(2) 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE


(1) EXISTING 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE (CONCURRENT GRACE VALLEY RANCH PHASE 6)

(2) EXISTING 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE (CONCURRENT GRACE VALLEY RANCH PHASE 6)

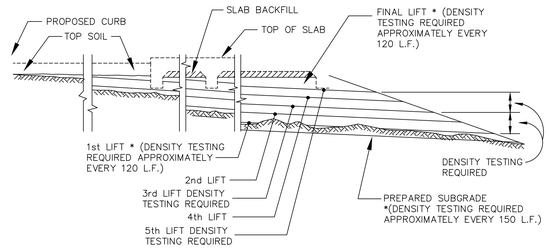

DENSITY TEST FREQUENCY

NOT TO SCALE

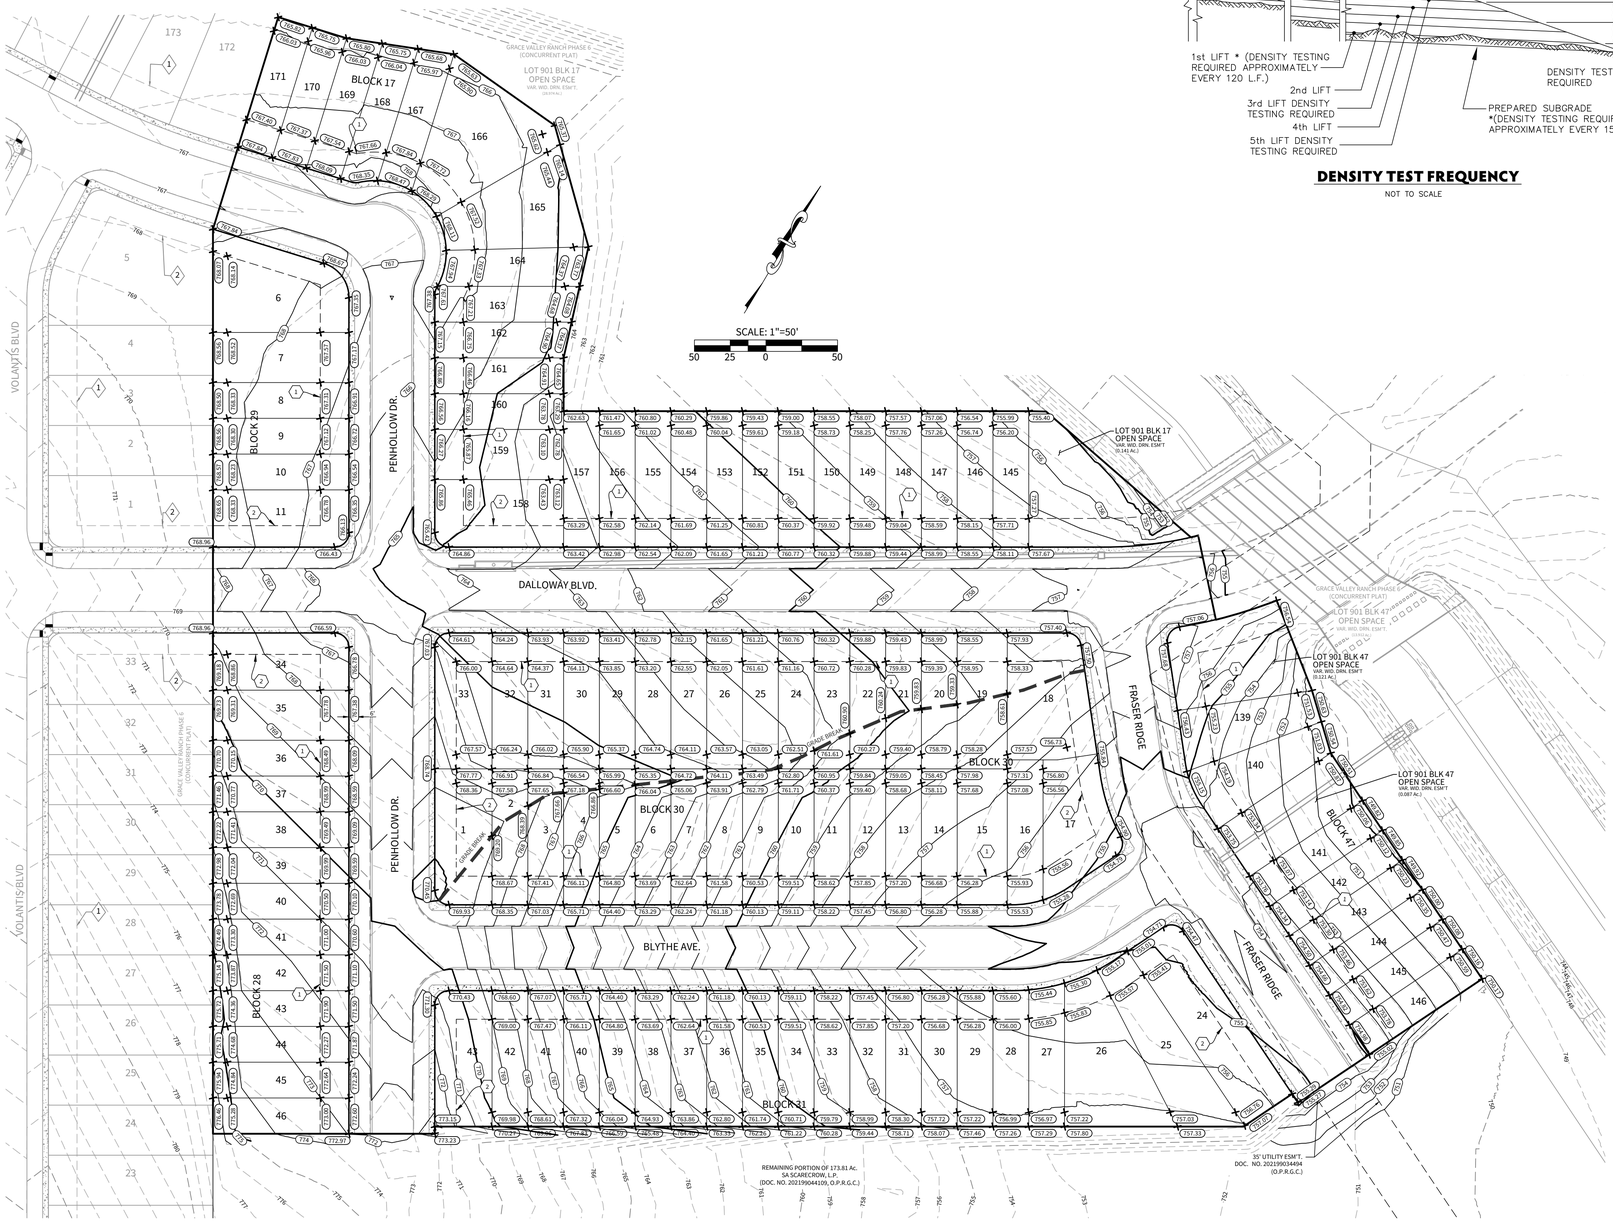

GENERAL SPECIFICATIONS FOR SITE PREPARATION

1. GENERAL DESCRIPTION

THIS ITEM SHALL CONSIST OF ALL CLEARING AND GRUBBING, DEMOLITION, PREPARATION OF LAND TO BE FILLED, FILLING OF THE LAND, SPREADING, COMPACTION TESTING AND INSPECTION OF THE FILL, AND ALL SUBSIDIARY WORK NECESSARY TO COMPLETE THE GRADING OF THE CUT AND FILL AREAS TO CONFORM WITH THE LINES, GRADES AND SLOPES AS SHOWN ON THE APPROVED PLANS.

ALL LOT GRADING MUST MEET REQUIREMENTS OF FHA/HUD HANDBOOK 4140.3, SPECIFICATIONS FOR LAND DEVELOPMENTS ON CONTROLLED EARTHWORK, DATASHEET 79G. HUD 79G REQUIREMENTS FOR FILL MATERIAL OF 6 INCHES AND MORE WILL BE CONDUCTED. ALL CUT AREAS WILL ALSO MEET THE REQUIREMENTS FOR HUD 79G COMPACTION TESTING. IN ADDITION, ENGINEERS MUST PROVIDED VERIFICATION OF ALL AREAS WHICH DO NOT REQUIRE HUD 79G.

2. CLEARING THE AREA TO BE FILLED

ALL TIMBER, LOGS, TREES, BRUSH AND RUBBISH SHALL BE REMOVED FROM THE SITE.

3. SCARIFYING THE AREA TO BE FILLED

ALL ORGANIC MATTER SHALL BE REMOVED FROM THE SURFACE UPON WHICH THE FILL IS TO BE PLACED, AND THE SURFACE SHALL THEN BE DISKED OR SCARIFIED TO A MINIMUM DEPTH OF SIX INCHES (6"), ALL SURFACE RUTS OR OTHER UNEVEN FEATURES WILL BE LEVELED PRIOR TO FIELD DENSITY TESTING.

4. COMPACTING THE AREA TO BE FILLED

FOLLOWING THE CLEARING AND DISKING OR SCARIFYING OF THE FILL AREA, IT SHALL BE BLADED UNTIL IT IS UNIFORM AND FREE FROM LARGE CLODS. THE AREA SHALL BE BROUGHT TO THE ADEQUATE MOISTURE CONTENT AND COMPACTED (TYPICALLY) TO NOT LESS THAN NINETY PERCENT (90%) OF MAXIMUM DENSITY IN ACCORDANCE WITH THE CURRENT ASTM D 1557 COMPACTION PROCEDURE, OR 95% OF MAXIMUM DENSITY IN ACCORDANCE WITH THE CURRENT THD--TEX--113--E COMPACTION PROCEDURE.

5. FILL MATERIALS

THE MATERIALS USED SHALL BE FREE FROM ORGANIC MATTER AND OTHER DELETERIOUS SUBSTANCES, SUCH AS TREES, BRUSH AND RUBBISH.

6. DEPTH AND MIXING OF FILL LAYERS

THE SELECTED FILL MATERIAL SHALL BE PLACED IN LEVEL, UNIFORM LAYERS WHICH, WHEN COMPACTED, SHALL HAVE A DENSITY CONFORMING TO THAT STIPULATED ABOVE. EACH LAYER SHALL BE THOROUGHLY MIXED DURING THE SPREADING TO ENSURE UNIFORMITY OF MATERIAL IN EACH LAYER. COMPACTED LAYER THICKNESS MAY VARY DEPENDING ON THE COMPACTION EQUIPMENT OF DEMONSTRATED CAPABILITY. THE MAXIMUM LOOSE DEPTH FOR ANY MATERIAL SHALL NOT EXCEED TWELVE INCHES (12"). FOR TESTING REQUIREMENTS OF FILL MATERIAL, SEE DENSITY TESTING.

7. ROCK

WHEN FILL MATERIAL INCLUDES ROCK, THE MAXIMUM ROCK SIZE SHALL BE AS APPROVED BY THE GEOTECHNICAL ENGINEER. NO LARGE ROCKS SHALL BE ALLOWED TO NEST AND ALL VOIDS MUST BE FILLED WITH SMALL STONES OR SOIL AND ADEQUATELY COMPACTED. NO LARGE ROCKS WILL BE PERMITTED WITHIN EIGHTEEN INCHES (18") OF THE FINISHED GRADE.

8. COMPACTION OF FILL LAYER

COMPACTION EQUIPMENT SHALL BE CAPABLE OF COMPACTING THE FILL TO THE SPECIFIED DENSITY. COMPACTION SHALL BE ACCOMPLISHED WHILE THE FILL MATERIAL IS AT OR NEAR THE APPROPRIATE MOISTURE CONTENT. COMPACTION OF EACH LAYER SHALL BE CONTINUOUS OVER THE ENTIRE STRUCTURAL AREA (BENEATH PROPOSED STRUCTURES).

9. COMPACTION OF SLOPES

THE FACES OF FILL SLOPES SHALL BE COMPACTED. COMPACTING OPERATIONS SHALL BE CONTINUED UNTIL THE SLOPE FACES ARE STABLE BUT NOT TOO DENSE FOR PLANTING ON THE SLOPES. COMPACTION OF THE SLOPE FACES MAY BE DONE PROGRESSIVELY IN INCREMENTS OF THREE TO FIVE FEET (3' TO 5') IN FILL HEIGHT AS THIS FILL PROGRESSES OR AFTER THE FILL HAS BEEN BROUGHT TO ITS TOTAL HEIGHT.

10. MOISTURE CONTENT

THE FILL MATERIAL SHALL BE COMPACTED AT THE APPROPRIATE MOISTURE CONTENT SPECIFIED FOR THE SOILS BEING USED. APPROPRIATE MOISTURE CONTENT IS DEFINED, TYPICALLY, AS OPTIMUM MOISTURE CONTENT; HOWEVER, FOR EXPANSIVE SOILS IT MAY BE GREATER THAN OPTIMUM MOISTURE CONTENT, AND OTHER MOISTURE CONTENTS MAY BE NECESSARY TO PRODUCE THE DESIRED RESULTS WITH CERTAIN SOILS.

11. DENSITY TESTS

FIELD DENSITY TESTS SHALL BE PERFORMED ON LAYERS OF FILL WHEN THE FILL IS BEING PLACED AS DIRECTED BY THE GEOTECHNICAL ENGINEER. THE MAXIMUM FILL HEIGHT BETWEEN DENSITY TESTING SHALL BE EIGHTEEN INCHES (18"). ALL TESTING SHALL BE REQUESTED BY THE CONTRACTOR TO MEET THE CONTRACTOR'S CONSTRUCTION SCHEDULE. NOTIFICATION BY THE CONTRACTOR TO CONDUCT TESTS SHALL BE AT LEAST THE DAY BEFORE. THIS NOTIFICATION SHALL INCLUDE THE FILL AREA LOCATION (LOT AND BLOCK), THE LIFT OR HEIGHT OF FILL AND APPROXIMATE DESIRED TIME OF TESTING. WHEN THESE TESTS INDICATE THAT THE DENSITY OF ANY LAYER OF FILL OR PORTION THEREOF IS BELOW THE REQUIRED DENSITY, THE PARTICULAR LAYER OR PORTION SHALL BE REWORKED AND RETESTED AT THE EXPENSE OF THE CONTRACTOR UNLESS THE CONTRACTOR CAN SHOW EVIDENCE THAT CIRCUMSTANCES BEYOND HIS CONTROL REQUIRED THE RETESTING. GENERALLY, THE SPECIFIC TESTING WILL BE AS FOLLOWS AND CONDUCTED BY GEOTECHNICAL ENGINEER.

1. THE LAND TO BE FILLED (PREPARED SUBGRADE) SHALL BE PREPARED AND TESTED AT A FREQUENCY AS DETERMINED BY THE GEOTECHNICAL ENGINEER.
2. THE FIRST LIFT OF COMPACTED FILL (GENERALLY 8 TO 12-IN.) SHALL BE TESTED AS DETERMINED BY THE GEOTECHNICAL ENGINEER. ANY AREAS SUPPORTING THE PROPOSED STRUCTURES REQUIRING FILL SHALL BE TESTED FOR DENSITY COMPLIANCE.
3. FILLS SHALL BE TESTED A MAXIMUM OF EACH EIGHTEEN INCHES (18") OF FILL.
4. TEST RESULTS WILL BE PROVIDED BY THE FIELD TECHNICIAN TO THE CONTRACTOR WHEN POSSIBLE; HOWEVER, ALL TEST RESULTS ARE TO BE REVIEWED BY THE GEOTECHNICAL ENGINEER FOR COMPLIANCE. THE ENGINEER WILL NOTIFY THE CONTRACTOR OF ALL THE TEST RESULTS.

12. CUT/FILL LOTS

AREAS INVOLVING CUT ON ONE PORTION AND FILL ON ANOTHER PORTION OF A SPECIFIC LOT SHALL BE PREPARED TO A MINIMUM DEPTH OF 4-IN. AND WILL BE THE SAME MATERIAL CLASSIFICATION AT THE SAME COMPACTION AND MOISTURE CONTENT. A MINIMUM OF TWO (2) FIELD DENSITY TESTS SHALL BE REQUIRED ON EACH CUT/FILL LOT FOR THE PURPOSE OF DETERMINING UNIFORMITY OF THE AREA SUPPORTING THE PROPOSED STRUCTURES.

NOTE:

LOT GRADING BASED ON SLABS BEING 15' BEHIND FRONT PROPERTY LINE.

ALL ELEVATIONS AT FRONT PROPERTY LINE ARE 0.30' ABOVE CURB ELEVATION ON MINOR STREETS.

TYPICAL PAD SIZES ARE 80' x 30' ON MINOR STREETS.

CONTOURS SHOWN ON STREET ARE TOP OF STREET.

CUDEENGINEERS.COM

CUDE ENGINEERS

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

GRADING PLAN

DATE
11/04/2025

PROJECT NO.
03499.009

DRAWN BY
AR/JF/RB

CHECKED BY
KMH

REVISIONS


1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
11/04/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C2.00


REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

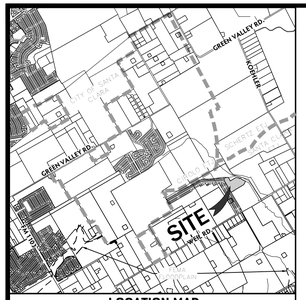

LOCATION MAP
N.T.S.

LEGEND

- PROPOSED SANITARY SEWER MANHOLE
- EXISTING SANITARY SEWER MANHOLE
- PROPOSED SANITARY SEWER LATERAL — vs
- PROPOSED SANITARY SEWER MAIN — 8"SS
- EXISTING SANITARY SEWER MAIN — EX. 8" SS
- PROPOSED WATER MAIN — 8"W
- EXISTING WATER MAIN — EX. 8" W
- PROPOSED STANDARD FIRE HYDRANT
- PROPOSED STANDARD GATE VALVE
- PROPOSED PERMANENT BLOWOFF
- SITE BOUNDARY
- ELECTRIC, GAS, TELEPHONE, & CABLE T.V. EASEMENT — E.G.T.C.A. ESM'T
- BUILDING SETBACK LINE — B.S.L.
- KEYNOTE — (1)
- STREET LIGHT



MINOR STREET CROSS-SECTION
N.T.S.

CAUTION!!!

THE CONTRACTOR SHALL BE AWARE THAT EXISTING UTILITIES ARE WITHIN THE SITE. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO HAVE THESE UTILITIES LOCATED PRIOR TO COMMENCING CONSTRUCTION. THE CONTRACTOR SHALL USE EXTREME CAUTION WHEN WORKING IN THIS AREA. ANY DAMAGE DONE TO THESE EXISTING FACILITIES WILL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO REPAIR.

TRENCH EXCAVATION SAFETY PROTECTION

CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/GEOTECHNICAL/SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITE(S) WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS, AND/OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEES OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

GVEC REQUIREMENTS FOR ELECTRIC UTILITY ROAD CROSSINGS

1. ONLY 2 ½ INCH SCHEDULE 40 GRAY ELECTRICAL CONDUIT IS TO BE USED AND IS TO BE SUPPLIED BY THE DEVELOPER. ALL JOINTS MUST BE GLUED.
2. ROAD CROSSINGS MUST BE INSTALLED 3 FT. BELOW FINAL SUB-GRADE OR 4 FT. FROM FINAL GRADE ON NON-WATER SIDE. WHEN ELECTRICAL CROSSINGS ARE REQUIRED TO CROSS WATER MAINS, THEY MUST BE 2 FT. BELOW OR 2 FT ABOVE WATER MAINS, BUT NOT LESS THAN 48 INCHES OF COVER BELOW FINAL GRADE (PIT SAND MAY BE REQUIRED BY SOME WATER UTILITIES).
3. ALL CONDUIT PIPES SHOULD BE LAID FLAT IN THE DITCH, SIDE BY SIDE, NOT STACKED OR TWISTED. IF MORE THAN TWO PIPES ARE IN A DITCH YOU MUST NUMBER THE INSIDE, BOTTOM OF EACH PIPE (EX: 1, 2, 3, ETC.)
4. ALL OTHER UTILITIES MUST MAINTAIN A MINIMUM OF 3 FT. OF SEPARATION FROM THE ELECTRICAL CROSSING DITCH.
5. NO OTHER UTILITY CROSSINGS SHOULD BE STUBBED OUT IN FRONT OF ELECTRICAL TRANSFORMERS OR SWITCHES.
6. NO OTHER UTILITIES ARE TO BE PLACED IN THE SAME DITCH AS THE ELECTRICAL CROSSING.
7. ALL CROSSINGS ARE TO BE INSTALLED AT THE PROPERTY LINE UNLESS THERE ARE WATER METERS EXISTING ON EACH SIDE OF THE PROPERTY LINE AT THE CROSSING LOCATION. AT LOCATIONS WHERE WATER METER CONFLICTS EXIST, THE ELECTRICAL CROSSING MUST BE MOVED 7' FROM THE PROPERTY LINE TO AVOID WATER METERS. ALL OTHER UTILITY CROSSINGS MUST BE LOCATED 3 FT. ON OPPOSITE SIDE OF PROPERTY LINE.
8. ALL CROSSINGS MUST BE INSPECTED BY A GVEC REPRESENTATIVE BEFORE THEY ARE BACKFILLED. PLEASE PROVIDE ONE WEEK NOTICE AS TO WHEN INSPECTIONS WILL BE NEEDED.
9. ALL UTILITY CONDUIT LOCATIONS SHALL BE PROVIDED ON A SEPARATE EXHIBIT THAT MUST BE REQUESTED BY THE CONTRACTOR TO THE ENGINEER.

NOTE

WATER METERS TO BE PLACED WITHIN RIGHT-OF-WAY TO AVOID CONFLICT WITH TRANSFORMERS/SECONDARY ENCLOSURE ELECTRIC SERVICE.

*CONDUIT SLEEVE NOTE:

1. SLEEVE INSTALLATION TO BE COMPLETED IN ACCORDANCE TO GVEC ISSUED ELECTRICAL PLAN.

DEVELOPER:


LENNAR HOMES OF TEXAS LAND AND CONSTRUCTION, LTD.
CONTACT PERSON: RICHARD MOTT
100 NE LOOP 410, SUITE 1155
SAN ANTONIO, TX 78216
TEL: (210) 403-6200

CIVIL ENGINEER:


CUDE ENGINEERS
CONTACT PERSON: CHRIS J. CHAFFEE, P.E.
4122 POND HILL ROAD, SUITE 101
SAN ANTONIO, TX 78231
TEL: (210) 681-2951
FAX: (210) 523-7112

KEYNOTES


1. 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
2. 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
1. EXISTING 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE (CONCURRENT GRACE VALLEY RANCH PHASE 6)
2. EXISTING 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE (CONCURRENT GRACE VALLEY RANCH PHASE 6)

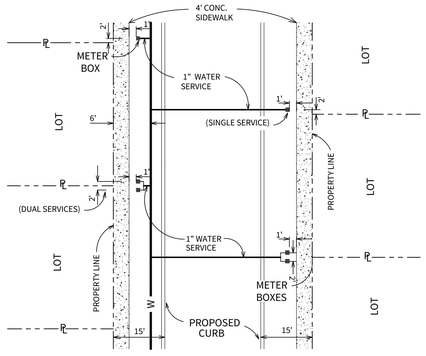

WATER METER BOX LOCATION (60' R.O.W.)
N.T.S.

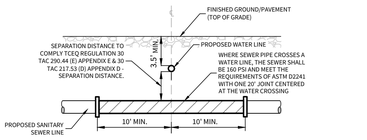

TYPICAL SANITARY SEWER/ WATER CROSSING DETAIL
N.T.S.

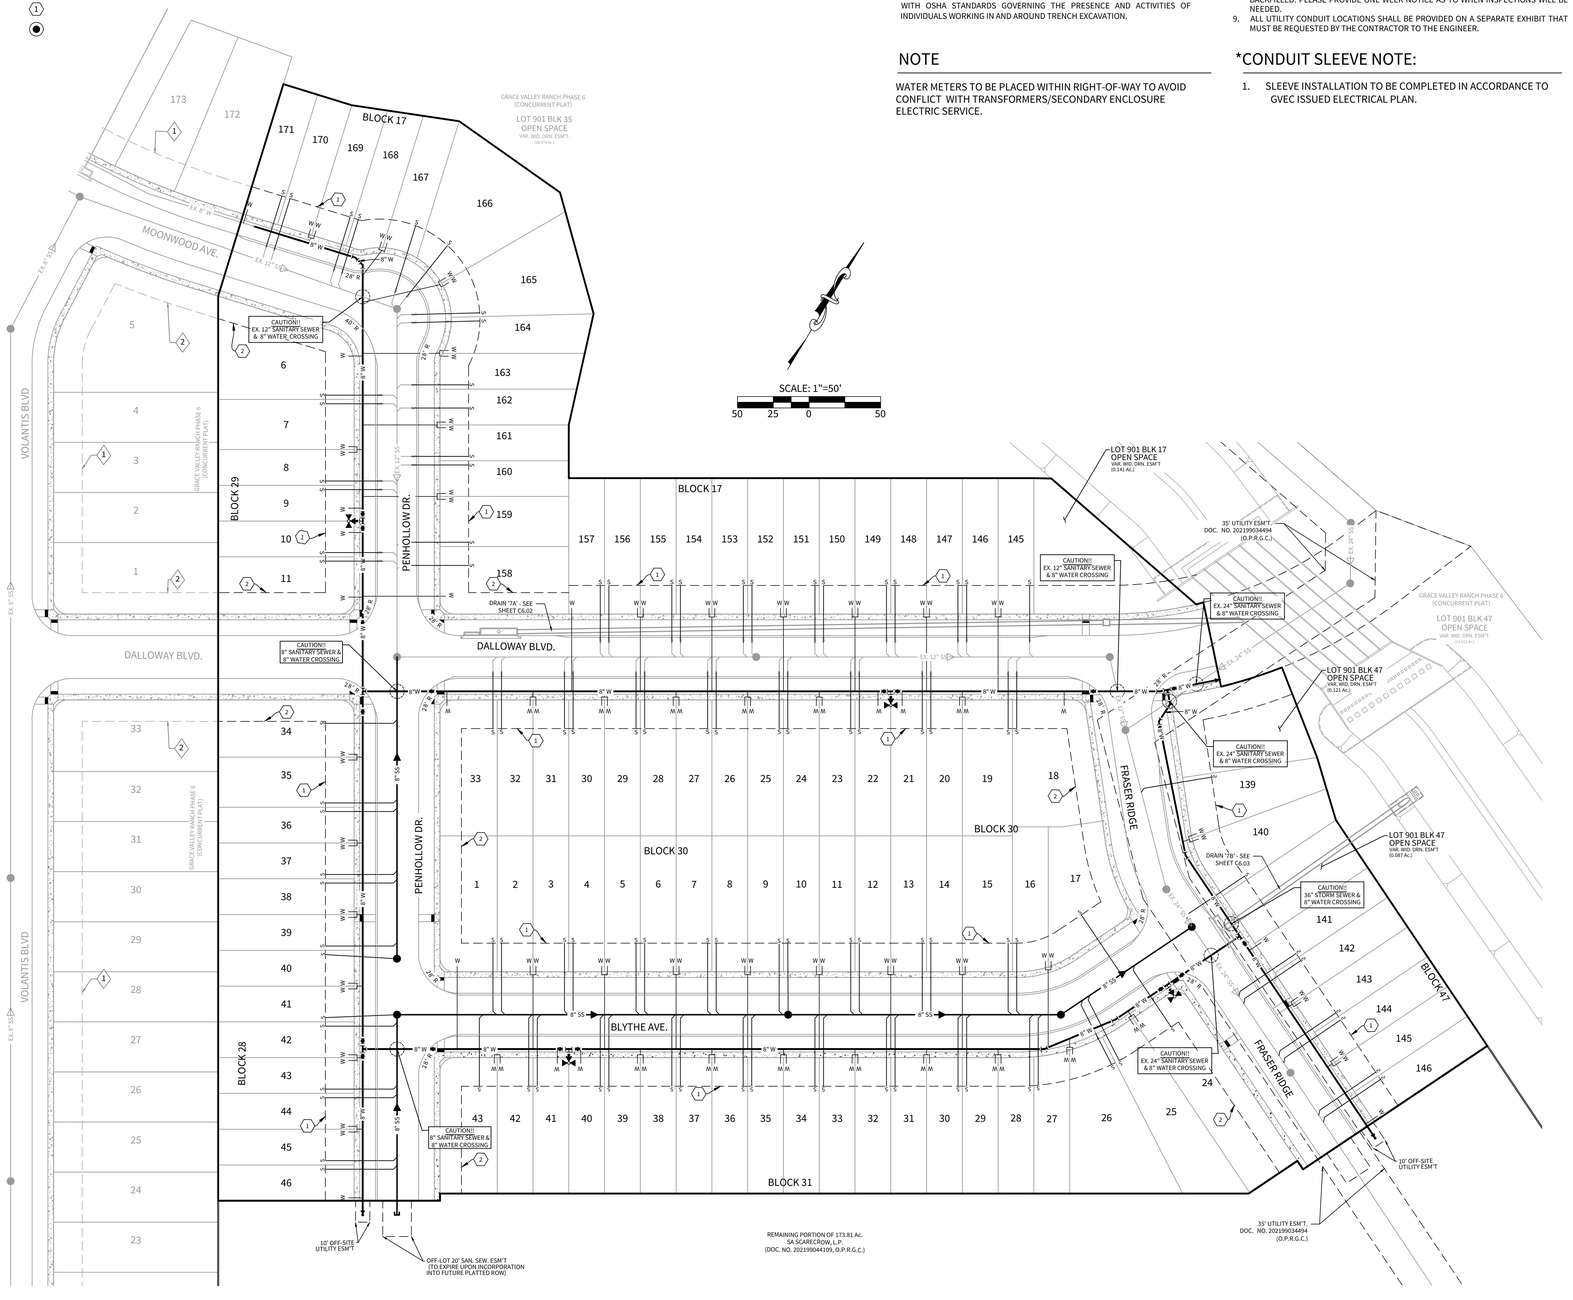

CUDEENGINEERS.COM

CUDE ENGINEERS

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

UTILITY LAYOUT PLAN

DATE
11/04/2025

PROJECT NO.
03499.009

DRAWN BY
AR/JF/RB

CHECKED BY
KMH

REVISIONS
1.
2.
3.
4.
5.
6.
7.
8.
9.


STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED PROFESSIONAL ENGINEER
11/04/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C3.00

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

P:\03499\009\2-DWG\4-Plans\C3.00 UTIL Plan 2025-11-04 1:50pm thamm

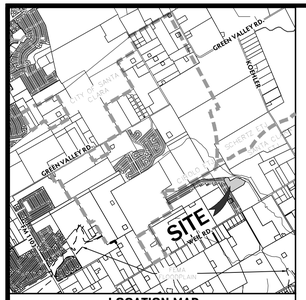

LOCATION MAP N.T.S.

DEVELOPER:

LENNAR HOMES OF TEXAS LAND AND CONSTRUCTION, LTD.
CONTACT PERSON: RICHARD MOTT
100 NE LOOP 410, SUITE 1155
SAN ANTONIO, TX 78216
TEL: (210) 403-6200

CIVIL ENGINEER:


CUDE ENGINEERS
CONTACT PERSON: CHRIS J. CHAFFEE, P.E.
4122 POND HILL ROAD, SUITE 101
SAN ANTONIO, TX 78231
TEL: (210) 681-2951
FAX: (210) 523-7112

LEGEND

- PROPOSED SANITARY SEWER MANHOLE
- EXISTING SANITARY SEWER MANHOLE
- PROPOSED SANITARY SEWER LATERAL — 6"
- PROPOSED SANITARY SEWER MAIN — 8"SS
- EXISTING SANITARY SEWER MAIN — EX. 8" SS
- PROPOSED WATER MAIN — 8"W
- EXISTING WATER MAIN — EX. 8" W
- PROPOSED STANDARD FIRE HYDRANT
- PROPOSED STANDARD GATE VALVE
- PROPOSED PERMANENT BLOWOFF
- ELECTRIC, GAS, TELEPHONE, & CABLE T.V. EASEMENT — E.G.T.C.A. ESM'T
- BUILDING SETBACK LINE — B.S.L.
- KEYNOTE (1)

KEYNOTES

1. 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
2. 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
3. EXISTING SANITARY SEWER LATERAL STUBOUT. CONTRACTOR TO EXTEND LATERAL (@2.0% MIN. SLOPE) TO UTILITY EASEMENT UNLESS SPECIFIED OTHERWISE.
4. CONTRACTOR TO USE LATERAL SADDLE TO MAKE SANITARY SEWER LATERAL CONNECTION TO EXISTING MAIN.

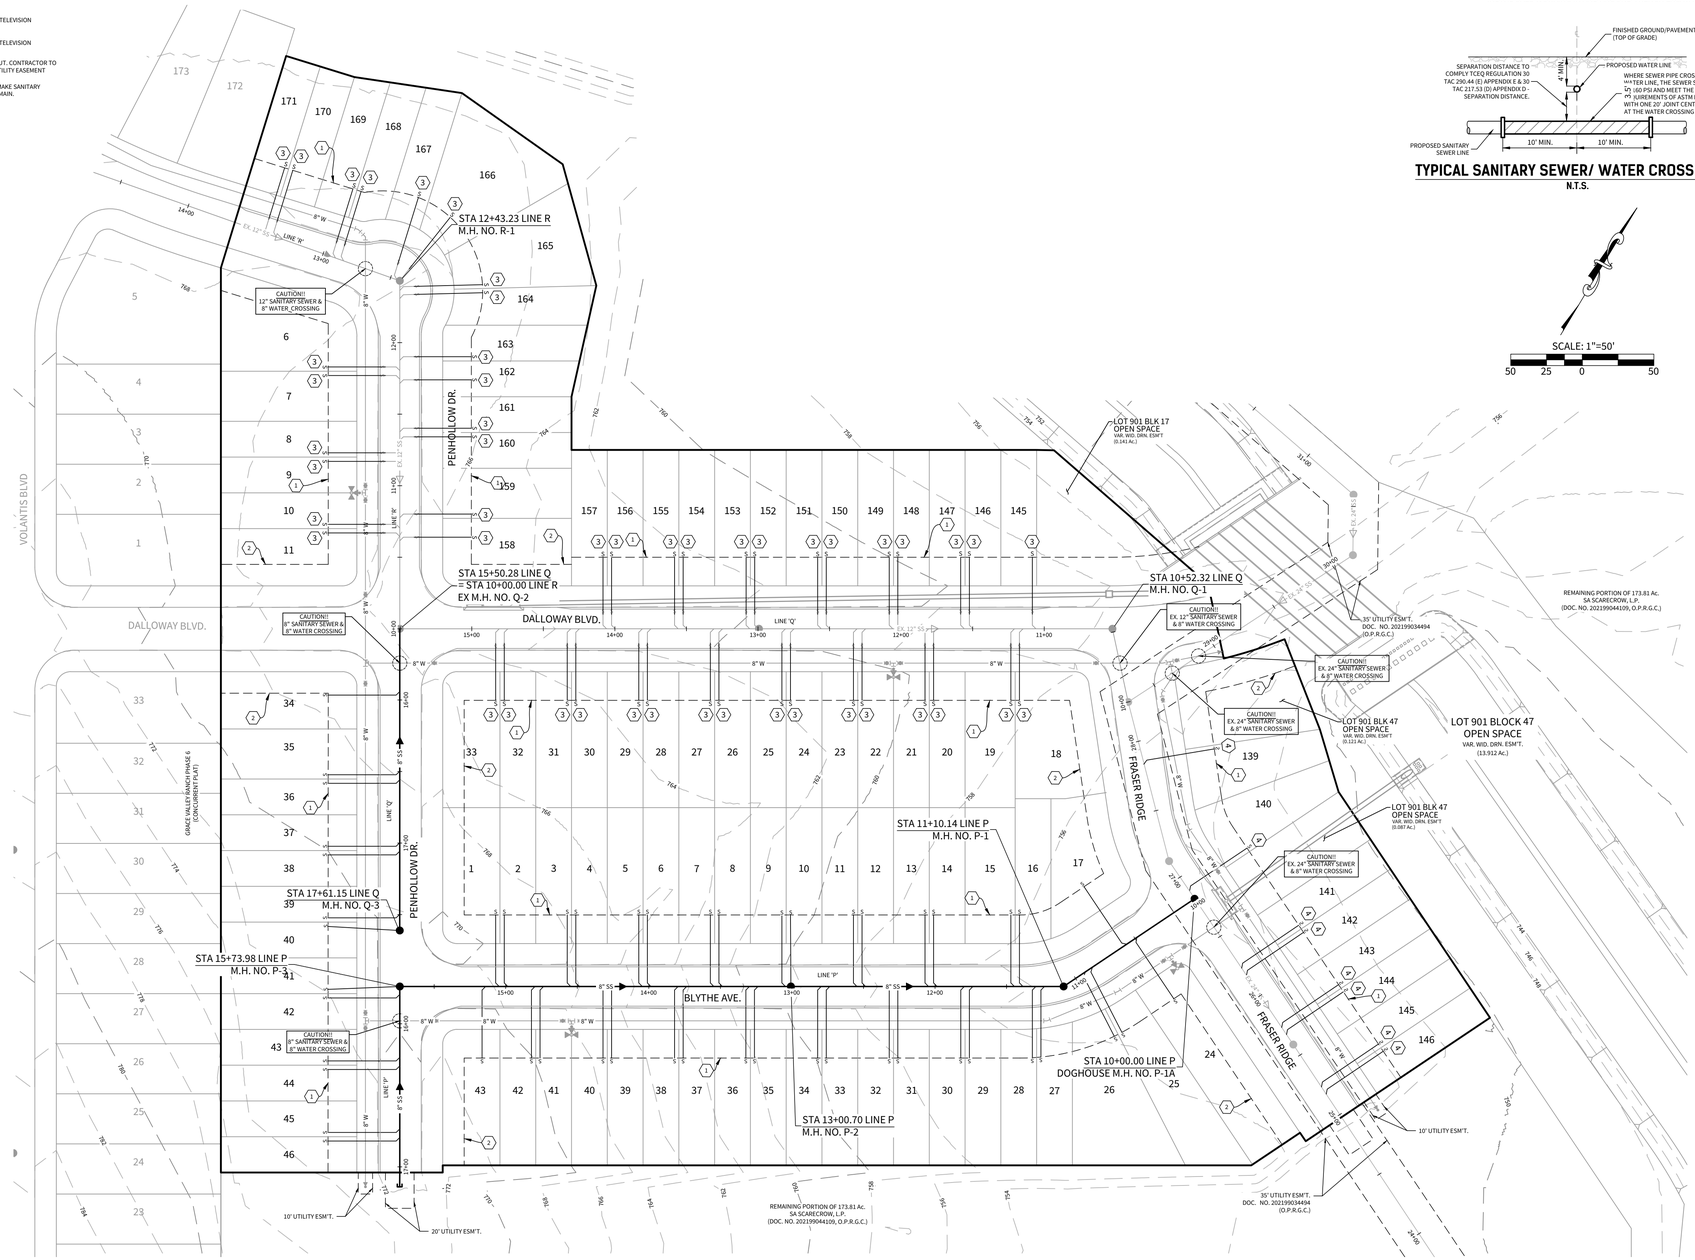

CAUTION!!!

THE CONTRACTOR SHALL BE AWARE THAT EXISTING UTILITIES ARE WITHIN FRASER RIDGE. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO HAVE THESE UTILITIES LOCATED PRIOR TO COMMENCING CONSTRUCTION. THE CONTRACTOR SHALL USE EXTREME CAUTION WHEN WORKING IN THIS AREA. ANY DAMAGE DONE TO THESE EXISTING FACILITIES WILL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO REPAIR.

TRENCH EXCAVATION SAFETY PROTECTION

CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/GEOTECHNICAL/SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITE(S) WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS, AND/OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEES OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

TYPICAL SANITARY SEWER/ WATER CROSSING DETAIL
N.T.S.

CUDEENGINEERS.COM

CUDE ENGINEERS EST. 1980

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

SANITARY SEWER MASTER PLAN

DATE 11/04/2025

PROJECT NO. 03499.009

DRAWN BY AR/JF/RB

CHECKED BY KMH

REVISIONS

1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
11/04/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C4.00

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

P:\03499\009\2-DWG\4-Plans\C4.00-SSMP.dwg, 11/4/2025 1:32pm, Hannah


LEGEND

- PROPOSED SANITARY SEWER MANHOLE
- EXISTING SANITARY SEWER MANHOLE
- PROPOSED SANITARY SEWER LATERAL
- PROPOSED SANITARY SEWER MAIN — 8"SS
- EXISTING SANITARY SEWER MAIN — EX. 8" SS
- PROPOSED WATER MAIN — 8"W
- EXISTING WATER MAIN — EX. 8" W
- PROPOSED STANDARD FIRE HYDRANT
- PROPOSED STANDARD GATE VALVE
- PROPOSED PERMANENT BLOWOFF
- ELECTRIC, GAS, TELEPHONE, & CABLE T.V. EASEMENT — E.G.T.C.A. ESM'T
- BUILDING SETBACK LINE — B.S.L.
- KEYNOTE — (1)

KEYNOTES

1. 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
2. 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE


SCALE: 1"=50'
50 25 0 50

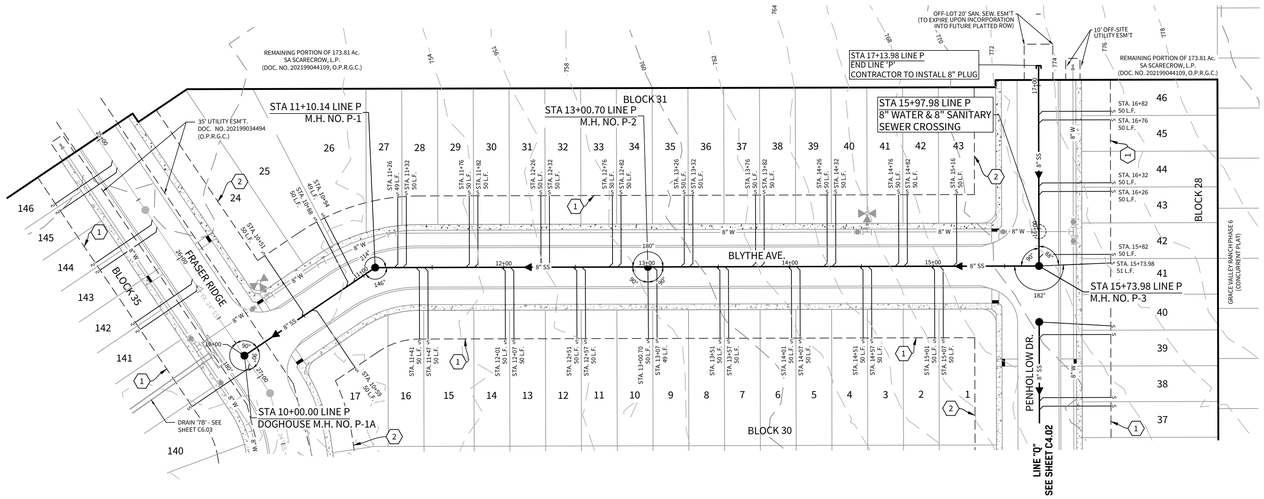

LINE "P"

STA. 10+00.00 TO STA. 17+13.98

HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

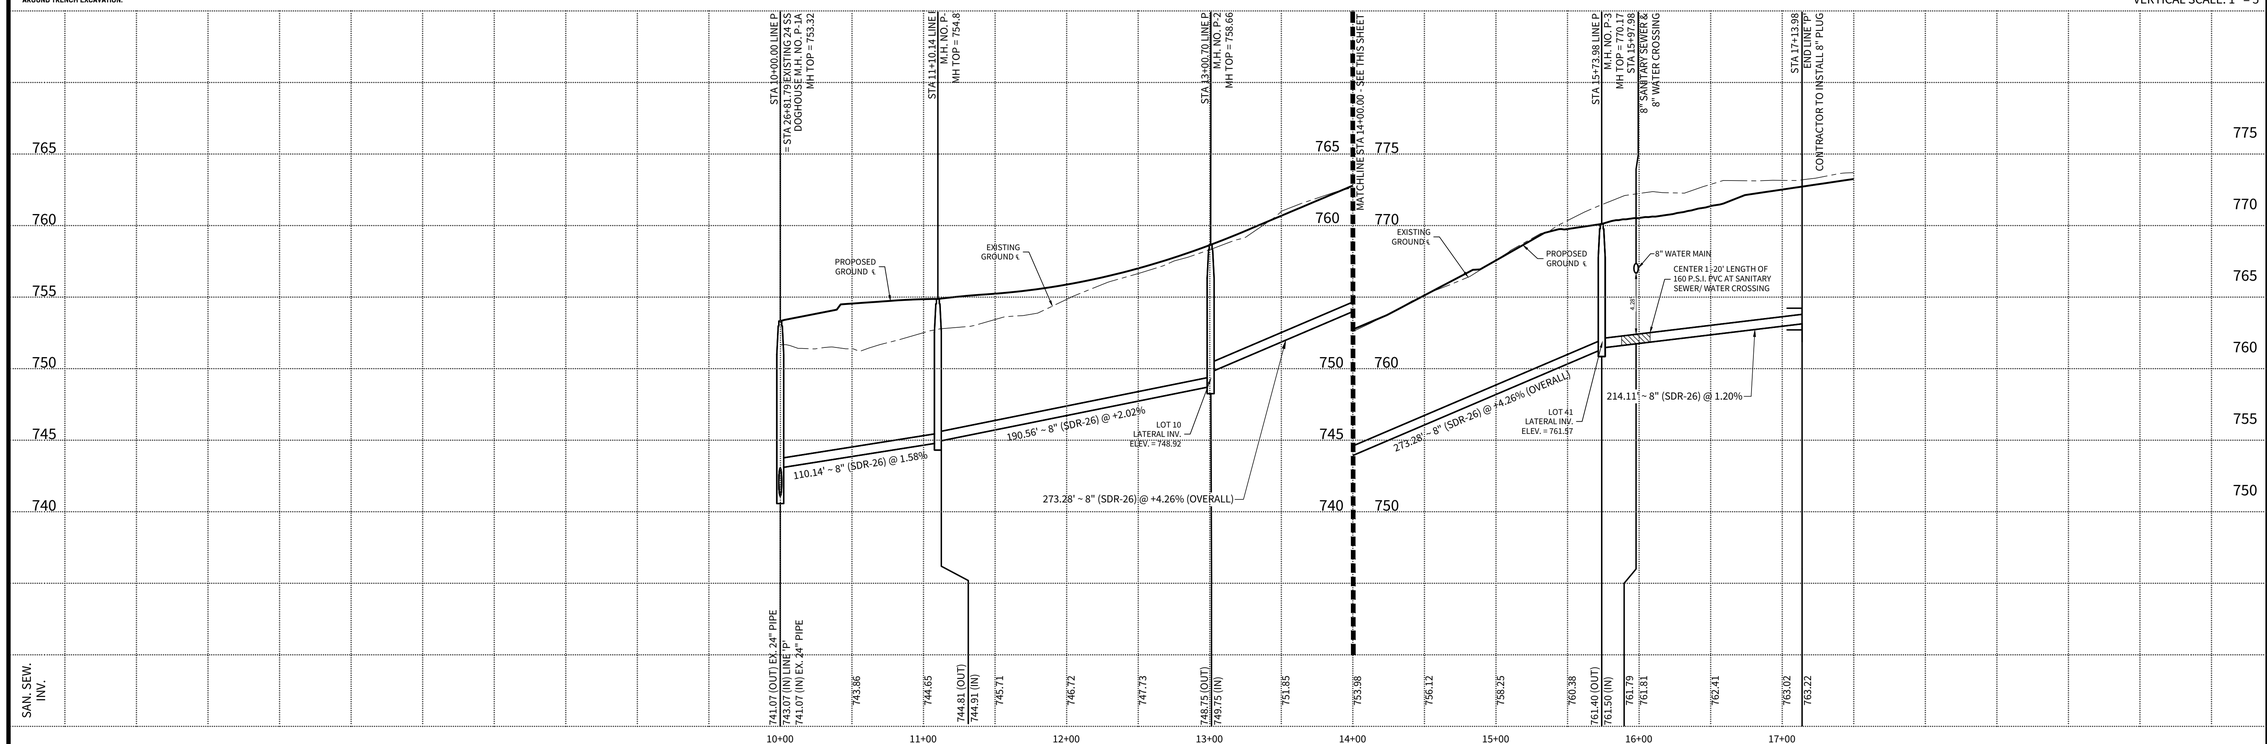

CAUTION!!!

THE CONTRACTOR SHALL BE AWARE THAT EXISTING UTILITIES ARE WITHIN THE SITE. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO HAVE THESE UTILITIES LOCATED PRIOR TO COMMENCING CONSTRUCTION. THE CONTRACTOR SHALL USE EXTREME CAUTION WHEN WORKING IN THIS AREA. ANY DAMAGE DONE TO THESE EXISTING FACILITIES WILL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO REPAIR.

TRENCH EXCAVATION SAFETY PROTECTION

CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/GEOTECHNICAL/SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITE(S) WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND/OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

CUDEENGINEERS.COM

CUDE ENGINEERS

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

SANITARY SEWER PLAN & PROFILE - LINE 'P'

DATE 10/15/2025

PROJECT NO. 03499.009

DRAWN BY AR/JF/RB

CHECKED BY KMH

REVISIONS

1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED PROFESSIONAL ENGINEER
10/15/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C4.01

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.


LEGEND

- PROPOSED SANITARY SEWER MANHOLE
- EXISTING SANITARY SEWER MANHOLE
- PROPOSED SANITARY SEWER LATERAL — VR
- PROPOSED SANITARY SEWER MAIN — 8"SS
- EXISTING SANITARY SEWER MAIN — EX. 8" SS
- PROPOSED WATER MAIN — 8"W
- EXISTING WATER MAIN — EX. 8" W
- PROPOSED STANDARD FIRE HYDRANT
- PROPOSED STANDARD GATE VALVE
- PROPOSED PERMANENT BLOWOFF
- ELECTRIC, GAS, TELEPHONE, & CABLE T.V. EASEMENT — E.G.T.C.A. ESM'T
- BUILDING SETBACK LINE — B.S.L.
- KEYNOTE — (1)

KEYNOTES


1. 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
2. 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
3. CONTRACTOR TO CONNECT PROPOSED 8" MAIN INTO EXISTING MANHOLE AND RECOAT MANHOLE PER GVSUD SPECIFICATIONS
4. EXISTING SANITARY SEWER LATERAL STUBOUT. CONTRACTOR TO EXTEND LATERAL (@2.0% MIN. SLOPE) TO UTILITY EASEMENT UNLESS SPECIFIED OTHERWISE.

SCALE: 1"=50'
50 25 0 50

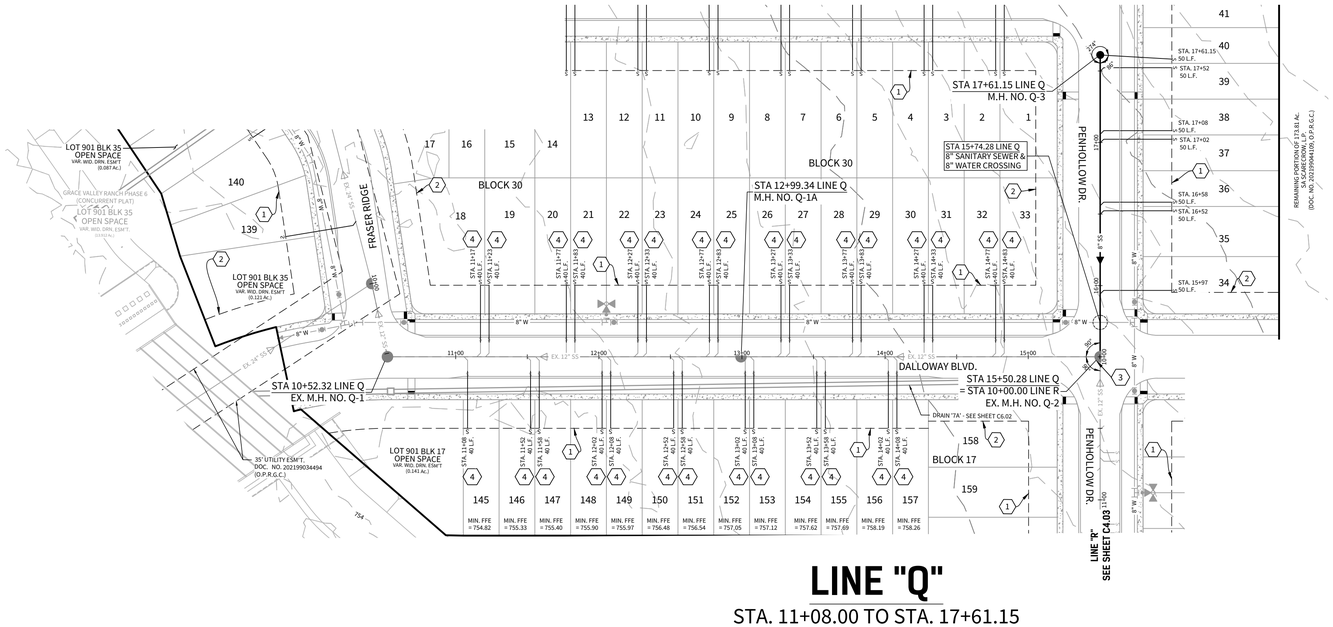

LINE "Q"

STA. 11+08.00 TO STA. 17+61.15

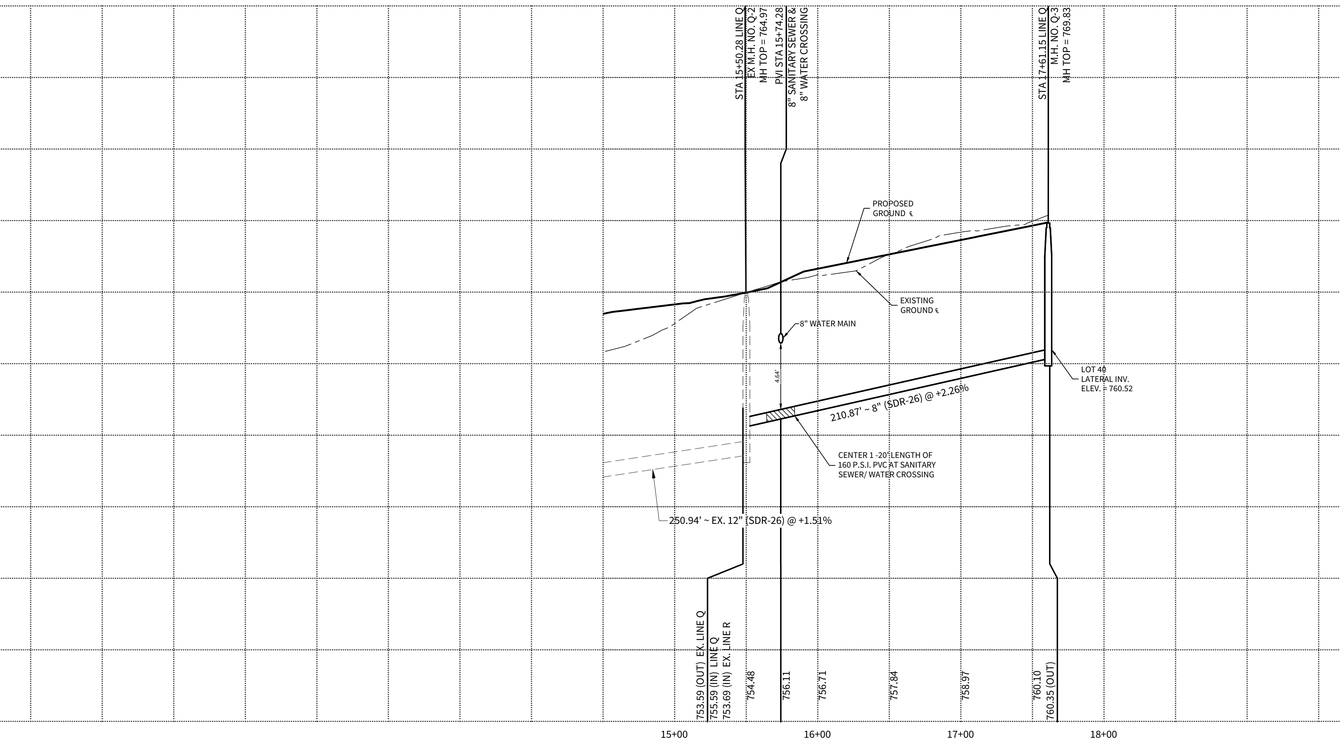

CAUTION!!!

THE CONTRACTOR SHALL BE AWARE THAT EXISTING UTILITIES ARE WITHIN THE SITE. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO HAVE THESE UTILITIES LOCATED PRIOR TO COMMENCING CONSTRUCTION. THE CONTRACTOR SHALL USE EXTREME CAUTION WHEN WORKING IN THIS AREA. ANY DAMAGE DONE TO THESE EXISTING FACILITIES WILL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO REPAIR.

TRENCH EXCAVATION SAFETY PROTECTION

CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/GEOTECHNICAL/SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITE(S) WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND/OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

CUDEENGINEERS.COM

CUDE ENGINEERS — EST. 1980

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

SANITARY SEWER PLAN & PROFILE - LINE "Q"

DATE 10/15/2025

PROJECT NO. 03499.009

DRAWN BY AR/JF/RB

CHECKED BY KMH

REVISIONS

1. 2. 3. 4. 5. 6. 7. 8. 9.

STATE OF TEXAS — KYLE M. HUDEK — 138753 — LICENSED PROFESSIONAL ENGINEER — 10/15/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C4.02


REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

LEGEND

- EXISTING SANITARY SEWER — EX.8"SS
- PROPOSED SANITARY SEWER — 8"SS
- EXISTING SANITARY SEWER MANHOLE
- PROPOSED SANITARY SEWER MANHOLE
- EXISTING WATER MAIN — EX.8"W
- PROPOSED WATER MAIN — 8"W
- EXISTING STANDARD FIRE HYDRANT
- PROPOSED STANDARD FIRE HYDRANT
- EXISTING STANDARD GATE VALVE
- PROPOSED STANDARD GATE VALVE
- EXISTING PERMANENT BLOWOFF
- PROPOSED PERMANENT BLOWOFF
- PROPOSED LIGHT POLE
- EXISTING OVERHEAD ELECTRIC — OHE
- ELECTRIC, GAS, TELEPHONE, & CABLE T.V. EASEMENT — E.G.T.CA. ESM'T
- BUILDING SETBACK LINE — B.S.L.

KEYNOTES

1. 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
2. 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
3. EXISTING SANITARY SEWER LATERAL STUBOUT. CONTRACTOR TO EXTEND LATERAL (@2.0% MIN. SLOPE) TO UTILITY EASEMENT UNLESS SPECIFIED OTHERWISE.
4. CONTRACTOR TO USE LATERAL SADDLE TO MAKE SANITARY SEWER LATERAL CONNECTION TO EXISTING MAIN.
1. EXISTING 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE (CONCURRENT GRACE VALLEY RANCH PHASE 6)
2. EXISTING 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE (CONCURRENT GRACE VALLEY RANCH PHASE 6)

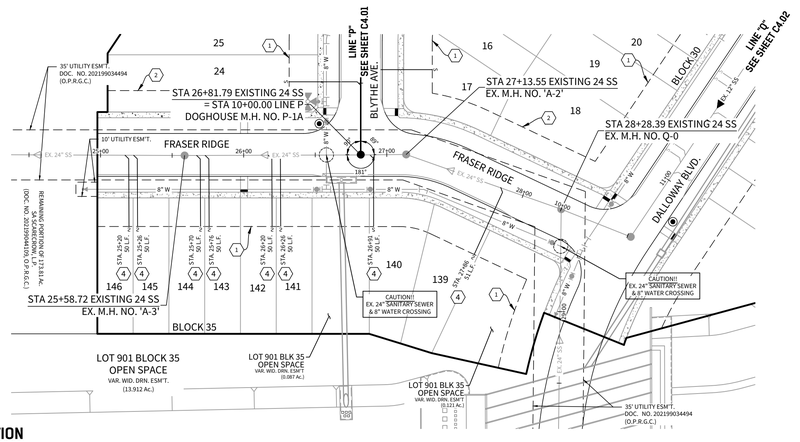

EXISTING 24" SAN. SEW.

STA. 24+97.78 TO STA. 29+05.23


TRENCH EXCAVATION SAFETY PROTECTION

CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/GEOTECHNICAL/SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITE(S) WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND/OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

CAUTION!!!


THE CONTRACTOR SHALL BE AWARE THAT EXISTING UTILITIES ARE WITHIN THE SITE. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO HAVE THESE UTILITIES LOCATED PRIOR TO COMMENCING CONSTRUCTION. THE CONTRACTOR SHALL USE EXTREME CAUTION WHEN WORKING IN THIS AREA. ANY DAMAGE DONE TO THESE EXISTING FACILITIES WILL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO REPAIR.

SCALE: 1"=50'
50 25 0 50

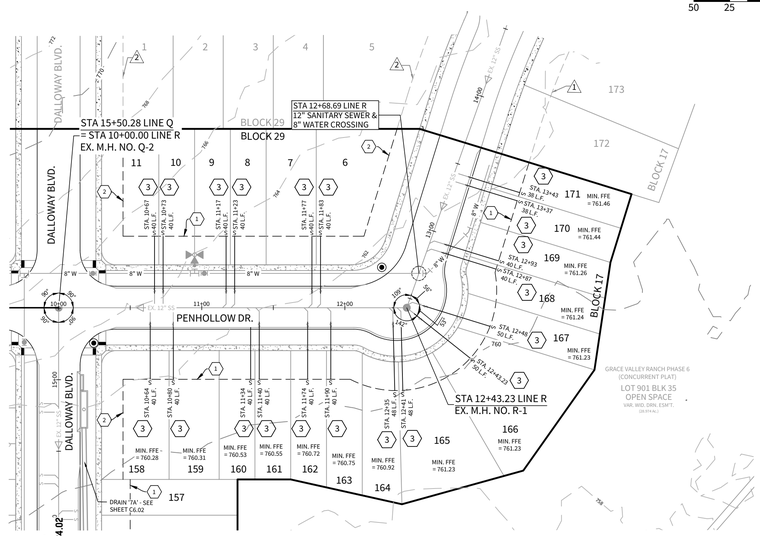

LINE "R"

STA. 10+00.00 TO STA. 13+43.00

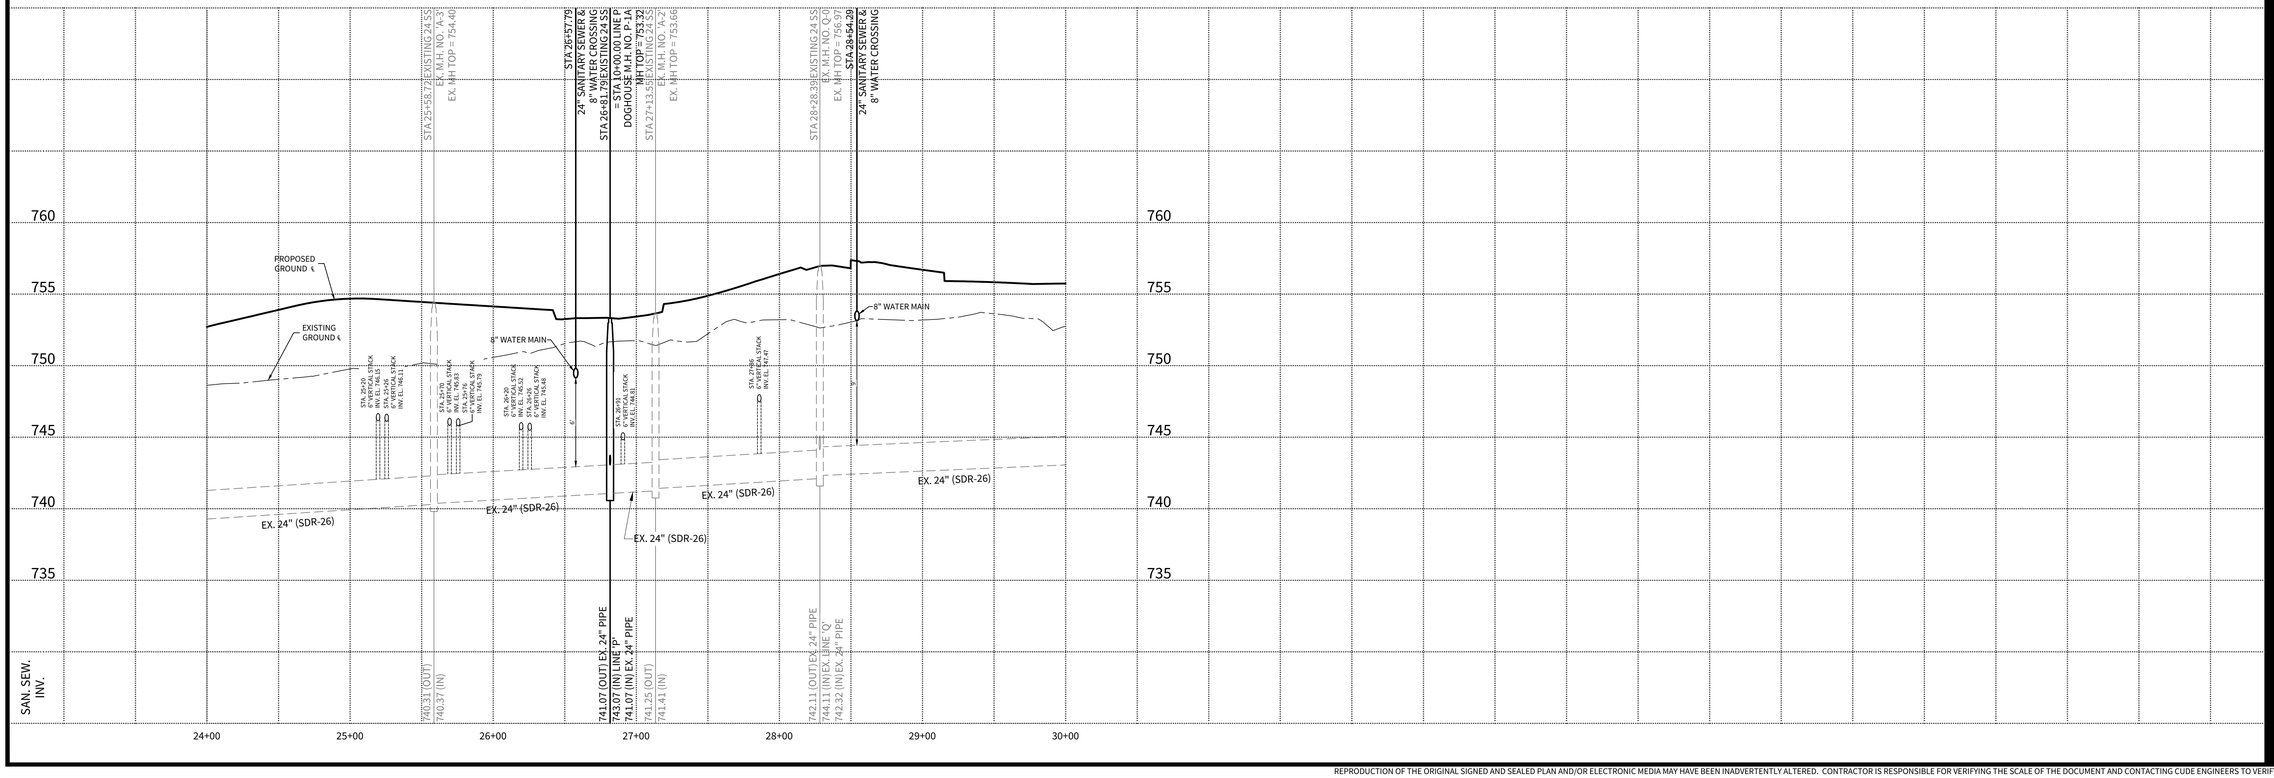

CUDEENGINEERS.COM

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

SANITARY SEWER PLAN & PROFILE - LINE 'R'

DATE 10/15/2025

PROJECT NO. 03499.009

DRAWN BY AR/JF/RB

CHECKED BY KMH

REVISIONS

1. 2. 3. 4. 5. 6. 7. 8. 9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
10/15/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C4.03

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

GREEN VALLEY SPECIAL UTILITY DISTRICT SANITARY SEWER SYSTEM GENERAL NOTES:

THE STANDARD SPECIFICATIONS AND DRAWING (DD) ARE PROVIDED AS A TECHNICAL RESOURCE FOR ENGINEERING PROFESSIONALS FOR USE IN DESIGN AND CONSTRUCTION OF SEWER COLLECTION SYSTEMS PROJECTS MANAGED AND CONTRACTED BY THE GREEN VALLEY SPECIAL UTILITY DISTRICT (GVSUD)

GENERAL: THE OWNER, DEVELOPER, ENGINEERING FIRM SHALL SUBMIT TO THE GREEN VALLEY SPECIAL UTILITY DISTRICT (GVSUD) ENGINEER, FOR APPROVAL, TWO (2) COPIES OF ALL PLATES, PLANS AND PROFILES, PLUMBING LAYOUT, WHICH HAVE BEEN DESIGNED AND THE DRAWINGS SEALED BY A REGISTERED PROFESSIONAL ENGINEER. WHEN APPROVED, ONE (1) COPY WILL BE RETURNED TO THE OWNER, DEVELOPER, ENGINEERING FIRM, SO MARKED. THE OWNER WILL BE REQUIRED TO MAKE ALL CHANGES INDICATED BY THE GVSUD ENGINEER, AND RETURN WITH ALL CHANGES, CORRECTIONS, BACK TO GVSUD FOR APPROVAL.

1. ALL MATERIALS AND CONSTRUCTION PROCEDURES WITHIN THE SCOPE OF THIS CONTRACT SHALL BE APPROVED BY THE GVSUD AND COMPLY WITH:
   A. CURRENT GVSUD TECHNICAL SPECIFICATIONS FOR UTILITIES CONSTRUCTION
   B. TEXAS COMMISSION ON ENVIRONMENTAL QUALITY (TCEQ), FORMERLY TEXAS NATURAL RESOURCE CONSERVATION COMMISSION (TNRCC), DESIGN CRITERIA FOR SEWAGE SYSTEMS 31 TAC 317.1, 31 TAC 317.2 AND 31 TAC 317.3, 30 TAC § 213.40 TAC 6217.
2. THE CONTRACTOR IS TO NOTIFY AND MAKE ARRANGEMENTS WITH THE GVSUD INSPECTIONS DIVISION AT (830)914-2335 OR (210)372-2228 - 48 HOURS PRIOR TO ANY EXCAVATION. A PRE-CONSTRUCTION CONFERENCE SHALL BE HELD BEFORE ANY EXCAVATION OR START OF PROJECT.
3. WORK SHALL NOT BE PERFORMED ON SATURDAYS, SUNDAYS OR HOLIDAYS BEFORE 7:30 A.M. OR AFTER 4:30 P.M., UNLESS PRIOR APPROVAL IS GRANTED BY THE GVSUD ENGINEER.
   A. THE LOCATIONS AND DEPTHS OF EXISTING UTILITIES TO INCLUDE SURFACE LATERALS, SHOWN IN THESE PLANS ARE APPROXIMATE ONLY. IT SHALL BE THE CONTRACTORS RESPONSIBILITY TO LOCATION (POT HOLE, VERIFY LOCATION, ELEVATIONS OF ALL) UTILITY SERVICE LINES 48 HOURS PRIOR TO EXCAVATION AND TO PROTECT THE SAME DURING CONSTRUCTION. CONTRACTOR WILL BE RESPONSIBLE FOR ANY DAMAGES OF EXISTING UTILITIES AND REPAIRS WILL BE AT THE CONTRACTORS EXPENSE.

EXISTING MANHOLES/SEWER

4. CONTRACTOR WILL MAINTAIN SERVICE TO ALL EXISTING SANITARY SEWERS AT ALL TIMES DURING CONSTRUCTION. CONTRACTOR WILL MARK, CLEAN ALL DEBRIS, GRAVEL, DIRT, ETC. OUT OF MANHOLES AND ANY STOPPAGES CAUSED BY DEBRIS DURING CONSTRUCTION. CONTRACTOR WILL UNPLUG STOPPAGE AT CONTRACTORS EXPENSE. ANY DAMAGE TO EXISTING MANHOLES OR SEWER MAIN WILL BE CORRECTED AT THE CONTRACTORS EXPENSE. CONTRACTOR SHALL TAKE ALL NECESSARY MEASURES TO PREVENT DAMAGE TO EXISTING OR NEW RINGS, COVERS, OR CONES FROM EQUIPMENT AND MATERIALS USED OR TAKEN THROUGH THE WORK AREA. IF AN EXISTING OR NEW MANHOLE COVER, RING, OR CONE IS DAMAGED BY THE CONTRACTOR IT SHALL BE REPLACED AS DIRECTED BY THE GVSUD INSPECTOR. MANHOLES WILL NEED TO BE RESEALED WITH THE GVSUD APPROVED SEALING. IF SEAL COATING IS BROKEN, CONTRACTOR WILL HAVE MANHOLE RECOATED. RESEAL ALL LEAKS AT CONTRACTORS EXPENSE.
   A. CONTRACTOR TO ENSURE ALL PLUGS USED TO PLUG SEWER LINES. WHILE TESTING THE PROJECT (SUCH AS AIR PLUGS, SCREW TYPE PLUGS, ETC.) ARE LABELED, MARKED OR TAGGED. PROJECT INSPECTOR WILL RECORD HOW MANY PLUGS ARE BEING USED, LOCATION AND I.D., WITHIN COLLECTION SYSTEM. CONTRACTOR WILL REPORT TO PROJECT INSPECTOR OF ANY LOST OR UNRESTRAINED PLUGS INTO SEWER COLLECTION SYSTEM
   B. CONTRACTOR WILL BE HELD LIABLE FOR ANY DAMAGES TO SEWER COLLECTION SYSTEM STOPPAGES, OVER-FLOWS, BACKUP INTO HOMES CAUSED BY LOST RUN-AWAY SEWER PLUGS THAT WERE USED ON THAT PROJECT OR OUTFALL LINE WASTEWATER TREATMENT PLANTS.
   C. CONTRACTOR WILL ALSO BE RESPONSIBLE FOR ANY DAMAGES DUE TO WASTEWATER TREATMENT APPARATUS, SUCH AS SCREW PUMPS, ETC. CAUSED BY LOST OF RUN-AWAY SEWER PLUGS. CONTRACTOR WILL BE HELD LIABLE FOR DAMAGES, AS WELL AS COST OF REPAIRS.
5. ALL WORK IN THE TEXAS HIGHWAY DEPARTMENT, BEXAR COUNTY, GUADALUPE COUNTY, AND CITY OF CIBOLO RIGHT OF WAY SHALL BE DONE IN ACCORDANCE WITH RESPECTIVE CONSTRUCTION SPECIFICATIONS AND PERMIT.
6. ALL WORK IN PUBLIC STREETS SHALL BE COORDINATED WITH AND APPROVED BY THE BEXAR COUNTY OR GUADALUPE COUNTY PUBLIC WORKS DEPARTMENT TRAFFIC DIVISION AND STREET ENGINEER.
7. DUE TO FEDERAL REGULATIONS TITLE 49, PART 192.181, CITY PUBLIC SERVICE MUST MAINTAIN ACCESS TO GAS VALVES AT ALL TIMES. THE CONTRACTOR MUST PROTECT AND WORK AROUND VALVES THAT ARE NOT PROTECTED AREAS.
8. NO TESTING WILL BE PERFORMED PRIOR TO 30 DAYS FROM THE COMPLETE INSTALLATION OF THE SANITARY SEWER LINES.

   THE FOLLOWING SEQUENCE WILL BE STRICTLY ADHERED TO:
   A. PULL MANDREL - AFTER 30 DAYS OF INSTALLATION
   B. PERFORM AIR TEST
   C. PULL WIPER (AFTER STREET HAS BE ASPHALTED IN NEW SUBDIVISIONS)
   D. VACUUM TEST ALL MANHOLES WITHIN THE PROJECT
   E. CCTV-ALL NEW LINE-PAN (TILL ALL SERVICE LATERALS TO 6"X6" CLEAN OUT. FLOOD ALL LINES BEFORE CCTV. SUMMIT DVD)
9. CONTRACTOR SHALL SUBMIT FIELD COPY PLANS AND PROFILES SHOWING AS-BUILT WORK AT END OF PROJECT, CCTV DVD AND COMPACTION DENSITY REPORTS FOR MAIN SEWER LINE AND ALL SERVICE LATERALS TRENCHES. WARRANTY LETTERS ON MATERIALS, WORKMANSHIP FOR 24 MONTHS AFTER FINAL ACCEPTANCE.
10. ALL MANHOLES SHALL BE CONSTRUCTED SO THAT THE TOP OF THE RING IS AT LEAST TWELVE (12) INCHES ABOVE THE FINISHED GRADE OF THE SURROUNDING GASLINE EXCEPT WHERE LOCATED IN PAVED AREAS. IN PAVED AREAS THE MANHOLE RING SHALL BE FLUSH WITH THE PAVEMENT. ALL NEW INSTALLED MANHOLES WILL BE WITH A 30" INCH OPENING, MINIMUM, WITH THE GVSUD LOGO ON THE COVER. EVERY THIRD MANHOLE COVER WILL HAVE A 1" HOLE OR A VENT.
11. ALL MANHOLES SHALL BE WITH A 30" INCH OPENING, HAVE WATERTIGHT RING AND COVERS, WITH THE GVSUD LOGO. ON PRIVATE PROPERTY, MANHOLE RING AND COVER SHALL BE TYPICAL MANHOLE COVER WATER TIGHT.
   A. BEFORE BACK FILLING/COMPACTION/CONCRETE ENCASEMENT
      ALL MANHOLE JOINT SECTION RISERS, CONE SECTIONS AND GRADE RING SHALL BE WRAPPED WITH GATOR WRAP SEALING SYSTEMS, BUTYL ADHESIVE SEALANT WITH A MINIMUM THICKNESS OF 30 MILS. INFI-SHIELD WRAPPED WITH RISER-WRAP SEALING SYSTEM, GATOR WRAP
      MATERIAL: RUBBER MEETS ASTM C923/MASTIC MEETS ASTM C 990 OR APPROVE BY THE GVSUD ENGINEER SUBSTITUTION ON OUTSIDE FOR I/I, GROUND WATER TABLE.
12. IF CONCRETE THROAT RINGS ARE TO BE INSTALLED, A MINIMUM OF TWO AND A MAXIMUM OF FOUR THROAT RINGS WILL BE USED AT EACH MANHOLE FOR ADJUSTMENT.
13. INFILTRATION DISHES WILL BE REQUIRED IN MANHOLES WHERE APPLICABLE (I.E., SUCH AS LOW DRAINAGE AREAS) AND EVERY THIRD MANHOLE SHALL BE VENTED. 30" INCH MANHOLE COVER WITH 1" INCH HOLE CENTER OF COVER WHERE APPLICABLE.

Note: Manhole cover inserts shall be FRW Industries, inc. "Inflow Protector-Cover" "Preco Industries Ltd.", "Sewer Guard", or approved equal, and shall be installed in strict accordance with the manufacturer's recommendations. The contractor shall be responsible for making the necessary field measurements for the manufacturer prior to construction.

   A. ALL MANHOLES MUST HAVE 350-400 FEET SPACING BETWEEN MANHOLES TO PROVIDE ACCESS TO SEWER LINES FOR CLEANING, ON THE GVSUD PUBLIC SEWER EASEMENT. A 16 FOOT GATE WITH LOCK WILL BE PROVIDED BY THE CONTRACTOR FOR ACCESS TO CLEANING AND MAINTAINING SEWER LINES.
   B. DROP MANHOLES SHALL BE REQUIRED WHEN THE INFLOW ELEVATION IS MORE THAN TWENTY-FOUR (24) INCHES ABOVE THE OUTFLOW ELEVATION. DROP SHALL BE LOCATED OUTSIDE THE MANHOLE WITH ITS FLOW LINE ELEVATION LOCATED BETWEEN THE CENTER LINE AND TOP OF SEWER LINE.
14. ALL MANHOLES WILL BE CONCRETE ENCASEMENT 1 FOOT AROUND RING, 28-INCH DEEP AFTER GATOR WRAP SEALING SYSTEM HAS BEEN APPLIED.
15. NEW MANHOLE PROTECTIVE COATING, LINER IS FOR THE PURPOSE OF INFILTRATION BECAUSE OF HIGH WATER TABLE. APPLICATION PROCEDURES ACCORDANCE WITH MANUFACTURER'S RECOMMENDATION AND PER THE FOLLOWING SPECIFICATIONS
   A. MANHOLE PROTECTIVE COATING CONTRACTOR WILL BE RESPONSIBLE FOR MANHOLES ON PROJECT SAFETY ASSESSMENT; CONFINED SPACE ENTRY SET BY OCCUPATIONAL SAFETY AND HEALTH STANDARDS, 29 CFR 1910.146 APP E.
   B. THE CONTRACTOR, SHALL NOTIFY THE GVSUD UTILITIES INSPECTIONS DEPARTMENT WITH A MINIMUM OF 2 DAYS ADVANCE NOTICE OF THE START OF ANY FIELD SURFACE PREPARATION WORK OF COATING APPLICATION WORK OF MANHOLES.
   C. ALL NEW MANHOLES IN NEW DEVELOPMENTS SHALL BE 30" INCH OPENING, WATERTIGHT AND THE INTERIOR WALL COATED WITH A GVSUD APPROVED SEWER STRUCTURE FOR ALL MANHOLES, SEWPERCOAT 2000 HR REGULAR, WITH THE REQUIRED ONE-INCH THICK APPLICATION.

APPROVED MATERIALS ARE AS FOLLOWS:
CEMENTITIOUS COATING WITH REQUIRED HALF-INCH THICK APPLICATION

- SEWPERCOAT 2000 HR REGULAR
- REFRATTA HAC 100
- MAXIMUM CA PLUS

EPOXY COATING: WITH SPECIFIED THICKNESS APPLICATION

- AROMATIC POLYUREA SCP DROPLINER REQUIRED THICKNESS 125 MILLS

   D. WARRANTY LETTER ON MANHOLE PROTECTIVE COATING FOR 10 YEARS AFTER FINAL ACCEPTANCE OF PROTECTIVE COATINGS CONTRACTOR IS NOT RELIEVED OF ITS RESPONSIBILITIES UNDER THE CONTRACT DOCUMENTS.
      i. ANY CONNECTIONS TO EXISTING MANHOLES WILL REQUIRE A 36-INCH CRADLE TO SUPPORT INCOMING PIPE. A RUBBER GASKET WILL ALSO BE REQUIRED (CENTERED AT MANHOLE WALL) WITH GROUTING AT INTERIOR AND EXTERIOR PENETRATIONS.
      ii. PENETRATION INTO MANHOLE WILL BE CORE DRILLED. ANY DAMAGE EXITING THE MANHOLE WILL BE REPLACED AT CONTRACTORS EXPENSE. IF COATING SEAL IS BROKEN, THE MANHOLE WILL BE RECOATED WITH THE SAME MATERIALS. IF EXISTING SEWER MANHOLE SEAL COATING IS BROKEN, ALL OF MANHOLE WILL BE RELEASED WITH SAME MATERIALS AND ONE-INCH THICKNESS.
      iii. ANY AND ALL EXISTING MANHOLES WITHIN CONSTRUCTION PROJECT THAT TIE IN, ARE DONE BY CONTRACTOR TO STUB-OUT ADJUSTMENT, RECONSTRUCTION, OR LEAKING. MANHOLE WILL BE COAT SEALED AT CONTRACTOR'S EXPENSE.
      iii. MANHOLES WITH STUB-OUTS (8"-30" INCH OR LARGER MUST BE LOCATED AT THE END OF ALL SEWER LINES THAT MAY BE EXTENDED IN THE FUTURE, MANHOLES PLACED AT THE END OF THE WASTEWATER COLLECTION SYSTEM PIPES THAT MAY BE EXTENDED IN THE FUTURE MUST INCLUDE STUB-OUTS WITH PLUGS.

PIPING

16. THE KIND AND DESCRIPTION OF THE PIPE CONDUIT IS SHOWN ON THE PLANS (IF PVC, SDR AND ASTM/ANSI DESIGNATION CLASS). AS SDR 26 PVC, ASTM D-3034 WITH A MINIMUM STIFFNESS OF 115 PSI TEXAS ADMINISTRATIVE CODE (TAC) RULES TO INCLUDECSS TAC § 213, OR ANY REVISIONS THERE TO APPLICABLE TCQ, 30 TAC 7 217, FOR ALL NEW DEVELOPMENT
17. THE USE OF ASBESTOS CEMENT PIPE WILL BE PROHIBITED UNDER THIS CONTRACT. ALL DUCTILE IRON PIPE USED IN THIS SYSTEM SHALL BE CORROSION PROTECTED ON BOTH THE INTERIOR AND EXTERIOR SURFACES. ALL CORROSION PROTECTION SHALL BE APPLIED AND INSTALLED IN SUCH A MANNER AS TO MAINTAIN A CONTINUOUSLY PROTECTED SURFACE AFTER FINAL PIPE INSTALLATION.
18. ALL PVC SEWER PIPE WITH OVER 14 FEET OF COVER SHALL BE EXTRA STRENGTH; MINIMUM PIPE STIFFNESS OF 150 PSI.
19. ALL SEWER PIPES SHALL HAVE COMPRESSION OR MECHANICAL JOINTS.
20. SEWER PIPE CONNECTIONS TO PRECAST MANHOLES SHALL BE APPROVED BY THE GVSUD. THIS CONNECTION SHALL USE FLEXIBLE "BOOT" TYPE CONNECTOR SUCH AS THE PSX POSITIVE SEAL SYSTEM OR ENGINEER APPROVED EQUAL AND COMPLY WITH ASTM C-923. SEWER PIPE CONNECTIONS TO MONOLITHIC MANHOLES WILL BE AS SHOWN ON THE STANDARD DETAIL SHEET. ANY CHANGES IN THESE METHODS MUST BE APPROVED BY GVSUD ENGINEER.
21. ALL PIPE TRENCHING, BEDDING AND BACKFILL SHALL BE DONE IN ACCORDANCE WITH APPROPRIATE ASTM/ANSI SPECIFICATIONS [REFERENCE 31 TAC 317.2(A)(5)(A); ASTMC-12 (ANSI A106.2) OR ASTM D-2321 (ANSI K65.171)]. ALL COMPACTION @ 98% DENSITY TESTS ACROSS THE BOARD, 1 RANDOM DENSITY TEST PER LIFT FOR EVERY 400 FEET.
   A. SAND MIGRATION, SEEPAGE PREVENTION COLLAR WHEN CHANGING THE INITIAL BACKFILL FROM SELECT INITIAL BACKFILL TO OPTIONAL SELECT INITIAL BACKFILL, A TWO (2) FOOT LONG CLASS D CONCRETE ENCASEMENT, EVERY 180 FEET ALONG PIPE AND 20 FEET FROM WALL OF MANHOLE IN EACH DIRECTION. NO EXTRA PAY ITEM.

   B. BEDDING SHALL CONSIST OF TXDOT-GRADE 4 (1 1/2"-1 5/8") COMMONLY KNOWN AS SEWER GRAVEL.
      i. THE BEDDING SHALL MEET THE FOLLOWING GRADATION:

a.	2"	100.0%
b.	1 ¾"	100.0%
c.	1 ½"	100.0%
d.	1"	52.6%
e.	¾"	10.7%
f.	⅜"	1.3%

   C. SEWER LINE LOCATION
      i. SEWER LINES SHALL BE SIZED AND EXTENDED THROUGH THE LIMITS OF A DEVELOPMENT TO SERVE ADJACENT PROPERTY OWNERS, WITH MANHOLES AND STUB-OUT AT END OF SEWER LINE.
         a. IN PHASED CONSTRUCTION OF THOROUGHFARES, THE SEWER LINE SHALL BE EXTENDED THE ENTIRE LENGTH OF THE THOROUGHFARE BEING CONSTRUCTED.
      ii. NO PUBLIC SEWER LINE SHALL BE LOCATED NEARER THAN FIVE (5) FEET FROM ANY TREE.
      iii. SIZES AND GRADES FOR SANITARY SEWER SHALL BE AS REQUIRED BY THE GVSUD ENGINEER AND CONSIDERATION SHALL BE GIVE AS TO POSSIBLE EXTENSIONS FOR FUTURE DEVELOPMENT. NO SANITARY SEWERS, OTHER THAN LATERALS AND FORCE MAINS, SHALL BE LESS THAN EIGHT (8) INCH IN DIAMETER.

22. WHEN SEWER LATERALS ARE TO BE CONNECTED TO EXISTING SEWER MAINS AND NO STUB-OUT HAS BEEN EARLIER PROVIDED, THE CONNECTION MUST BE MADE WITH AN APPROVED SERVICE SADDLE AS PER 31 TAC 313.5(C) (7). NEW INVERT TO BE BUILT, SMOOTH CHANNEL FOR NEW PIPE/SLOPE AT 2% FLOW.
23. ALL RESIDENTIAL SERVICE LATERALS SHALL BE SDR 26 WITH RATING OF 115 PSI, BE EXTENDED TO THE PROPERTY LINE AT (6 X 6) CAPPED AND SEALED. ATTACH SEWER BURIAL TAPE TO THE END OF ALL SEWER LATERALS AND BRING UP TO THE GROUND LEVEL FOR MARKER (GREEN). (SEE HOUSE LATERALS DETAILS)
   AA. SEWER SERVICE LATERALS. THE SIZES AND LOCATIONS OF LATERALS SHALL BE DESIGNATED AS FOLLOWS UNLESS OTHERWISE DIRECTED BY THE GVSUD ENGINEER:
      i. IN GENERAL FOR SINGLE FAMILY DWELLING, THE LATERAL SIZE SHALL BE FOUR (4) INCH MINIMUM. HOUSE LATERALS SHALL BE IN STALL CENTER OF THE LOT AND SHALL HAVE A TEN(10) FOOT SEPARATION FROM THE WATER SERVICE. THE SERVICE SHALL THEN BE EXTENDED AT A FORTY-FIVE (45) DEGREE ANGLE TO FOUR (4) FEET ABOVE THE FINISHED GRADE AND CAPPED. USE SEWER BURIAL TAPE TO MARK ALL SEWER SERVICE LATERALS.
      ii. MULTIPLE UNITS, APARTMENTS, LOCAL RETAIL AND COMMERCIAL SIX (6) INCH MINIMUM. MANUFACTURING AND INDUSTRIES - EIGHT (8) INCH MINIMUM, OR LARGER AS REQUIRED.

TRAPS AND INTERCEPTORS (FOG - TECQ)

UNIFORM PLUMBING CODE, CITY OF SAN ANTONIO BUILDING INSPECTIONS DEPARTMENT. ALL COMMERCIAL BUILDINGS WILL HAVE TRAPS (FOG-TECQ)

OIL SEPARATORS

WHICH INCLUDE OIL SEPARATOR-GASOLINE SERVICE STATIONS, CAR WASHES, GARAGES, DRY CLEANERS, CHEMICAL PLANTS, GAS PLANTS, HIDE PROCESSORS, TESTING LABORATORIES, OR ANY PLANT WHERE OIL OR SOLVENTS MAY BE INTRODUCED IN TO THE SANITARY SEWER SYSTEM. THE SIZING CRITERIA FOR OIL SEPARATORS SHALL BE BASED ON THE G.P.M. RATE OF ALL FIXTURES, APPLIANCE OR APPURTENANCE, DRAINING INTO SEWER SYSTEM.

SAND INTERCEPTORS

SAND INTERCEPTORS SHALL BE INSTALLED IN THE SEWER SYSTEM OF THE FOLLOWING ESTABLISHMENTS, GARAGES, CAR WASHES, SERVICE STATIONS, OR ANY PLACE OF BUSINESS WHERE HEAVY SOLIDS MAY BE INTRODUCED INTO THE SANITARY SEWER SYSTEM. THE SIZING CRITERIA FOR A SAND INTERCEPTOR SHALL BE BASED ON THE REQUIRED G.P.M .X 12 MINUTE RETENTION TIMES TO OBTAIN THE TANK SIZE IN GALLONS CAPACITY.

AUTOMATIC CAR WASHES

WITH HIGH PRESSURE SPRAYS AND/OR BRUSHES INSTALL A 50 G.P.M. INTERCEPTOR. MINIMUM, FOR A 4-BAY VEHICLE WASH. THE SIZE OF THE INTERCEPTOR SHALL INCREASE 10 G.P.M. FOR EACH ADDITIONAL WASH BAY OVER 4. SINGLE BAY OR PORTABLE WASHER TYPE VEHICLE WASHES SHALL INSTALL A 20 G.P.M. INTERCEPTOR MINIMUM.

NEUTRALIZING DEVICES

IN NO CASE SHALL CORROSIVE LIQUIDS, SPENT ACIDS, OR OTHER HAMMFUL CHEMICALS WHICH MIGHT DESTROY OR INJURE A DRAIN, SEWER, SOIL, OR WASTE PIPE, OR WHICH MIGHT CREATE NOXIOUS OR TOXIC FUMES, DISCHARGE INTO THE SANITARY SEWER SYSTEM WITH OUT BEING THOROUGHLY NEUTRALIZED BY PASSING THOROUGHLY CONSTRUCTED AND ACCEPTABLE NEUTRALIZING DEVICE. SUCH DEVICE SHALL BE PROVIDED WITH A SUFFICIENT INTAKE OF NEUTRALIZING MEDIUM, CONSISTING OF LIMESTONE OR MARBLE CHIPS, SO AS THE MAKE ITS CONTENTS NON-INJURIOUS BEFORE BEING DISCHARGED INTO THE SANITARY SEWER SYSTEM.

LINT TRAPS

PUBLIC AND PRIVATE WASHATERIAS AND COMMERCIAL LAUNDRIES SHALL INSTALL A LINT TRAP EQUIPPED WITH A CONVENIENTLY LOCATED AND EASILY REMOVABLE WIRE BASKET OR OTHER SIMILAR DEVICE THAT WILL PREVENT THE STRINGS, RAGS, BUTTONS, OR OTHER PROHIBITED MATERIAL FROM ENTERING THE SANITARY SEWER SYSTEM. THE BASKET OR OTHER SIMILAR DEVICE SHALL PREVENT PASSAGE TO THE SANITARY SEWER SYSTEM OF SOLIDS GREATER THAN 1/2" INCH DIAMETER. THE LINT TRAP SIZE SHALL BE BASED ON THE TOTAL G.P.M. OF ALL FIXTURES, APPLIANCES AND APPURTENANCES DRAINING TO IT IN LIEU OF A LINT TRAP, A LINT INTERCEPTOR MAY BE INSTALL. THE INTERCEPTOR SHALL BE SIZED AND DESIGNED BY A TEXAS REGISTERED ENGINEER WITH HIS SEAL AND SIGNATURE ON THE DRAWINGS.

SILVER RECOVERY UNITS

SILVER RECOVERY UNITS SHALL BE INSTALLED IN WASTE LINES(S) LEADING FROM X-RAY PROCESSING, PHOTOGRAPHIC PROCESSING, AND/OR ANY PROCEDURES IN ESTABLISHMENT SUCH AS MEDICAL LABS, DENTAL LABS, PHOTO FINISHERS, PRINTERS, GRAPHIC ARTS PRODUCTION FACILITIES, HOSPITAL FACILITIES, VETERINARY HOSPITALS, OR OTHER ESTABLISHMENTS WHERE SILVER MAY BE INTRODUCED INTO THE SANITARY SEWER SYSTEM.

SOLID INTERCEPTORS

SOLIDS INTERCEPTORS SHALL BE INSTALLED WHEN PRE-TREATMENT OF WASTE STREAMS IS NECESSARY TO PREVENT SOLIDS GREATER THAN ½" IN DIAMETER, WHICH MAY CAUSE LINE STOPPAGE FROM ENTERING THE SANITARY SEWER SYSTEM.

INTERCEPTORS

   a. INTERCEPTORS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE DESIGN APPROVED BY THE GVSUD CONSISTING OF A MINIMUM OF TWO COMPARTMENTS WITH FITTINGS DESIGNED FOR GREASE RETENTION AND PROVIDE FOR A MINIMUM OF TWELVE (12) MINUTES RETENTION
   b. THERE SHALL BE AN ADEQUATE NUMBER OF MANHOLES TO PROVIDE ACCESS FOR CLEANING ALL AREAS OF AN INTERCEPTOR, ONE MANHOLE PER TRAP COMPARTMENT. MANHOLE COVERS SHALL BE GAS TIGHT IN CONSTRUCTION HAVING A MINIMUM OPENING DIMENSION OF 20 INCHES (0.5 M).
   c. IN AREAS WHERE TRAFFIC MAY EXIST THE INTERCEPTOR SHALL BE DESIGNED TO HAVE ADEQUATE REINFORCEMENT AND COVER.
   d. ALL INTERCEPTORS SHALL HAVE THE SIZE OF THE INTERCEPTOR (IN GALLON PER MINUTE OR GALLON CAPACITY) PERMANENTLY AFFIXED TO THE DEVICE.
   e. ALL CONCRETE UTILIZED IN THE CONSTRUCTION OF INTERCEPTOR SHALL HAVE A MINIMUM STRENGTH OF 3000 PSI.
   f. AN EFFLUENT SAMPLING WELL ON ALL INTERCEPTORS SHALL BE REQUIRED. THE SAMPLE WELL SHALL HAVE A RISER A MINIMUM OF 6" INCHES IN DIAMETER AND SHALL BE INSTALLED AFTER THE CONFLUENCE OF ALL WASTE STREAMS FROM THE FACILITY AND PRIOR TO DISCHARGING INTO SANITARY SEWER COLLECTION SYSTEM. THE WELL SHALL BE PERPENDICULAR TO THE EFFLUENT LATERAL TO ALLOW VISUAL OBSERVATION OF THE FLOW STREAM AND PROVIDE FOR SAMPLING OF WASTEWATER.

WATERTIGHT TESTING (24 HOURS)

   g. ALL INTERCEPTORS SHALL BE WATER TESTED OUT AT JOB SITE AFTER BEING INSTALLED (PLUG BOTH ENDS AND FILL TO TOP OF INTERCEPTOR). INTERCEPTOR SHALL SHOW NO LEAKAGE FROM SECTION SEAMS, PINHOLES, OR OTHER IMPERFECTIONS. ANY LEAKAGE IS CAUSE FOR REJECTION. WHEN LEAKAGE OCCURS, ADDITIONAL WATER TESTING SHALL BE MADE. AFTER CORRECTING MEASURE TEST, REPORTS SHALL SHOW TOTAL NUMBER OF INTERCEPTORS TESTED, WHEN LEAKAGE OCCURS, CORRECTIVE MEASURES TAKEN SHALL BE REPORTED BY GVSUD INSPECTORS. GVSUD INSPECTORS SHALL RECORD IN DAILY LOG WITH PROJECT NAME, DATE IT WAS TESTED AND COMPLETED.

   B. MANHOLES WILL BE REQUIRED ON SIX (6) INCH AND LARGER LATERALS WHERE THEY CONNECT TO THE MAIN
      a. LATERALS WILL NOT BE ATTACHED TO SEWER MAINS THAT ARE DEEPER THAN TWO (2) FEET.
      b. FITTINGS ARE NOT PERMITTED ON LATERALS BETWEEN THE WYE AND THE PROPERTY LINE.
      c. DEEP CUT OR DROP CONNECTIONS SHALL NOT BE PERMITTED.
      d. A MINIMUM OF ONE (1) LATERAL PER BUILDING SHALL BE REQUIRED. ALSO, A MINIMUM OF ONE (1) LATERAL PER RESIDENTIAL LOT SHALL BE REQUIRED. DUPLEXES SHALL HAVE TWO (2) LATERALS THAT SHALL BE INDEPENDENTLY ATTACHED TO THE MAIN.
      e. ALL SEWER LATERAL CROSSING WATER MAINS SHALL CONFORM TO THE REQUIREMENTS OF THE TCEQ CHAPTER 317 (DESIGN CRITERIA FOR SEWERAGE SYSTEMS) LATEST REVISION, SDR 26 150 PSI, OR DUCTILE IRON PIPE, CONCRETE ENCASEMENT.

24. WHERE REQUIRED CONCRETE ENCASEMENT SHALL BE PLACED FOR FULL WIDTH OF THE TRENCH TO A PLAIN SIX (6) INCHES ABOVE THE TOP OF THE PIPE WITH PAY UNITS AS SHOWN ON THE STANDARD DETAILS SHEET.
25. A MINIMUM OF FOUR (4) FEET OF COVER IS TO BE MAINTAINED OVER THE SANITARY SEWER MAIN AND LATERALS AT GRADE, OTHERWISE CONCRETE ENCASEMENT IS REQUIRED.
26. WHERE POROUS MATERIAL , INCLUDING "SUBGRADE FILLER" IS USED FOR BACKFILL IN THE BEDDING AND INITIAL BACKFILL ZONES, SEE REQUIRED EXCAVATION AND PAY ADJUSTMENT AT 180 FEET RETAINERS SHALL CONSIST OF CLASS "D" CONCRETE ENCASEMENT. THE RETAINERS SHALL EXTEND FROM THE BOTTOM OF THE TRENCH TO THE TOP OF THE GRANULAR MATERIAL FOR THE ENTIRE TRENCH WIDTH. ENCASEMENT SHALL BE 24 INCHES LONG. NO EXTRA PAY ITEM

BLASTING


27. WHEN ALLOWABLE, BLASTING SHALL BE PREFORMED IN ACCORDANCE WITH THE ABOVE CRITERIA ESTABLISHED BY THE NATIONAL FIRE PROTECTION ASSOCIATION 312 TAC 313.5(C) (6).
28. BLASTING SEWER LINE EXCAVATION MUST BE DONE IN SUCH A MANNER AS TO MINIMIZE THE FRACTURING OF ROCK BEYOND THE REQUIRED EXCAVATION. THE CONTRACTOR SHALL CONSIDER THE ELEVATION OF THE EXISTING SANITARY SEWER MAIN IN RELATION TO THE BLASTING CHARGE AND RELATIVE DIRECTION OF EXISTING AND PROPOSED TRENCHES. BLASTING WITHIN SUCH AREAS SHALL BE ACCOMPLISHED ONLY BY QUALIFIED BLASTING CONTRACTORS WHO HOLD BLASTING LICENSES FROM A QUALIFIED AGENCY SUCH AS THE SAN ANTONIO FIRE DEPARTMENT IN BEXAR COUNTY. ANY DAMAGE TO EXISTING SANITARY SEWERS RESULTING FROM BLASTING SHALL BE REPAIRED AND RESTORED BY THE CONTRACTOR AT HIS OWN EXPENSE.
29. NO BLASTING SHALL BE PERFORMED WITH 75 FEET OF EXISTING UTILITIES.

TESTING


30. ALL SEWER LINES MUST BE TESTED IN ACCORDANCE WITH THE FOLLOWING:
   A. 317.2(A)(5)(B), DEFLECTION TEST FOR FLEXIBLE AND SEMI-RIGID PIPE CONDUCTED AFTER FINAL BACKFILL AS BEEN IN PLACE AT LEAST 30 DAYS.
   B. 317.2(A)(4)(A) & (B) OR GVSUD SPECIFICATIONS INFILTRATION AND OR EXFILTRATION AND OR LOW-PRESSURE AIR TEST.
   C. 313.5(C)(10)(C) OR GVSUD SPECIFICATIONS: ALL MANHOLES AND WET WELLS MUST BE TESTED SEPARATELY AND INDEPENDENTLY OF THE COLLECTION LINES.
   D. IN THE EVENT THAT TESTING REQUIREMENTS CONFLICT, THE LATEST TCEQ DESIGN CRITERIA SHALL BE USED.
31. SEWER LINES SHALL BE TESTED FROM MANHOLE TO MANHOLE.
32. SANITARY SEWER CONNECTIONS MADE DIRECTLY TO EXISTING MANHOLES WHICH REQUIRE PENETRATION INTO MANHOLE WILL BE CORE DRILLED. ANY DAMAGE TO EXISTING MANHOLE WILL BE REPLACED AT CONTRACTORS EXPENSE AND WILL REQUIRE SUCCESSFUL TESTING OF THE EXISTING MANHOLE IN ACCORDANCE WITH THE GVSUD SPECIFICATIONS. HANG A GOLF BALL IN FRONT OF CAMERA, PIPE GRADE IS OUT OF TOLERANCE IF GOLF BALL BECOMES 50% SUBMERGED.
33. AFTER CONSTRUCTION, TESTING WILL BE DONE BY PAN/TILT TV CAMERA BY THE CONTRACTOR AND OBSERVED BY INSPECTOR, WASTEWATER ENGINEERING PERSONNEL AND CONTRACTOR AS CAMERA IS RUN THROUGH THE LINES. PAN/TILT ALL 8" SERVICE LATERALS TO 6"X6" STUB-OUT. VIDEOS MUST INCLUDE SUBDIVISION NAME, MANHOLE NUMBER, SERVICE LATERAL STATION NUMBER, FLOW DIRECTION , LOCATION ANY ABNORMALITIES, SUCH AS BROKEN PIPE OR MISALIGNED, JOINT, GRAVEL, DIRT, MUST BE CLEANED OUT, REPLACE AT CONTRACTOR'S EXPENSE. NEW SEWER SYSTEM WILL BE FLOODED WITH H20 BEFORE BEING TV. ALL SEWER LINES MUST BE PRESSURE CLEANED TO INCLUDE SERVICE LATERALS 6" INCH TO STUB-OUT. ALL VIDEOS SHALL BE SUBMITTED IN DVD FORMAT WITH WRITTEN REPORTS.
34. A COPY OF ALL TESTING REPORTS INCLUDING BACKFILL COMPACTION TESTS SHALL BE FORWARDED TO GVSUD.
   A. DENSITY TEST WILL BE REQUIRED ON ALL SANITARY SEWER TRENCHES INCLUDING SERVICE LATERALS. SERVICE LATERALS TO BE CHOSEN RANDOMLY BY FIELD INSPECTOR. DENSITIES ON SERVICE LATERAL SHALL NOT EXCEED 25% OF TOTAL NUMBER OF SERVICES.

EXCAVATION


35. CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/GEOTECHNICAL/SAFETY/EQUIPMENT CONSULTANT, IF ANY , SHALL REVIEW THESE PLANS AND AVAILABLE GEO

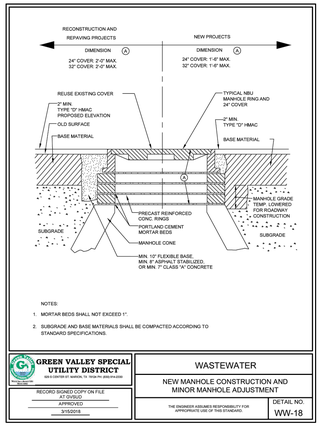


GREEN VALLEY SPECIAL UTILITY DISTRICT	WASTEWATER
RECORD SIGNED COPY ON FILE AT GVSUD APPROVED 3/15/2018	NEW MANHOLE CONSTRUCTION AND MINOR MANHOLE ADJUSTMENT
	THE ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD. DETAIL NO. WW-18

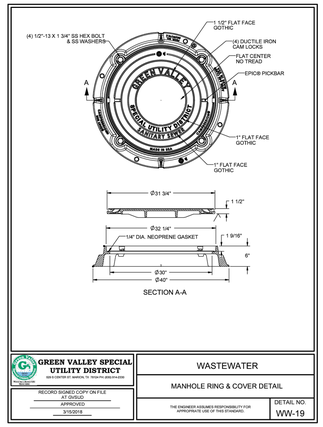


GREEN VALLEY SPECIAL UTILITY DISTRICT	WASTEWATER
RECORD SIGNED COPY ON FILE AT GVSUD APPROVED 3/15/2018	MANHOLE RING & COVER DETAIL
	THE ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD. DETAIL NO. WW-19

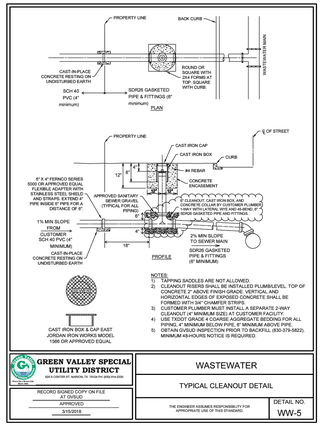

GREEN VALLEY SPECIAL UTILITY DISTRICT	WASTEWATER
RECORD SIGNED COPY ON FILE AT GVSUD APPROVED 3/15/2018	TYPICAL CLEANOUT DETAIL
	THE ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD. DETAIL NO. WW-5

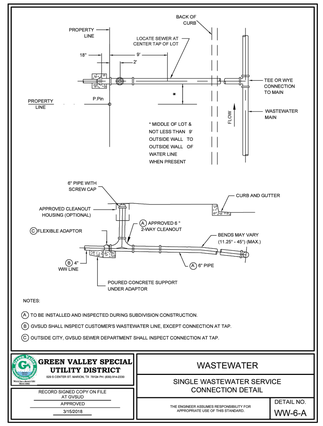

GREEN VALLEY SPECIAL UTILITY DISTRICT	WASTEWATER
RECORD SIGNED COPY ON FILE AT GVSUD APPROVED 3/15/2018	SINGLE WASTEWATER SERVICE CONNECTION DETAIL
	THE ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD. DETAIL NO. WW-6-A

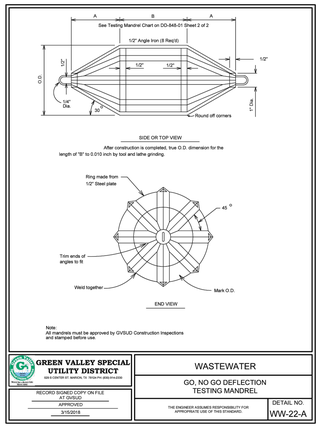

Note:
All mandrels must be approved by GVSUD Construction Inspectors and stamped before use.

GREEN VALLEY SPECIAL UTILITY DISTRICT	WASTEWATER
RECORD SIGNED COPY ON FILE AT GVSUD APPROVED 3/15/2018	GO, NO GO DEFLECTION TESTING MANDREL
	THE ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD. DETAIL NO. WW-22-A


			MANDREL O.D.			RING O.D.		
SIZE	A	B	PSM (SDR-35)	PSM (SCH-26)	LARGE DIA. RIBBED	PSM (SDR-35)	PSM (SCH-26)	LARGE DIA. RIBBED
6"	4.5"	4"	5.56	5.43	———	4.85	4.72	———
8"	5.7"	6"	7.45	7.28	———	6.74	6.57	———
10"	6.7"	8"	9.32	9.10	———	8.61	8.39	———
12"	8.0"	8"	11.06	10.83	———	10.37	10.12	———
15"	10.0"	9"	13.87	13.28	———	12.86	12.55	———
18"	12.3"	11"	16.58	———	16.72	15.89	———	16.01
21"	14.5"	12"	19.56	———	19.66	18.85	———	18.95
24"	16.0"	15"	22.00	———	22.26	21.29	———	21.55
27"	18.0"	16"	24.80	———	25.10	24.09	———	24.39
30"	20.5"	18"	———	———	27.94	———	———	27.23
36"	24.5"	21"	———	———	33.83	———	———	32.92
42"	26.9"	24"	———	———	37.41	———	———	36.70
48"	32.0"	29"	———	———	44.99	———	———	44.28

Note:
Standards for all PVC pipe shall conform to minimum of ASTM D3033.


GREEN VALLEY SPECIAL UTILITY DISTRICT	WASTEWATER
RECORD SIGNED COPY ON FILE AT GVSUD APPROVED 3/15/2018	GO, NO GO DEFLECTION TESTING MANDREL CHART
	THE ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD. DETAIL NO. WW-22-B

NOTES:
1. UTILITY CONTRACTOR, DURING SUBDIVISION CONSTRUCTION, INSTALLS WASTEWATER CONNECTION TO MAIN, 6" STUB WITH 6" SERVICE BRANCH WITH 2-WAY CLEANOUT AND RISER FOR CLEANOUTS (CAPPED) AND PLUGS FOR 2-WAY CLEANOUTS AT PROPERTY LINE END. ALL WASTEWATER PIPING SHALL HAVE ELASTOMERIC GASKET TYPE JOINTS AND SHALL SLOPE DOWNWARD TO MAIN 2%, 1/4 " PER FOOT, MINIMUM TO 45° MAXIMUM. DEPTH OF SERVICE STUB AT PROPERTY LINE WILL BE SHOWN ON PLANS BY ENGINEER OR DESIGNATED REPRESENTATIVE IF GREATER THAN 4', OTHERWISE, THE INSTALLED DEPTH WILL TYPICALLY BE 4 ' TO 6 '. IF WASTEWATER SERVICE LINE TO MAIN REQUIRES DEFLECTION EXCEEDING 45°, REFER TO DETAIL DRAWING 301. ALL INSTALLATIONS SHALL BE MADE IN ACCORDANCE WITH INFORMATION SHOWN ON APPLICABLE STANDARD DRAWINGS AND WILL BE INSPECTED BY GREEN VALLEY SPECIAL UTILITY DISTRICT (GVSUD) CONSTRUCTION INSPECTION PERSONNEL.
2. CUSTOMERS REMOVE PLUGS FROM 2-WAY CLEANOUT, AT PROPERTY LINE, INSTALL MINIMUM 18" LENGTH OF 6" PIPE, INSTALL 4 " WASTEWATER LINES EXTEND 4" PIPE 6" MINIMUM INTO 6" PIPE AND JOINT WITH FLEXIBLE ADAPTOR) AND CAST IN PLACE CONCRETE SUPPORT BLOCK UNDER THE FLEXIBLE ADAPTOR. BLOCK SHALL HAVE MINIMUM DIMENSIONS OF 6" THICK AND 18" WIDE AND EXTEND A MINIMUM OF 6" BEYOND EITHER END OF ADAPTOR. IF WASTEWATER WILL NOT SATISFACTORILY FLOW BY GRAVITY TO SEWER MAIN ADJACENT TO PROPERTY, PUMP EQUIPMENT MUST BE PROVIDED BY THE CUSTOMER AS PART OF CUSTOMER'S WASTEWATER SYSTEM.
3. CUSTOMER IS RESPONSIBLE FOR PIPING SYSTEM UNTIL WASTEWATER IS CONNECTED. ANY MISSING OR DAMAGED PARTS SHALL BE REINSTALLED BY CUSTOMER WHO SHALL GUARANTEE, FOR A PERIOD OF ONE (1) YEAR FROM DATE OF ACCEPTANCE, THAT CONNECTIONS TO NBU SYSTEMS ARE FREE FROM DEFECTS IN WORKMANSHIP OR MATERIALS. CUSTOMER ALSO HAS THE RESPONSIBILITY TO ASSURE THAT 2-WAY CLEANOUTS REMAIN CLEAR OF SIDEWALKS AND OTHER OBSTRUCTIONS.
4. GREEN VALLEY SPECIAL UTILITY DISTRICT (GVSUD) ACTIVITY IS LIMITED TO INSPECTION OF CONNECTIONS TO GVSUD'S WASTEWATER SYSTEM. FOR MAINTENANCE PURPOSES, GVSUD'S RESPONSIBILITY ENDS AT THE CUSTOMER'S WASTEWATER CONNECTION TO THE 2-WAY CLEANOUT.
5. PIPING IN STREET RIGHT-OF-WAY AND IN EASEMENT AREA SHALL BE BEDDED IN GRANULAR MATERIALS AS REQUIRED BY NBU STANDARD SPECIFICATION; MATERIALS SHALL BE AS SPECIFIED; BACKFILL ABOVE THE GRANULAR BEDDING. SERVICE LINES IN THESE AREAS SHALL HAVE A MINIMUM COVER BELOW FINAL STREET GRADE OF 42"; ANY EXCEPTION MUST BE SPECIFICALLY APPROVED BY THE ENGINEER.

GREEN VALLEY SPECIAL UTILITY DISTRICT	WASTEWATER
RECORD SIGNED COPY ON FILE AT GVSUD APPROVED 3/15/2018	SINGLE WASTEWATER SERVICE CONNECTION DETAIL
	THE ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD. DETAIL NO. WW-6-B

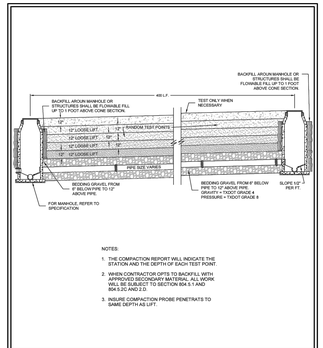

GREEN VALLEY SPECIAL UTILITY DISTRICT	WASTEWATER
RECORD SIGNED COPY ON FILE AT GVSUD APPROVED 3/15/2018	TRENCH COMPACTION DETAIL
	THE ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD. DETAIL NO. WW-7

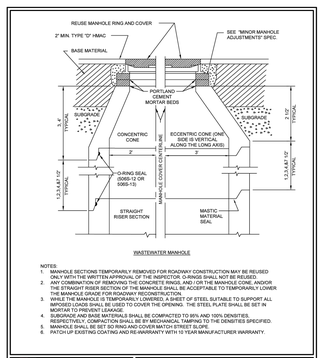


NOTES:
1. MANHOLE SECTIONS TEMPORARILY REMOVED FOR ROADWAY CONSTRUCTION MAY BE REUSED ONLY WITH THE WRITTEN APPROVAL OF THE INSPECTOR. O-RINGS SHALL NOT BE REUSED.
2. ANY COMBINATION OF REMOVING THE CONCRETE RINGS, AND / OR THE MANHOLE CONE, AND/OR THE STRAIGHT RISER SECTION OF THE MANHOLE SHALL BE ACCEPTABLE TO TEMPORARILY LOWER THE MANHOLE FOR ROADWAY CONSTRUCTION.
3. WHILE THE MANHOLE IS TEMPORARILY LOWERED, A SHEET OF STEEL SUITABLE TO SUPPORT ALL IMPOSED LOADS SHALL BE USED TO COVER THE OPENING. THE STEEL PLATE SHALL BE SET IN MORTAR TO PREVENT LEAKAGE.
4. SUBGRADE AND BASE MATERIALS SHALL BE COMPACTED TO 95% AND 100% DENSITIES RESPECTIVELY, UNLESS OTHERWISE SPECIFIED IN THE PLANS. THESE DENSITIES SPECIFIED.
5. MANHOLE SHALL BE SET 3/D RING AND COVER MATCH STREET SLOPE.
6. PATCH UP EXISTING COATING AND RE-WARRANTY WITH 10 YEAR MANUFACTURER WARRANTY.

GREEN VALLEY SPECIAL UTILITY DISTRICT	WASTEWATER
RECORD SIGNED COPY ON FILE AT GVSUD APPROVED 3/15/2018	MAJOR MANHOLE ADJUSTMENT
	THE ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD. DETAIL NO. WW-17

ENGINEER SANITARY SEWER GENERAL NOTES:

1. CONTRACTOR IS RESPONSIBLE FOR REPLACING ANY FENCING THAT IS REMOVED OR DAMAGED DURING CONSTRUCTION TO EXISTING OR BETTER CONDITION.
2. CONTRACTOR IS TO NOTIFY ENGINEER OF ANY DISCREPANCIES OR UTILITY CONFLICTS.
3. CONTRACTOR SHALL REFERENCE GRADING PLAN FOR CLEARING AND GRADING LIMITS.
4. CONTRACTOR SHALL RE-VEGETATE ALL DISTURBED AREAS WITHIN EASEMENT LIMITS UPON COMPLETION OF INFRASTRUCTURE.

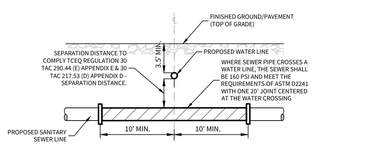

TYPICAL SANITARY SEWER/ WATER CROSSING DETAIL

N.T.S.

TRENCH EXCAVATION PROTECTION

CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/GEOTECHNICAL/SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITE(S) WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND/OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

TCEQ - 30 TAC290.44(e)

(e) LOCATION OF WATERLINES. THE FOLLOWING RULES APPLY TO INSTALLATIONS OF WATERLINES, WASTEWATER MAINS OR LATERALS, AND OTHER CONVEYANCES/APPURTENANCES IDENTIFIED AS POTENTIAL SOURCES OF CONTAMINATION. FURTHERMORE, ALL RATINGS SPECIFIED SHALL BE DEFINED BY ASTM OR AWWA STANDARDS UNLESS STATED OTHERWISE. NEW MAINS, SERVICE LINES, OR LATERALS ARE THOSE THAT ARE INSTALLED WHERE NO MAIN, SERVICE LINE, OR LATERAL PREVIOUSLY EXISTED, OR WHERE EXISTING MAINS, SERVICE LINES, OR LATERALS ARE REPLACED WITH PIPES OF DIFFERENT SIZE OR MATERIAL.

(1) WHEN NEW POTABLE WATER DISTRIBUTION LINES ARE CONSTRUCTED, THEY SHALL BE INSTALLED NO CLOSER THAN NINE FEET IN ALL DIRECTIONS TO WASTEWATER COLLECTION FACILITIES. ALL SEPARATION DISTANCES SHALL BE MEASURED FROM THE OUTSIDE SURFACE OF EACH OF THE RESPECTIVE PIECES.

(2) POTABLE WATER DISTRIBUTION LINES AND WASTEWATER MAINS OR LATERALS THAT FORM PARALLEL UTILITY LINES SHALL BE INSTALLED IN SEPARATE TRENCHES.

(3) NO PHYSICAL CONNECTION SHALL BE MADE BETWEEN A DRINKING WATER SUPPLY AND A SEWER LINE. ANY APPURTENANCE SHALL BE DESIGNED AND CONSTRUCTED SO AS TO PREVENT ANY POSSIBILITY OF SEWAGE ENTERING THE DRINKING WATER SYSTEM.

(4) WHERE THE NINE-FOOT SEPARATION DISTANCE CANNOT BE ACHIEVED, THE FOLLOWING CRITERIA SHALL APPLY.

(A) NEW WATERLINE INSTALLATION - PARALLEL LINES.

(i) WHERE A NEW POTABLE WATERLINE PARALLELS AN EXISTING, NON-PRESSURE OR PRESSURE RATED WASTEWATER MAIN OR LATERAL AND THE LICENSED PROFESSIONAL ENGINEER LICENSED IN THE STATE OF TEXAS IS ABLE TO DETERMINE THAT THE EXISTING WASTEWATER MAIN OR LATERAL IS NOT LEAKING, THE NEW POTABLE WATERLINE SHALL BE LOCATED AT LEAST TWO FEET ABOVE THE EXISTING WASTEWATER MAIN OR LATERAL, MEASURED VERTICALLY, AND AT LEAST FOUR FEET AWAY, MEASURED HORIZONTALLY, FROM THE EXISTING WASTEWATER MAIN OR LATERAL. EVERY EFFORT SHALL BE EXERTED NOT TO DISTURB THE BEDDING AND BACKFILL OF THE EXISTING WASTEWATER MAIN OR LATERAL.

(ii) WHERE A NEW POTABLE WATERLINE PARALLELS AN EXISTING PRESSURE-RATED WASTEWATER MAIN OR LATERAL AND IT CANNOT BE DETERMINED BY THE LICENSED PROFESSIONAL ENGINEER IF THE EXISTING LINE IS LEAKING, THE EXISTING WASTEWATER MAIN OR LATERAL SHALL BE REPLACED WITH AT LEAST 150 PSI PRESSURE-RATED PIPE. THE NEW POTABLE WATERLINE SHALL BE LOCATED AT LEAST TWO FEET ABOVE THE NEW WASTEWATER LINE, MEASURED VERTICALLY, AND AT LEAST FOUR FEET AWAY, MEASURED HORIZONTALLY, FROM THE REPLACED WASTEWATER MAIN OR LATERAL.

(iii) WHERE A NEW POTABLE WATERLINE PARALLELS A NEW WASTEWATER MAIN, THE WASTEWATER MAIN OR LATERAL SHALL BE CONSTRUCTED OF AT LEAST 150 PSI PRESSURE-RATED PIPE. THE NEW POTABLE WATERLINE SHALL BE LOCATED AT LEAST TWO FEET ABOVE THE WASTEWATER MAIN OR LATERAL, MEASURED VERTICALLY, AND AT LEAST FOUR FEET AWAY, MEASURED HORIZONTALLY, FROM THE WASTEWATER MAIN OR LATERAL.

(B) NEW WATERLINE INSTALLATION - CROSSING LINES.

(i) WHERE A NEW POTABLE WATERLINE CROSSES ABOVE A WASTEWATER MAIN OR LATERAL, THE SEGMENT OF THE WATERLINE PIPE SHALL BE CENTERED OVER AND MUST BE PERPENDICULAR TO THE WASTEWATER MAIN OR LATERAL SUCH THAT THE JOINTS OF THE WATERLINE PIPE ARE EQUIDISTANT AND AT LEAST NINE FEET HORIZONTALLY FROM THE CENTERLINE OF THE WASTEWATER MAIN OR LATERAL. WHEN CROSSING AN EXISTING WASTEWATER MAIN OR LATERAL AND IT IS DISTURBED OR SHOWS SIGNS OF LEAKING, THE WASTEWATER MAIN OR LATERAL SHALL BE REPLACED FOR AT LEAST NINE FEET IN BOTH DIRECTIONS (18 FEET TOTAL) WITH AT LEAST 150 PSI PRESSURE-RATED PIPE EMBEDDED IN CEMENT STABILIZED SAND (SEE CLAUSE (V) OF THIS SUBPARAGRAPH) FOR THE TOTAL LENGTH OF ONE PIPE SEGMENT PLUS 12 INCHES BEYOND THE JOINT ON EACH END.

(ii) THE POTABLE WATERLINE SHALL BE AT LEAST TWO FEET ABOVE AN EXISTING, NON-PRESSURE RATED WASTEWATER MAIN OR LATERAL.

(III) THE POTABLE WATERLINE SHALL BE AT LEAST SIX INCHES ABOVE AN EXISTING, PRESSURE-RATED WASTEWATER MAIN OR LATERAL.

(iii) WHERE A NEW POTABLE WATERLINE CROSSES A NEW, NON-PRESSURE RATED WASTEWATER MAIN OR LATERAL, THE SEGMENT OF THE WATERLINE PIPE SHALL BE CENTERED OVER AND SHALL BE PERPENDICULAR TO THE WASTEWATER MAIN OR LATERAL SUCH THAT THE JOINTS OF THE WATERLINE PIPE ARE EQUIDISTANT AND AT LEAST NINE FEET HORIZONTALLY FROM THE CENTERLINE OF THE WASTEWATER MAIN OR LATERAL. THE POTABLE WATERLINE SHALL BE AT LEAST TWO FEET ABOVE THE WASTEWATER MAIN OR LATERAL. WHENEVER POSSIBLE, THE CROSSING SHALL BE CENTERED BETWEEN THE JOINTS OF THE WASTEWATER MAIN OR LATERAL. THE WASTEWATER PIPE SHALL HAVE A MINIMUM PIPE STIFFNESS OF 115 PSI AT 5.0% DEFLECTION. THE WASTEWATER MAIN OR LATERAL SHALL BE EMBEDDED IN CEMENT STABILIZED SAND (SEE CLAUSE (V) OF THIS SUBPARAGRAPH) FOR THE TOTAL LENGTH OF ONE PIPE SEGMENT PLUS 12 INCHES BEYOND THE JOINT ON EACH END. THE MATERIALS AND METHOD OF INSTALLATION SHALL CONFORM TO ONE OF THE FOLLOWING OPTIONS:

(I) WITHIN NINE FEET HORIZONTALLY OF EITHER SIDE OF THE WATERLINE, THE WASTEWATER PIPE AND JOINTS SHALL BE CONSTRUCTED WITH PIPE MATERIAL HAVING A MINIMUM PRESSURE RATING OF AT LEAST 150 PSI. AN ABSOLUTE MINIMUM VERTICAL SEPARATION DISTANCE OF TWO FEET SHALL BE PROVIDED. THE WASTEWATER MAIN OR LATERAL SHALL BE LOCATED BELOW THE WATERLINE.

GVSUD WASTEWATER NOTES

General:

1. Noise and odor impacts shall be considered in design.
2. Piping friction losses shall be calculated with a Hazen-Williams coefficient no greater than 130.
3. Sanitary tapping saddles are not allowed.
4. Low pressure sanitary sewer collection systems are not allowed.
5. Force mains, and valves shall be located outside of roadways, pavement, curbs, etc., unless specifically approved otherwise.
6. All force mains to be installed 4-feet minimum behind back of curb.
7. Force mains shall be installed in a 20-foot dedicated GVSUD sanitary sewer easement. Installation in ROW will not be allowed.
8. Gravity wastewater mains may be installed within roadways.
9. All piping shall be designed in straight alignment. Pipe deflection is not allowed. Gravity mains shall not be more than 20-feet below finished grade as measured from pipe invert to finished grade.
10. All sanitary sewer mains and laterals entering manholes at a distance of 24-inches or greater from penetration to invert shall be external drop manholes.
11. Wastewater pipe joints shall be centered at crossings with all other utilities. Both pipe joints shall be centered where water crosses wastewater 10-feet in either direction, including wastewater laterals.
12. Maintain a minimum of 10-feet horizontal and 24-inch vertical clearance between water/wastewater and other utilities. Shared trenches are not allowed.
13. Wastewater piping (including mains, services, and laterals) shall be sleeved if located under box culverts, single barrel, or multiple barrel storm sewer crossings regardless of size.
14. Profile all water, wastewater, and storm piping regardless of size. Show all utility crossings on all profiles. Show wastewater service laterals on storm. Show/overlay water and storm profiles onto wastewater piping profiles.
15. Air release valves shall be provided for all force mains regardless of main size.
16. Force main deflection is not allowed. All bends shall be MJ restrained and coated per TAC guidelines.
17. Force main plug valves shall be installed every 2,000-feet minimum.
18. Force mains shall be 4-inch minimum diameter.
19. Service laterals shall be 6-inch minimum diameter.
20. Service lateral stubouts for home shall be 2-feet and capped.
21. Cleanouts are to be centered in lot and on property line.
22. Cleanouts to be protected by utility defender shroud or approved equivalent.
23. All manholes are to be flow filled 6-inches minimum.
24. Provide restraint lengths at all bends.

Materials:


1. Gravity wastewater pipe and fittings shall be green color gasketed ASTM D3034 SDR26. All sanitary sewer and water crossings shall be SDR26 of at least 150 PSI pressure class.
2. Sanitary tapping saddles are not allowed.
3. Force main piping shall be green color C900 DR18 minimum. Fittings shall be AWWA C153 compact mechanical joint ductile iron with Ford Uni-Flange Series 1500 restraints or approved equivalent. Pipe bell joint restraints shall be Ford Uni-Flange Series 1300 or approved equivalent.
4. All fasteners shall be 304 stainless-steel (e.g. hardware, screws, anchor bolts, rods, flange bolts and nuts, etc.). All bolts and nuts shall be heavy hex. Field-apply nickel anti-seize compound prior to assembly. Bolts and nuts shall not be painted.
5. All buried metal pipe, fittings, and valves shall be wrapped with 8mil poly.
6. Paint shall be high-build epoxy with topcoat of polyurethane.
7. Manhole coatings shall be SewperCoat or approved equivalent. Concrete additives may be substituted in lieu of coatings per GVSUD approval.

Testing:

1. All testing shall be arranged and paid for by the contractor and witnessed by GVSUD.
2. All testing must be complete prior to paving streets.
3. The Contractor shall provide GVSUD copies of all test results prior to acceptance of the project.
4. All testing must be complete prior to performing tie-ins to existing wastewater systems.
5. All other utilities must be complete and offsite prior to performing wastewater pressure testing.
6. Contractor shall perform pre-testing to verify passing results prior to requesting GVSUD inspection. Provide connection point for GVSUD digital test gauge (quick connect).
7. Perform trench backfill density testing at intervals specified by the design engineer, exact locations to be designated by inspector. Schedule with GVSUD to witness 48 hours prior to test. Provide copies of reports to GVSUD.
8. All gravity wastewater piping shall be subject to low pressure air testing in accordance with TCEQ requirements. Infiltration and exfiltration testing are not allowed.
9. Mandrel shall be pulled by hand through all gravity wastewater mains prior to installation of corrosion resistant manhole lining, but no earlier than 30 days after backfilling is complete.
10. All manholes, regardless of vehicular traffic detouring, shall be vacuum tested after completion of backfill, compaction, and final grading of road base but prior to installation of asphalt paving and prior to installation of corrosion resistant manhole lining. Vacuum testing shall be performed with a plate type test head placed on top of completed manhole metal casting ring which has been installed and encased in concrete at final grade. Manholes shall be tested at 10-inches of mercury for 2 minutes duration. Allowable loss is 1-inch of mercury. Infiltration and exfiltration testing are not allowed.
11. Wiping of internal seams is not allowed.
12. Perform video inspection of gravity wastewater piping after application of corrosion resistant manhole lining. Flood system with water immediately prior to performing video inspection. Hang and drag a golf ball in front of camera. Pipe grade is out of tolerance if water level is more than a full golf ball. Schedule GVSUD to witness video inspection. Provide PDF and written reports to GVSUD.
13. Follow TCEQ pipe testing procedures and allowable leakage for force mains. Test every valve section (i.e. test against every valve in closed position). Test pressure shall be the maximum rating of material installed.

Construction Notes:

1. All work shall be in accordance with GVSUD standards as published at the following website: http://www.gvsud.org/
2. Material submittals shall be provided for GVSUD review and approval. Allow 21 calendar days for review.
3. All wastewater installations must be inspected and approved by GVSUD prior to backfilling or otherwise covering the work. GVSUD will reject anything backfilled prior to GVSUD approval. This includes crossings of water and wastewater by other utilities. GVSUD will perform a maximum of one (1) inspection daily for one (1) hour duration between 7:30am and 4:00pm excluding weekends and holidays. Call to schedule inspections (48-hours advance notice is required for all inspections).
4. Trench excavation and pipe installation will not be permitted until subgrade has been established. Survey staking must be installed prior to and maintained during trench excavation and pipe installation. Survey staking shall include horizontal and vertical control at a minimum of 50-foot station intervals. Survey staking shall be performed by the contractor.
5. Proper shoring and/or benching must be present at all times for anything 4-feet in depth or deeper. GVSUD will stop work until proper safety protocols have been established.
6. Backflow prevention in the form of a reduced pressure zone backflow assembly must be provided for temporary connections to existing water lines. Backflow prevention assemblies shall be tested and submitted to GVSUD by a licensed backflow prevention assembly tester.
7. Sanitary tapping saddles are not allowed.
8. All manhole sections shall be grouted. Gator tape shall not be permitted.
9. Pipe bells shall be installed in upstream direction.
10. All piping shall be installed in straight alignment. Pipe deflection is not allowed.
11. Install concrete thrust blocking and mechanical joint restraints for pressure piping systems.
12. Wastewater pipe shall be installed below all water and all joints shall be centered at crossings with all other utilities. Pipe joints shall be centered where water crosses wastewater 10-feet in either direction, including wastewater laterals.
13. Maintain a minimum of 10-feet horizontal and 24-inch vertical clearance between water and wastewater and other utilities. Sh

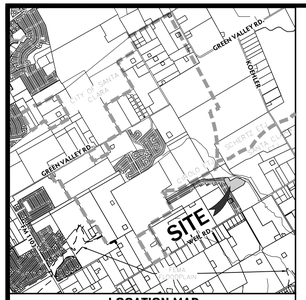


LOCATION MAP

N.T.S.


LEGEND

- EXISTING SANITARY SEWER — EX.8"SS
- PROPOSED SANITARY SEWER — 8"SS
- EXISTING SANITARY SEWER MANHOLE
- PROPOSED SANITARY SEWER MANHOLE
- EXISTING WATER MAIN — EX.8"W
- PROPOSED WATER MAIN — 8"W
- EXISTING STANDARD FIRE HYDRANT
- PROPOSED STANDARD FIRE HYDRANT
- EXISTING STANDARD GATE VALVE
- PROPOSED STANDARD GATE VALVE
- EXISTING PERMANENT BLOWOFF
- PROPOSED PERMANENT BLOWOFF
- ELECTRIC, GAS, TELEPHONE, & CABLE T.V. EASEMENT — E.G.T.C.A. ESM'T



MINOR STREET CROSS-SECTION

N.T.S.

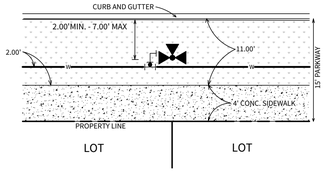


NOTE:

1. EXCLUSIVE OF THE TEE, PAYMENT FOR THE FIRE HYDRANT SHALL INCLUDE ALL FITTINGS, 6" D.I. PIPE AND 6" GATE VALVE & BOX.
2. FIRE HYDRANT TO BE INSTALLED OUTSIDE OF THE LIMITS OF ALL PROPOSED SIDEWALKS.


LOCAL RESIDENTIAL FIRE HYDRANT DETAIL (4' SIDEWALK)

N.T.S.

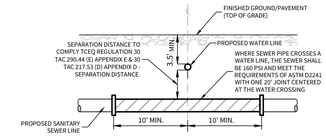


TYPICAL SANITARY SEWER/ WATER CROSSING DETAIL

N.T.S.

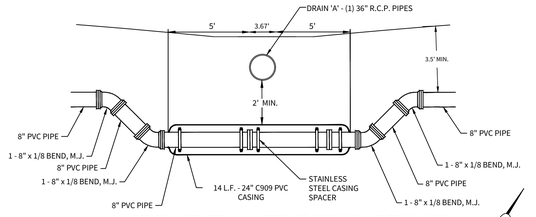


STORM SEWER / WATER CROSSING – DETAIL "C"

N.T.S.

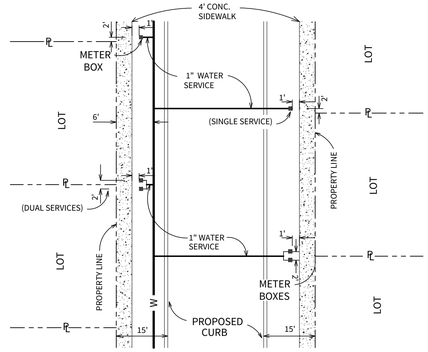

WATER METER BOX LOCATION (60' R.O.W.)

N.T.S.



DEVELOPER:

LENNAR HOMES OF TEXAS LAND AND CONSTRUCTION, LTD.
CONTACT PERSON: RICHARD MOTT
100 NE LOOP 410, SUITE 1155
SAN ANTONIO, TX 78216
TEL: (210) 403-6200

CIVIL ENGINEER:

CUDE ENGINEERS
CONTACT PERSON: CHRIS J. CHAFFEE, P.E.
4122 POND HILL ROAD, SUITE 101
SAN ANTONIO, TX 78231
TEL: (210) 681-2951
FAX: (210) 523-7112

KEYNOTES

1. 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
2. 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
3. 1 - 2" BLOWOFF ASSEMBLY (PERM.)
   SEE G.V.S.U.D. STD. DTL. No. W-28 (SHEET C5.02)
   1 - 8"x2" M.J. THR. DI. ECCENTRIC REDUCER (PERM.)
5. AFTER RELEASED FOR SERVICE, CONTRACTOR TO TIE NEW 8" WATER MAIN INTO EXIST. 8" WATER MAIN. CUT AS REQUIRED.
   VALVE TO REMAIN CLOSED UNTIL AFTER DISINFECTION & ACCEPTANCE BY GVSUD
   1 - 8" SOLID SLEEVE, M.J.
   1 - 2" BLOWOFF ASSEMBLY (TEMP.)
   1 - 8"x2" M.J. THR. DI. ECCENTRIC REDUCER (TEMP.)
6. 1 - 8" x 6" TEE, M.J., ANCHOR
   2 - 8" GATE VALVE
   1 - 6" x 1/4 BEND, M.J.
   1 - 6" GATE VALVE, M.J.
   1 - 6" VALVE BOX, COMPLETE
   1 - STD. FIRE HYDRANT
   1 - 6" D.I. PIPE, CUT AS REQ'D.
   SEE G.V.S.U.D. STANDARD DTL. No. W-22 (SHEET C5.02)
7. 1 - 8" x 6" TEE, M.J., ANCHOR
   1 - 8" GATE VALVE, M.J.
   1 - 6" x 1/4 BEND, M.J.
   1 - 6" GATE VALVE, M.J.
   2 - 6" VALVE BOX, COMPLETE
   1 - STD. FIRE HYDRANT
   1 - 6" D.I. PIPE, CUT AS REQ'D.
   SEE G.V.S.U.D. STANDARD DTL. No. W-22 (SHEET C5.02)
8. CONTRACTOR TO INSTALL 24" C-909 CASING AROUND THE WATER MAIN FROM FITTING TO FITTING AT ALL PAVEMENT CROSSINGS. SEE GVSUD DETAILS W-6, W-7 & W-8, SHEET C5.01.
1. EXISTING 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE (CONCURRENT GRACE VALLEY RANCH PHASE 6)
2. EXISTING 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE (CONCURRENT GRACE VALLEY RANCH PHASE 6)

NOTES:

1. LICENSED CONTRACTOR TO OBTAIN ALL REQUIRED PERMITS FROM THE GUADALUPE COUNTY FIRE MARSHAL'S OFFICE PRIOR TO THE INSTALLATION OF THE UNDERGROUND FIRE LINE.
2. CONTRACTOR TO SUBMIT ALL UNDERGROUND FIRE LINE MATERIAL SUBMITTALS TO GUADALUPE COUNTY FIRE MARSHAL'S OFFICE FOR REVIEW AND APPROVAL.
3. CONTRACTOR TO COORDINATE UNDERGROUND FIRE LINE INSPECTIONS WITH THE GUADALUPE COUNTY FIRE MARSHAL'S OFFICE. FIRE MARSHAL INSPECTION IS REQUIRED OF ALL UNDERGROUND FIRE LINE WHEN CONSTRUCTED IN THE TRENCH PRIOR TO BACKFILLING. STAGED INSPECTIONS ARE ACCEPTABLE.
4. UNDERGROUND FIRE LINE TO BE TESTED TO GUADALUPE COUNTY FIRE MARSHAL REQUIREMENTS. CONTRACTOR TO CONTACT FIRE MARSHAL'S OFFICE WHEN READY TO PERFORM HYDROSTATIC TESTING AND FLOW RATE VERIFICATION PROCEDURES.

CAUTION!!!

THE CONTRACTOR SHALL BE AWARE THAT EXISTING UTILITIES ARE WITHIN THE SITE. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO HAVE THESE UTILITIES LOCATED PRIOR TO COMMENCING CONSTRUCTION. THE CONTRACTOR SHALL USE EXTREME CAUTION WHEN WORKING IN THIS AREA. ANY DAMAGE DONE TO THESE EXISTING FACILITIES WILL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO REPAIR.

TRENCH EXCAVATION SAFETY PROTECTION

CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/GEOTECHNICAL/SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITE(S) WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS, AND/OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEES OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

NOTES:

1. IN THE CITY OF SANTA CLARA, FIRE HYDRANTS SHALL BE MUELLER OR EJ TYPE AND SHALL BE 2' MINIMUM AND 7' MAXIMUM FROM THE BACK OF CURB.
2. DISINFECTION SHALL BE BY MACHINE CHLORINATION.
3. CONTRACTOR TO UTILIZE APPROVED WATER LINE STOPS AND/OR MUELLER INSERTION-VALVES TO MINIMIZE WATER OUTAGES AS REQUIRED BY GVSUD DURING CONSTRUCTION.
4. MOISTURE DENSITY COMPACTION TESTING FREQUENCY- WATER MAIN TRENCHES REQUIRED EVERY 300 L.F. FOR EACH VERTICAL FOOT OF COMPACTED BACKFILL. SERVICES RANDOMLY SELECTED AS REQUIRED BY GVSUD INSPECTOR.
5. ALL TESTING AND TEST REPORTS SHALL BE COORDINATED WITH GVSUD INSPECTOR BY THE CONTRACTOR.
6. ALL DUCTILE IRON PIPE TO BE AMERICAN, ZINC COATED, AWWA/ANSI C-151

Developer's Name	LENNAR HOMES OF TEXAS LAND AND CONSTRUCTION, LTD
Developer's Address	100 NE LOOP 410, SUITE 1155
City	SAN ANTONIO
State	TEXAS
Zip	78216
Phone #	(210) 403-6282
Fax #	–
Total EDU's	N/A
Total Acreage	10.2
Total Linear Footage of Pipe	8" W – 2,347 L.F.
Plat No.	N/A
Meter Size	106 – 5/8" METER , N/A – 3/4" METER (IRR.)
Number of Lots	106
Job No.	N/A

CUDEENGINEERS.COM

CUDE ENGINEERS

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

WATER DISTRIBUTION PLAN

DATE
11/04/2025

PROJECT NO.
03499.009

DRAWN BY
AR/JF/RB

CHECKED BY
KMH


REVISIONS
1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED PROFESSIONAL ENGINEER
11/04/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C5.00

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

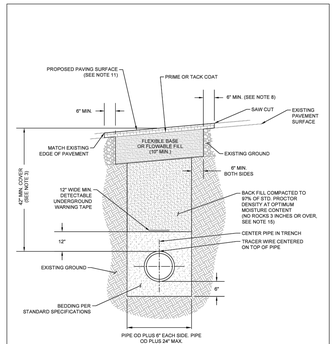


GREEN VALLEY SPECIAL UTILITY DISTRICT STANDARD DETAILS	TRENCH DETAIL FOR PAVED AREAS (1 OF 2)	
REVISED: JANUARY 2024	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	DETAIL NO. W-1

NOTES:

1. ALL WASTEWATER PVC PIPING SHALL BE GREEN IN COLOR. NO WATER DESIGNATED PIPE SHALL BE USED IN WASTEWATER WITHOUT PRIOR APPROVAL FROM THE ENGINEER.
2. ALL WATER PIPING SHALL HAVE A MINIMUM PRESSURE CLASS OF 235 PSI WATER PVC PIPING SHALL BE BLUE IN COLOR.
3. ALL WATER LINES AND WASTEWATER FORCEMAIN SHALL HAVE 42 INCH MINIMUM COVER AND 72 INCH MAXIMUM COVER. WASTEWATER GRAVITY LINES SHALL HAVE 42 INCHES MINIMUM COVER AND 15 FOOT MAXIMUM COVER.
4. GENERAL CONTRACTOR SHALL CONTACT THE APPROPRIATE STREET OWNER AND PROCESS, POST FISCAL SURETY, AND HAVE STREET CUT PERMIT ISSUED IN THEIR NAME.
5. CONTRACTOR TO REPAIR PAVED AREA TO STREET OWNER'S ROAD STANDARDS FOR ALL DISTURBED AREA. GREEN VALLEY SPECIAL UTILITY DISTRICT PAYS FOR QUANTITY OF REPAIR SHOWN IN DETAIL.
6. CONTRACTOR SHALL NOT EXCEED THE MAXIMUM TRENCH ALLOWED AS INDICATED IN THE PLANS AND SPECIFICATIONS.
7. THE EXISTING PAVED SURFACE SHALL BE SAW CUT IN A STRAIGHT LINE, A MINIMUM OF 12 INCHES WIDER THAN UNDISTURBED SIDES OF THE TRENCH AND SYMMETRICAL ABOUT THE CENTER LINE OF THE EXCAVATION.
8. ANY CONCRETE PAVING SHALL BE CUT 6 INCHES WIDER THAN UNDISTURBED SIDES OF EXCAVATION.
9. IF EXCAVATION AREA IS OPEN FOR TEMPORARY PUBLIC USE, THE SURFACE SHALL BE MAINTAINED LEVEL WITH ADJACENT RIDING SURFACE WITH TEMPORARY COLD MIX ASPHALT CONCRETE OR TEMPORARY HOT MIXED ASPHALT CONCRETE. TEMPORARY MIX SHALL BE PLACED OVER FLEXIBLE BASE.
10. FLEXIBLE BASE SHALL BE REPLACED IN KIND WITH BASE AND PAVEMENT THICKNESS WITH BASE EQUAL TO EXISTING BASE THICKNESS PLUS 3 INCHES, BUT IN NO CASE LESS THAN 10 INCHES.
11. DAMAGED PAVEMENT OUTSIDE THE TRENCH CUT SHALL BE REMOVED AND REPLACED WITH A MINIMUM OF 2 INCHES HOT MIXED ASPHALT CONCRETE AND A BASE OF 10 INCHES OR A THICKNESS MATCHING EXISTING, WHICHEVER IS GREATER.
12. TACK COAT ALL EXPOSED EDGES AND SURFACES.
13. TYPE AND THICKNESS OF PROPOSED PAVING SURFACE SHALL BE AS FOLLOWS:
    - TWO COURSE SURFACE TREATMENT: SHALL MATCH EXISTING SURFACE AND SHALL BE IN ACCORDANCE WITH SPECIFICATION 02170.
    - ASPHALT PAVING: SHALL BE IN ACCORDANCE WITH SPECIFICATION 02740. HOT MIXED ASPHALT CONCRETE PAVING SHALL BE PLACED IN TWO LIFTS WITH EACH LIFT NOT LESS THAN 1 INCH IN THICKNESS OVER 2 INCHES AND UP TO 3 INCHES. LIFT THICKNESS SHALL NOT BE MORE THAN 3 INCHES
14. DETECTABLE UNDERGROUND WARNING TAPE SHALL BE PLACED DIRECTLY ABOVE THE CENTERLINE OF THE PIPE AND ABOVE BEDDING, IN ACCORDANCE WITH THE MANUFACTURER'S REQUIREMENTS. THE TAPE SHALL CONFORM TO THE SPECIFICATIONS AND COLOR CODED IN ACCORDANCE WITH APWA UNIFORM COLOR CODE. THE DETECTABLE UNDERGROUND WARNING TAPE SHALL CONFORM TO THE SPECIFICATIONS AND COLOR CODED IN ACCORDANCE WITH THE AMERICAN PUBLIC WORKS ASSOCIATION UNIFORM COLOR CODE.
15. PIPE BEDDING SHALL BE PLACED BEFORE PIPING IS LAID, UP TO BOTTOM OF PIPE, AND COMPACTED TO 97% STANDARD PROCTOR DENSITY.
16. PLACE PIPE BEDDING IN 12 INCH LIFTS AFTER PIPE IS LAID TO 12 INCHES ABOVE THE PIPE.
17. SELECT BACKFILL MATERIAL PLACED TO REQUIRED HEIGHT IN 6 INCH LIFTS.

GREEN VALLEY SPECIAL UTILITY DISTRICT STANDARD DETAILS	TRENCH DETAIL FOR PAVED AREAS (2 OF 2)	
REVISED: JANUARY 2024	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	DETAIL NO. W-1

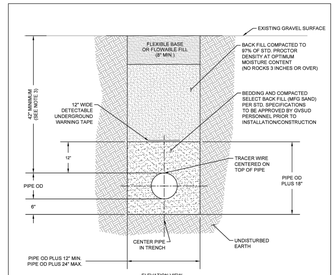


ELEVATION VIEW

GREEN VALLEY SPECIAL UTILITY DISTRICT STANDARD DETAILS	TRENCH DETAIL FOR GRAVEL SURFACED AREAS	
REVISED: JANUARY 2024	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	DETAIL NO. W-2

NOTES:

1. ALL WASTEWATER PVC PIPING SHALL BE GREEN IN COLOR. NO WATER DESIGNATED PIPE WILL BE USED IN WASTEWATER.
2. ALL WATER PIPING SHALL HAVE A MINIMUM PRESSURE CLASS OF 235 PSI WATER PVC PIPING SHALL BE COLOR CODED BLUE.
3. ALL WATER LINES AND WASTEWATER FORCEMAIN SHALL HAVE 42 INCHES MINIMUM COVER AND 72 INCHES MAXIMUM COVER. WASTEWATER GRAVITY LINES SHALL HAVE 42 INCHES MINIMUM COVER AND 15 FEET MAXIMUM COVER.
4. CONTRACTOR SHALL NOT EXCEED THE MAXIMUM TRENCH ALLOWED AS INDICATED IN THE PLANS AND SPECIFICATIONS.
5. DETECTABLE UNDERGROUND WARNING TAPE SHALL BE PLACED DIRECTLY ABOVE THE CENTERLINE OF THE PIPE AND ABOVE BEDDING, IN ACCORDANCE WITH THE MANUFACTURER'S REQUIREMENTS. THE TAPE SHALL CONFORM TO THE SPECIFICATIONS AND COLOR CODED IN ACCORDANCE WITH APWA UNIFORM COLOR CODE.
6. PIPE BEDDING PLACED BEFORE PIPING IS LAID UP TO BOTTOM OF PIPE COMPACTED TO 95% ASHTO DENSITY.
7. PLACE IN 12 INCH LIFTS AFTER PIPE IS LAID TO 12 INCHES ABOVE THE PIPE.
8. SELECT BACKFILL MATERIAL PLACED TO REQUIRED HEIGHT IN 6 INCH LIFTS.

GREEN VALLEY SPECIAL UTILITY DISTRICT STANDARD DETAILS	TRENCH DETAIL FOR NON-PAVED AREAS	
REVISED: JANUARY 2024	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	DETAIL NO. W-3

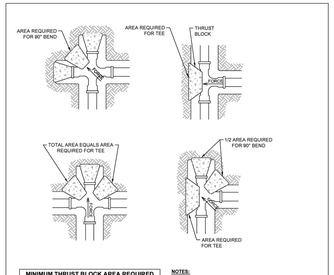

ELEVATION VIEW




RESTRAINED LENGTH FOR BENDS

PIPE SIZE (INCHES)	BEND ANGLE (DEG)	RESTRAINED LENGTH IN FEET, WHEN TEST PRESSURE = 200 PSI
6	90	23
6	45	9
6	22.5	5
6	11.25	2
8	90	30
8	45	12
8	22.5	6
8	11.25	3
12	90	43
12	45	18
12	22.5	8
12	11.25	4
16	90	63
16	45	26
16	22.5	13
16	11.25	7
24	90	85
24	45	35
24	22.5	17
24	11.25	9

NOTES:

1. RESTRAINED LENGTH CALCULATIONS FOR P.V.C PIPE BEDDED IN COMPACTED GRANULAR MATERIAL EXTENDING TO THE TOP OF THE PIPE. NATIVE SOIL MATERIAL IS ASSUMED TO BE INORGANIC CLAY OF HIGH PLASTICITY. DEPTH OF BURY IS ASSUMED TO BE 4 FEET.
2. THESE CALCULATIONS ARE PROVIDED FOR REFERENCE. THE RESTRAINED LENGTH SHALL BE DESIGNED BASED UPON THE CONDITIONS ENCOUNTERED DURING INSTALLATION.
3. CONTRACTOR SHALL RESTRAIN ALL JOINTS WITHIN THE REQUIRED RESTRAINT DISTANCE PLUS THE NEXT JOINT OUTSIDE THE REQUIRED RESTRAINT DISTANCE.

GREEN VALLEY SPECIAL UTILITY DISTRICT STANDARD DETAILS		BEND RESTRAINED LENGTH DESIGN	
REVISED:	JANUARY 2024	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	DETAIL NO. W-18



RESTRAINED LENGTH FOR REDUCERS

PIPE SIZE (INCHES)	SMALL SIZE (INCHES)	RESTRAINED LENGTH IN FEET, WHEN TEST PRESSURE = 200 PSI
6	4	32
8	4	55
8	6	32
12	4	95
12	6	80
12	8	58
16	4	131
16	6	120
16	8	104
16	12	60
24	16	110

NOTES:

1. RESTRAINED LENGTH CALCULATIONS FOR P.V.C PIPE BEDDED IN COMPACTED GRANULAR MATERIAL EXTENDING TO THE TOP OF THE PIPE. NATIVE SOIL MATERIAL IS ASSUMED TO BE INORGANIC CLAY OF HIGH PLASTICITY. DEPTH OF BURY IS ASSUMED TO BE 4 FEET.
2. THESE CALCULATIONS ARE PROVIDED FOR REFERENCE. THE RESTRAINED LENGTH SHALL BE DESIGNED BASED UPON THE CONDITIONS ENCOUNTERED DURING INSTALLATION.
3. CONTRACTOR SHALL RESTRAIN ALL JOINTS WITHIN THE REQUIRED RESTRAINT DISTANCE PLUS THE NEXT JOINT OUTSIDE THE REQUIRED RESTRAINT DISTANCE.

GREEN VALLEY SPECIAL UTILITY DISTRICT STANDARD DETAILS		REDUCER RESTRAINED LENGTH DESIGN	
REVISED:	JANUARY 2024	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	DETAIL NO. W-19




RESTRAINED LENGTH FOR DEAD ENDS/INLINE VALVES

PIPE SIZE (INCHES)	RESTRAINED LENGTH IN FEET, WHEN TEST PRESSURE = 200 PSI
4	42
6	59
8	77
12	109
16	142
24	202

NOTES:

1. RESTRAINED LENGTH CALCULATIONS FOR P.V.C PIPE BEDDED IN COMPACTED GRANULAR MATERIAL EXTENDING TO THE TOP OF THE PIPE. NATIVE SOIL MATERIAL IS ASSUMED TO BE INORGANIC CLAY OF HIGH PLASTICITY. DEPTH OF BURY IS ASSUMED TO BE 4 FEET.
2. THESE CALCULATIONS ARE PROVIDED FOR REFERENCE. THE RESTRAINED LENGTH SHALL BE DESIGNED BASED UPON THE CONDITIONS ENCOUNTERED DURING INSTALLATION.
3. CONTRACTOR SHALL RESTRAIN ALL JOINTS WITHIN THE REQUIRED RESTRAINT DISTANCE PLUS THE NEXT JOINT OUTSIDE THE REQUIRED RESTRAINT DISTANCE.

GREEN VALLEY SPECIAL UTILITY DISTRICT STANDARD DETAILS		VALVE AND DEAD END RESTRAINED LENGTH DESIGN	
REVISED:	JANUARY 2024	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	DETAIL NO. W-20




RESTRAINED LENGTH FOR TEES

PIPE SIZE (INCHES)	BRANCH SIZE (INCHES)	LENGTH OF RUN (FEET)	RESTRAINED LENGTH IN FEET, WHEN TEST PRESSURE = 200 PSI
6	4	0	42
6	4	5	7
6	4	10	1
6	6	0	59
6	6	5	33
6	6	10	30
8	4	0	42
8	4	5	1
8	6	0	59
8	6	5	28
8	6	10	1
8	8	0	77
8	8	5	53
8	8	10	30
8	8	15	8
12	4	0	42
12	4	5	1
12	6	0	59
12	6	5	13
12	6	10	1
12	8	0	77
12	8	5	42
12	8	10	7
12	8	15	1
12	12	0	109
12	12	5	86
12	12	10	63
12	12	15	39
16	4	0	42
16	4	5	1
16	6	0	59
16	6	5	1
16	8	0	78
16	8	5	39
16	8	10	1
16	12	0	110
16	12	5	84
16	12	10	59
16	12	15	33
16	12	20	7
16	16	0	142
16	16	5	123
16	16	10	104
16	16	15	85
16	16	20	65
24	24	5	169
24	24	10	136
24	24	15	103
24	24	20	70

NOTES:

1. RESTRAINED LENGTH CALCULATIONS FOR P.V.C PIPE BEDDED IN COMPACTED GRANULAR MATERIAL EXTENDING TO THE TOP OF THE PIPE. NATIVE SOIL MATERIAL IS ASSUMED TO BE INORGANIC CLAY OF HIGH PLASTICITY. DEPTH OF BURY IS ASSUMED TO BE 4 FEET.
2. THESE CALCULATIONS ARE PROVIDED FOR REFERENCE. THE RESTRAINED LENGTH SHALL BE DESIGNED BASED UPON THE CONDITIONS ENCOUNTERED DURING INSTALLATION.
3. CONTRACTOR SHALL RESTRAIN ALL JOINTS WITHIN THE REQUIRED RESTRAINT DISTANCE PLUS THE NEXT JOINT OUTSIDE THE REQUIRED RESTRAINT DISTANCE.


GREEN VALLEY SPECIAL UTILITY DISTRICT STANDARD DETAILS		TEE RESTRAINED LENGTH DESIGN	
REVISED:	JANUARY 2024	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	DETAIL NO. W-21

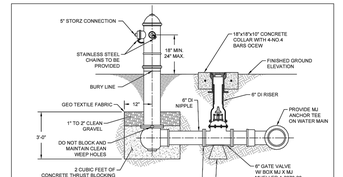

NOTES:

1. HYDRANT ASSEMBLY INCLUDES FIRE HYDRANT, VALVE, DIP, D FITTINGS, ANCHOR RESTRAINERS, AND PIPE TO DISTRIBUTION SYSTEM
2. FIRE HYDRANTS SHALL HAVE A MINIMUM OF 7 FEET OF CLEARANCE SURROUNDING HYDRANT.
3. HYDRANTS SHALL BE A MINIMUM DISTANCE OF 5 FEET BEHIND THE CURB OR 5 FEET FROM THE R.O.W. UNDER NO CIRCUMSTANCES SHALL VALVES OR HYDRANTS BE PLACED IN A CURB OR SIDEWALK. IN AREAS WITHOUT CURBS OR SIDEWALKS, HYDRANT SHALL BE PLACED 3-5 FEET FROM THE DISTRIBUTION SYSTEM
4. FOR BURY DEPTHS GREATER THAN 6 FEET, ONE BARREL EXTENSION NOT EXCEEDING 5 FEET IN LENGTH SHALL BE INSTALLED DIRECTLY BELOW THE FIRE HYDRANT.
5. 1 CU FOOT (MIN) OF CRUSHED STONE OR GRAVEL SHALL BE PLACED AROUND WEEP HOLE FOR A RADIUS OF 12 INCHES AND EXTEND 12 INCHES ABOVE THE OUTLET.
6. VALVE, DUCTILE IRON PIPE, AND STANDARD FIRE HYDRANT SYSTEM SHALL BE RESTRAINT JOINT CONTINUOUSLY TOGETHER.
7. FIRE HYDRANT SHALL BE 6 INCH (3) WAY HYDRANT WITH BREAK AWAY BOLTS (SHOE TYPE) PROVIDED WITH STORZ CONNECTION. DEPTH OF BURY SHALL BE 42 INCHES MINIMUM. FIRE HYDRANTS MUST BE SET PLUMB. HOSE CONNECTION MUST FACE ROADWAY
8. HYDRANT ASSEMBLY SHALL BE RESTRAINED FROM TEE TO HYDRANT.
9. IN THE CITY OF CIBOLO'S CITY LIMITS, FIRE HYDRANTS SHALL BE MUELLER TYPE AND SHALL BE 1 FOOT MINIMUM AND 7 FEET MAXIMUM FROM THE BACK OF CURB.
10. HYDRANTS UPPER BARREL SHALL BE FACTORY PAINTED RED WITH BONNET AND CAPS COATED FOR CURRENT NFPA 291 STANDARDS.
11. HYDRANTS LOCATED IN RURAL AREAS SHALL HAVE 6' TALL POLLARD WATER FLEXPLAS #PRR6662.

GREEN VALLEY SPECIAL UTILITY DISTRICT STANDARD DETAILS		STANDARD HYDRANT ASSEMBLY INSTALLATION	
REVISED:	JANUARY 2024	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	DETAIL NO. W-22

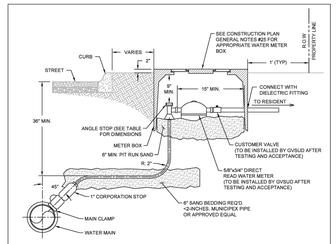

MAIN SIZE	METER SIZE	MAIN SADDLE	CORPORATION	ANGLE STOP
<1/2"	5/8" OR 3/4"	S-91804 IP	H-15028 IP 1"	B-24258N: 1"x 3/4"
<1/2"	1"	S-91804 IP	H-15028 IP 1"	B-24258N: 1"X1"


NOTES:

1. FITTINGS SHALL BE MUELLER OR APPROVED EQUAL
2. A TRACER WIRE SHALL BE INSTALLED ON THE SERVICE LINE TAPED AT 10-INCH INCREMENTS

GREEN VALLEY SPECIAL UTILITY DISTRICT STANDARD DETAILS		STANDARD SERVICE CONNECTION	
REVISED:	JANUARY 2024	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	DETAIL NO. W-23

NOTES:


1. ALL EXTERIOR METAL SURFACES IN SLICA SAND.
2. ALL REINFORCING BARS IN THE REACTION BLOCK SHALL BE NO. 4.

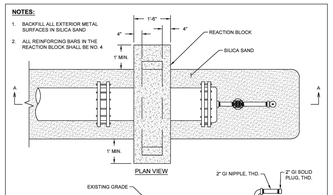

GREEN VALLEY SPECIAL UTILITY DISTRICT STANDARD DETAILS		2" TEMPORARY BLOW-OFF ASSEMBLY ON 12" TO 16" OFF MAINS	
REVISED:	JANUARY 2024	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	DETAIL NO. W-25

NOTES:


1. EMBED ALL EXTERIOR METAL SURFACES IN SLICA SAND.
2. ALL REINFORCING BARS IN THE REACTION BLOCK SHALL BE NO. 5.

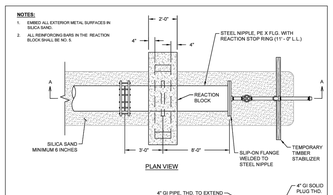


GREEN VALLEY SPECIAL UTILITY DISTRICT STANDARD DETAILS		4" TEMPORARY BLOW-OFF ASSEMBLY ON 20" OR LARGER MAINS (JOINT RESTRAINT)	
REVISED:	JANUARY 2024	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	DETAIL NO. W-26

NOTES:

1. EMBED ALL EXTERIOR METAL SURFACES IN SLICA SAND.
2. ALL REINFORCING BARS IN THE REACTION BLOCK SHALL BE NO. 5.

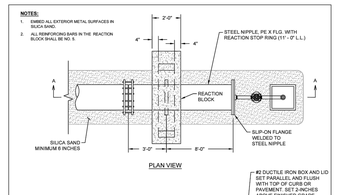


GREEN VALLEY SPECIAL UTILITY DISTRICT STANDARD DETAILS		2" & 4" PERMANENT URBAN BLOW-OFF ASSEMBLY	
REVISED:	JANUARY 2024	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	DETAIL NO. W-28

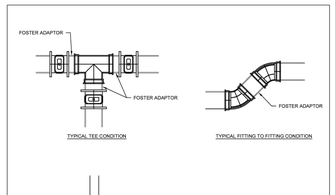

NOTE:

1. FOSTER ADAPTORS, OR APPROVED EQUAL, REQUIRED AT ALL FITTING TO FITTING CONNECTIONS AND FITTING TO VALVE CONNECTIONS.
2. ANCHOR COUPLINGS MAY BE SUBSTITUTED FOR FOSTER ADAPTORS AT GVSUD'S DISCRETION.

GREEN VALLEY SPECIAL UTILITY DISTRICT STANDARD DETAILS		MECHANICAL JOINT ADAPTOR DETAIL	
REVISED:	JANUARY 2024	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	DETAIL NO. W-31

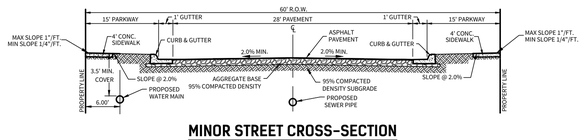

MINOR STREET CROSS-SECTION

N.T.S.

GVSUD WATER NOTES

General:

1. PVC mains 12-inches and below shall conform to AWWA C-909 pressure class 235 or above. PVC main greater than 12-inches shall conform to AWWA C-900 DR 18 or above. Water mains shall have an absolute minimum depth of 48-inches in all areas.
2. All water pipe shall be installed minimum 4-feet beyond back of curb.
3. All water mains to be installed 4-feet minimum behind back of curb.
4. No pressurized fittings under roadways, pavement, or sidewalks.
5. All water main ductile iron fittings shall be mechanical joint and conform to ANSI/AWWA C-153 or C-110. All bolts shall have copper anti-seize corrosion resistant coating. Valves shall be attached to tees by foster adaptor or anchor nipple. Foster adapter, anchor nipple, or Ford Uni-Flange retainer glands and thrust blocks shall be used on all fittings and valves.
6. Tracer wire shall be installed on all pipelines including service lines and brought into valve and meter boxes for locating purposes. Insulated water proof connectors shall be used to splice wires together. A 6-inch or 12-inch-wide detectable metal tape shall be placed above bedding initial backfill.
7. Over inserting bell joints and passing the insertion reference mark is prohibited and will require removal and reinstallation.
8. Standard fire hydrant shall include hydrant, 6-inch resilient wedge gate valve and box, anchor fittings, ductile iron pipe, and all appurtenances. Hydrants shall be limited to those manufactured by Mueller, AVK, American Flow, Clow, Or East Jordan. Only Mueller hydrants and EJ shall be used in City of Cibolo's jurisdiction. Hydrant upper barrel shall be factory painted red. Hydrants shall have a Stortz connection on steamer nozzle. Fittings for plug shall be fully restrained and tied to valve.
9. All fire hydrant assemblies shall have an in-line upstream and downstream valve.
10. All tees shall include three (3) valves.
11. Valves shall be AWWA approved resilient wedge seated gate valve, open left, and limited to those manufactured by Mueller, AVK, American Flow, Clow, Or East Jordan.
12. Valves are prohibited in ADA ramps, curbs, and roadways. Valves are prohibited in sidewalks in City of New Braunfels.
13. Meter boxes are prohibited in any sidewalks, driveways, or roadways.
14. Small service taps shall be 1-inch Rehau Municipex with CTS 200 PSI plastic insert or 2-inch Yelomine PVC ASTM D1784 with Harco fittings or approved equivalent. Small service taps to be made with single brass strap tapping saddle or dual banded stainless-steel flat-strap epoxy saddle with iron pipe threads.
15. Casing required for all long small services. 1-inch service requires 3-inch casing and 2-inch service requires 4-inch casing. Casing shall be white color PVC schedule 40 or approved equal.
16. 5/8" & ¾" meter boxes shall be DFW36C 16" x 11". All meter boxes shall be plastic with lids and knockout.
17. Dual services are not permitted.
18. Tapping machines must retain coupon.
19. Contractor to curb cut v's for valves and x's for meters and paint blue.
20. Water lines crossing cul-de-sacs shall be fully restrained under pavement and cased.
21. All street crossings are to be cased from edge of impermeable cover to edge of impermeable cover.
22. All bends, fittings, and valves shall have one (1) restraint upstream and downstream regardless of length.
23. Contractor shall chlorinate new mains per TCEQ and ANSI/AWWA C651 and dechlorinate during flushing per ANSI/AWWA C655; the contractor shall coordinate with the GVSUD inspector to witness chlorinating and pressure testing of new mains. All test results must be provided to GVSUD.
24. Operation of existing valves in the GVSUD water distribution system shall be operated by GVSUD personnel only, unless approved by GVSUD inspector.
25. New water mains and appurtenances shall pass pressure testing and pass the minimum public health standards for bacteriological quality testing prior to any tie in to the existing GVSUD water system as required by TCEQ and ANSI/AWWA.
26. Hydrostatic pressure testing shall be every 1200 LF (max) of water line or as approved by the engineer. All errors of workmanship shall be corrected immediately. All parts of the pipeline shall be backfilled and braced sufficiently to prevent movement under pressure.
27. The contractor shall provide the engineer with all the information as required so that the engineer can supply GVSUD the GIS package for approval.
28. A final walk through for field acceptance will be scheduled with the contractor after the preliminary walk-through punch list items have been completed.
29. Provide restraint lengths at all bends, valves, tees, and all other fittings.
30. All master metered distribution lines shall be protected by an RPZ backflow preventer.
31. All non-chemical fire lines shall be protected by a DCDA backflow preventer.
32. All chemically injected fire lines shall be protected by an RPZ backflow preventer.

Materials:

1. PVC mains 12 inches and below shall conform to AWWA C-909 pressure class 235 or above. PVC main greater than 12 inches shall conform to AWWA C-900 DR 18 or above. Water mains shall have an absolute minimum depth of 48 inches in all areas.
2. 2-inch service crossings shall be Yelomine ASTM D2241 or approved equivalent.
3. Tapping saddles shall be single brass strap or dual banded stainless-steel flat-strap epoxy saddle with iron pipe threads.
4. All fasteners shall be 304 stainless-steel (e.g. hardware, screws, anchor bolts, rods, flange bolts and nuts, etc.). All bolts and nuts shall be heavy hex. Field-apply nickel anti-seize compound prior to assembly. Bolts and nuts shall not be painted.
5. All buried metal pipe, fittings, and valves shall be wrapped with 8mil poly.
6. Paint shall be high-build epoxy with topcoat of polyurethane.
7. All fire hydrant leads shall be ductile iron C151 or approved equivalent.

Testing:

1. All testing shall be arranged and paid for by the contractor and witnessed by GVSUD.
2. All testing must be complete prior to paving streets.
3. The Contractor shall provide GVSUD copies of all test results prior to acceptance of the project.
4. All testing must be complete prior to performing tie-ins to existing water systems.
5. All other utilities must be complete and offsite prior to performing hydrostatic pressure testing.
6. Contractor shall perform spike test at 200 PSI for 15 minutes then reduce pressure to 150 PSI for 2 hours.
7. Contractor shall perform pre-testing to verify passing results prior to requesting GVSUD inspection. Provide connection point for GVSUD digital test gauge (quick connect).
8. Perform trench backfill density testing at intervals specified by the design engineer, exact locations to be designated by inspector. Schedule with GVSUD to witness 48 hours prior to test. Provide copies of reports to GVSUD.
9. Hydrostatic pressure testing shall be every 1200 LF (max) of water line or as approved by the engineer. All errors of workmanship shall be corrected immediately. All parts of the pipeline shall be backfilled and braced sufficiently to prevent movement under pressure.

Construction Notes:

1. All work shall be in accordance with GVSUD standards as published at the following website: http://www.gvsud.org/
2. Material submittals shall be provided for GVSUD review and approval. Allow 21 calendar days for review.
3. All water installations must be inspected and approved by GVSUD prior to backfilling or otherwise covering the work. GVSUD will reject anything backfilled prior to GVSUD approval. This includes crossings of water and wastewater by other utilities. GVSUD will perform a maximum of one (1) inspection daily for one (1) hour duration between 7:30am and 4:00pm excluding weekends and holidays. Call to schedule inspections (48-hours advance notice is required for all inspections).
4. Trench excavation and pipe installation will not be permitted until subgrade has been established. Survey staking must be installed prior to and maintained during trench excavation and pipe installation. Survey staking shall include horizontal and vertical control at a minimum of 50-foot station intervals. Survey staking shall be performed by the contractor.
5. Proper shoring and/or benching must be present at all times for anything 4-feet in depth or deeper. GVSUD will stop work until proper safety protocols have been established.
6. Backflow prevention in the form of a reduced pressure zone backflow prevention assembly must be provided for temporary connections to existing water lines. Backflow prevention assemblies shall be tested by a licensed backflow prevention assembly tester.
7. All piping shall be installed in straight alignment. Pipe deflection is not allowed.
8. Install concrete thrust blocking and mechanical restraints for pressurized piping systems.
9. Water pipe shall be installed above wastewater and all pipe joints shall be centered at crossings with all other utilities. Both pipe joints shall be centered where water crosses wastewater mains and laterals 10-feet in either direction.
10. Maintain a minimum of 10-feet horizontal and 24-inch vertical clearance between water and wastewater and other utilities. Shared trenches are not allowed.
11. Water piping shall be sleeved if located under box culverts, single barrel, or multiple barrel storm sewer crossings regardless of size.
12. Valve boxes and appurtenances shall be painted. Provide painted curb cut markings at valves and services.
13. All exposed vertical and horizontal concrete edges shall be formed with ¾" chamfer strips. Concrete in unpaved areas shall be 2" above finish grade.
14. The contractor shall provide a competent and qualified superintendent to supervise all work. The superintendent shall be present during all construction activities, including inspections.

No separate pay will be given to de-water trenches or other excavated areas.

CUDEENGINEERS.COM

CUDE ENGINEERS

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

WATER DISTRIBUTION STANDARD NOTES AND DETAILS

DATE 10/15/2025

PROJECT NO. 03499.009

DRAWN BY AR/JF/RB

CHECKED BY KMH

REVISIONS


1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
10/15/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C5.D2

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

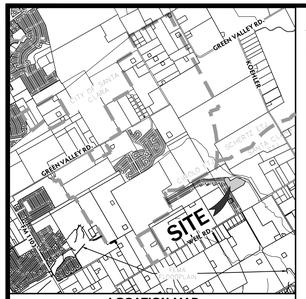


LOCATION MAP
N.T.S.

LEGEND

- = UNIT BOUNDARY
- = DRAINAGE BOUNDARY
- = SHEET FLOW Tc LINE
- = SHALLOW CONCENTRATED Tc LINE
- = CONCENTRATED Tc LINE
- = ACCUMULATION POINT

SCALE: 1"=300'
300 150 0 300

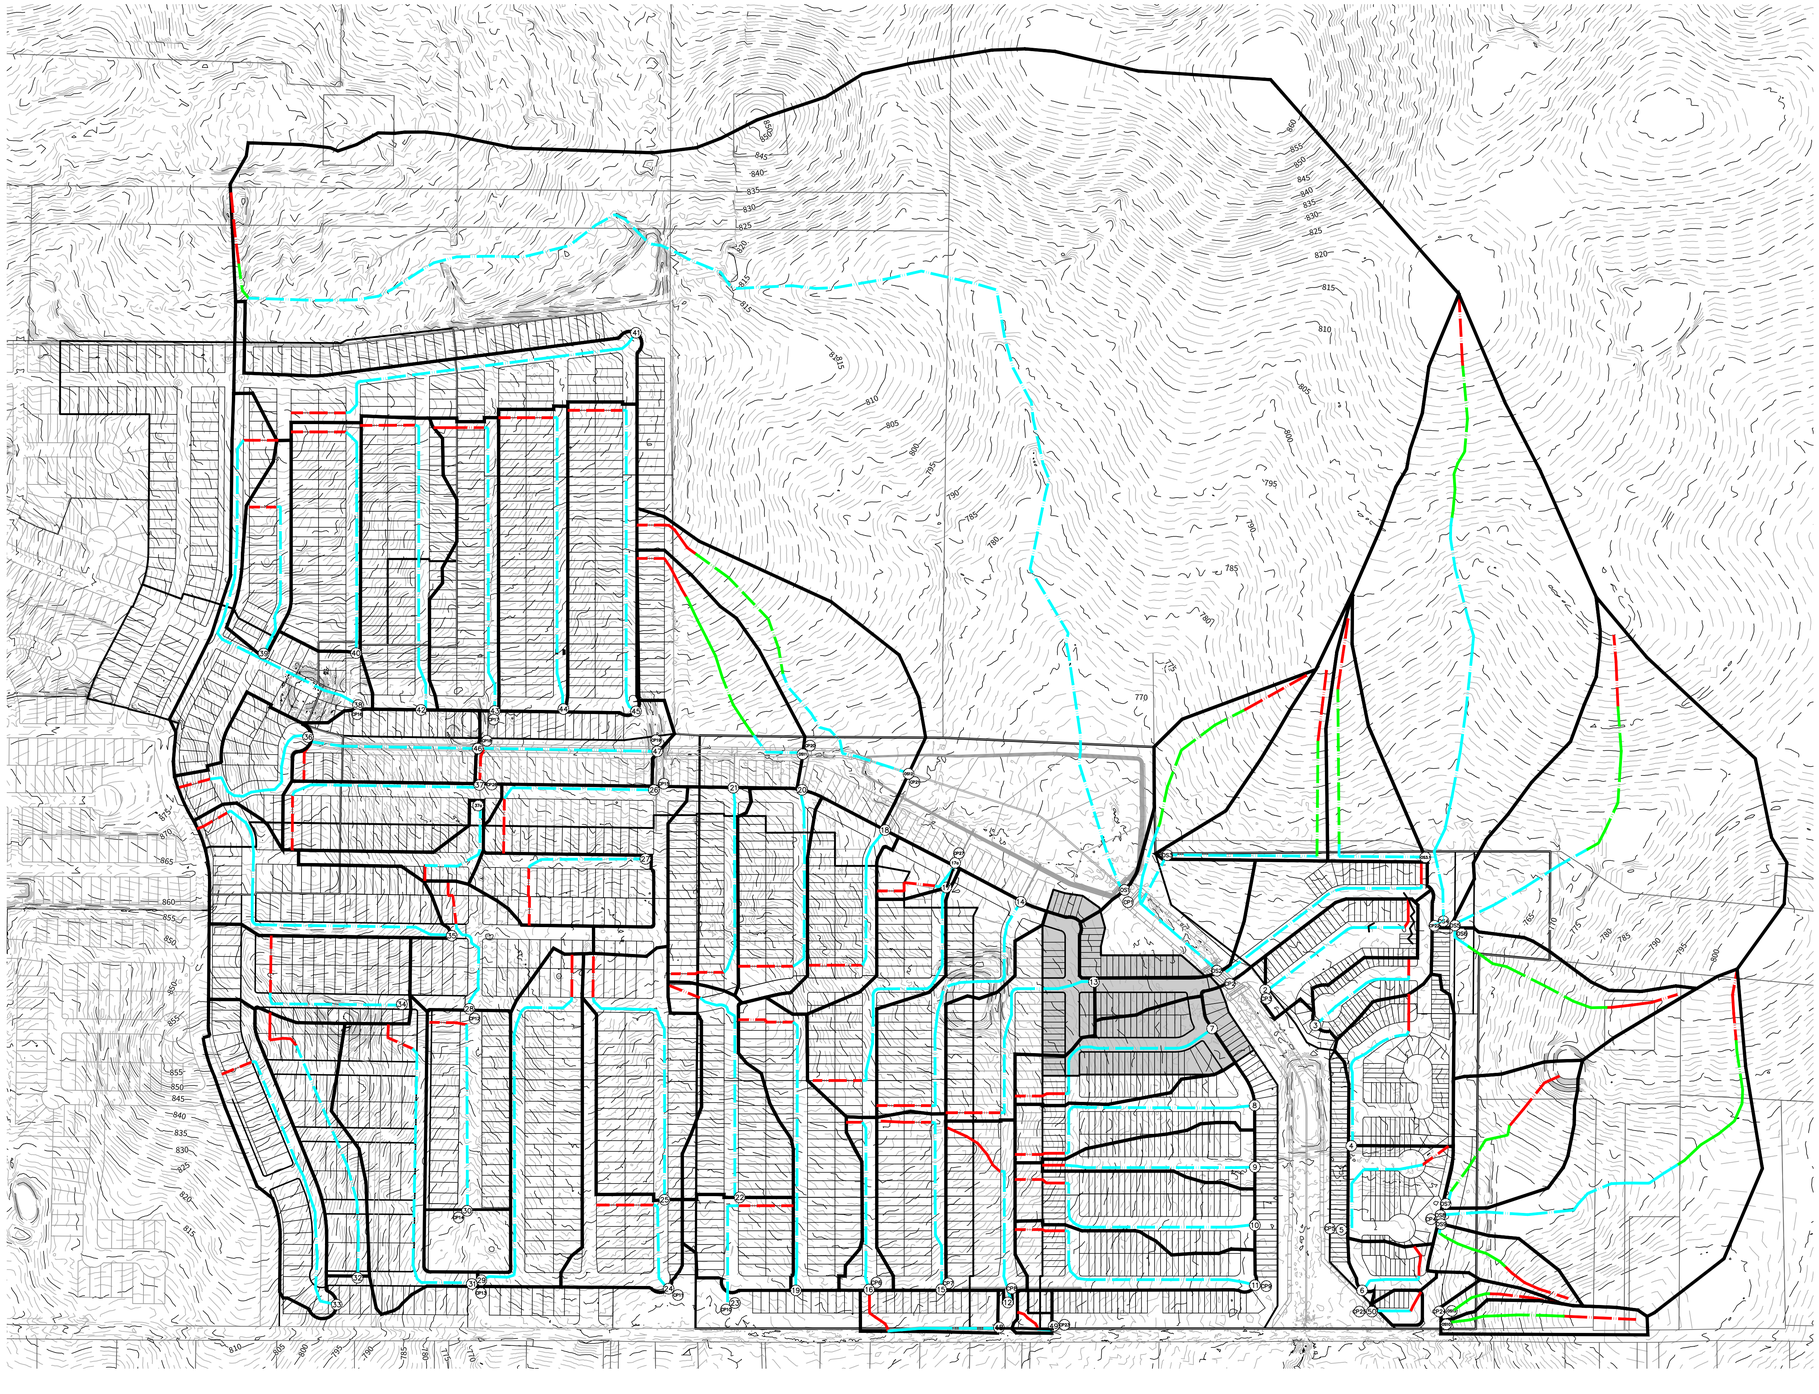

DEVELOPER:

LENNAR HOMES OF TEXAS LAND AND CONSTRUCTION, LTD.
CONTACT PERSON: RICHARD MOTT
100 NE LOOP 410, SUITE 1155
SAN ANTONIO, TX 78216
TEL: (210) 403-6200

CIVIL ENGINEER:

CUDE ENGINEERS
CONTACT PERSON: CHRIS J. CHAFFEE, P.E.
4122 POND HILL ROAD, SUITE 101
SAN ANTONIO, TX 78231
TEL: (210) 681-2951
FAX: (210) 523-7112

TYPICAL LOT SITE PLAN
N.T.S.

CUDEENGINEERS.COM

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

DRAINAGE MASTER PLAN - ULTIMATE CONDITIONS

DATE
10/15/2025

PROJECT NO.
03499.009

DRAWN BY
AR/JF/RB

CHECKED BY
KMH


REVISIONS
1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
10/15/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C6.00

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

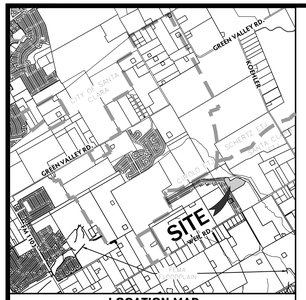

LOCATION MAP N.T.S.

DEVELOPER:

LENNAR HOMES OF TEXAS LAND AND CONSTRUCTION, LTD.
CONTACT PERSON: RICHARD MOTT
100 NE LOOP 410, SUITE 1155
SAN ANTONIO, TX 78216
TEL: (210) 403-6200

CIVIL ENGINEER:

CUDE ENGINEERS
CONTACT PERSON: CHRIS J. CHAFFEE, P.E.
4122 POND HILL ROAD, SUITE 101
SAN ANTONIO, TX 78231
TEL: (210) 681-2951
FAX: (210) 523-7112

ULTIMATE CONDITIONS

Project Name: Grace Valley Ranch Phase 6 — **Preci** — **PA2**
Calculation Summary for Time of Concentrations & Ultimate Flow

HYDROLOGY						Sheet Flow Tc Compuations						Shallow Conc. Tc Compuations					Concentrated Tc Computations			Overall	INTENSITY			Q FLOW			
Drainage Shed	Shed Area (Ac.)	AREA OF ACCUMULATION (Ac.)	C (5-YR)	C (25-YR)	C (100-YR)	*Length - 300'*	Paved (Y or N)	Upstream Elev.	Downstream Elev	Slope	Time of Concentration	*Length - 650'*	Paved (Y or N)	Downstream Elev	Slope	Time of Concentration	*Length*	Velocity (fps)	Time of Concentration	Time of Concentration (min)	I5	I25	I100	Q5	Q25	Q100	Drainage Shed
OS-A1	224.39	=OS-A1	0.38	0.45	0.53	*300.00*	N	897.15	885.41	3.91%	18.00	*154.58*	N	872.88	8.10%	0.56	*5993.79*	5	19.98	38.00	3.34	4.66	5.85	288.14	474.35	689.38	OS-A1
OS-A2	12.15	=OS-A2	0.38	0.44	0.51	*300.00*	N	794.00	783.69	3.44%	18.00	*650.00*	N	763.67	3.08%	3.83	*766.33*	5	2.55	24.00	4.31	6.00	7.55	19.72	32.28	47.14	OS-A2
OS-A3	6.28	=OS-A3	0.36	0.42	0.49	*300.00*	N	795.01	786.69	2.77%	18.46	*482.11*	N	769.32	3.60%	2.61	*862.80*	5	2.88	23.00	4.42	6.15	7.74	9.99	16.22	23.82	OS-A3
OS-A3.1	4.96	=OS-A3.1	0.36	0.42	0.49	*300.00*	N	798.00	792.54	1.82%	20.00	*650.00*	N	769.36	3.57%	3.54	*411.06*	5	1.37	24.00	4.31	6.00	7.55	7.70	12.50	18.35	OS-A3.1
OS-A4	34.79	=OS-A4	0.36	0.42	0.49	*300.00*	N	825.00	823.36	0.55%	20.00	*650.00*	N	802.31	3.24%	3.72	*1777.70*	5	5.93	29.00	3.79	5.26	6.60	47.47	76.86	112.51	OS-A4
OS-A5	29.13	=OS-A5	0.36	0.42	0.49	*300.00*	N	800.00	791.22	2.93%	18.15	*650.00*	N	770.00	3.26%	3.70	*613.23*	5	2.04	23.00	4.42	6.15	7.74	46.35	75.24	110.48	OS-A5
OS-A6	8.69	=OS-A6	0.37	0.43	0.50	*300.00*	N	796.00	789.17	2.28%	19.44	*650.00*	N	759.28	4.60%	3.11	*106.98*	5	0.36	22.00	4.52	6.30	7.94	14.43	23.55	34.54	OS-A6
OS-A7	22.14	=OS-A7	0.36	0.42	0.49	*300.00*	N	800.00	791.39	2.87%	18.26	*650.00*	N	772.70	2.88%	3.97	*1061.30*	5	3.54	25.00	4.21	5.85	7.36	33.56	54.40	79.85	OS-A7
OS-A8	6.26	=OS-A8	0.36	0.42	0.49	*300.00*	N	780.00	766.05	4.65%	17.35	*396.93*	N	750.38	3.95%	2.06	*53.72*	5	0.18	19.00	4.84	6.75	8.51	10.91	17.75	26.10	OS-A8
OS-A9	2.44	=OS-A9	0.36	0.42	0.49	*300.00*	N	778.00	761.74	5.42%	16.58	*313.28*	N	749.24	3.99%	1.62	*39.09*	5	0.13	18.00	4.94	6.89	8.70	4.34	7.06	10.40	OS-A9
OS-A10	1.91	=OS-A10	0.36	0.42	0.49	*300.00*	N	784.00	779.12	1.63%	20.00	*496.67*	N	749.01	6.06%	2.08	*27.57*	5	0.09	22.00	4.52	6.30	7.94	3.11	5.05	7.43	OS-A10
OS-A11	10.63	=OS-A11	0.41	0.48	0.56	*300.00*	N	825.32	816.44	2.96%	18.08	*650.00*	N	788.23	4.34%	3.21	*240.56*	5	0.80	22.00	4.52	6.30	7.94	19.56	32.46	47.07	OS-A11
OS-A12	12.63	=OS-A12	0.38	0.44	0.52	*300.00*	N	830.75	821.51	3.08%	18.00	*650.00*	N	794.89	4.10%	3.32	*723.72*	5	2.41	23.00	4.42	6.15	7.74	21.08	34.50	50.38	OS-A12
A1	5.81	=A1	0.47	0.57	0.65	*93.80*	N	766.40	764.63	1.89%	13.22						*948.00*	5	3.16	16.00	5.15	7.19	9.08	14.02	23.79	34.09	A1
A2	4.10	=A2	0.43	0.52	0.59	*124.33*	N	763.00	760.16	2.28%	13.65						*686.68*	5	2.29	15.00	5.26	7.34	9.27	9.28	15.54	22.46	A2
A3	2.48	=A3	0.52	0.64	0.72	*75.00*	N	758.85	757.45	1.86%	13.27						*473.63*	5	1.58	14.00	5.46	7.64	9.68	7.04	12.13	17.28	A3
A4	6.45	=A4	0.50	0.62	0.70	*156.41*	N	757.14	755.00	1.37%	17.08						*623.26*	5	2.08	19.00	4.84	6.75	8.51	15.73	26.91	38.26	A4
A5	3.79	=A5	0.50	0.62	0.70	*133.26*	N	756.26	753.26	2.25%	14.17						*511.42*	5	1.70	15.00	5.26	7.34	9.27	10.07	17.23	24.53	A5
A6	1.54	=A6	0.51	0.63	0.71	*132.58*	N	750.19	748.42	1.33%	15.96						*268.45*	5	0.89	16.00	5.15	7.19	9.08	4.05	6.94	9.87	A6
A7	5.87	=A7	0.52	0.64	0.72	*212.50*	N	786.67	774.47	5.74%	14.16						*806.55*	5	2.69	16.00	5.15	7.19	9.08	15.72	27.01	38.38	A7
A8	4.64	=A8	0.52	0.64	0.72	*211.23*	N	786.76	777.90	4.19%	15.37						*976.26*	5	3.25	18.00	4.94	6.89	8.70	11.92	20.46	29.06	A8
A9	3.19	=A9	0.52	0.64	0.72	*95.00*	N	780.30	778.04	2.38%	12.25						*796.20*	5	2.65	14.00	5.46	7.64	9.68	9.06	15.60	22.23	A9
A10	6.18	=A10	0.52	0.64	0.72	*215.64*	N	785.30	776.44	4.11%	15.68						*951.51*	5	3.17	18.00	4.94	6.89	8.70	15.88	27.25	38.71	A10
A11	5.03	=A11	0.52	0.64	0.72	*211.07*	N	777.52	769.96	3.58%	15.74						*974.26*	5	3.25	18.00	4.94	6.89	8.70	12.92	22.18	31.51	A11
A12	4.90	=A12	0.52	0.64	0.72	*297.19*	N	799.49	785.84	4.59%	17.27						*523.17*	5	1.74	19.00	4.84	6.75	8.51	12.33	21.17	30.02	A12
A13	7.30	=A13	0.52	0.64	0.72	*230.00*	N	800.46	788.38	5.25%	14.87						*877.48*	5	2.92	17.00	5.05	7.04	8.89	19.17	32.89	46.73	A13
A14	6.54	=A14	0.52	0.64	0.72	*230.00*	N	805.31	799.85	2.37%	17.50						*1107.28*	5	3.69	21.00	4.63	6.45	8.13	15.75	27.00	38.28	A14
A15	4.92	=A15	0.52	0.64	0.72	*212.34*	N	805.00	800.11	2.30%	16.77						*724.75*	5	2.42	19.00	4.84	6.75	8.51	12.38	21.25	30.15	A15
A16	1.67	=A16	0.52	0.64	0.72	*67.50*	N	806.81	805.79	1.50%	13.99						*711.97*	5	2.37	16.00	5.15	7.19	9.08	4.47	7.68	10.92	A16
A17	7.24	=A17	0.52	0.64	0.72	*207.09*	N	807.29	803.86	1.65%	17.94						*1167.72*	5	3.89	21.00	4.63	6.45	8.13	17.43	29.89	42.38	A17
A18	5.80	=A18	0.52	0.64	0.72	*222.62*	N	806.00	793.22	5.74%	14.36						*594.41*	5	1.98	16.00	5.15	7.19	9.08	15.53	26.69	37.92	A18
A19	7.23	=A19	0.52	0.64	0.72	*240.00*	N	818.40	811.28	2.97%	17.07						*1133.27*	5	3.78	20.00	4.73	6.60	8.32	17.78	30.54	43.31	A19
A20	5.81	=A20	0.52	0.64	0.72	*230.00*	N	817.79	807.30	4.56%	15.44						*764.57*	5	2.55	17.00	5.05	7.04	8.89	15.26	26.18	37.19	A20
A21	5.56	=A21	0.52	0.64	0.72	*227.71*	N	823.72	818.56	2.27%	17.39						*784.91*	5	2.62	20.00	4.73	6.60	8.32	13.68	23.49	33.31	A21
A22	4.78	=A22	0.52	0.64	0.72	*138.72*	N	823.40	821.02	1.71%	15.51						*785.03*	5	2.62	18.00	4.94	6.89	8.70	12.28	21.08	29.94	A22
A23	5.31	=A23	0.52	0.64	0.72	*230.00*	N	796.00	790.55	2.37%	17.50						*526.50*	5	1.76	19.00	4.84	6.75	8.51	13.36	22.94	32.54	A23
A24	4.98	=A24	0.52	0.64	0.72	*240.00*	N	798.20	788.96	3.85%	16.15						*378.61*	5	1.26	17.00	5.05	7.04	8.89	13.08	22.44	31.88	A24
A25	9.29	=A25	0.52	0.64	0.72	*172.13*	N	830.48	827.74	1.59%	16.75						*1092.14*	5	3.64	20.00	4.73	6.60	8.32	22.85	39.24	55.65	A25
A26	6.36	=A26	0.52	0.64	0.72	*230.00*	N	820.63	814.71	2.58%	17.35						*659.42*	5	2.20	19.00	4.84	6.75	8.51	16.01	27.48	38.97	A26
A27	4.74	=A27	0.52	0.64	0.72	*245.00*	N	826.41	819.23	2.93%	17.14						*501.60*	5	1.67	18.00	4.94	6.89	8.70	12.18	20.90	29.69	A27
A28	5.68	=A28	0.52	0.64	0.72	*197.76*	N	829.34	824.64	2.38%	16.22						*422.10*	5	1.41	17.00	5.05	7.04	8.89	14.92	25.59	36.36	A28
A29	9.16	=A29	0.52	0.64	0.72	*177.21*	N	830.22	828.00	1.25%	17.93						*1511.81*	5	5.04	22.00	4.52	6.30	7.94	21.53	36.93	52.37	A29
A30	6.80	=A30	0.46	0.56	0.64	*156.38*	N	818.00	808.94	5.80%	12.82						*778.12*	5	2.59	15.00	5.26	7.34	9.27	16.57	28.05	40.25	A30
A31	8.36	=A31	0.49	0.60	0.68	*168.58*	N	825.29	815.51	5.80%	13.08						*1233.96*	5	4.11	17.00	5.05	7.04	8.89	20.66	35.18	50.23	A31
A32	5.68	=A32	0.42	0.51	0.58	*240.79*	N	846.31	840.00	2.62%	17.76						*1018.09*	5	3.39	21.00	4.63	6.45	8.13	11.16	18.63	26.90	A32
A33	6.68	=A33	0.52	0.64	0.72	*135.61*	N	849.87	845.14	3.49%	12.89						*1143.38*	5	3.81	16.00	5.15	7.19	9.08	17.89	30.74	43.67	A33
A34	6.71	=A34	0.51	0.63	0.71	*240.00*	N	849.61	846.08	1.47%	20.00						*578.77*	5	1.93	21.00	4.63	6.45	8.13	15.85	27.11	38.50	A34
A35	7.93	=A35	0.52	0.64	0.72	*143.68*	N	870.00	856.76	9.21%	11.14						*1362.99*	5	4.54	15.00	5.26	7.34	9.27	21.69	37.25	52.93	A35
A36	3.82	=A36	0.52	0.64	0.72	*134.64*	N	873.00	862.72	7.63%	10.83						*626.93*	5	2.09	12.00	5.87	8.25	10.49	11.66	20.17	28.85	A36
A37	7.20	=A37	0.52	0.64	0.72	*229.71*	N	857.95	849.73	3.58%	16.20						*798.91*	5	2.66	18.00	4.94	6.89	8.70	18.50	31.75	45.10	A37
A38	8.21	=A38	0.52	0.64	0.72	*144.96*	N	880.25	877.33	2.02%	14.98						*1494.95*	5	4.98	19.00	4.84	6.75	8.51	20.66	35.47	50.30	A38
A39	3.50	=A39	0.50	0.62	0.70	*115.00*	N	872.36	869.64	2.37%	13.01						*646.37*	5	2.15	15.00	5.26	7.34	9.27	9.29	15.89	22.63	A39
A40	6.43	=A40	0.51	0.63	0.71	*230.00*	N	880.00	872.14	3.42%	16.29						*946.85*	5	3.16	19.00	4.84	6.75	8.51	15.89	27.23	38.67	A40
A41	9.20	=A41	0.52	0.64	0.72	*230.00*	N	878.47	871.78	2.91%	16.68						*1359.12*	5	4.53	21.00	4.63	6.45	8.13	22.15	37.98	53.85	A41
A42	9.24	=A42	0.52	0.64	0.72	*230.00*	N	872.08	864.00	3.51%	16.24						*1210.50*	5	4.04	20.00	4.73	6.60	8.32	22.73	39.03	55.35	A42
A43	6.82	=A43	0.52	0.64	0.72	*212.38*	N	863.91	859.03	2.30%	16.77						*1208.80*	5	4.03	20.00	4.73	6.60	8.32	16.77	28.81	40.85	A43
A44	8.44	=A44	0.52	0.64	0.72	*230.00*	N	859.42	850.71	3.79%	16.11						*1253.16*	5	4.18	20.00	4.73	6.60	8.32	20.76	35.65	50.56	A44
A45	8.68	=A45	0.52	0.64	0.72	*230.00*	N	851.27	839.83	4.97%	15.03						*1295.78*	5	4.32	19.00	4.84	6.75	8.51	21.85	37.50	53.18	A45
A46	5.06	=A46	0.48	0.58	0.66	*162.06*	N	848.28	845.78	1.54%	16.84						*698.18*	5	2.33	19.00	4.84	6.75	8.51	11.69	19.85	28.36	A46
A47	5.55	=A47	0.48	0.59	0.66	*145.59*	N	817.11	814.00	2.13%	14.81						*725.71*	5	2.42	17.00	5.05	7.04	8.89	13.49	22.92	32.77	A47
A48	2.31	=A48	0.44	0.53	0.60	*207.46*	N	784.25	772.08	5.87%	14.05						*457.01*	5	1.52	15.00	5.26	7.34	9.27	5.35	8.98	12.95	A48
A49	0.62	=A49	0.42	0.50	0.57	*116.9*	N	767.6	759.7	6.73%	10.84						*60.27*	5	0.20	11.00	6.08	8.56	10.89	1.57	2.64	3.85	A49
*CP1	344.21	=OS-A1+CP20+A14+A17+A18	0.43	0.51	0.59	*300.00*	N	897.15	885.41	3.91%	18.00	*154.58*	N	864.42	13.58%	0.43	*5993.79*	5	19.98	38.00	3.34	4.66	5.85	490.41	820.51	1179.38	*CP1
*CP2	368.45	=OS-A2 + OS-A3 + A1 + CP1	0.42	0.51	0.58	*300.00*	N	897.15	885.41	3.91%	18.00	*154.58*	N	856.76	18.53%	0.37	*6515.50*	5	21.72	40.00	3.26	4.54	5.71	509.83	850.80	1225.81	*CP2
CP3	81.67	=A2 + CP22	0.36	0.43	0.50	*300.00*	N	825.00	823.36	0.55%	20.00	*650.00*	N	802.31	3.24%	3.72	*2589.84*	5	8.63	32.00	3.60	5.00	6.27	107.11	173.93	254.09	CP3
CP4	30.84	=OS-A7 + OS-A8 + OS-A9	0.36	0.42	0.49	*300.00*	N	800.00	791.39	2.87%	18.26	*650.00*	N	772.70	2.88%	3.97	*1061.30*	5	3.54	25.00	4.21	5.85	7.36	46.74	75.77	111.22	CP4
CP5	34.63	=A5+CP4	0.38	0.44	0.51	*300.00*	N	800.00	791.39	2.87%	18.26	*650.00*	N	772.70	2.88%	3.97	*1447.58*	5	4.83	27.00	4.00	5.56	6.98	52.06	85.07	123.95	CP5
CP6	8.90	=A16+A19	0.52	0.64	0.72	*240.00*	N	818.40	811.28	2.97%	17.07						*1440.11*	5	4.80	21.00	4.63	6.45	8.13	21.43	36.74	52.10	CP6
CP7	13.82	=A15+CP6	0.52	0.64	0.72	*240.00*	N	818.40	811.28	2.97%	17.07						*1742.66*	5	5.81	22.00	4.52	6.30	7.94	32.48	55.72	79.01	CP7
CP8	18.72	=A12+CP7	0.52	0.64	0.72	*240.00*	N	818.40	811.28	2.97%	17.07						*1959.18*	5	6.53	23.00	4.42	6.15	7.74	43.03	73.68	104.32	CP8
CP9	23.75	=A11+CP8	0.52	0.64	0.72	*240.00*	N	818.40	811.28	2.97%	17.07						*3069.04*	5	10.23	27.00	4.00	5.56	6.98	49.40	84.51	119.36	CP9
CP10	10.09	=A22+A23	0.52	0.64	0.72	*138.72*	N	823.40	821.02	1.71%	15.51						*1343.95*	5	4.48	19.00	4.84	6.75	8.51	25.39	43.59	61.82	CP10
CP11	14.27	=A24+A25	0.52	0.64	0.72	*172.13*	N	830.48	827.74	1.59%	16.75						*1474.05*	5	4.91	21.00	4.63	6.45	8.13	34.36	58.91	83.53	CP11
CP12	20.32	=A28+A34+A35	0.52	0.64	0.72	*240.00*	N	849.61	846.08	1.47%	20.00						*878.01*	5	2.93	22.00	4.52	6.30	7.94	47.76	81.93	116.17	CP12
CP13	17.52	=A29+A31	0.51	0.62	0.70	*177.21*	N	830.22	828.00	1.25%	17.93						*1511.81*	5	5.04	22.00	4.52	6.30	7.94	40.02	68.42	97.23	CP13
CP14	27.12	=A30+CP12	0.51	0.62	0.70	*240.00*	N	849.61	846.08	1.47%	20.00						*1725.42*	5	5.75	25.00	4.21	5.85	7.36	57.75	98.44	139.63	CP14
CP15	11.10	=A26+A27	0.52	0.64	0.72	*245.00*	N	826.41	819.23	2.93%	17.14						*858.69*	5	2.86	20.00	4.73	6.60	8.32	27.30	46.89	66.49	CP15
CP16	18.14	=A38+A39+A40	0.51	0.63	0.71	*144.96*	N	880.25	877.33	2.02%	14.98						*1494.95*	5	4.98	19.00	4.84	6.75	8.51	45.10	77.31	109.75	CP16
CP17	16.06	=A42+A43	0.52	0.64	0.72	*212.38*	N	863.91	859.03	2.30%	16.77						*1208.80*	5	4.03	20.00	4.73	6.60	8.32	39.50	67.84	96.21	CP17
CP18	27.02	=A36+A46+CP16	0.51	0.62	0.70	*144.96*	N	880.25	877.33	2.02%	14.98						*1889.96*	5	6.30	21.00	4.63	6.45	8.13	63.53	108.61	154.31	CP18
CP19	72.95	=A37+A44+A45+A47+CP17+CP18	0.51	0.63	0.71	*144.96*	N	880.25	877.33	2.02%	14.98						*2643.41*	5	8.81	23.00	4.42	6.15	7.74	165.26	282.52	400.47	CP19
CP20	100.24	=OS-A11 + A21+CP15+CP19	0.50	0.62	0.69	*144.96*	N	880.25	877.33	2.02%	14.98						*3244.06*	5	10.81	25.00	4.21	5.85	7.36	212.09	361.25	512.72	CP20
CP21	112.87	=OS-A12 + CP20	0.49	0.60	0.67	*144.96*	N	880.25	877.33	2.02%	14.98						*3700.88*	5	12.34	27.00	4.00	5.56	6.98	220.59	374.54	531.67	CP21
CP22	77.57	=OS-3.1 + OS-A4 + OS-A5 + OS-A6	0.36	0.42	0.49	*300.00*	N	825.00	823.36	0.55%	20.00	*650.00*	N	802.31	3.24%	3.72	*1777.70*	5	5.93	29.00	3.79	5.26	6.60	106.08	171.83	251.47	CP22
CP23	2.93	=A48+A49	0.43	0.52	0.60	*207.5*	N	784.3	772.1	5.87%	14.05						*693.01*	5	2.31	16.00	5.15	7.19	9.08	6.56	11.02	15.90	CP23

* - DENOTES DRAINAGE AREA ANALYZED USING THE SCS HYDROLOGY METHOD DUE TO DRAINAGE AREA SIZE AND DETENTION CONSIDERATIONS. ALL HYDRAULIC CALCULATIONS FOR DRAINAGE STRUCTURES ASSOCIATED WITH THESE DRAINAGE AREAS SHOULD BE DERIVED FROM THE SCS METHOD HYDROLOGY CHART FOUND BELOW.

"c" DENOTES CARRYOVER FLOW FROM INLET ON GRADE
"i" DENOTES INLET FLOW FROM INLET ON GRADE

CUDEENGINEERS.COM

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

OVERALL DRAINAGE MASTER PLAN CALCULATIONS

DATE
10/15/2025

PROJECT NO.
03499.009

DRAWN BY
AR/JF/RB

CHECKED BY
KMH

REVISIONS
1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
10/15/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500


C6.01

P:\03499\03499-DWG\4 Plans\CAD\C6.01_ExhibitPlan.dwg 2025/10/15 10:18am jfarris


REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

KEYNOTES

1. 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
2. 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE

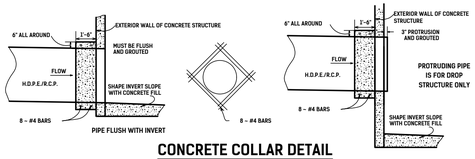


CONCRETE COLLAR DETAIL
(N.T.S.)

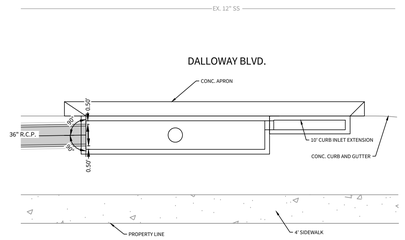

CURB INLET '7A–1' DETAIL
SCALE: 1"=10'






4'X4' JUNCTION BOX '7A–1' DETAIL
SCALE: 1"=10'

DRAIN "7A"

STA. 10+00.00 TO STA. 15+12.15

HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

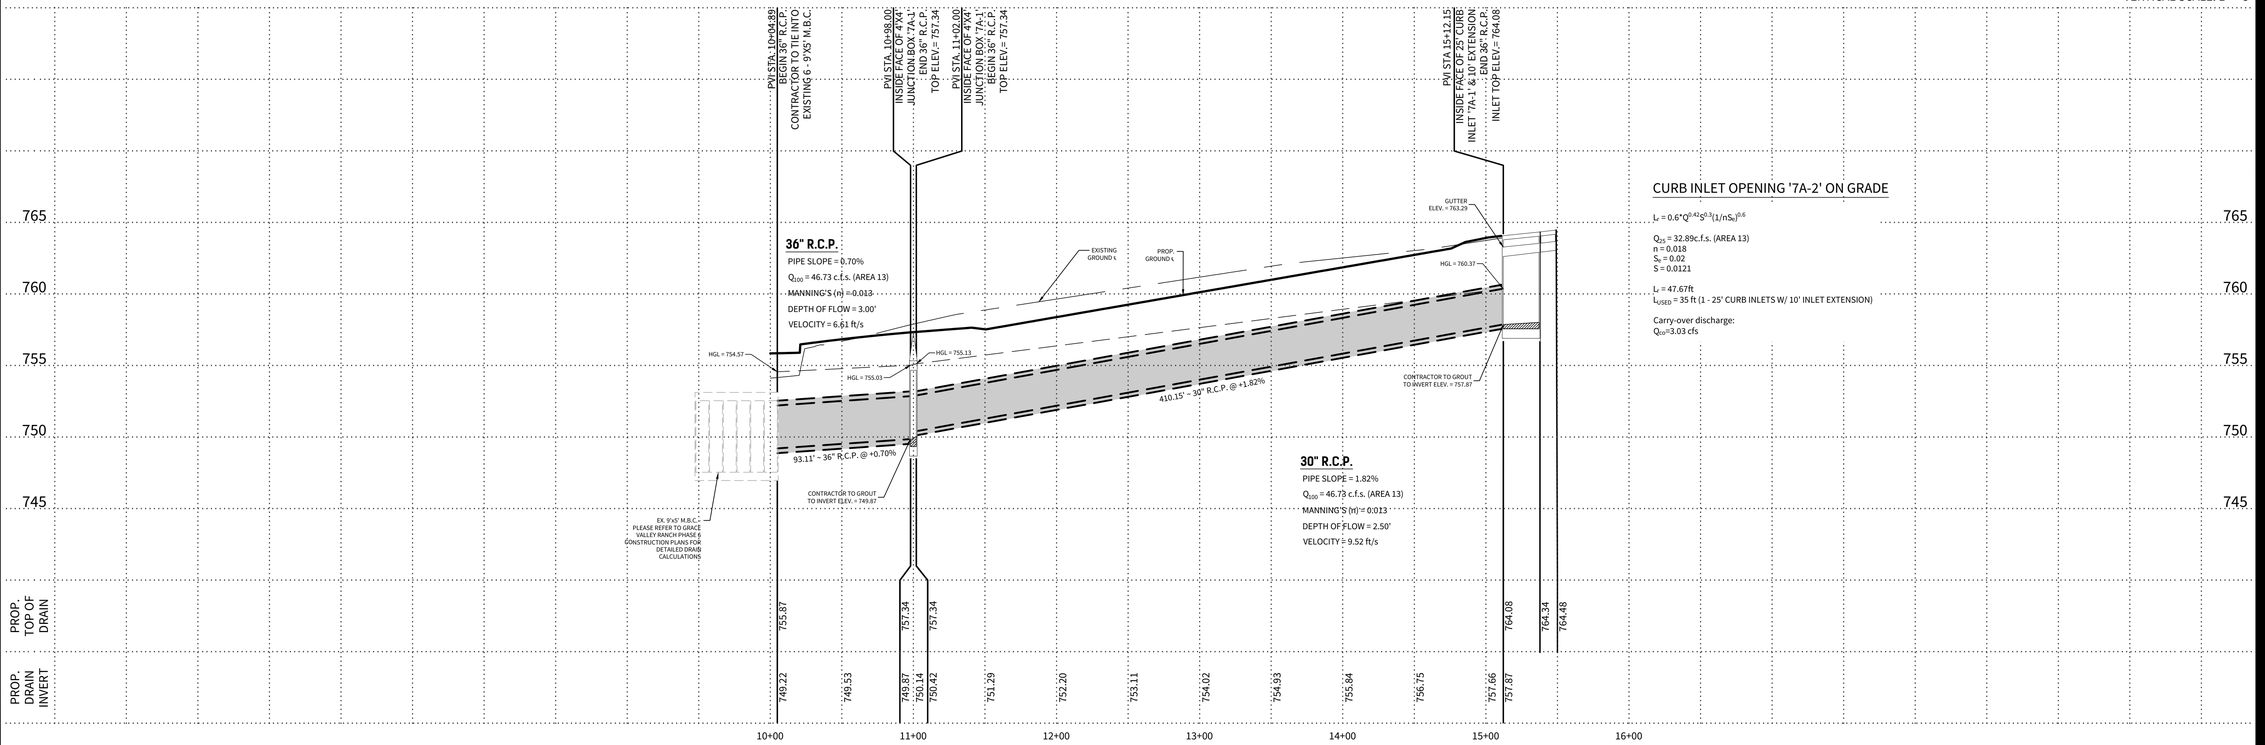

CUDEENGINEERS.COM

CUDE ENGINEERS

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

DRAINAGE PLAN & PROFILE - DRAIN '7A'

DATE
11/03/2025

PROJECT NO.
03499.009

DRAWN BY
AR/JF/RB

CHECKED BY
KMH

REVISIONS
1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
11/04/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C6.02

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.


LEGEND

GABION MATTRESS

CONCRETE RIP-RAP


KEYNOTES

1. 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
2. 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE

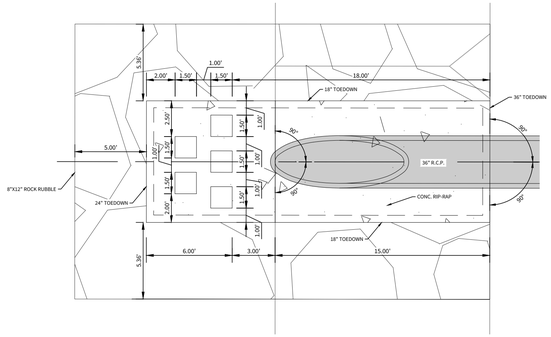

DRAIN '7B' OUTFALL DETAIL


SCALE: 1"=5'

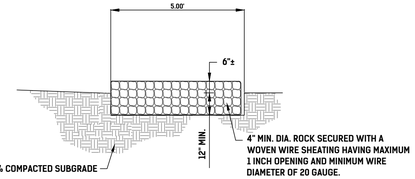

NOTE: GABION MATTRESS TO BE FREE OF GEO-TEXTILE FABRIC LINING.

GABION STYLE ROCK EROSION CONTROL MATTRESS DETAIL

N.T.S.




BAFFLE BLOCK DRAIN '7B' REINFORCEMENT DETAIL

(N.T.S.)


SCALE: 1"=50'

50 25 0 50

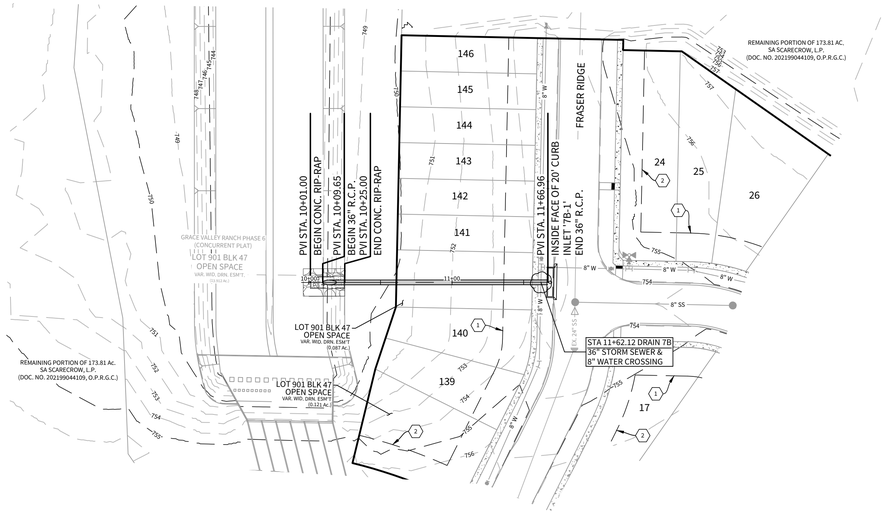


DRAIN "7B"

STA. 10+00.00 TO STA. 11+66.96

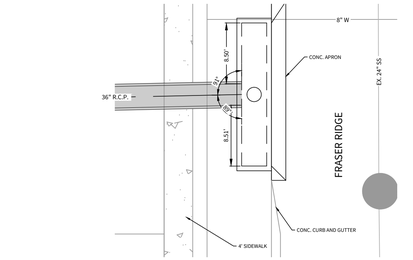


CURB INLET '7B-1' DETAIL

SCALE: 1"=10'



DRAIN '7B' OUTFALL DETAIL


(N.T.S.)

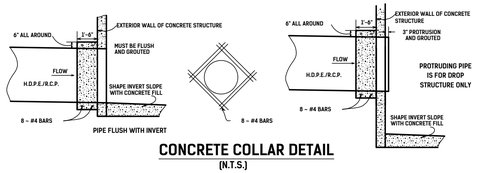

CONCRETE COLLAR DETAIL

(N.T.S.)

HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

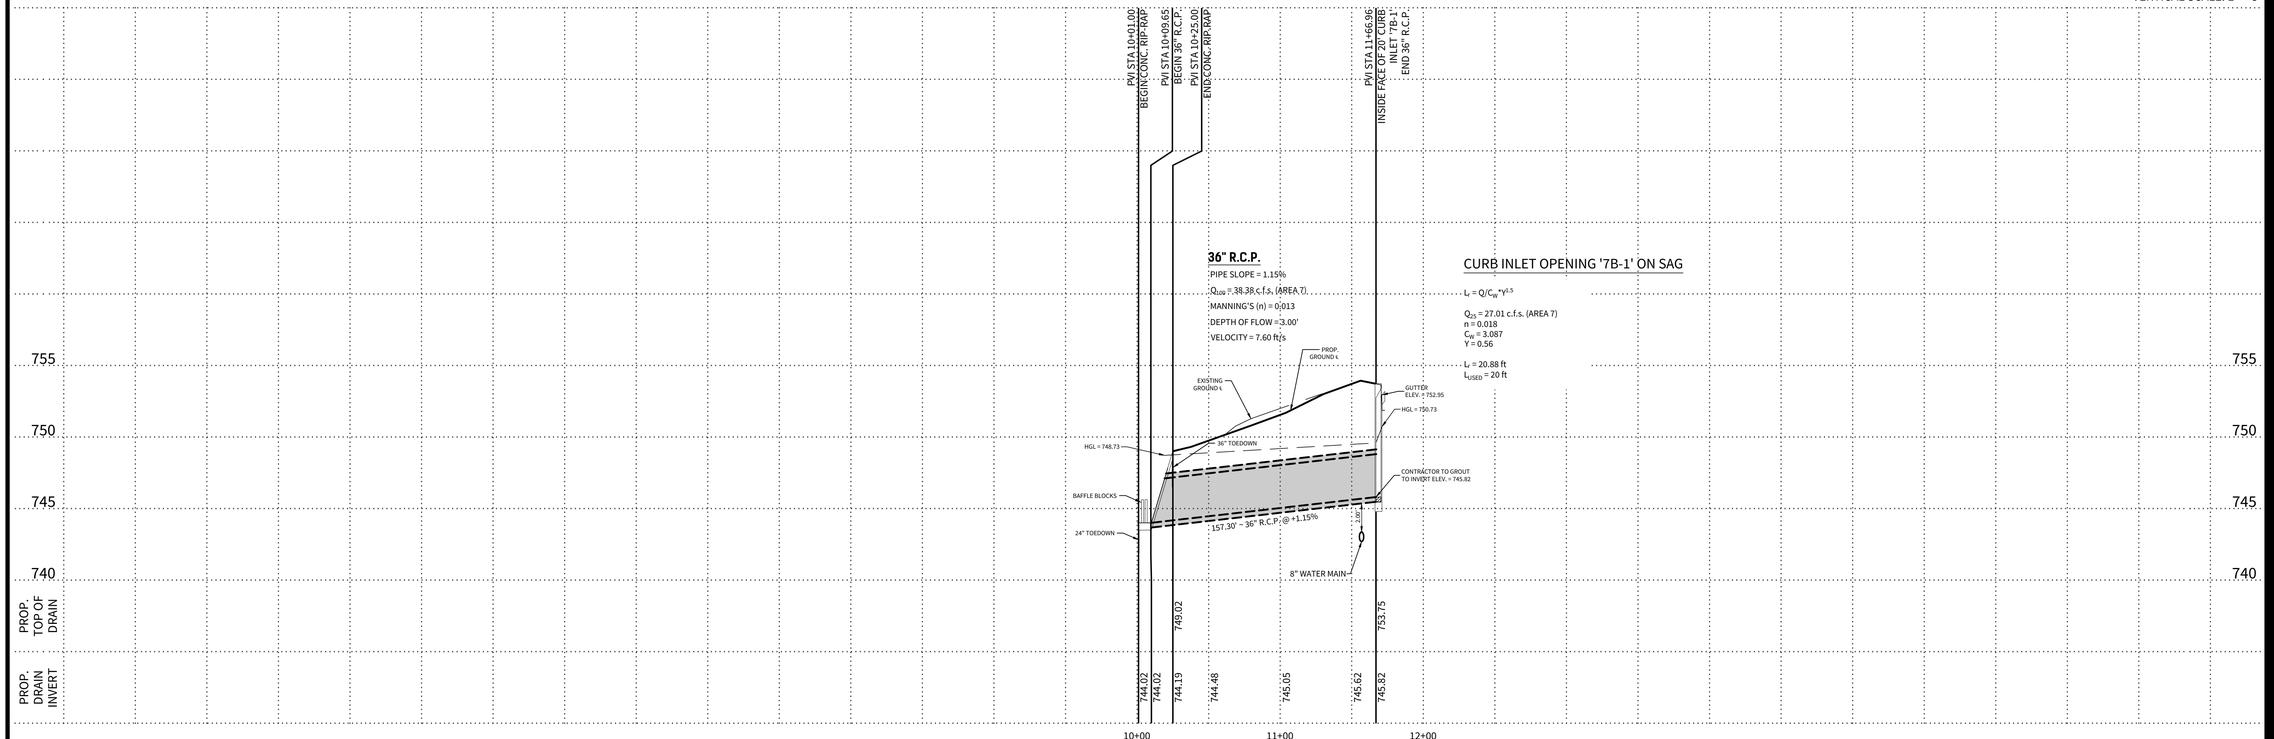

CUDEENGINEERS.COM

CUDE ENGINEERS

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

DRAINAGE PLAN & PROFILE - DRAIN '7B'

DATE
11/03/2025

PROJECT NO.
03499.009

DRAWN BY
AR/JF/RB

CHECKED BY
KMH

REVISIONS
1.
2.
3.
4.
5.
6.
7.
8.
9.


STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED PROFESSIONAL ENGINEER
11/04/2025


CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500


C6.03


P:\03499\009\CAD\C4.4 Plans\C4.03.DWG, 11/3/2025 5:59pm, Ramirez

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

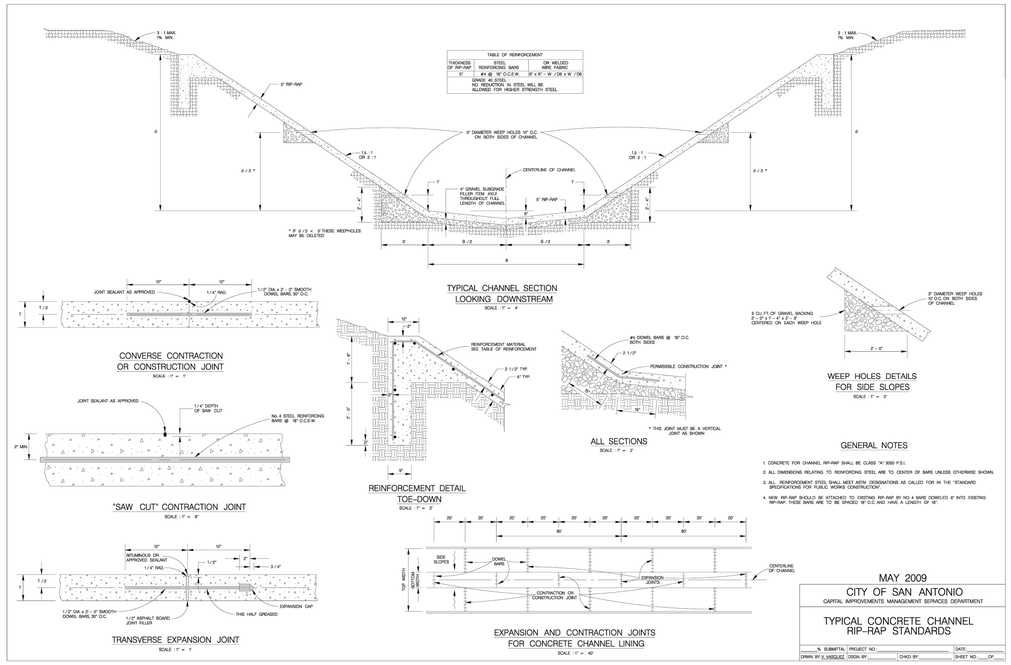

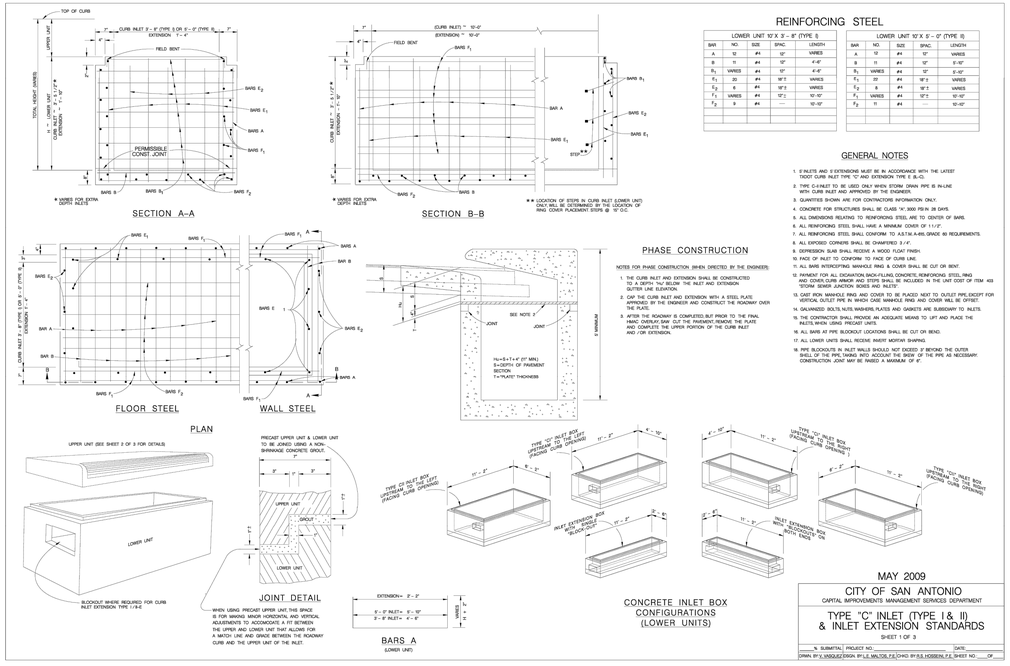

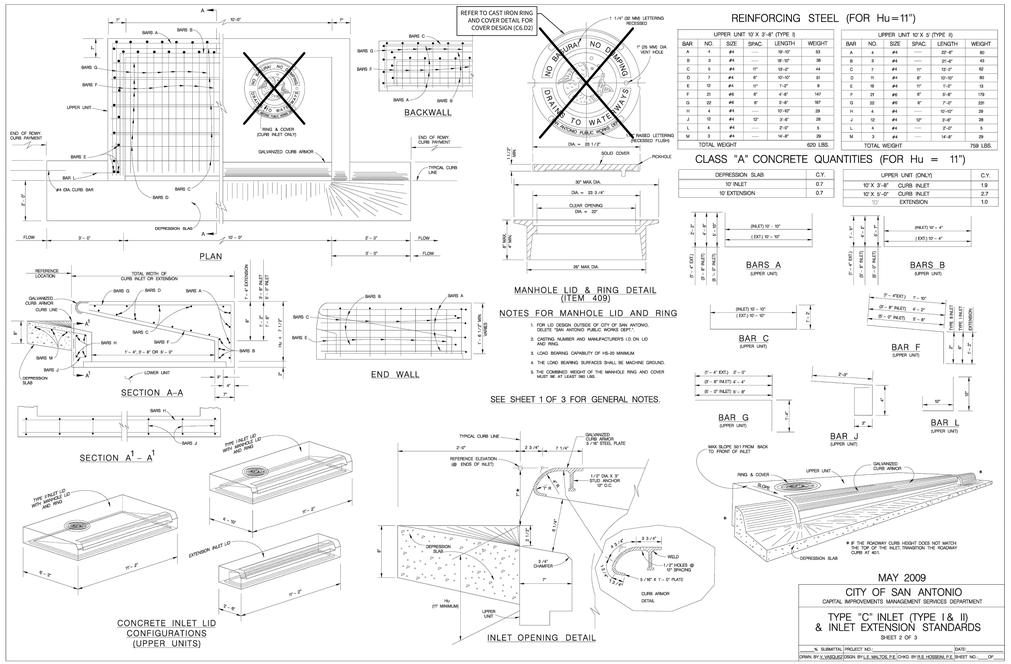

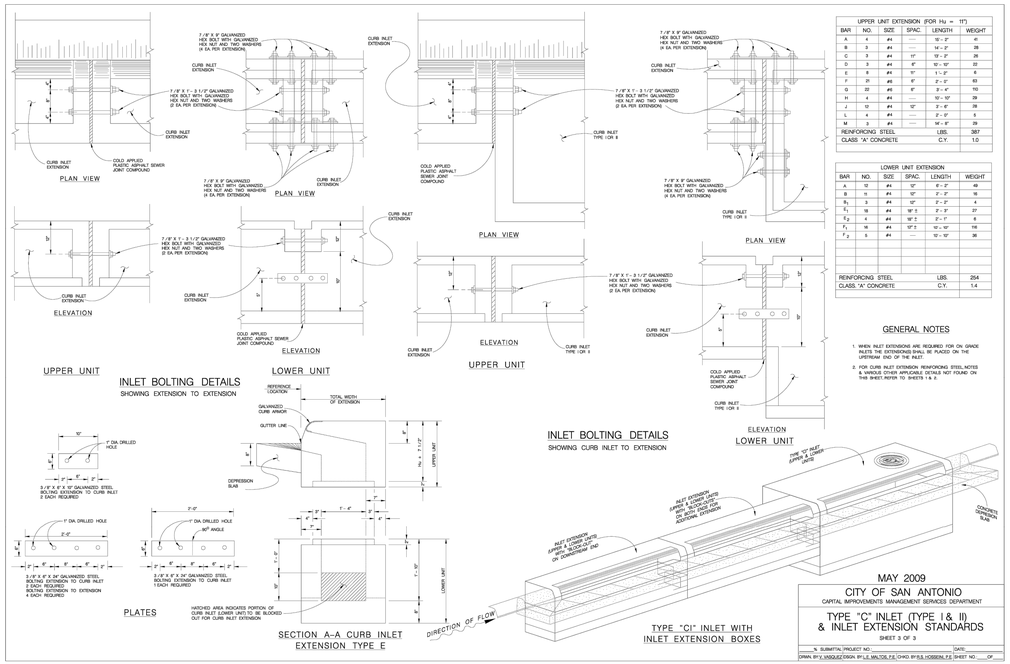

CUDEENGINEERS.COM
CUDE ENGINEERS
EST. 1980
4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

CONCRETE RIPRAP AND INLET DETAILS

DATE
10/15/2025

PROJECT NO.
03499.009

DRAWN BY
AR/JF/RB


CHECKED BY
KMH


REVISIONS
1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
10/15/2025
CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500


C6.D1

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

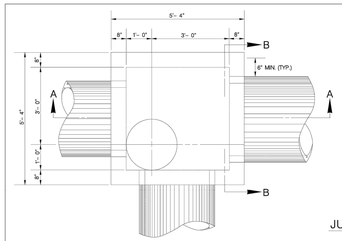



JUNCTION BOX TOP SLAB SHOWING STEEL




SCHEDULE FOR REINFORCING STEEL

J.B. NO. 1 & 4	SHAPE	BAR	NO.	SIZE	SPACING	LENGTH	WEIGHT
4'X 4'X 4'-4"	STRAIGHT	A	16	4	9" O.C.	5'- 1"	54
		B	32	5	8" O.C.	6'- 10"	228
		C	32	5	8" O.C.	4'- 3"	142
	STRAIGHT	D	16	4	9" O.C.	5'- 1"	54
	STRAIGHT	E	16	3	12" O.C.	3'-11"	24
	STRAIGHT	G	16	4	12" O.C.	5'-1"	54
	STRAIGHT	G_1	8	4	AS SHOWN	5'-1"	27
	STRAIGHT	H	20	3	12" O.C.	4'-5"	33
	STRAIGHT	J	8	6	3 1/2"	2'- 10"	34
						TOTAL	650 LBS.

CLASS "A" CONCRETE- 3.43 CU. YDS.
(DOES NOT EXCLUDE MANHOLE OPENINGS OR PIPE OPENING)


★ NOTE: BAR SIZE AND SPACING BASED ON SPANS AS SHOWN – ANY REVISIONS TO THESE SPANS SHALL INCLUDE A RE-DESIGN ON STEEL REQ'D.


1. CONCRETE FOR STRUCTURE SHALL BE CLASS "A," 3,000 P.S.I. AT 28 DAYS.
2. ALL EXPOSED EDGES SHALL BE CHAMFERED 3 /4".
3. REINFORCING STEEL SHALL BE NEW BILLET STEEL, INTERMEDIATE GRADE, ASTM A-15. THE DEFORMATION SHALL CONFORM TO ASTM A-305.
4. ALL DIMENSIONS RELATING TO REINFORCING STEEL ARE TO CENTER OF BARS.
5. ALL BARS INTERCEPTING MANHOLE OPENING AND REINFORCED CONCRETE PIPE SHALL BE FIELD-CUT.
6. WHERE LAPPING OF BARS IS REQUIRED, A MINIMUM LAP OF 33 DIAMETERS SHALL BE USED.
7. INVERT OF JUNCTION BOX TO BE SHAPED WITH CONCRETE FILL AT 200 P.S.I. TO EFFECT DRAINAGE TO OUTLET PIPE. COST SUBSIDIARY TO CLASS "A" CONCRETE (JUNCTION BOXES).
8. PAYMENT FOR ALL EXCAVATION, BACKFILLING, CONCRETE, REINFORCING STEEL, VERTICAL STACK, RING AND COVER SHALL BE INCLUDED IN THE UNIT COST OF ITEM 403 – "STORM SEWER JUNCTION BOXES AND INLETS".



VARIATION OF VERTICAL STACK

VERTICAL STACK DESIGN SHALL BE GOVERNED BY THE DEPTH OF THE TOP OF THE JUNCTION BOX BELOW THE FINISHED STREET GRADE.






MANHOLE LID & RING DETAIL


SCALE: 1 : 16

NOTES FOR MANHOLE LID AND RING


1. FOR LID DESIGN OUTSIDE OF CITY OF SAN ANTONIO, DELETE "SAN ANTONIO PUBLIC WORKS DEPT.".
2. CASTING NUMBER AND MANUFACTURER'S I.D. ON LID AND RING.
3. LOAD BEARING CAPABILITY OF HS-20 MINIMUM.
4. THE LOAD BEARING SURFACES SHALL BE MACHINE GROUND.
5. THE COMBINED WEIGHT OF THE MANHOLE RING AND COVER MUST BE AT LEAST 260 LBS.

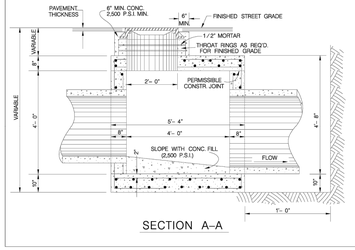


SECTION A–A



SECTION B–B



CAST IRON RING & COVER DETAIL



CURVED DEFLECTOR DETAIL

JANUARY 2005

CITY OF SAN ANTONIO
CAPITAL IMPROVEMENTS MANAGEMENT SERVICES DEPARTMENT

4'x4'x4' JUNCTION BOX STANDARDS

% SUBMITTAL PROJECT NO.: _____ DATE: _____
DRAWN BY: _____ DSGN BY: _____ CHKD. BY: _____ SHEET NO.: ____OF____

CUDEENGINEERS.COM

CUDE ENGINEERS EST. 1980

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

JUNCTION BOX AND INLET DETAILS

DATE
10/15/2025

PROJECT NO.
03499.009

DRAWN BY
AR/JF/RB

CHECKED BY
KMH

REVISIONS

1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER

10/15/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C6.D2

P:\03499\050\2 DWG\4-Sheets\C6.D2_DRAFT.dwg 2025-10-15 10:20:xx AR

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

KEYNOTES


1. 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
2. 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
1. EXISTING 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE (CONCURRENT GRACE VALLEY RANCH PHASE 6)
2. EXISTING 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE (CONCURRENT GRACE VALLEY RANCH PHASE 6)

LEGEND

- PROPOSED SIDEWALK
- SIDEWALK CONSTRUCTED WITH INFRASTRUCTURE
- STREET WASHOUT (SEE DETAIL SHEET C7.D1)
- STREET CENTERLINE
- EXISTING CONTOURS
- XXX.XX - TOP OF CURB SPOT ELEVATION
- DRIVEWAY
- XXX.XX - PAVEMENT ELEVATION

(SEE DETAIL SHEET C7.D1) FOR ADA RAMPS AT SIDEWALK INTERSECTIONS


TXDOT TYPE "10" WHEEL CHAIR RAMPS ARE INDICATED
THUS "" UNLESS OTHERWISE NOTED.
(SEE DETAIL SHEET C7.D1) FOR ADA RAMPS AT SIDEWALK INTERSECTIONS.
DETECTABLE WARNING PAVERS WITH TRUNCATED DOMES ONLY.

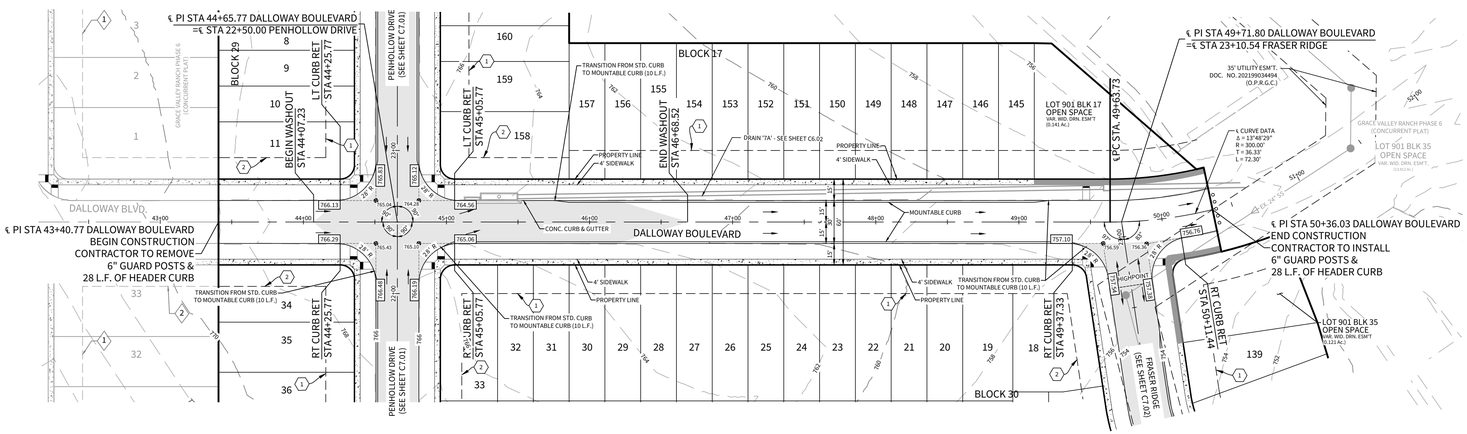

DALLOWAY BOULEVARD

STA. 43+40.77 TO STA. 50+36.03

HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

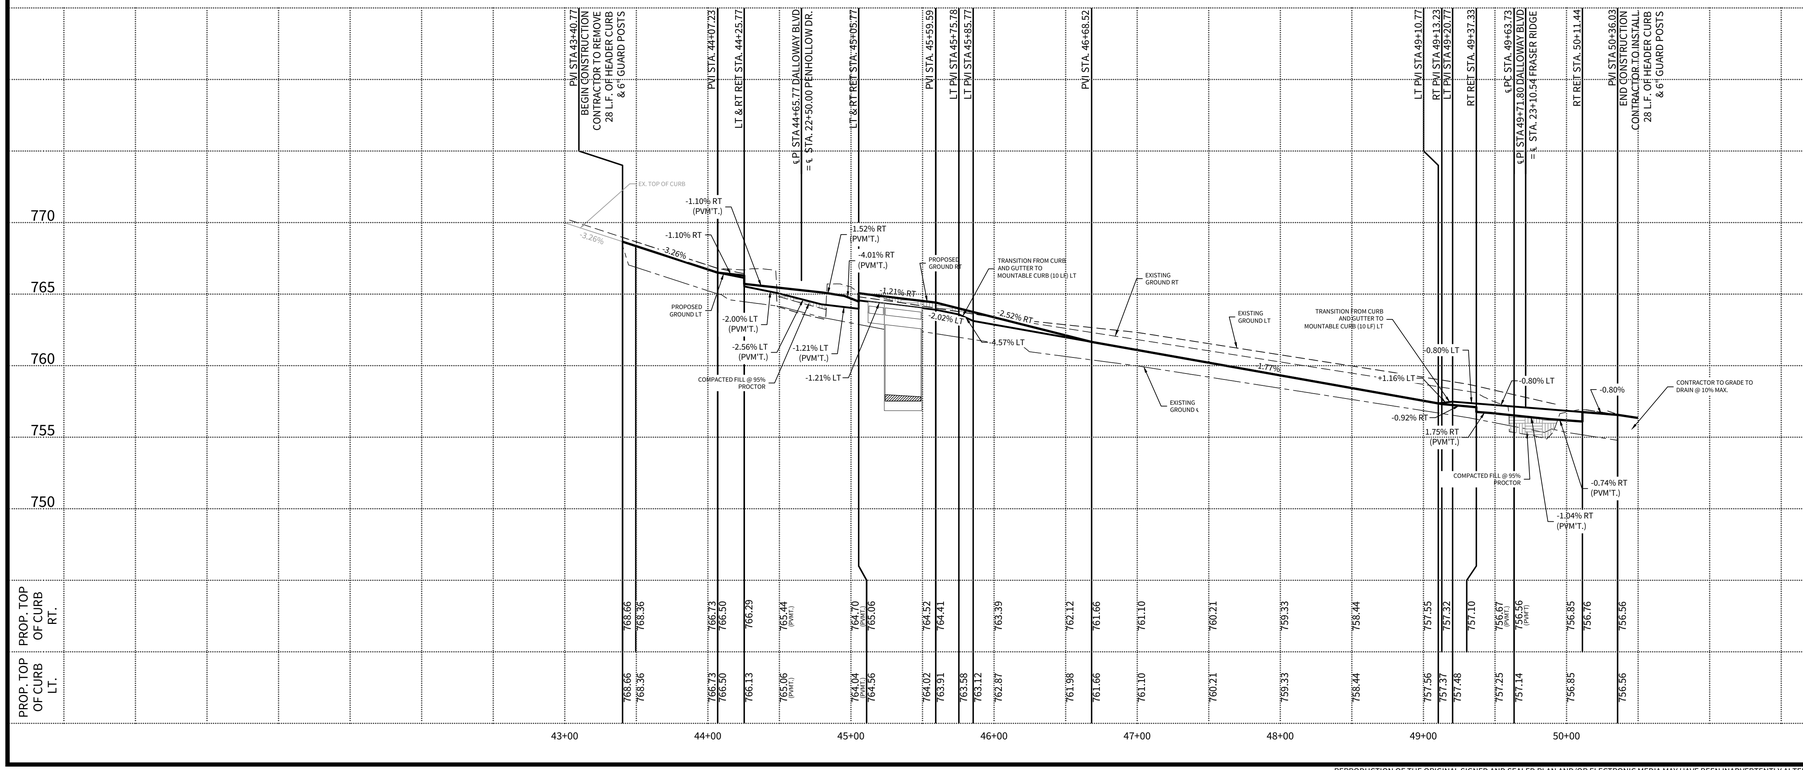

CUDEENGINEERS.COM

CUDE ENGINEERS

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

CAUTION!!!

THE CONTRACTOR SHALL BE AWARE THAT EXISTING UTILITIES ARE WITHIN THE SITE. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO HAVE THESE UTILITIES LOCATED PRIOR TO COMMENCING CONSTRUCTION. THE CONTRACTOR SHALL USE EXTREME CAUTION WHEN WORKING IN THIS AREA. ANY DAMAGE DONE TO THESE EXISTING FACILITIES WILL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO REPAIR.

SCALE: 1"=50'
50 25 0 50

GRACE VALLEY RANCH PHASE 7

STREET PLAN & PROFILE - DALLOWAY BLVD.

DATE
11/04/2025

PROJECT NO.
03499.009

DRAWN BY
AR/JF/RB

CHECKED BY
KMH

REVISIONS
1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
11/04/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C7.00

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

KEYNOTES

1. 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
2. 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
1. EXISTING 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE (CONCURRENT GRACE VALLEY RANCH PHASE 6)
2. EXISTING 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE (CONCURRENT GRACE VALLEY RANCH PHASE 6)

CAUTION!!!


THE CONTRACTOR SHALL BE AWARE THAT EXISTING UTILITIES ARE WITHIN THE SITE. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO HAVE THESE UTILITIES LOCATED PRIOR TO COMMENCING CONSTRUCTION. THE CONTRACTOR SHALL USE EXTREME CAUTION WHEN WORKING IN THIS AREA. ANY DAMAGE DONE TO THESE EXISTING FACILITIES WILL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO REPAIR.

LEGEND

- PROPOSED SIDEWALK
- SIDEWALK CONSTRUCTED WITH INFRASTRUCTURE
- STREET WASHOUT (SEE DETAIL SHEET C7.D1)
- STREET CENTERLINE
- EXISTING CONTOURS
- XXX.XX - TOP OF CURB SPOT ELEVATION
- DRIVEWAY
- XXX.XX - PAVEMENT ELEVATION


(SEE DETAIL SHEET C7.D1) FOR ADA RAMPS AT SIDEWALK INTERSECTIONS

TXDOT TYPE "10" WHEEL CHAIR RAMPS ARE INDICATED THUS "" UNLESS OTHERWISE NOTED.
(SEE DETAIL SHEET C7.D1) FOR ADA RAMPS AT SIDEWALK INTERSECTIONS.
DETECTABLE WARNING PAVERS WITH TRUNCATED DOMES ONLY.

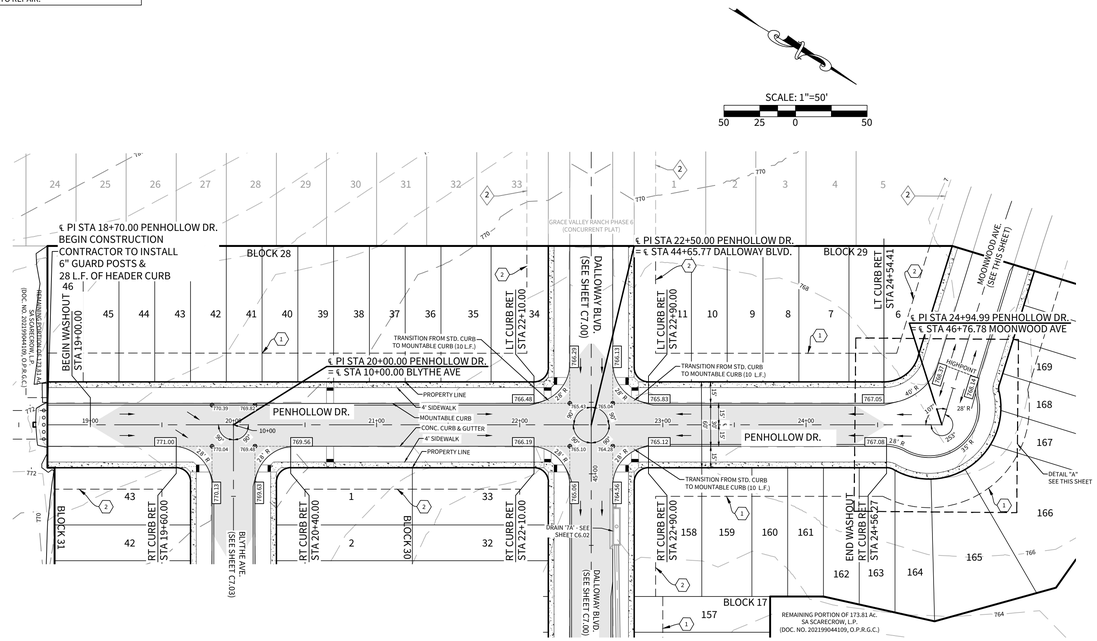


PENHOLLOW DRIVE

STA. 18+70.00 TO STA. 24+56.27

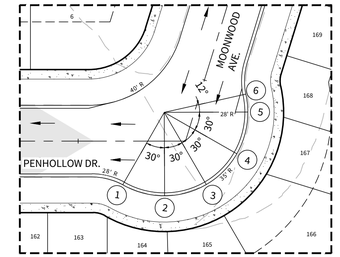

DETAIL "A"
SCALE: 1" = 30'


PENHOLLOW DRIVE KNUCKLE	
POINT	TOP OF CURB ELEVATION
1	767.21
2	767.39
3	767.57
4	767.75
5	767.93
6	768.01

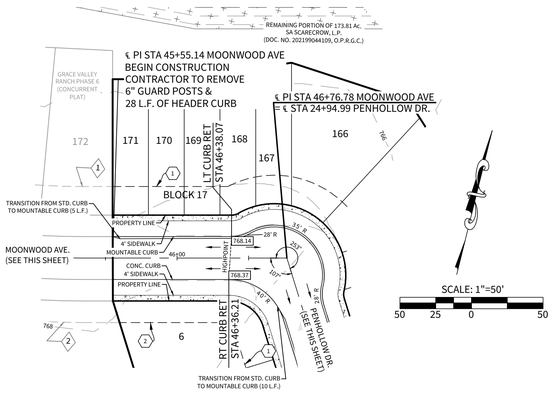

MOONWOOD AVENUE

STA. 45+55.14 TO STA. 46+76.78

HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

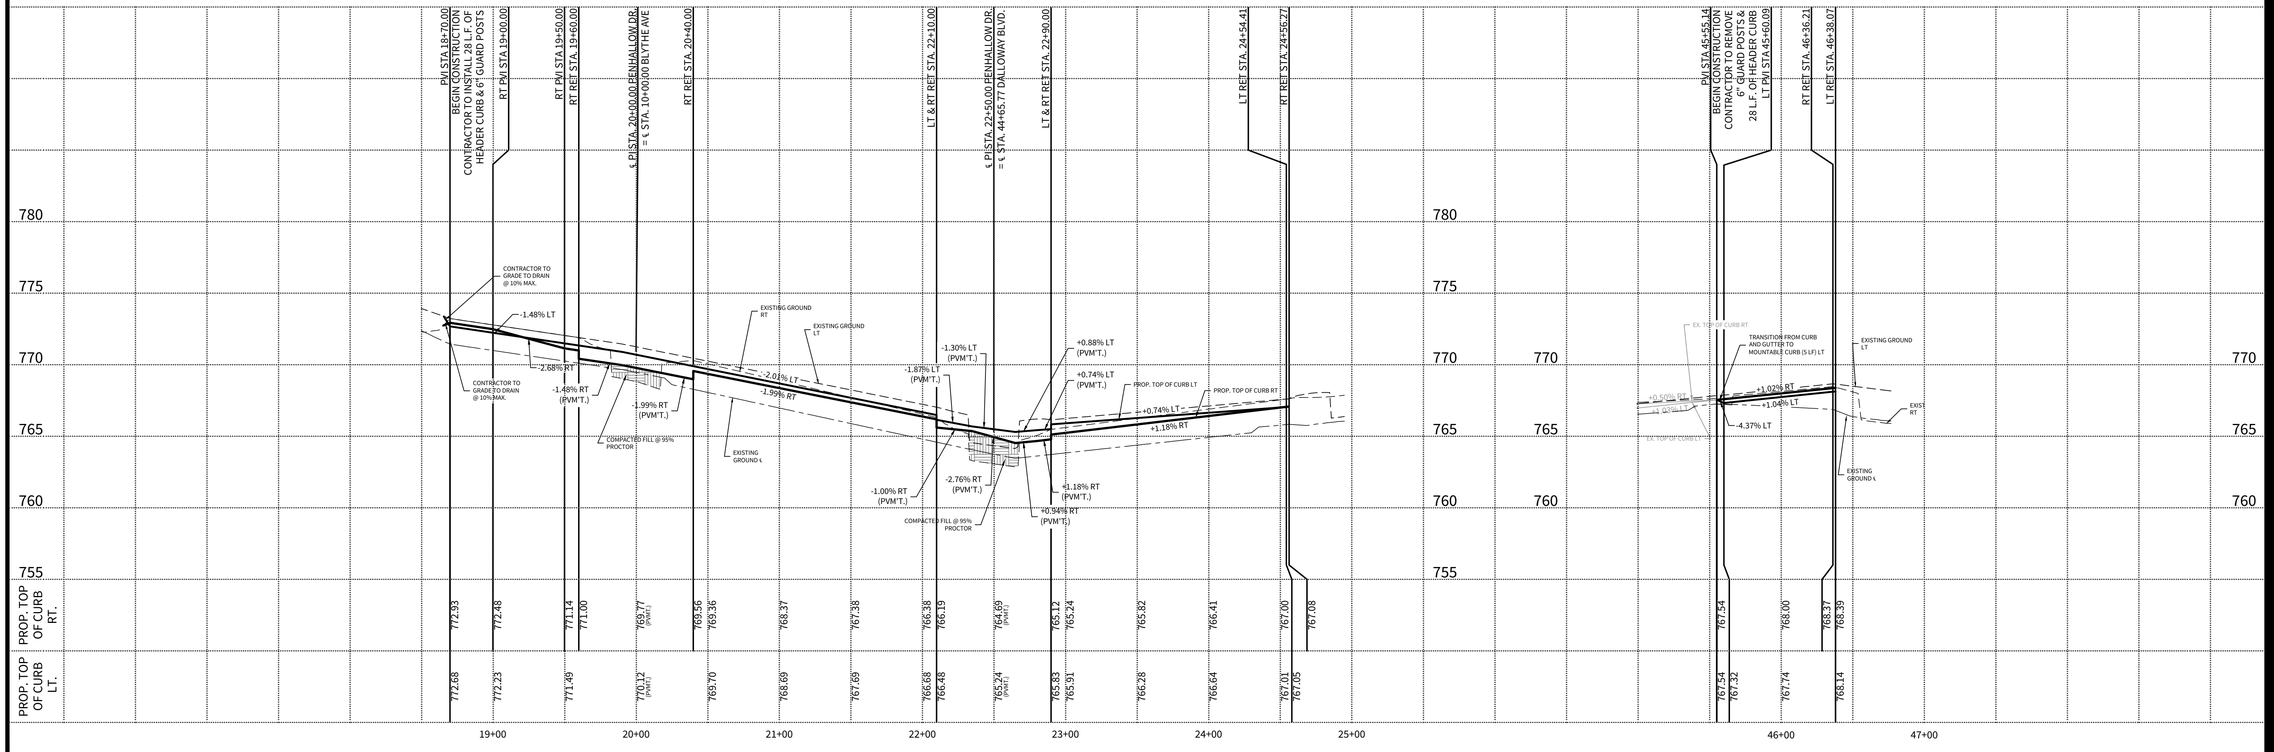

CUDEENGINEERS.COM

CUDE ENGINEERS
4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

STREET PLAN & PROFILE - PENHOLLOW DR. AND MOONWOOD AVE.

DATE 11/04/2025

PROJECT NO. 03499.009

DRAWN BY AR/JF/RB

CHECKED BY KMH

REVISIONS

1. 2. 3. 4. 5. 6. 7. 8. 9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
11/04/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C7.01

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

KEYNOTES


1. 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
2. 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE

LEGEND

- PROPOSED SIDEWALK
- SIDEWALK CONSTRUCTED WITH INFRASTRUCTURE
- STREET WASHOUT (SEE DETAIL SHEET C7.D1)
- STREET CENTERLINE
- EXISTING CONTOURS
- XXX.XX - TOP OF CURB SPOT ELEVATION
- DRIVEWAY
- XXX.XX - PAVEMENT ELEVATION

(SEE DETAIL SHEET C7.D1) FOR ADA RAMPS AT SIDEWALK INTERSECTIONS


TXDOT TYPE "10" WHEEL CHAIR RAMPS ARE INDICATED
THUS "" UNLESS OTHERWISE NOTED.
(SEE DETAIL SHEET C7.D1) FOR ADA RAMPS AT SIDEWALK INTERSECTIONS.
DETECTABLE WARNING PAVERS WITH TRUNCATED DOMES ONLY.

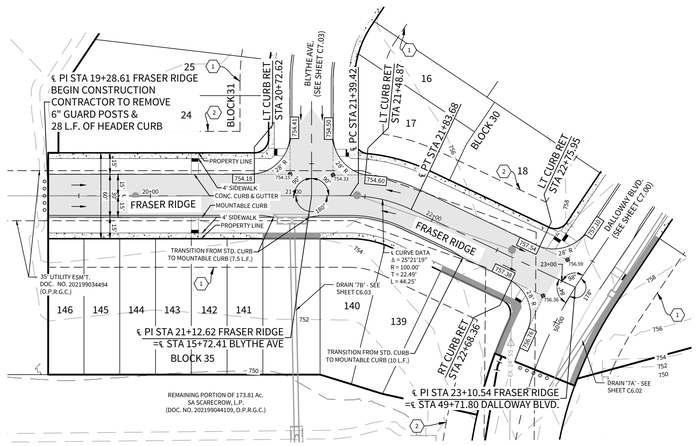

FRASER RIDGE

STA. 19+28.61TO STA. 23+10.54

HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

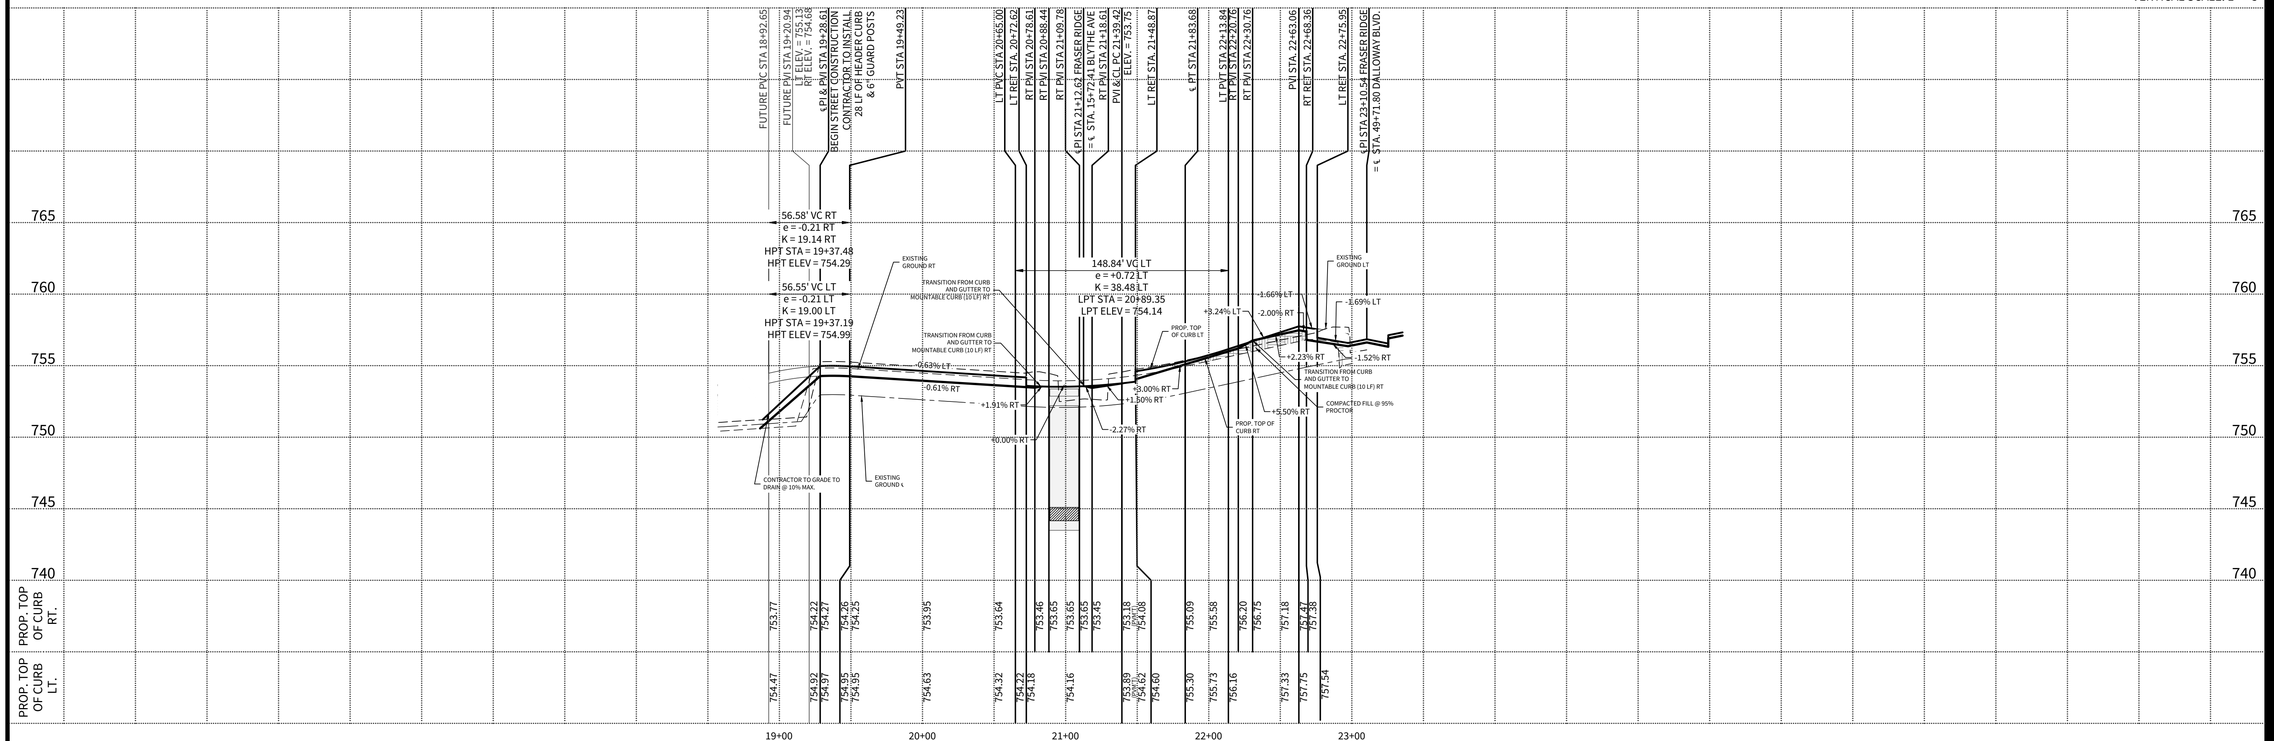

CAUTION!!!

THE CONTRACTOR SHALL BE AWARE THAT EXISTING UTILITIES ARE WITHIN THE SITE. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO HAVE THESE UTILITIES LOCATED PRIOR TO COMMENCING CONSTRUCTION. THE CONTRACTOR SHALL USE EXTREME CAUTION WHEN WORKING IN THIS AREA. ANY DAMAGE DONE TO THESE EXISTING FACILITIES WILL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO REPAIR.

SCALE: 1"=50'
50 25 0 50

CUDEENGINEERS.COM

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

STREET PLAN & PROFILE - FRASER RIDGE

DATE
11/04/2025

PROJECT NO.
03499.009

DRAWN BY
AR/JF/RB

CHECKED BY
KMH

REVISIONS
1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
11/04/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C7.02

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

KEYNOTES

1. 20' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE
2. 15' ELECTRIC, GAS, TELEPHONE, AND CABLE TELEVISION EASEMENT & BUILDING SETBACK LINE

LEGEND


- PROPOSED SIDEWALK
- SIDEWALK CONSTRUCTED WITH INFRASTRUCTURE
- STREET WASHOUT (SEE DETAIL SHEET C7.D1)
- STREET CENTERLINE
- EXISTING CONTOURS
- XXX.XX - TOP OF CURB SPOT ELEVATION
- DRIVEWAY
- XXX.XX - PAVEMENT ELEVATION


(SEE DETAIL SHEET C7.D1) FOR ADA RAMPS AT SIDEWALK INTERSECTIONS

TXDOT TYPE "10" WHEEL CHAIR RAMPS ARE INDICATED THUS "" UNLESS OTHERWISE NOTED.
(SEE DETAIL SHEET C7.D1) FOR ADA RAMPS AT SIDEWALK INTERSECTIONS.
DETECTABLE WARNING PAVERS WITH TRUNCATED DOMES ONLY.

CAUTION!!!

THE CONTRACTOR SHALL BE AWARE THAT EXISTING UTILITIES ARE WITHIN THE SITE. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO HAVE THESE UTILITIES LOCATED PRIOR TO COMMENCING CONSTRUCTION. THE CONTRACTOR SHALL USE EXTREME CAUTION WHEN WORKING IN THIS AREA. ANY DAMAGE DONE TO THESE EXISTING FACILITIES WILL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO REPAIR.

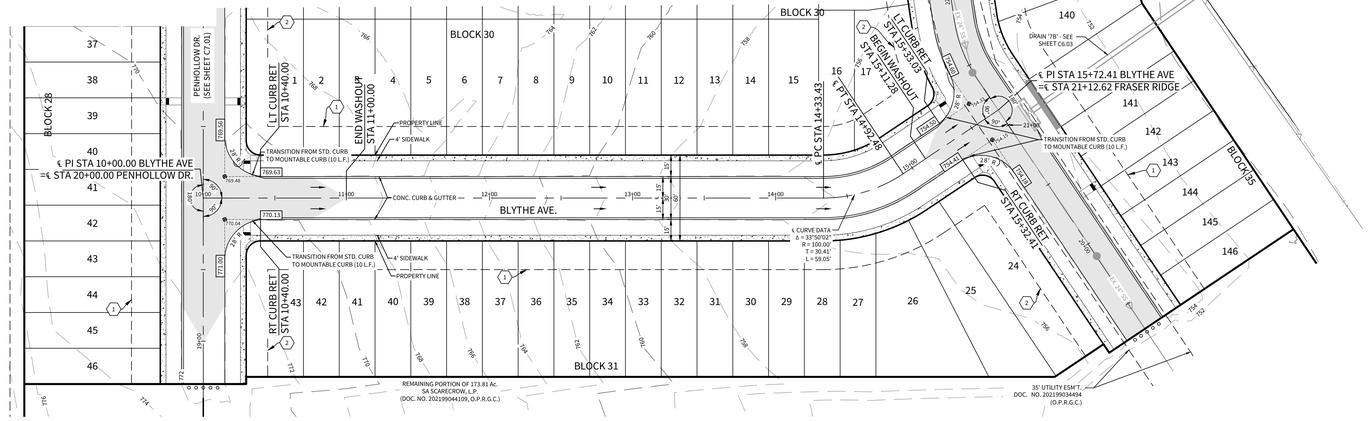




BLYTHE AVENUE

STA. 10+00.00 TO STA. 15+72.41

HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

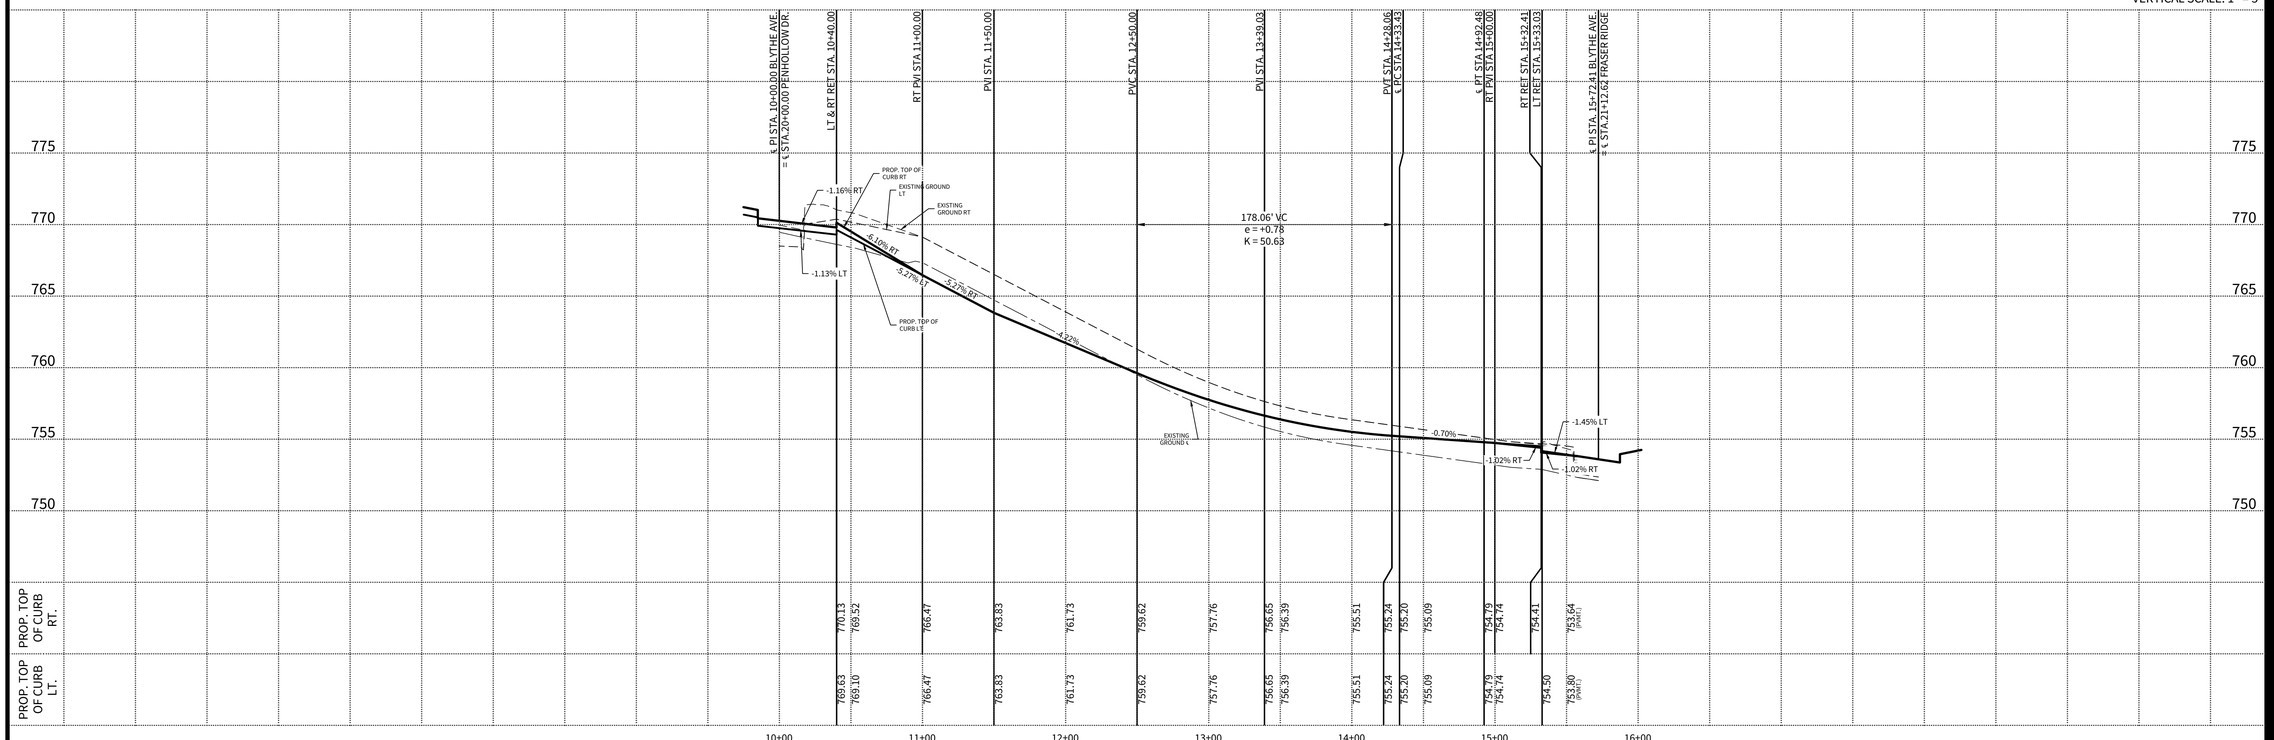

CUDEENGINEERS.COM

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

STREET PLAN & PROFILE - BLYTHE AVE.

DATE 11/04/2025

PROJECT NO. 03499.009

DRAWN BY AR/JF/RB

CHECKED BY KMH

REVISIONS

1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED PROFESSIONAL ENGINEER
11/04/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C7.03

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

STREET PAVEMENT DESIGN OPTIONS (TTL , INC. - 00240902004.00)

1. PAVEMENT SECTION REQUIRED IS TO BE DETERMINED BY GEOTECHNICAL ENGINEER ON-SITE.

SUBGRADE NOTES (*):

- THE SUBGRADE WILL BE PROOF ROLLED TO IDENTIFY SOFT AREAS BEFORE STABILIZATION.
- THE SUBGRADE PLASTICITY INDEX VALUE IS EXPECTED TO BE GREATER THAN 20. SUBGRADE LIME STABILIZATION IS NEEDED.
- UNDERCUT SOFT, WEAK, AND UNSTABLE SOILS BY EXCAVATING BELOW SUBGRADE LEVEL TO EXPOSE STABLE SOILS. THE EXCAVATED SOIL CAN BE USED TO RESTORE THE EXCAVATION SUBGRADE, PROVIDED THAT THE SOILS ARE RELATIVELY FREE AND CLEAN OF DELETERIOUS MATERIAL AND MATERIALS EXCEEDING 3 INCHES IN MAXIMUM DIMENSION. THE EXCAVATED SOIL, OR IMPORTED FILL SOIL, SHALL BE PLACED IN MAXIMUM 6-INCH COMPACTED LIFTS. EACH LIFT OF SOIL SHALL BE MOISTURE CONDITIONED BETWEEN PLUS OR MINUS TWO (±2) PERCENTAGE POINTS OF THE OPTIMUM MOISTURE CONTENT AND COMPACTED TO AT LEAST 95 PERCENT OF THE MAXIMUM DRY DENSITY DETERMINED IN ACCORDANCE WITH THE STANDARD COMPACTION EFFORT (ASTM D 698). IF UNDERCUTTING DEEPER THAN ABOUT 3 FEET IS NEEDED, CONTACT TTL, INC.
- SOIL SUBGRADE AREAS REQUIRING FILL PLACEMENT SHOULD BE SCARIFIED TO A DEPTH OF ABOUT EIGHT (8) INCHES AND MOISTURE CONDITIONED BETWEEN PLUS OR MINUS TWO (±2) POINTS OF THE OPTIMUM MOISTURE CONTENT. THE MOISTURE CONDITIONED SUBGRADE SHOULD THEN BE COMPACTED TO AT LEAST 95 PERCENT OF THE MAXIMUM DRY DENSITY DETERMINED IN ACCORDANCE WITH THE STANDARD COMPACTION EFFORT (ASTM D 6998). THE SUBGRADE SHOULD BE MOISTURE CONDITIONED JUST PRIOR TO FILL PLACEMENT SO THE SUBGRADE MAINTAINS ITS COMPACTION MOISTURE LEVELS AND DOES NOT DRY OUT.
- ON-SITE SOILS (GENERAL FILL), SELECT FILL OR GRANULAR FILL SOIL SHOULD BE PLACED TO ACHIEVE THE DESIRED ELEVATION.

GENERAL NOTES (**)

- INPUT PARAMETERS ARE SHOWN IN TABLE NO. 6. PLEASE CALL US TO PROVIDE PAVEMENT RECOMMENDATIONS, IF NEEDED, FOR DIFFERENT INPUT VALUES.
- IF REPETITIVE TRUCK OR HEAVY TRUCK TRAFFIC IS ANTICIPATED, PLEASE CONTACT US FOR REVISED PAVEMENT RECOMMENDATIONS.
- PAVEMENT SECTION RECOMMENDATIONS ARE BASED ON A CBR VALUE OF 2.0. THE PAVEMENT RECOMMENDATIONS PRESENTED ABOVE ARE NOT BASED ON THE SHRINK / SWELL CHARACTERISTICS OF THE UNDERLYING SOILS. IF WATER IS ALLOWED TO GET UNDERNEATH THE ASPHALT / CONCRETE OR IF MOISTURE CONTENT OF THE BASE OR SUBGRADE CHANGES SIGNIFICANTLY, THEN PAVEMENT DISTRESS WILL OCCUR. MOISTURE PENETRATION UNDERNEATH THE ASPHALT PAVEMENT SURFACE WILL BE REDUCED BY USING DEEPER CURBS; CURBS EXTENDING A MINIMUM OF 3 INCHES INTO BASE.

SUBGRADE VERIFICATION:


- AT THE TIME OF CONSTRUCTION, THE FINAL PAVEMENT SUBGRADE WILL BE OBSERVED AND VERIFIED BY A REPRESENTATIVE OF TTL, INC.

PRIME COAT:


- THE PRIME COAT SHOULD CONSIST OF SEALING THE BASE WITH AN OIL SUCH AS MC-30 OR AE-P ASPHALT CEMENT. THE PRIME COAT SHOULD BE APPLIED AT A RATE NOT TO EXCEED 0.35 GALLONS PER SQUARE YARD WITH MATERIALS WHICH MEET TXDOT ITEM 300. THE PRIME COAT WILL HELP TO MINIMIZE PENETRATION OF RAINFALL AND OTHER MOISTURE THAT PENETRATES THE BASE.

TACK COAT:

- THE ASPHALTIC MATERIAL USED FOR TACK COAT SHALL MEET THE REQUIREMENTS FOR “ASPHALT CEMENT”, “CUT-BACK ASPHALT” OR “EMULSIFIED ASPHALT” IN ITEM NO. 300, “ASPHALTS, OILS AND EMULSIONS” OF THE TEXAS DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS. THE ASPHALTIC MATERIAL USED FOR TACK COAT SHALL BE THE TYPE OR GRADE SHOWN IN THE REFERRING SPECIFICATION, OR ON THE PLANS, OR AS DIRECTED/APPROVED BY THE ENGINEER.

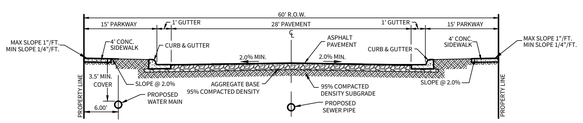


MINOR ACCESS STREET CROSS-SECTION
N.T.S.

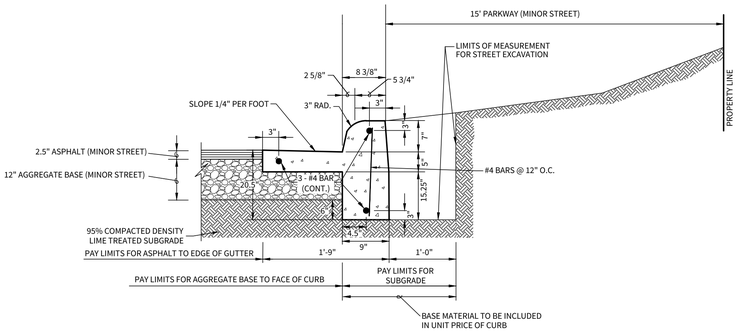


MINOR ACCESS STREET - CURB & GUTTER DETAIL

N.T.S.

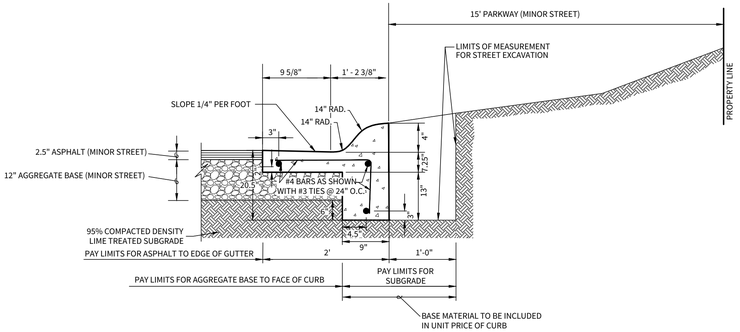


MINOR ACCESS STREET - MOUNTABLE CURB DETAIL

N.T.S.

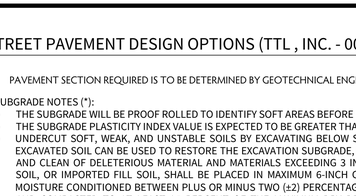


WASHOUT CROWN TRANSITION DETAIL

N.T.S.

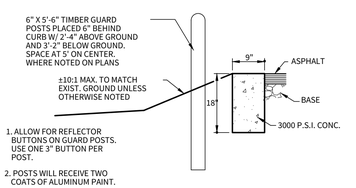


HEADER CURB DETAIL

N.T.S.

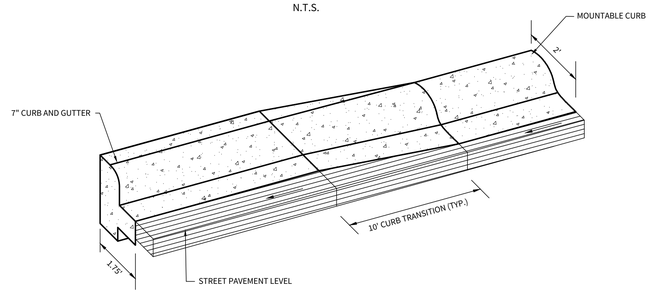


CURB TRANSITION DETAIL

N.T.S.

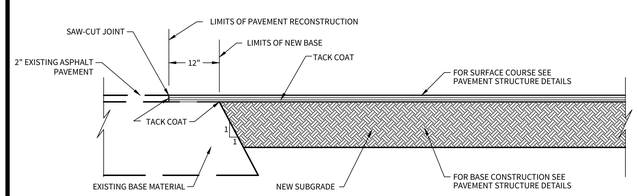


PAVEMENT JUNCTION DETAILS

N.T.S.

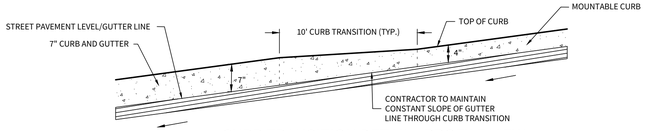

CURB TRANSITION DETAIL - PROFILE VIEW


N.T.S.

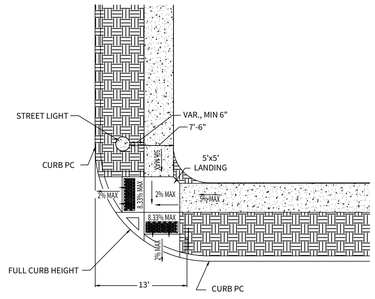

ADA RAMP INTERSECTION LAYOUT DETAIL (TYPE 10 DIRECTIONAL RAMPS)
N.T.S.

NOTES:


1. STREET LIGHTS SHALL BE INSTALLED 7.5' WITHIN R.O.W. AND A MINIMUM DISTANCE OF 6" FROM THE PROPOSED SIDEWALK.

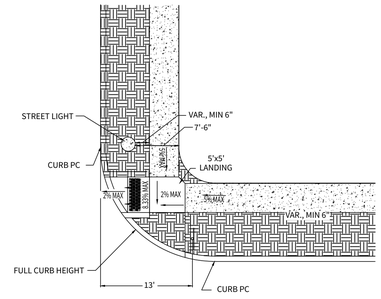

ADA RAMP INTERSECTION LAYOUT DETAIL (TYPE 10 DIRECTIONAL RAMPS – SINGLE DIRECTION)
N.T.S.

NOTES:


1. STREET LIGHTS SHALL BE INSTALLED 7.5' WITHIN R.O.W. AND A MINIMUM DISTANCE OF 6" FROM THE PROPOSED SIDEWALK.



TYPICAL DRIVEWAY CUT SECTION


STREET TYPE	HMAC TYPE "D"	FLEX BASE (TY A OR B GR 2)	LIME SUBGRADE	STRUCTURAL NUMBER
MINOR ACCESS	2.5"	12"	6" (24 LB/SY)	3.26

STREET PAVEMENT DESIGN

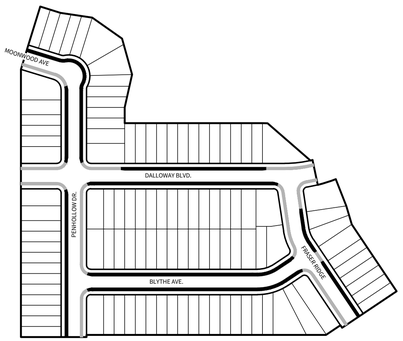

CONC. CURB DESIGN DETAIL

- CURB AND GUTTER
- MOUNTABLE CURB

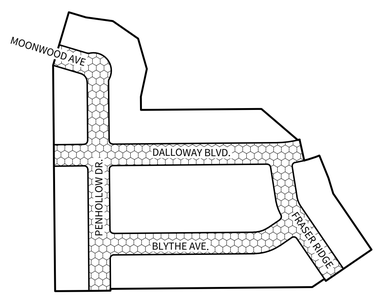

PAVEMENT DESIGN SCHEMATIC N.T.S.

NOTE:
REFERENCE GEOTECHNICAL REPORT TTL INC NO. 00240902004.00 FOR BORING INFORMATION AND CBR LOCATIONS.

LEGEND:

MINOR STREET		
MOONWOOD AVE.	STA. 45+55.14 - 46+76.78	
DALLOWAY BLVD.	STA. 43+40.77 - 50+64.27	
PENHOLLOW DR.	STA. 18+70.00 - 24+56.27	
BLYTHE AVE.	STA. 10+00.00 - 15+72.41	
FRASER RIDGE	STA. 19+28.61 - 23+10.54	

CUDEENGINEERS.COM

CUDE ENGINEERS

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

STANDARD STREET DETAILS

DATE
11/04/2025

PROJECT NO.
03499.009

DRAWN BY
AR/JF/RB

CHECKED BY
KMH


REVISIONS
1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED PROFESSIONAL ENGINEER
11/04/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500


C7.D1

P:\03499\2025\2.2 DWG\4.4 Plans\C7.D1_STDP.dwg, 2025/11/04 4:33pm, hhudek
REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

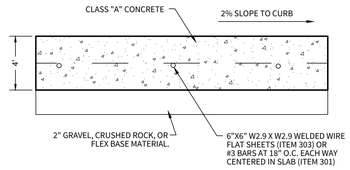

CONCRETE SIDEWALK

N.T.S.

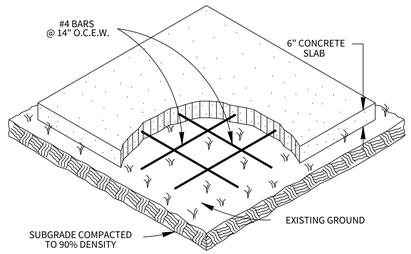

MAIL BOX PAD NOTE:

1. THE CONTRACTOR WILL CONSTRUCT SLABS FOR "TEMPORARY MAIL BOX COLLECTION PAD" FOR THE UNITED STATES POSTAL SERVICE WITH LOCATIONS AND SIZES SPECIFIED BY THE CITY ENGINEER DURING CONSTRUCTION.
2. THE CONSTRUCTION OF SLABS SHALL CONFORM TO ITEM 513 "REMOVING AND RELOCATING MAILBOXES".
3. PAYMENT WILL BE MADE UNDER ITEM 513.2 "COMMUNITY MAILBOX SLAB - PER SQUARE YARD".
4. UNIT PRICE WILL INCLUDE REMOVAL OF "TEMPORARY MAIL BOX COLLECTION PAD" SLABS AT THE END OF THE PROJECT. NO SEPARATE PAY ITEM.

COMMUNITY MAIL BOX SLAB


ITEM 513.2

1) REFLECTORIZED BLUE - FIRE HYDRANT

2) ADHENSIVE SHALL BE APPLIED IN SUFFICIENT TO ENSURE THE FOLLOWING:
   a) 100 PERCENT OF THE BONDING AREA OF RAISED PAVEMENT MARKERS SHALL BE IN CONTACT WITH THE ADHESIVE.
   b) RAISED PAVEMENT MARKERS SHALL NOT BE IN CONTACT WITH THE PAVEMENT SURFACE, BUT SHALL BE SEATED ON A CONTINUOUS LAYER OF ADHESIVE.
   c) BITUMINOUS ADHESIVE FOR MARKERS ON BITUMIOUS PAVEMENTS. EPOXY ADHENSIVE FOR MARKERS ON PORTLAND CEMENT CONCRETE PAVEMENTS. EPOXY ADHESIVE SHALL BE MACHINE MIXED.

3) RAISED PAVEMENT MARKERS SHALL BE FREE OF RUST, SCALE, DIRT, OIL, GREASE, MOISTURE, OR CONTAMINATES WHICH MIGHT ADVERSELY AFFECT THE ADHESIVE BOND. ADHESIVE OR ANY OTHER MATERIAL THAT IMPAIRS THE FUNCTIONAL REFLECTIVITY WILL NOT BE ACCEPTABLE.

4) PLACEMENT OF RAISED PAVEMENT MARKERS SHALL BE 4 FEET OFF STREET CENTELINE TOWARD ITEM MARKED.

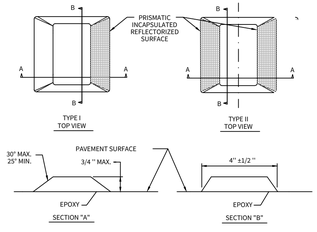

PAVEMENT REFLECTORS DETAIL

N.T.S.

CUDEENGINEERS.COM

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

STANDARD STREET DETAILS

DATE
11/04/2025

PROJECT NO.
03499.009

DRAWN BY
AR/JF/RB

CHECKED BY
KMH

REVISIONS
1.
2.
3.
4.
5.
6.
7.
8.
9.


STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
11/04/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C7.D2

P:\03499\002\2-Dsn\4-Plans\C7.D2_STDT.dwg 2025/11/04 12:03pm rbarrera

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

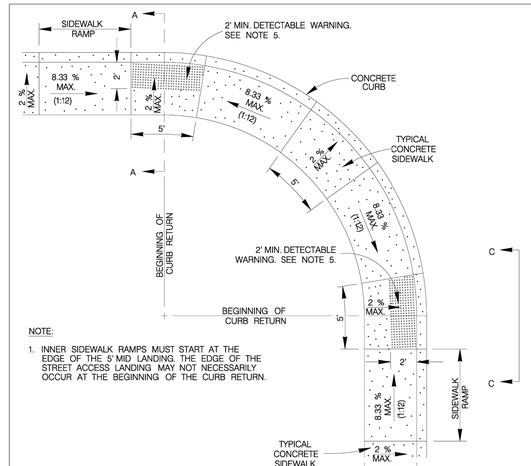


NOTE:

1. INNER SIDEWALK RAMPS MUST START AT THE EDGE OF THE 5' MID LANDING. THE EDGE OF THE STREET ACCESS LANDING MAY NOT NECESSARILY OCCUR AT THE BEGINNING OF THE CURB RETURN.

TYPICAL SIDEWALK RAMP – TYPE I

SIDEWALK ABUTS THE CURB

SCALE : 1" = 10'

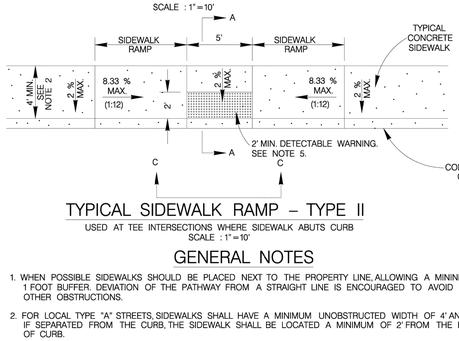


TYPICAL SIDEWALK RAMP – TYPE II

USED AT TEE INTERSECTIONS WHERE SIDEWALK ABUTS CURB

SCALE : 1" = 10'

GENERAL NOTES

1. WHEN POSSIBLE SIDEWALKS SHOULD BE PLACED NEXT TO THE PROPERTY LINE, ALLOWING A MININMUM OF 1 FOOT BUFFER. DEVIATION OF THE PATHWAY FROM A STRAIGHT LINE IS ENCOURAGED TO AVOID TREES OR OTHER OBSTRUCTIONS.
2. FOR LOCAL TYPE "A" STREETS, SIDEWALKS SHALL HAVE A MINIMUM UNOBSTRUCTED WIDTH OF 4' AND IF SEPARATED FROM THE CURB, THE SIDEWALK SHALL BE LOCATED A MINIMUM OF 2' FROM THE BACK OF CURB.
3. FOR OTHER THAN LOCAL TYPE "A" STREETS, SIDEWALKS SHALL HAVE A MINIMUM UNOBSTRUCTED WIDTH OF 4' AND SEPARATED A MINIMUM OF 2' FROM THE BACK OF CURB OR AS AN OPTION, THE SIDEWALK SHALL HAVE A MINIMUM WIDTH OF 6' WHEN LOCATED AT THE BACK OF CURB.
4. SIDEWALK RAMP LENGTHS PRESENTED IN TABLE 1 ARE GUIDELINES ONLY. SIDEWALK RAMP LENGTHS SHALL BE OF SUFFICIENT LENGTH TO MAINTAIN 8.33% (1:12) MAXIMUM SLOPE.
5. ALL CURB-RAMPS OR LANDINGS ABUTTING THE CROSSWALK SHALL HAVE A DETECTABLE WARNING 24 INCHES DEEP (IN THE DIRECTION OF PEDESTRIAN TRAVEL) AND EXTENDING THE FULL WIDTH OF THE CURB RAMP OR LANDING. THE DETECTABLE WARNING SHALL CONSIST OF RAISED TRUNCATED DOMES, ALIGNED IN A GRID PATTERN WITH A DIAMETER OF A NOMINAL 0.9 INCHES (23 MM), A HEIGHT OF NOMINAL 0.2 INCHES (5 MM) AND A CENTER-TO-CENTER SPACING OF NOMINAL 2.35 INCHES (60 MM). THE DETECTABLE WARNING SURFACE SHALL BE A CAST-IN-PLACE TILE CONFORMING TO THE CITY OF SAN ANTONIO STANDARD SPECIFICATIONS OR PAVERS CONFORMING TO TXDOT STANDARD PED-05, PEDESTRIAN FACILITIES.
6. DETECTABLE WARNINGS SHALL CONTRAST VISUALLY WITH ADJOINING SURFACES, EITHER LIGHT-ON-DARK, OR DARK-ON-LIGHT. THE MATERIAL USED TO PROVIDE CONTRAST SHALL BE AN INTEGRAL PART OF THE WALKING SURFACE.
7. SIDEWALK RAMP TYPE V SHALL BE USED ONLY WHERE THERE IS SIGNIFICANT RESTRICTION WITHIN THE PARKWAY TO CONSTRUCT TYPE I OR TYPE III RAMPS.
8. CONSTRUCTION OF ALL WHEELCHAIR RAMPS TO BE INCLUDED UNDER ITEMS "500 – CONCRETE CURB, GUTTER, AND CONCRETE CURB AND GUTTER" AND / OR "502 – CONCRETE SIDEWALKS". RAMP SURFACE SHALL BE BRUSH FINISHED.
9. THESE DETAILS ARE FOR REFERENCE ONLY. ACTUAL LOCATIONS OF WHEELCHAIR RAMPS TO BE SHOWN ON CONSTRUCTION PLANS. CITY CONSTRUCTION INSPECTOR CAN ADJUST LOCATIONS FOR SAFETY OR UTILITY CLEARANCE.
10. SIDEWALKS LESS THAN 5 FEET IN WIDTH SHALL BE PROVIDED WITH A PASSING SPACE AT A MAXIMUM SPACING OF 200 FEET.
11. WHEELCHAIR RAMP SHALL BE CONSTRUCTED WITH 4" CLASS "A" CONCRETE AND 2" MINIMUM GRAVEL, CRUSHED ROCK OR FLEXIBLE BASE MATERIAL.
12. REINFORCING STEEL SHALL BE #3 BARS AT 18" O.C.E.W. OR 6" x 6" – W2.9 x W2.9 WIRE MESH.
13. SIDEWALK GRADES SHALL NOT EXCEED THE GRADE ESTABLISHED FOR THE ADJACENT ROADWAY. ANY SIDEWALK CONSTRUCTION THAT DEVIATES FROM THE NATURAL GRADE OF THE ROADWAY TO CREATE A GRADE STEEPER THAN THE EXISTING ROADWAY WILL REQUIRE RAMPS, HANDRAILS AND RESTING PLATFORMS TO BE CONSTRUCTED IN ACCORDANCE WITH ADA AND TAS STANDARDS.
14. SIDEWALK CROSS GRADE SHALL HAVE A MAXIMUM SLOPE OF 2%. LANDINGS SHALL HAVE A MAXIMUM SLOPE OF 2% IN ANY DIRECTION.
15. THE CHANGE OF GRADE BETWEEN ADJACENT SURFACES SHALL BE LESS THAN 11%. THE CHANGE OF GRADE SHALL BE DEFINED AS THE ALGEBRAIC DIFFERENCE OF THE ADJACENT SURFACE SLOPES. IN THE CASE OF A STREET ACCESS RAMP DESIGNED AT THE 8.33% MAXIMUM SLOPE, THE ADJACENT PAVEMENT CROSS SLOPE SHALL BE LESS THAN 2.67% (I.E. 8.33–(–2.67) = 11). IN ADDITION, THE ADJACENT PAVEMENT CROSS SLOPE SHALL BE LESS THAN OR EQUAL TO 5%.
16. IF THE CHANGE OF GRADE BETWEEN ADJACENT SURFACES IS GREATER THAN OR EQUAL TO 11%, A LEVELING STRIP, 2 FEET IN LENGTH, SHALL BE PROVIDED TO TRANSITION THE ADJACENT SURFACES.
17. ADA COMPLIANCE IN ALTERATIONS INCLUDE ONLY THAT WORK WITHIN THE LIMITS, BOUNDARIES OR SCOPE OF A PLANNED PROJECT.

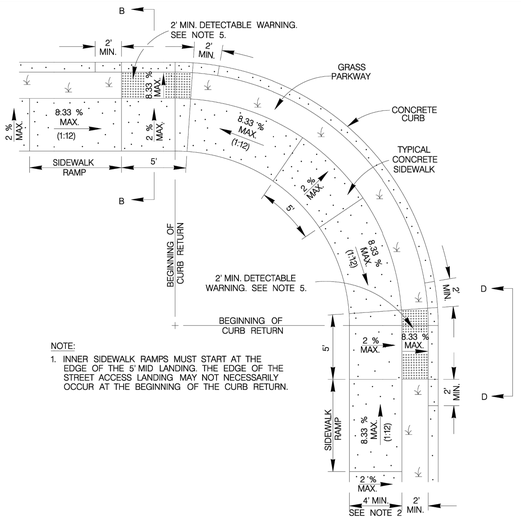


NOTE:

1. INNER SIDEWALK RAMPS MUST START AT THE EDGE OF THE 5' MID LANDING. THE EDGE OF THE STREET ACCESS LANDING MAY NOT NECESSARILY OCCUR AT THE BEGINNING OF THE CURB RETURN.

TYPICAL SIDEWALK RAMP – TYPE III

SIDEWALK SEPARATED FROM CURB


SCALE : 1" = 10'

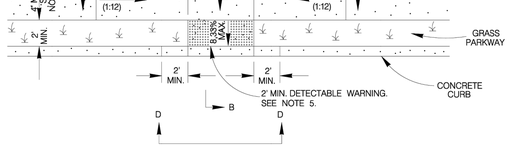

TYPICAL SIDEWALK RAMP – TYPE IV


USED AT TEE INTERSECTIONS WHERE SIDEWALK IS SEPARATED FROM CURB

SCALE : 1" = 10'

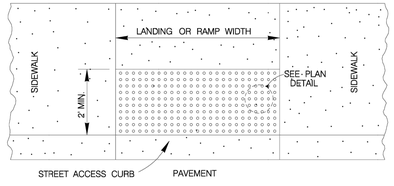


DETECTABLE WARNING SURFACE

SCALE : 1" = 4'



PLAN DETAIL


NO SCALE



DOME SECTION

NO SCALE

NOTE:
STAMPED CONCRETE TRUNCATED DOMES WILL NOT BE ALLOWED TO BE USED FOR DETECTABLE WARNING ON WHEELCHAIR RAMPS. CONTRACTOR MUST SUBMIT TRUNCATED DOME INFORMATION THAT IS TO BE USED ON WHEELCHAIR RAMPS TO THE PROJECT MANAGER FOR APPROVAL AT LEAST 30 DAYS PRIOR TO INSTALLATION.

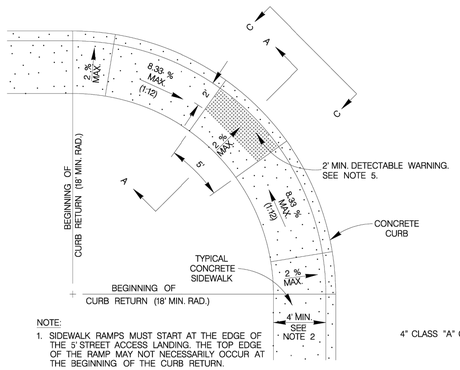


NOTE:

1. SIDEWALK RAMPS MUST START AT THE EDGE OF THE 5' STREET ACCESS LANDING. THE TOP EDGE OF THE RAMP MAY NOT NECESSARILY OCCUR AT THE BEGINNING OF THE CURB RETURN.
2. TYPE V RAMPS MUST HAVE 18' MIN. RADIUS.

TYPICAL SIDEWALK RAMP – TYPE V

SIDEWALK ABUTS CURB

SCALE : 1" = 10'

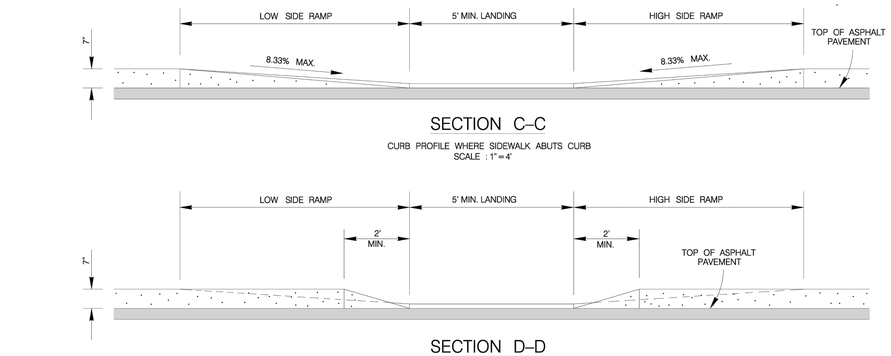

SECTION C–C


CURB PROFILE WHERE SIDEWALK ABUTS CURB

SCALE : 1" = 4'

SECTION D–D


CURB PROFILE WHERE SIDEWALK IS SEPARATED FROM CURB

SCALE : 1" = 4'

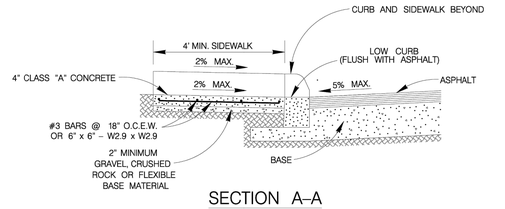


SECTION A–A

SCALE : 1" = 4'

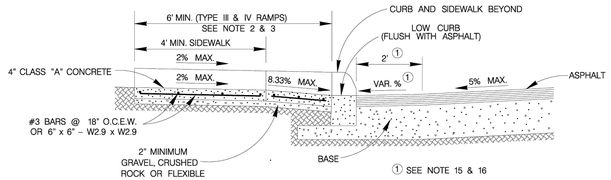

SECTION B–B

SCALE : 1" = 4'

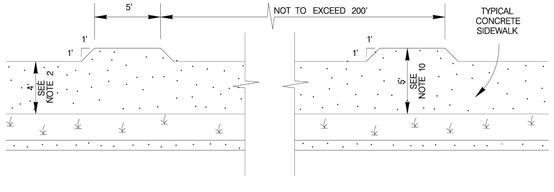

SIDEWALK PASSING SPACE

SCALE : 1" = 10'

TABLE 1 (SEE NOTE 4)		
GUTTER SLOPE	SIDEWALK RAMP LENGTH (1:12)	
	LOW SIDE	HIGH SIDE
1%	5'–6"	7'–2"
2%	5'–0"	8'–4"
3%	4'–6"	10'–0"
4%	4'–2"	12'–6"
5%	3'–10"	16'–8"

MAY 2009

CITY OF SAN ANTONIO

CAPITAL IMPROVEMENTS MANAGEMENT SERVICES DEPARTMENT

WHEELCHAIR RAMP STANDARDS

____% SUBMITTAL	PROJECT NO.:_____	DATE:_____
DRWN. BY: V. VASQUEZ	DSGN. BY:_____	CHKD. BY: R.S. HOSSEINI, P.E.	SHEET NO.:____OF____

CUDEENGINEERS.COM

CUDE ENGINEERS

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

STANDARD STREET DETAILS

DATE 10/15/2025

PROJECT NO. 03499.009

DRAWN BY AR/JF/RB

CHECKED BY KMH

REVISIONS


1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
10/15/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500


C7.D3

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

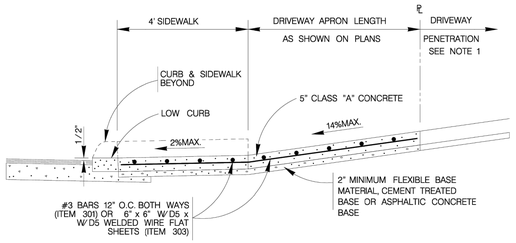

TYPICAL RESIDENTIAL DRIVEWAY SECTION


WITH SIDEWALK ABUTTING CURB
ITEM 503.1

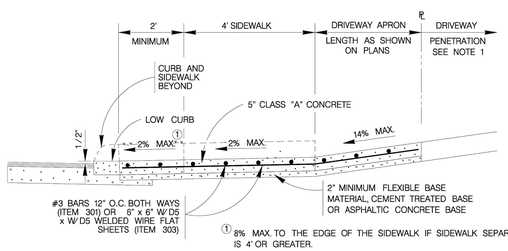

① 8% MAX. TO THE EDGE OF THE SIDEWALK IF SIDEWALK SEPARATION IS 4' OR GREATER.

TYPICAL RESIDENTIAL DRIVEWAY SECTION


WITH SIDEWALK SEPARATED FROM CURB
ITEM 503.1

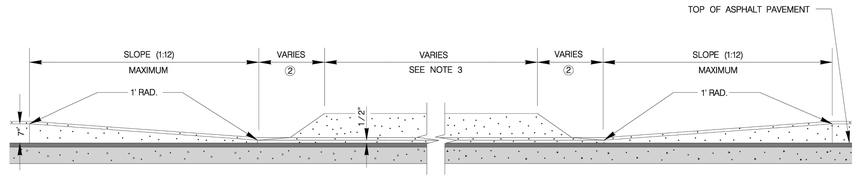

② RESIDENTIAL : 2' MAXIMUM; COMMERCIAL: SEE PLAN VIEW

CURB PROFILE AT DRIVEWAY


WITH SIDEWALK ABUTTING CURB

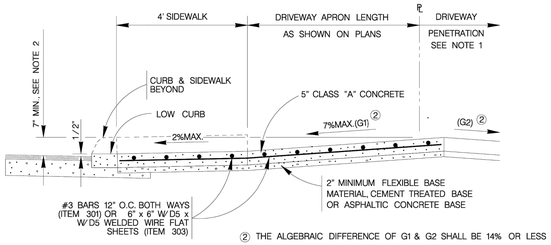

② THE ALGEBRAIC DIFFERENCE OF G1 & G2 SHALL BE 14% OR LESS

TYPICAL RESIDENTIAL DRIVEWAY SECTION

WHERE PROPERTY IS LOWER THAN STREET & SIDEWALK IS ABUTTING CURB
ITEM 503.1

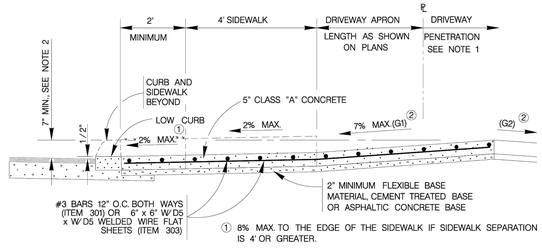


① 8% MAX. TO THE EDGE OF THE SIDEWALK IF SIDEWALK SEPARATION IS 4' OR GREATER.

② THE ALGEBRAIC DIFFERENCE OF G1 & G2 SHALL BE 14% OR LESS

TYPICAL RESIDENTIAL DRIVEWAY SECTION


WHERE PROPERTY IS LOWER THAN STREET & SIDEWALK IS SEPARATED FROM CURB
ITEM 503.1

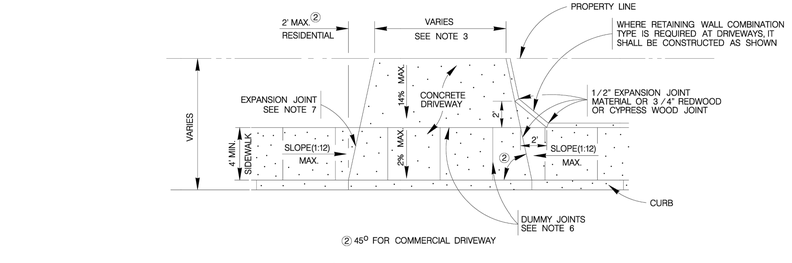

② 45° FOR COMMERCIAL DRIVEWAY


TYPICAL DRIVEWAY PLAN VIEW

WITH SIDEWALK ABUTTING CURB

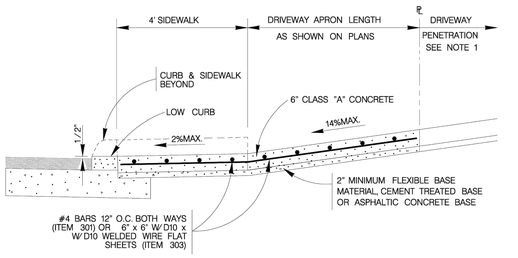

TYPICAL COMMERCIAL DRIVEWAY SECTION

WITH SIDEWALK ABUTTING CURB
ITEM 503.2

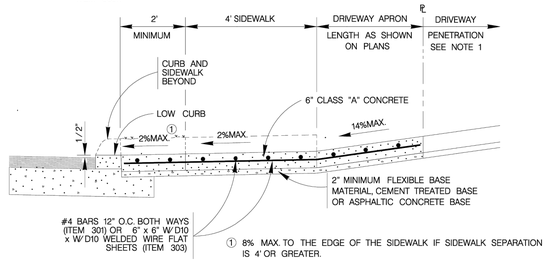

① 8% MAX. TO THE EDGE OF THE SIDEWALK IF SIDEWALK SEPARATION IS 4' OR GREATER.

TYPICAL COMMERCIAL DRIVEWAY SECTION


WITH SIDEWALK SEPARATED FROM CURB
ITEM 503.2

CONCRETE DRIVEWAY NOTES

1. DRIVEWAY PENETRATION REFERS TO A PORTION OF THE DRIVEWAY THAT MAY BE NECESSARY TO RECONSTRUCT WITHIN PRIVATE PROPERTY TO COMPLY WITH A MAXIMUM DRIVEWAY SLOPE. THIS PORTION OF THE DRIVEWAY SHALL BE PAID FOR UNDER THE FOLLOWING ITEMS AS MAY APPLY:
   A.) CONCRETE DRIVEWAY PAID FOR UNDER ITEM NO. 503.1 OR 503.2.
   B.) ASPHALTIC CONCRETE DRIVEWAY PAID FOR UNDER ITEM NO. 503.4 AND SHALL INCLUDE A MINIMUM OF 1" ASPHALT TYPE 'D' & 6" FLEXIBLE BASE
   C.) GRAVEL DRIVEWAY PAID FOR UNDER ITEM NO. 503.5 AND SHALL INCLUDE A MINIMUM OF 6" FLEXIBLE BASE
2. 7" MINIMUM HEIGHT WILL NOT NECESSARILY OCCUR AT THE PROPERTY LINE. IT MAY OCCUR WITHIN THE RIGHT OF WAY OR WITHIN THE DRIVEWAY PENETRATION ON PRIVATE PROPERTY.
3. THE PROPOSED DRIVEWAY SHOULD MATCH THE EXISTING WIDTH AT THE PROPERTY LINE BUT UNLESS AUTHORIZED BY THE CITY TRAFFIC ENGINEER, THE WIDTH SHALL BE WITHIN THE FOLLOWING VALUES:

TYPE	MINIMUM	MAXIMUM
RESIDENTIAL	10'	20'
COMMERCIAL – ONE WAY	12'	20'
COMMERCIAL – TWO WAY	24'	30'


4. FOR LOCAL TYPE "A" STREETS, SIDEWALK SHALL HAVE A MINIMUM WIDTH OF 4' AND IF SEPARATED FROM THE CURB, THE SIDEWALK SHALL BE LOCATED A MINIMUM OF 2' FROM THE BACK OF CURB.
5. FOR OTHER THAN LOCAL TYPE "A" STREETS, THE SIDEWALK SHALL HAVE A MINIMUM WIDTH OF 4' AND SEPARATED A MINIMUM OF 2' FROM THE BACK OF CURB OR, AS AN OPTION, THE SIDEWALK SHALL HAVE A MINIMUM WIDTH OF 6' WHEN LOCATED AT THE BACK OF CURB.
6. DUMMY JOINTS PARALLEL TO THE CURB SHALL BE PLACED WHERE THE SIDEWALK MEETS THE DRIVEWAY. DUMMY JOINTS PERPENDICULAR TO THE CURB, AND WITHIN THE BOUNDARIES OF THE PARALLEL DUMMY JOINTS, SHALL BE PLACED AT INTERVALS EQUAL TO THE WIDTH OF THE SIDEWALK.
7. A MINIMUM OF TWO ROUND AND SMOOTH DOWEL BARS 3 /8" IN DIAMETER AND 18" IN LENGTH SHALL BE SPACED 18" APART AT EACH EXPANSION JOINT.
8. SIDEWALK RAMP LENGTHS SHALL BE OF SUFFICIENT LENGTH TO MAINTAIN 8.33% (1:12) MAXIMUM SLOPE. WHERE SIDEWALKS CROSS DRIVEWAYS, SIDEWALK CROSS SLOPE SHALL NOT EXCEED 2%.
9. SIDEWALK RAMP SURFACE SHALL BE BRUSH FINISHED.

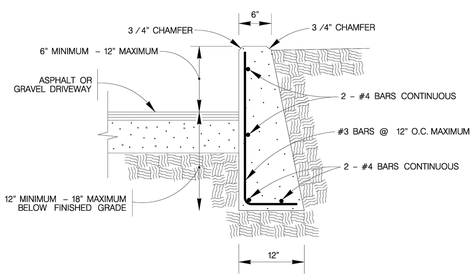

NOTE:
1. COST OF REINFORCEMENT TO BE INCLUDED IN UNIT COST OF ITEM 307.1.
2. CONCRETE RETAINING WALL COMBINATION TYPE SHALL BE USED FOR CONCRETE DRIVEWAYS.

DRIVEWAY – CONCRETE RETAINING WALL


ON COMPACTED SUBGRADE
ITEM 307.1

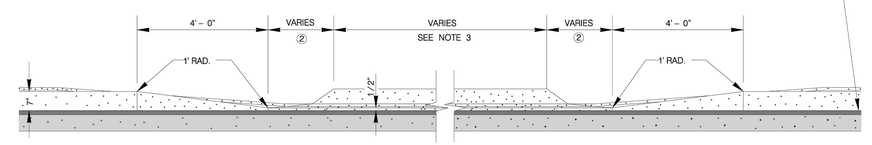

② RESIDENTIAL : 2' MAXIMUM; COMMERCIAL: SEE PLAN VIEW

CURB PROFILE AT DRIVEWAY

WITH SIDEWALK SEPARATED FROM CURB

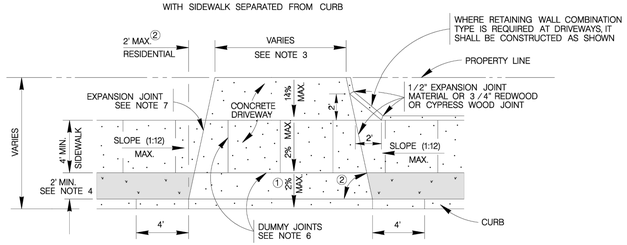

① 8% MAX. TO THE EDGE OF THE SIDEWALK IF SIDEWALK SEPARATION IS 4' OR GREATER.

② 45° FOR COMMERCIAL DRIVEWAY

TYPICAL DRIVEWAY PLAN VIEW

WITH SIDEWALK SEPARATED FROM CURB

MAY 2009

CITY OF SAN ANTONIO

CAPITAL IMPROVEMENTS MANAGEMENT SERVICES DEPARTMENT

CONCRETE DRIVEWAY STANDARDS

_____% SUBMITTAL	PROJECT NO.:_____	DATE:_____
DRWN. BY: V. VASQUEZ	DSGN. BY:_____	CHKD. BY: R.S. HOSSEINI, P.E.	SHEET NO.: ____OF____

CUDEENGINEERS.COM
CUDE ENGINEERS
EST. 1980
4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

STANDARD STREET DETAILS


DATE 10/15/2025
PROJECT NO. 03499.009
DRAWN BY AR/JF/RB
CHECKED BY KMH

REVISIONS
1. 2. 3. 4. 5. 6. 7. 8. 9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
10/15/2025
CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C7.D4

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

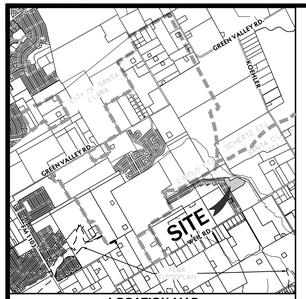

LOCATION MAP N.T.S.

NOTE:


CONTRACTOR TO COORDINATE SIGN PLACEMENT WITH SIDEWALK/ADA RAMP, VALVE BOX, HYDRANT AND STREET LIGHT CONSTRUCTION TO AVOID ANY POSSIBLE CONFLICTS.

DEVELOPER:

LENNAR HOMES OF TEXAS LAND AND CONSTRUCTION, LTD.
CONTACT PERSON: RICHARD MOTT
100 NE LOOP 410, SUITE 1155
SAN ANTONIO, TX 78216
TEL: (210) 403-6200

CIVIL ENGINEER:

CUDE ENGINEERS
CONTACT PERSON: CHRIS J. CHAFFEE, P.E.
4122 POND HILL ROAD, SUITE 101
SAN ANTONIO, TX 78231
TEL: (210) 681-2951
FAX: (210) 523-7112

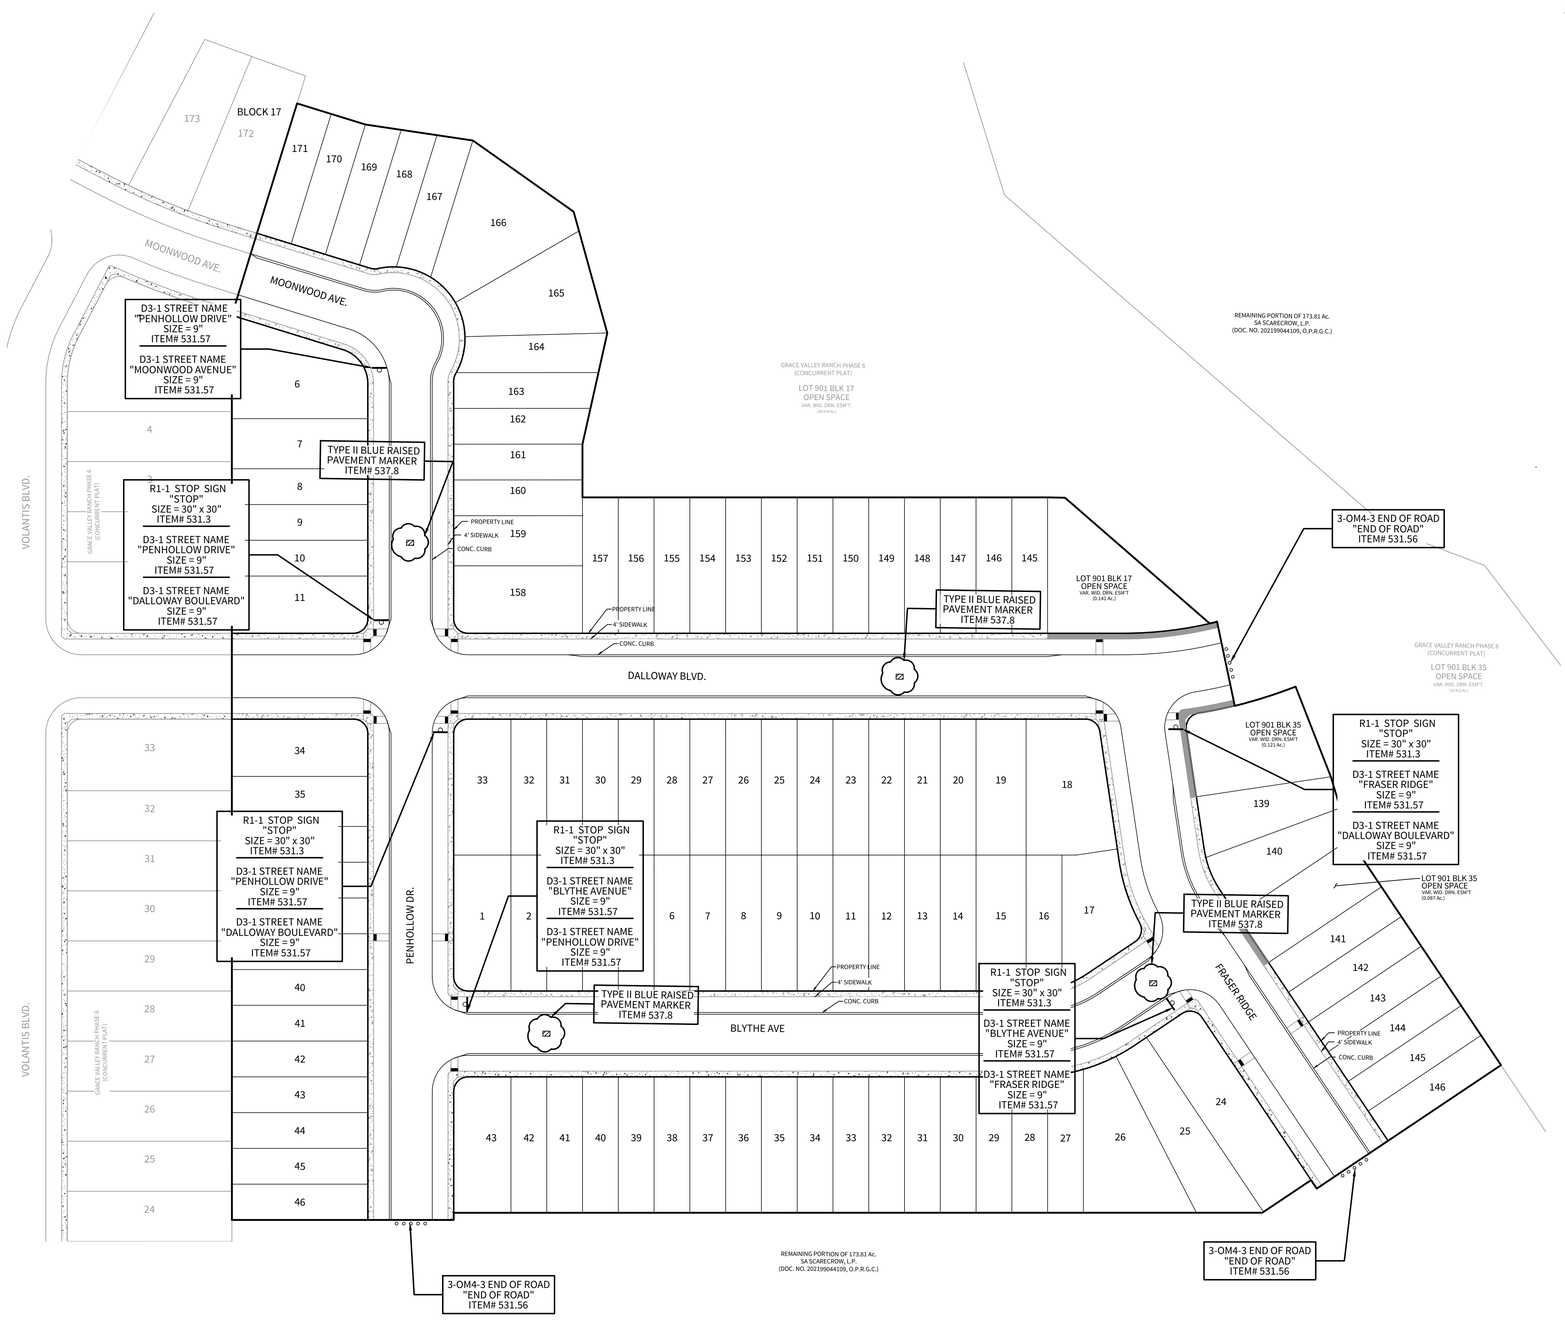

CUDEENGINEERS.COM

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 7

TRAFFIC SIGNAGE PLAN

DATE
10/15/2025

PROJECT NO.
03499.009

DRAWN BY
AR/JF/RB

CHECKED BY
KMH

REVISIONS
1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER

10/15/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C8.00

P:\03499\0001\CIVIL\Exhibits\EXH5_TSAP_Plan 2025.10.15 10:25am jfarias

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by the Texas Department of Transportation for any purpose whatsoever. The Texas Department of Transportation assumes no responsibility for the accuracy or completeness of this standard and for any errors or omissions that may appear in it as transmitted to other formats or for incorrect results or damages resulting from its use.

DATE PLOTTED:

SIGN SUPPORT DESCRIPTIVE CODES

(Descriptive Codes correspond to project estimate and quantities sheets)

SM RD SGN ASSM TY XXXXX(X)XX(X-XXXX)

Post Type

FRP = Fiberglass Reinforced Plastic Pipe (see SMD(FRP))
TWT = Thin-Walled Tubing (see SMD(TWT))
10SWG = 10 SWG Tubing (see SMD(SLIP-1) to (SLIP-3))
SCH = Schedule 80 Pipe (see SMD(SLIP-1) to (SLIP-3))

Number of Posts (1 or 2)


Anchor Type

UA = Universal Anchor - Concreted (see SMD(FRP) and (TWT))
UB = Universal Anchor - Bolted down (see SMD(FRP) and (TWT))
WS = Wedge Anchor Steel - (see SMD(TWT))
WP = Wedge Anchor Plastic (see SMD(TWT))
SA = Slipbase - Concreted (see SMD(SLIP-1) to (SLIP-3))
SB = Slipbase - Bolted Down (see SMD(SLIP-1) to (SLIP-3))

Sign Mounting Designation

P = Prefab. "Plate" (see SMD(SLIP-1) to (SLIP-3), (TWT), (FRP))
T = Prefab. "T" (see SMD(SLIP-1) to (SLIP-3), (TWT))
U = Prefab. "U" (see SMD(SLIP-1) to (SLIP-3))
IF REQUIRED
(EX) or (EXT) - Number of Extensions (see SMD(SLIP-1) to (SLIP-3), (TWT))
BM = Extruded Wind Beam (see SMD(SLIP-1) to (SLIP-3))
WC = 1.12 #/ft Wing Channel (see SMD(SLIP-1) to (SLIP-3))
EXAL = Extruded Aluminum Sign Panels (see SMD(SLIP-1) to (SLIP-3))


REQUIRED CLEARANCE FOR BREAKAWAY SUPPORT



To avoid vehicle undercarriage snagging, any substantial remains of a breakaway support, when it is broken away, should not project more than 4 inches above a 60-inch chord (i.e., typical space between wheel pathsl.

SIGN LOCATION

PAVED SHOULDERS

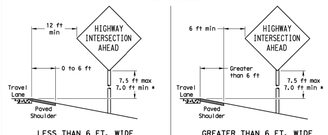


LESS THAN 6 FT. WIDE — GREATER THAN 6 FT. WIDE


When the shoulder is 6 ft. or less in width, the sign must be placed at least 12 ft. from the edge of the travel lane.

When the shoulder is greater than 6 ft in width, the sign must be placed at least 6 ft. from the edge of the shoulder.


T-INTERSECTION



When this sign is needed at the end of a two-lane, two way roadway, the right edge of the sign should be in line with the centerline of the roadway. Place as close to ROW as practical.



BEHIND BARRIER

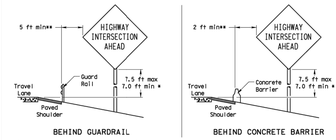

BEHIND GUARDRAIL — BEHIND CONCRETE BARRIER

**Sign clearance based on distance required for proper guard rail or concrete barrier performance.

* Signs shall be mounted using the following condition that results in the greatest sign elevations

(1) a minimum of 7 to a maximum of 7.5 feet above the edge of the travel lane or


(2) a minimum of 7 to a maximum of 7.5 feet above the grade at the base of the support when sign is installed on the backslope.

The maximum values may be increased when directed by the Engineer.

See the Traffic Operations Division website for detailed drawings of sign clamps, Triangular Slipbase System components and Wedge Anchor System components.


The website address is: http://www.txdot.gov/publications/traffic.htm


No more than 2 sign posts should be located within a 7 ft. circle.

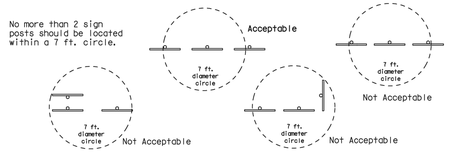

TYPICAL SIGN ATTACHMENT DETAIL

Single Signs — Back-to-Back Signs






Bolts used to mount sign panels to the clamp are 5/16-18 UNC galvanized square head with nut, nylon washer, flat washer and lock washer. The bolt length is 1 inch for aluminum.

When two sign clamps are used to mount signs back-to-back, use a 5/16-18 UNC galvanized hex head per ASTM A307 with nut and helical-spring lock washer. The approximate bolt lengths for various post sizes and sign clamp types are given in the table at right. The bolt length may need to be adjusted depending upon field conditions.

Sign clamps may be either the specific size clamp or the universal clamp.


Pipe Diameter	Approximate Bolt Length	
	Specific Clamp	Universal Clamp
2" nominal	3"	3 or 3 1/2"
2 1/2" nominal	3 or 3 1/2"	3 1/2 or 4"
3" nominal	3 1/2 or 4"	4 1/2"

SIGNS WITH PLAQUES




When a supplemental plaque or secondary sign is used, the 7 ft sign height is measured to the bottom of the supplemental plaque or secondary sign.

CURB & GUTTER OR RAISED ISLAND



RESTRICTED RIGHT-OF-WAY

(When 6 ft min. is not possible.)



Right-of-way restrictions may be created by rocks, water, vegetation, fences, buildings, a narrow island, or other factors.

In situations where a lateral restriction prevents the minimum horizontal clearance from the edge of the travel lane, signs should be placed as far from the travel lane as practical.

*** Post may be shorter if protected by guardrail or if Engineer determines the post could not be hit due to extreme slope.

Texas Department of Transportation
Traffic Operations Division


SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS GENERAL NOTES & DETAILS

SMD(GEN)-08

©TxDOT July 2002	ᵀʷᵒ TXDOT	DN: TXDOT	ᶜᴴᴷ TXDOT	DW: TXDOT
9-08 REVISIONS	CK:	JOB	HIGHWAY	
	DIST	COUNTY		SHEET NO.

26A

TRIANGULAR SLIPBASE INSTALLATION GENERAL REQUIREMENTS

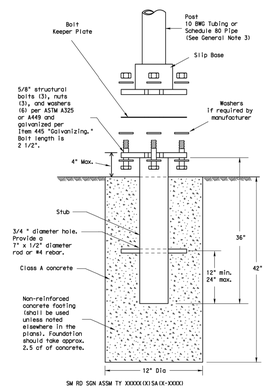

SM RD SGN ASSM TY XXXXX(X)SA(X-XXXX)

NOTE

There are various devices approved for the Triangular Slipbase System. Please reference the Material Producer List for approved slip base systems. http://www.txdot.gov/business/producer_list.htm The devices shall be installed per manufacturers' recommendations. Installation procedures shall be provided to the Engineer by Contractor.

GENERAL NOTES:


1. Slip base shall be permanently marked to indicate manufacturer. Methods, design, and location of marking are subject to approval of the TxDOT Traffic Standards Engineer.
2. Material used as post within this system shall conform to the following specifications:
   10 BWG Tubing (2.875" outside diameter)
   0.134" nominal wall thickness
   Seamless or electric-resistance welded steel tubing or pipe
   Steel shall be HSLAS Gr 55 per ASTM A1011 or ASTM A1008
   Other steels may be used if they meet the following:
   55,000 PSI minimum yield strength
   70,000 PSI minimum tensile strength
   20% minimum elongation in 2"
   Wall thickness (uncoated) shall be within the range of 0.122" to 0.138"
   Outside diameter (uncoated) shall be within the range of 2.867" to 2.883"
   Galvanization per ASTM A123 or ASTM A653 G210, for precoated steel tubing (ASTM A653), recoat tube outside diameter weld seam by metallizing with zinc wire per ASTM B833.
   Schedule 80 Pipe (2.875" outside diameter)
   0.276" nominal wall thickness
   Steel tubing per ASTM A500 Gr C
   Other seamless or electric-resistance welded steel tubing or pipe with equivalent outside diameter and wall thickness may be used if they meet the following:
   46,000 PSI minimum yield strength
   62,000 PSI minimum tensile strength
   21% minimum elongation in 2"
   Wall thickness (uncoated) shall be within the range of 0.248" to 0.304"
   Outside diameter (uncoated) shall be within the range of 2.855" to 2.895"
   Galvanization per ASTM A123
3. See the Traffic Operations Division website for detailed drawings of sign clamps and Texas Universal Triangular Slipbase System components. The website address is: http://www.txdot.gov/publications/traffic.htm
4. Sign supports shall not be spliced except where shown. Sign support posts shall not be spliced.

ASSEMBLY PROCEDURE

Foundation
1. Prepare 12-inch diameter by 42-inch deep hole. If solid rock is encountered, the depth of the foundation may be reduced such that it is embedded a minimum of 18 inches into the solid rock.
2. The Engineer may permit batches of concrete less than 2 cubic yards to be mixed with a portable, motor-driven concrete mixer. For small placements less than 0.5 cubic yards, hand mixing in a suitable container may be allowed by Engineer. Concrete shall be Class A.
3. Push the pipe end of the slip base stub into the center of the concrete. Rotate the stub back and forth while pushing it down into the concrete to assure good contact between the concrete and stub. Continue to work the stub into the concrete until it is between 2 to 4 inches above the ground.
4. Frame the stub. Allow a minimum of 4 days to set, unless otherwise directed by the Engineer.
5. The triangular slipbase system is multidirectional and is designed to release when struck from any direction.

Support
1. Cut support so that the bottom of the sign will be 7 to 7.5 feet above the edge of the traveleay (i.e., edge of the closest lane) when slip plate is below the edge of pavement or 7 to 7.5 feet above slip plate when the slip plate is above the edge of the traveleay. The cut shall be plumb and straight.
2. Attach sign to support using connections shown. When multiple signs are installed on the same support, ensure the minimum clearance between each sign is maintained. See SMD(SLIP-2) for clearances based on sign types.

CONCRETE ANCHOR



SM RD SGN ASSM TY XXXXX(X)SB(X-XXXX)

Concrete anchor consists of 5/8" diameter stud bolt with UNC series bolt threads on the upper end. Heavy hex nut per ASTM A563, and hardened washer per ASTM F436. The stud bolt shall have a minimum yield and ultimate tensile strength of 50 and 75 KSI, respectively. Nuts, bolts and washers shall be galvanized per Item 445, "Galvanizing." Adhesive type anchors shall have stud bolts installed with Type III epoxy per DMS-6100, "Epoxies and Adhesives." Adhesive anchors may be loaded after adequate epoxy cure time per the manufacturer's recommendations. Top of bolt shall extend at least flush with top of the nut when installed. The anchor, when installed in 4000 psi normal-weight concrete with a 5 1/2" minimum embedment, shall have a minimum allowable tension and shear of 3900 and 3100 psi, respectively.


Texas Department of Transportation
Traffic Operations Division

SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS TRIANGULAR SLIPBASE SYSTEM

SMD(SLIP-1)-08

©TxDOT July 2002	ᵀʷᵒ TXDOT	DN: TXDOT	ᶜᴴᴷ TXDOT	DW: TXDOT
9-08 REVISIONS	CK:	JOB	HIGHWAY	
	DIST	COUNTY		SHEET NO.

26B

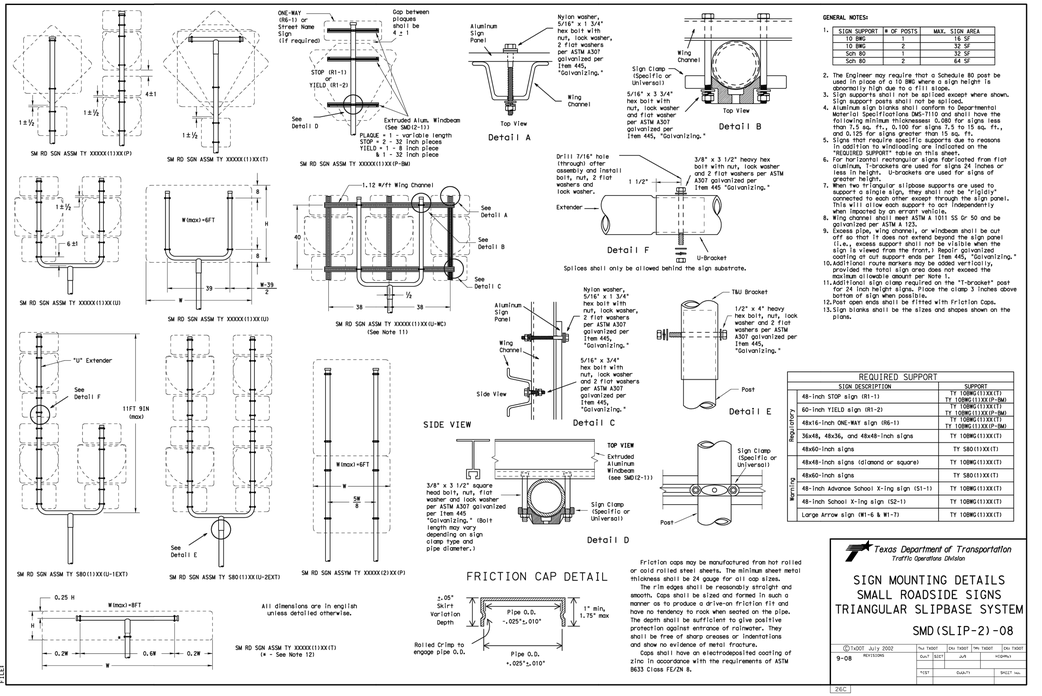

REQUIRED SUPPORT		
	SIGN DESCRIPTION	SUPPORT
Regulatory	48-inch STOP sign (R1-1)	TY 10BWG(1)XX(T) TY 10SWG(1)XX(P-BM)
	60-inch YIELD sign (R1-2)	TY 10BWG(1)XX(T)
	48x16-inch ONE-WAY sign (R6-1)	TY 10BWG(1)XX(T) TY 10SWG(1)XX(P-BM)
	36x48, 48x36, and 48x48-inch signs	TY 10BWG(1)XX(T)
	48x60-inch signs	TY S80(1)XX(T)
	48x48-inch signs (diamond or square)	TY 10BWG(1)XX(T)
	48x60-inch signs	TY S80(1)XX(T)
Warning	48-inch Advance School X-ing sign (S1-1)	TY 10BWG(1)XX(T)
	48-inch School X-ing sign (S2-1)	TY 10BWG(1)XX(T)
	Large Arrow sign (W1-6 & W1-7)	TY 10BWG(1)XX(T)

GENERAL NOTES:

1. | SIGN SUPPORT | # OF POSTS | MAX. SIGN AREA |
   |---|---|---|
   | 10 BWG | 1 | 16 SF |
   | 10 BWG | 2 | 32 SF |
   | Sch 80 | 1 | 32 SF |
   | Sch 80 | 2 | 64 SF |
2. The Engineer may require that a Schedule 80 post be used in place of a 10 BWG where a sign height is abnormally high due to its location.
3. Sign supports shall not be spliced except where shown. Sign support posts shall not be spliced.
4. Aluminum sign blanks shall conform to Departmental Material Specifications DMS-7110 and shall have the following minimum thicknesses: 0.080 for signs less than 7.5 sq. ft., 0.100 for signs 7.5 to 15 sq. ft., and 0.125 for signs greater than 15 sq. ft.
5. Signs that require specific supports due to reasons in addition to windloading are indicated on the "REQUIRED SUPPORT" table on this sheet.
6. For horizontal rectangular signs fabricated from flat aluminum, T-brackets are used for signs 24 inches or less in height. U-brackets are used for signs of greater height.
7. Only two triangular slipbase supports are used to support a single sign, they shall not be "rigidly" connected to each other except through the sign panel. This will allow each support to act independently when impacted by an errant vehicle.
8. Wing channel shall meet ASTM A 1011 SS Gr 50 and be galvanized per ASTM A 123.
9. Excess plow, wing channel, or windbeam shall be cut off so that it does not extend beyond the sign panel (i.e., excess support shall not be visible when the sign is viewed from the front.) Repair galvanized coating at cut support ends per Item 445, "Galvanizing."
10. Additional route markers may be added vertically, provided that the total sign height does not exceed the maximum allowable height per Note 1.
11. Additional sign clamp required on the "T-bracket" post for 24 inch height signs. Place the clamp 3 inches above bottom of sign when possible.
12. Post open ends shall be fitted with friction Caps.
13. Sign blanks shall be the sizes and shapes shown on the plans.


Texas Department of Transportation
Traffic Operations Division

SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS TRIANGULAR SLIPBASE SYSTEM

SMD(SLIP-2)-08

©TxDOT July 2002	ᵀʷᵒ TXDOT	DN: TXDOT	ᶜᴴᴷ TXDOT	DW: TXDOT
9-08 REVISIONS	CK:	JOB	HIGHWAY	
	DIST	COUNTY		SHEET NO.

26C

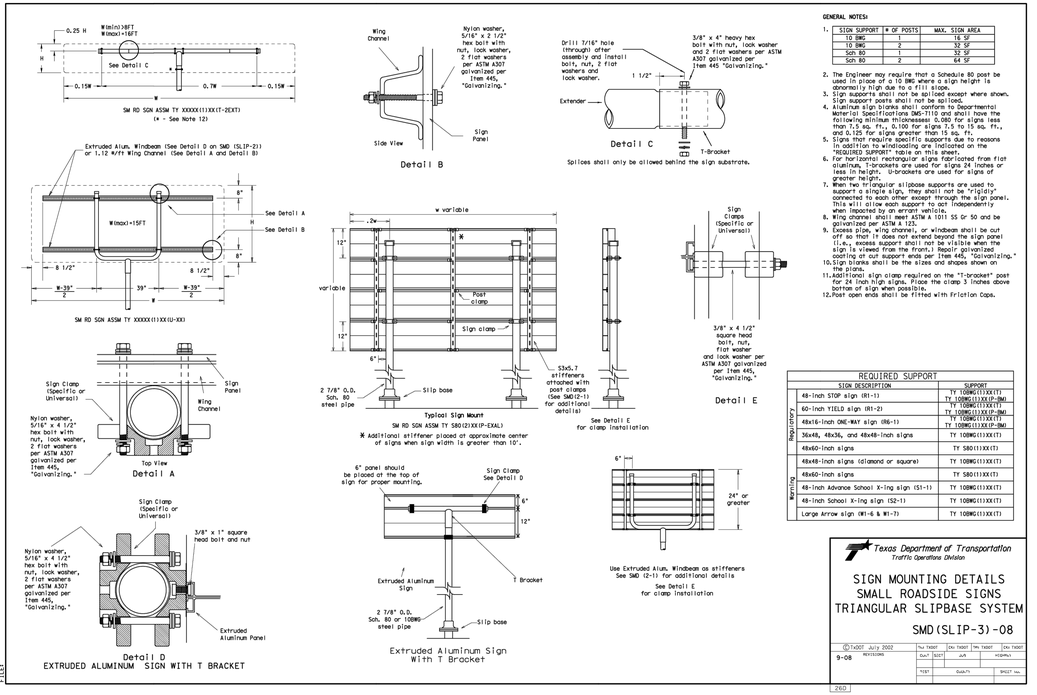

REQUIRED SUPPORT		
	SIGN DESCRIPTION	SUPPORT
Regulatory	48-inch STOP sign (R1-1)	TY 10BWG(1)XX(T) TY 10SWG(1)XX(P-BM)
	60-inch YIELD sign (R1-2)	TY 10BWG(1)XX(T) TY 10SWG(1)XX(P-BM)
	48x16-inch ONE-WAY sign (R6-1)	TY 10BWG(1)XX(T) TY 10SWG(1)XX(P-BM)
	36x48, 48x36, and 48x48-inch signs	TY 10BWG(1)XX(T)
	48x60-inch signs	TY S80(1)XX(T)
	48x48-inch signs (diamond or square)	TY 10BWG(1)XX(T)
	48x60-inch signs	TY S80(1)XX(T)
Warning	48-inch Advance School X-ing sign (S1-1)	TY 10BWG(1)XX(T)
	48-inch School X-ing sign (S2-1)	TY 10BWG(1)XX(T)
	Large Arrow sign (W1-6 & W1-7)	TY 10BWG(1)XX(T)

GENERAL NOTES:

1. | SIGN SUPPORT | # OF POSTS | MAX. SIGN AREA |
   |---|---|---|
   | 10 BWG | 1 | 16 SF |
   | 10 BWG | 2 | 32 SF |
   | Sch 80 | 1 | 32 SF |
   | Sch 80 | 2 | 64 SF |
2. The Engineer may require that a Schedule 80 post be used in place of a 10 BWG where a sign height is abnormally high due to its location.
3. Sign supports shall not be spliced except where shown. Sign support posts shall not be spliced.
4. Aluminum sign blanks shall conform to Departmental Material Specifications DMS-7110 and shall have the following minimum thicknesses: 0.080 for signs less than 7.5 sq. ft., 0.100 for signs 7.5 to 15 sq. ft., and 0.125 for signs greater than 15 sq. ft.
5. Signs that require specific supports due to reasons in addition to windloading are indicated on the "REQUIRED SUPPORT" table on this sheet.
6. For horizontal rectangular signs fabricated from flat aluminum, T-brackets are used for signs 24 inches or less in height. U-brackets are used for signs of greater height.
7. Only two triangular slipbase supports are used to support a single sign, they shall not be "rigidly" connected to each other except through the sign panel. This will allow each support to act independently when impacted by an errant vehicle.
8. Wing channel shall meet ASTM A 1011 SS Gr 50 and be galvanized per ASTM A 123.
9. Excess plow, wing channel, or windbeam shall be cut off so that it does not extend beyond the sign panel (i.e., excess support shall not be visible when the sign is viewed from the front.) Repair galvanized coating at cut support ends per Item 445, "Galvanizing."
10. Sign blanks shall be the sizes and shapes shown on the plans.
11. Additional sign clamp required on the "T-bracket" post for 24 inch high signs. Place the clamp 3 inches above bottom of sign when possible.
12. Post open ends shall be fitted with friction Caps.

Texas Department of Transportation
Traffic Operations Division

SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS TRIANGULAR SLIPBASE SYSTEM

SMD(SLIP-3)-08

©TxDOT July 2002	ᵀʷᵒ TXDOT	DN: TXDOT	ᶜᴴᴷ TXDOT	DW: TXDOT
9-08 REVISIONS	CK:	JOB	HIGHWAY	
	DIST	COUNTY		SHEET NO.

26D

CUDEENGINEERS.COM

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 6

TRAFFIC PLAN SIGNAGE DETAILS

DATE
10/15/2025

PROJECT NO.
03499.008

DRAWN BY
AG/BK/SG/RB/JF

CHECKED BY
K.M.H.

REVISIONS
1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED PROFESSIONAL ENGINEER
10/15/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C8.D1


P:\03499\PLOTS\C8.D1\SLIP-1-3.dwg 10/15/2025 10:53:26am BKeen

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for errors that may appear in this standard or for incorrect results or damages resulting from its use.


DATE:
FILE:

Wedge Anchor Steel System

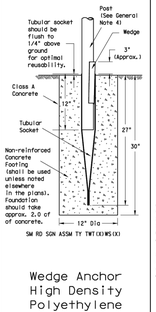


SMD RD SGN ASSM TY TWT(XX)WS(X)

Wedge Anchor High Density Polyethylene (HDPE) System

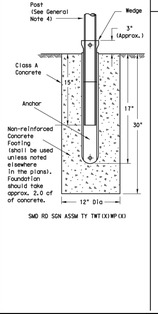


SMD RD SGN ASSM TY TWT(XX)WP(X)


Universal Anchor System with Thin-Walled Tubing Post

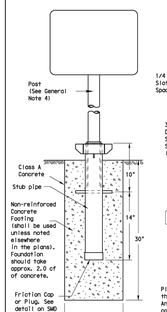

SM RD SGN ASSM TY TWT(XX)A(P)

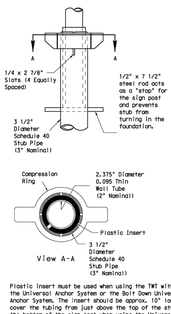


Plastic insert must be used when using the TWT with either the Universal Anchor System or the Bolt Down Universal Anchor System. The insert should be approx. 10" long and cover the tubing from just above the top of the stub pipe to the bottom of the sign post when using the Universal Anchor System. The insert should be cut to approx. 4 1/2" when used with the Bolt Down Universal Anchor System.

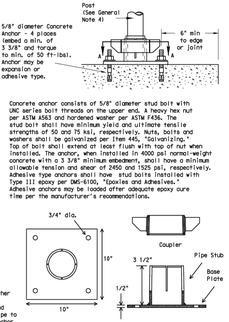

SM RD SGN ASSM TY TWT(XX)B(P)

Sign Installation Using a Prefabricated T-Bracket for Thin-Wall Tubing Post

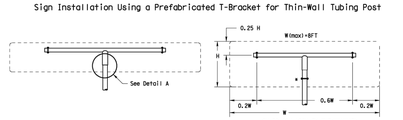

SM RD SGN ASSM TY TWT(XX)XX(T)
(* - See General Note 6)

NOTE
The devices shall be installed per manufacturer's recommendations.
Installation procedures shall be provided to the Engineer by Contractor.

GENERAL NOTES:
1. The Wedge Anchor System and the Universal Anchor System with thin wall tubing post may be used to support up to 10 square feet of sign area.
2. The tubular socket, wedge and prefabricated T-bracket shall be permanently marked to indicate manufacturer. Methods, design, and location of marking are subject to the approval of the TxDOT Traffic Standards Engineer.
3. Except for posts (13 BWG Tubing), clamps, nuts and bolts, all components shall be prequalified. A list of prequalified vendors may be obtained from the Material Producer List web page. The website address is: http://www.txdot.gov/business/producer list.htm
4. Material used as post with this system shall conform to the following specifications:
   13 BWG Tubing (2.375" outside diameter) (TWT)
   0.095" nominal wall thickness
   Seamless or electric-resistance welded steel tubing
   Steel shall be HSLAS Gr 55 per ASTM A1011 or ASTM A1008
   Other steels may be used if they meet the followings:
   55,000 PSI minimum yield strength
   70,000 PSI minimum tensile strength
   18% minimum elongation in 2"
   Wall thickness (uncoated) shall be within the range of .083" to .099"
   Outside diameter (uncoated) shall be within the range of 2.369" to 2.381"
   Galvanization per ASTM 123 or ASTM A653 G210. For precoated steel tubing (ASTM A653), repair tube outside diameter weld seam by metallizing with zinc wire per ASTM B833.
5. Sign blanks shall be the sizes and shapes shown on the plans.
6. Additional sign clamp required on the "T-bracket" post for 24" high signs. Place clamp at least 3" above bottom of sign when possible.
7. Sign supports shall not be spliced except where shown. Sign support posts shall not be spliced.
8. See the Traffic Operations Division website for detailed drawings of sign clamps and Wedge Anchor System components. The website address is: http://www.txdot.gov/publications/traffic.htm

WEDGE ANCHOR SYSTEM INSTALLATION PROCEDURE:
1. Dig foundation hole. Where solid rock is encountered at ground level, the foundation shall be a minimum depth of 18". When solid rock is encountered below ground level, the foundation shall extend in the solid rock a minimum depth of 18" or provide a minimum foundation depth of 30". If solid rock is encountered, the socket/stub may be reduced in length as required to a minimum length of 18". Any material removed from the socket/stub shall be from the bottom and the clearance requirements given on SMD(SIGN) must be followed. The inner surfaces of the socket/stub must remain free of concrete or other debris.
2. The Engineer may permit batches of concrete less than 2 cubic yards to be mixed with a portable, motor driven concrete mixer. For small placements less than 0.5 cubic yards, hand mixing in a suitable container may be allowed by Engineer. Place concrete into hole until it is approximately flush with the ground. Concrete shall be Class A.
3. Insert tubular socket into concrete until top of socket is approximately 1/4 " above the socket footing.
4. Plumb the socket. Allow a minimum 4 days for concrete to set, unless otherwise directed by Engineer..
5. Attach the sign to the sign post.
6. Insert the sign post into socket and align sign face with roadway.
7. Drive the wedge into the socket to secure post. This will leave approximately 3 inches of the wedge exposed.

UNIVERSAL ANCHOR SYSTEM INSTALLATION PROCEDURE
1. Dig foundation hole. Where solid rock is encountered at ground level, the foundation shall be a minimum depth of 18". When solid rock is encountered below ground level, the foundation shall extend in the solid rock a minimum depth of 18" or provide a minimum foundation depth of 30". If solid rock is encountered, the socket/stub may be reduced in length as required to a minimum length of 18". Any material removed from the socket/stub shall be from the bottom and the clearance requirements given on SMD(SIGN) must be followed. The inner surfaces of the socket/stub must remain free of concrete or other debris.
2. Insert base post in hole to depths shown and backfill hole with concrete.
3. Level and plumb the base post using a torpedo level and allow concrete adequate time to set. The bottom of the slots provided in the stub pipe shall remain above the top of the concrete foundation.
4. Attach the sign to the sign post.
5. Install plastic insert around bottom of post.
6. Insert sign post into base post. Lower until the post comes to rest on steel rod.
7. Seat compression ring using a hammer. Typically, the top of compression ring will be approximately level with top of stub post when optimally installed.
8. Check sign post by hand to ensure it is unable to turn. If loose, increase the tightening of the compression ring.

Texas Department of Transportation
Traffic Operations Division


SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS WEDGE & UNIVERSAL ANCHOR WITH THIN WALL TUBING POST

SMD(TWT)-08

©TxDOT July 2002	TRU TXDOT	DSN TXDOT	TRN TXDOT	CKD TXDOT
9-08 REVISIONS	CONT	SECT	JOB	HIGHWAY
	DIST	COUNTY		SHEET NO.


266

Universal Anchor System with Fiberglass Reinforced Plastic (FRP) Post

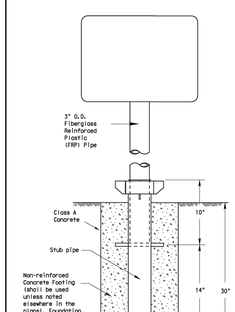


SM RD SGN ASSM TY FRP(XX)A(P)

BOLT-DOWN DETAILS

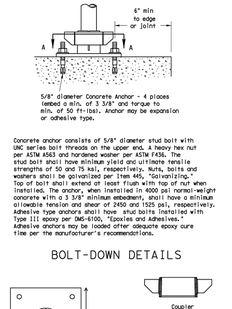


SM RD SGN ASSM TY FRP(XX)B(P)

Typical Sign Mounting Detail for FRP Support with Single Sign



Typical Sign Mounting Detail for FRP Support with Back-to-Back Signs



GENERAL NOTES:
1. FRP sign supports for a single type sign support may be used for signs up to and including 12 square feet. Dual post installation may be used for signs up to and including 32 square feet.
2. All nuts, bolts and washers shall be galvanized per Item 445, "Galvanizing."
3. See the Traffic Operations Division website for detailed drawings of sign clamps. The website address is: http://www.txdot.gov/publications/traffic.htm

FRP POST REQUIREMENTS
1. Materials shall conform to the requirements of Departmental Material Specification DMS-4610 and will be furnished in a yellow or gray color as specified elsewhere in the plans.
2. Thickness of FRP sign support is 0.125" + 0.031", - 0.0".
3. FRP sign supports are prequalified by the Traffic Operations Division.
   Prequalification procedures are obtained by writing:
   Texas Department of Transportation
   Traffic Operations Division
   125 East 11th Street
   Austin, Texas 78701-2483

UNIVERSAL ANCHOR SYSTEM INSTALLATION PROCEDURES
1. Dig foundation hole. Where solid rock is encountered at ground level, the foundation shall be a minimum depth of 18". When solid rock is encountered below ground level, the foundation shall extend in the solid rock a minimum depth of 18" or provide a minimum foundation depth of 30". If solid rock is encountered, the socket/stub may be reduced in length as required to a minimum length of 18". Any material removed from the socket/stub shall be from the bottom and the clearance requirements given on SMD(SIGN) must be followed. The inner surfaces of the socket/stub must remain free of concrete or other debris.
2. The Engineer may permit batches of concrete less than 2 cubic yards to be mixed with a portable, motor driven concrete mixer. For small placements less than 0.5 cubic yards, hand mixing in a suitable container may be allowed by Engineer. Concrete shall be Class A.
3. Insert base post in foundation hole to depths shown and fill hole with concrete. Cut base post from bottom and ensure a minimum of 18" embedment if installed in solid rock.
4. Level and plumb the base post with coupler using a torpedo level and let concrete set a minimum of 4 days, unless otherwise directed by Engineer. Bottom of base post slots shall be above the concrete footing.
5. Attach sign to FRP post.
6. Insert sign post into base post. Lower until the post comes to rest on the steel rod.
7. Use hammer to ensure the coupler is firmly seated. Top of coupler should be level with top of base post in most instances.
8. Check sign to ensure there is no twist. If loose, increase the tightening of coupler.

BOLT DOWN SIGN SUPPORT
1. Position base plate with coupler on existing concrete.
2. Drill holes into concrete and insert the 5/8" diameter bolts with wedge anchors, and tighten nuts.
3. Attach sign to FRP post.
4. Insert bottom of sign post into pipe stub.
5. Use hammer to ensure the coupler is firmly seated. Top of coupler should be level with top of base post in most instances.
6. Check sign to ensure there is no twist. If loose, increase the tightening of coupler.

Texas Department of Transportation
Traffic Operations Division

SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS UNIVERSAL ANCHOR SYSTEM WITH FRP POST

SMD(FRP)-08


©TxDOT July 2002	TRU TXDOT	DSN TXDOT	TRN TXDOT	CKD TXDOT
9-08 REVISIONS	CONT	SECT	JOB	HIGHWAY
	DIST	COUNTY		SHEET NO.

267


DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for errors that may appear in this standard or for incorrect results or damages resulting from its use.

DATE:
FILE:


REFLECTIVE RAISED PAVEMENT MARKERS FOR VEHICLE POSITIONING GUIDANCE




CENTERLINE FOR ALL TWO LANE ROADWAYS

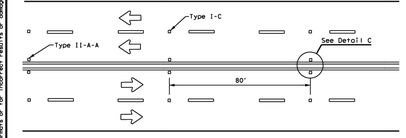


CENTERLINE & LANE LINES FOR FOUR LANE TWO-WAY HIGHWAYS

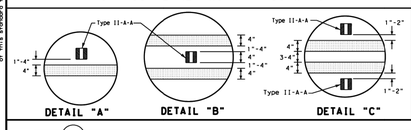




CENTERLINE AND LANE LINES FOR TWO-WAY LEFT TURN LANE

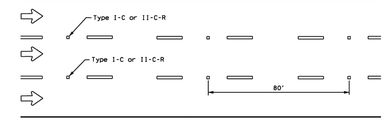

LANE LINES FOR ONE-WAY ROADWAY (NON-FREEWAY FACILITIES)

Raised pavement markers Type II-C-R shall have clear face toward normal traffic and red face toward wrong-way traffic.

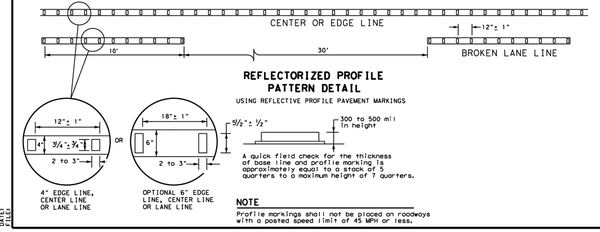


NOTE
Profile markings shall not be placed on roadways with a posted speed limit of 45 MPH or less.

GENERAL NOTES
1. All raised pavement markers placed in broken lines shall be placed in line with and midway between the stripes.
2. On concrete pavements the raised pavement markers should be placed to one side of the longitudinal joints.

MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
TRAFFIC PAINT	DMS-8200
HOT APPLIED THERMOPLASTIC	DMS-8220
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240

All pavement marking materials shall meet the required Departmental Material Specifications as specified by the plans.

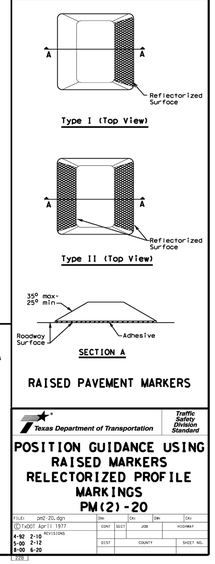

RAISED PAVEMENT MARKERS

Texas Department of Transportation
Traffic Safety Division Standard

POSITION GUIDANCE USING RAISED MARKERS RELECTORIZED PROFILE MARKINGS PM(2)-20

FILE: pm2-20.dgn	DW:	CK:	DW:	CK:
©TxDOT April 1977	CONT	SECT	JOB	HIGHWAY
REVISIONS				
4-92 2-10	DIST	COUNTY		SHEET NO.
3-00 2-12				
8-00 6-20				

268

CUDEENGINEERS.COM

CUDE ENGINEERS

4122 Pond Hill Road, Suite 101
San Antonio, Texas 78231
P:(210) 681.2951 F: (210) 523.7112

GRACE VALLEY RANCH PHASE 6

TRAFFIC PLAN SIGNAGE DETAILS

DATE
10/15/2025

PROJECT NO.
03499.008

DRAWN BY
AG/BK/SG/RB/JF

CHECKED BY
K.M.H.

REVISIONS
1.
2.
3.
4.
5.
6.
7.
8.
9.

STATE OF TEXAS
KYLE M. HUDEK
138753
LICENSED
PROFESSIONAL ENGINEER
10/15/2025

CUDE ENGINEERS
TBPE No. 455
TBPLS No. 10048500

C8.D2

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

P:\03499\050\CAD\C8-Details\C8.D2 - TRAFFIC PLAN SIGNAGE DETAILS.dwg, 10/15/2025 10:25:34am, jfloyd