




Construction Materials Testing  
**Waterline Installation—Backfill Compaction**  
**Miralomas Garden Homes Unit 3**  
**Kendall County, Texas**

**InTEC Project No. S242024-2**  
January 7, 2026

**Miralomas Development Corp.**  
440 TX 46  
Boerne, Texas



**Integrated Testing and Engineering Company of San Antonio, L.P.**

Geotechnical & Environmental Engineering • Construction Services • Geologic Assessment

January 7, 2026

E.A. Palaniappan, Ph.D., P.E.  
Murali Subramaniam, Ph.D., P.E.  
Kausi Subramaniam, B.S.

**Miralomas Development Corp.**  
440 TX 46  
Boerne, Texas

**Attention: Ms. Susan Wright**

**Re: Construction Materials Testing**  
**Waterline Installation – Backfill Compaction**  
**Miralomas Garden Homes Unit 3**  
Kendall County, Texas

**InTEC Project #: S242024-2**

Ladies & Gentlemen:

Integrated Testing and Engineering Company of San Antonio, L.P. (InTEC) performed compaction evaluation at the above referenced project site between August 13, 2024 and January 10, 2025.

Field density tests were performed on an “on call” basis by the contractor. Full time observation of fill placement was not performed. The Laboratory Compaction and Field Density Tests results at the above referenced project site are presented for your review.

We appreciate and wish to thank you for the opportunity to be of service to you on this project. If we can be of additional assistance, or if you have any questions, please call us.

Respectfully Submitted,  
InTEC of San Antonio, L.P.

Murali Subramaniam, Ph.D., P.E.

Copies Submitted: Above (1)



*Jinhu Song*  
1/7/2026



# Moisture Density Relationship

**InTEC of San Antonio**  
12028 Radium  
San Antonio, TX 78216  
Phone: 210-525-9033

**Client:**  
V.K. Knowlton Construction & Utilities, Ltd.  
18225 FM 2252  
San Antonio, TX 78266

**Project:**  
S242024  
Miralomas Garden Homes Unit 3  
29.763718, -98.809387  
Kendall County, TX

## SAMPLE DATA

**Sample Number:** 28464

**Sample Date:** 07/24/2024

**Technician:** Pereida, Gerald

**Material Use:** Utility Backfill


**Sample Location:** Utilities

**Material Description:** Tan Gravelly Clay

## LAB DATA

**Test Method:** ASTM D1557 - Method C

**Proctor Curve:**

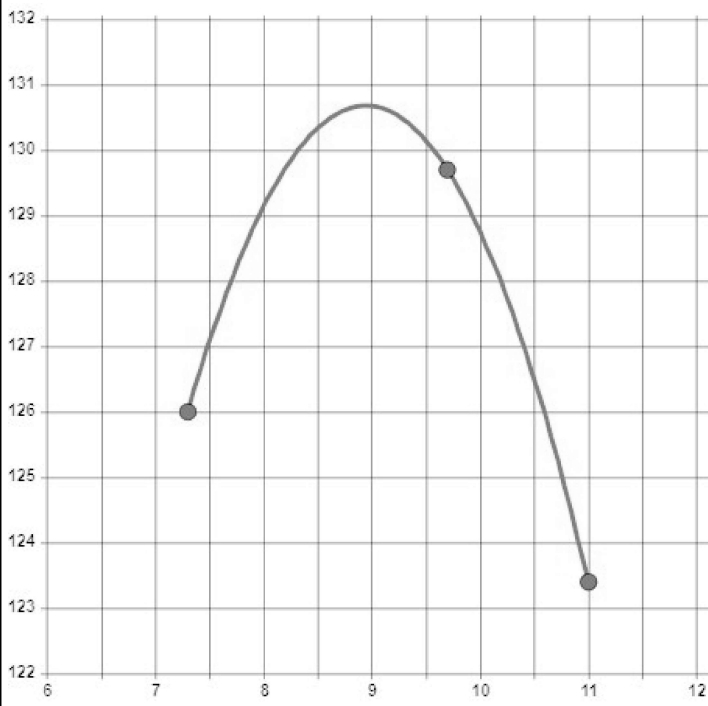

**Maximum Dry Density (pcf):** 130.7

**Optimum Moisture (%):** 8.9

**Soil Classification:** GC Gravelly Clay

**Test Completed Date:** 07/26/2024

**Test Completed By:** Efediyi, Eugene



InTEC of San Antonio  
 12028 Radium  
 San Antonio, TX 78216  
 Phone: 210-525-9033

# Compaction Evaluation

Report Date: 01/07/2026  
 Test Method: ASTM D6938, Tex 115E

Client:  
 V.K. Knowlton Construction & Utilities, Ltd.  
 18225 FM 2252  
 San Antonio, TX 78266

Project:  
 S242024  
 Miralomas Garden Homes Unit 3  
 29.763718, -98.809387  
 Kendall County, TX

Test Results															
Test #	Retest Of	Test Date	Proctor ID	Method	Soil Classification	Optimum Moisture (%)	Maximum Dry Density (pcf)	In Place Moisture (%)	In Place Dry Density (pcf)	In Place Wet Density (pcf)	Probe Depth (in)	Percent Compaction	Min Comp. (%)	Optimum Moisture Tolerance (%)	Remark
427		08/13/24	U28464		GC	8.9	130.7	10.5	130.5	144.2	6	99.8	95	-2 / 2	C
428		08/13/24	U28464		GC	8.9	130.7	9.9	130.8	143.7	6	100.1	95	-2 / 2	C
429		08/13/24	U28464		GC	8.9	130.7	8.8	130.3	141.8	6	99.7	95	-2 / 2	C
430		08/13/24	U28464		GC	8.9	130.7	8.7	131.0	142.4	6	100.2	95	-2 / 2	C
431		08/13/24	U28464		GC	8.9	130.7	8.5	130.5	141.6	6	99.8	95	-2 / 2	C
432		08/13/24	U28464		GC	8.9	130.7	8.9	131.0	142.7	6	100.2	95	-2 / 2	C
433		08/13/24	U28464		GC	8.9	130.7	8.6	130.5	141.7	6	99.8	95	-2 / 2	C
434		08/13/24	U28464		GC	8.9	130.7	8.6	130.7	141.9	6	100.0	95	-2 / 2	C
Test Information															
Test #	Test Location	Elevation	Reference	Gauge Specs Make / Model / SN / Calibrated	Gauge Standardization Density Standard/Moisture Standard	Field Technician									
427	Water Main: Oriole Ln, Lot 6		1st Lift	Troxler / 3430 / 30173 / 07/26/2023	1591 / 555	Villarreal Sr., Robert									
428	Water Main: Oriole Ln, Lot 6		2nd Lift	Troxler / 3430 / 30173 / 07/26/2023	1591 / 555	Villarreal Sr., Robert									
429	Water Main: Oriole Ln, Lot 11		1st Lift	Troxler / 3430 / 30173 / 07/26/2023	1591 / 555	Villarreal Sr., Robert									
430	Water Main: Oriole Ln, Lot 11		2nd Lift	Troxler / 3430 / 30173 / 07/26/2023	1591 / 555	Villarreal Sr., Robert									
431	Water Main: Hibiscus, Lot 17		1st Lift	Troxler / 3430 / 30173 / 07/26/2023	1591 / 555	Villarreal Sr., Robert									
432	Water Main: Hibiscus, Lot 17		2nd Lift	Troxler / 3430 / 30173 / 07/26/2023	1591 / 555	Villarreal Sr., Robert									
433	Water Main: Mockingbird Trail, Lot 60		1st Lift	Troxler / 3430 / 30173 / 07/26/2023	1591 / 555	Villarreal Sr., Robert									
434	Water Main: Mockingbird Trail, Lot 60		2nd Lift	Troxler / 3430 / 30173 / 07/26/2023	1591 / 555	Villarreal Sr., Robert									
Remarks				Comments											
C: Compliant				Tests are "Direct Transmission" (Method A) unless probe depth is noted as "Backscatter". Gauge calibration data on file with the testing agency.											

Testing performed when called in.  
 InTEC did not observe the installation of the material.  
 Testing directed by the City Inspector when present.  
 Test results apply only to the specific locations and materials noted and may not represent any other locations or elevations.



InTEC of San Antonio  
 12028 Radium  
 San Antonio, TX 78216  
 Phone: 210-525-9033

# Compaction Evaluation

Report Date: 01/07/2026  
 Test Method: ASTM D6938, Tex 115E

Client:  
 V.K. Knowlton Construction & Utilities, Ltd.  
 18225 FM 2252  
 San Antonio, TX 78266

Project:  
 S242024  
 Miralomas Garden Homes Unit 3  
 29.763718, -98.809387  
 Kendall County, TX

Test Results															
Test #	Retest Of	Test Date	Proctor ID	Method	Soil Classification	Optimum Moisture (%)	Maximum Dry Density (pcf)	In Place Moisture (%)	In Place Dry Density (pcf)	In Place Wet Density (pcf)	Probe Depth (in)	Percent Compaction	Min Comp. (%)	Optimum Moisture Tolerance (%)	Remark
435		08/13/24	U28464		GC	8.9	130.7	8.8	130.5	142.0	6	99.8	95	-2 / 2	C
436		08/13/24	U28464		GC	8.9	130.7	8.3	131.1	142.0	6	100.3	95	-2 / 2	C
437		08/13/24	U28464		GC	8.9	130.7	8.1	131.0	141.6	6	100.2	95	-2 / 2	C
438		08/13/24	U28464		GC	8.9	130.7	7.9	131.2	141.6	6	100.4	95	-2 / 2	C
439		08/13/24	U28464		GC	8.9	130.7	8.2	130.8	141.5	6	100.1	95	-2 / 2	C
440		08/13/24	U28464		GC	8.9	130.7	7.9	130.4	140.7	6	99.8	95	-2 / 2	C
441		08/14/24	U28464		GC	8.9	130.7	7.8	130.5	140.7	6	99.8	95	-2 / 2	C
442		08/14/24	U28464		GC	8.9	130.7	7.6	130.6	140.5	6	99.9	95	-2 / 2	C
Test Information															
Test #	Test Location	Elevation	Reference	Gauge Specs Make / Model / SN / Calibrated	Gauge Standardization Density Standard/Moisture Standard	Field Technician									
435	Water Main: Mockingbird Trail, Lot 52		1st Lift	Troxler / 3430 / 30173 / 07/26/2023	1591 / 555	Villarreal Sr., Robert									
436	Water Main: Mockingbird Trail, Lot 52		2nd Lift	Troxler / 3430 / 30173 / 07/26/2023	1591 / 555	Villarreal Sr., Robert									
437	Water Main: Mockingbird Trail, Lot 39		1st Lift	Troxler / 3430 / 30173 / 07/26/2023	1591 / 555	Villarreal Sr., Robert									
438	Water Main: Mockingbird Trail, Lot 39		2nd Lift	Troxler / 3430 / 30173 / 07/26/2023	1591 / 555	Villarreal Sr., Robert									
439	Water Main: Mockingbird Trail, Lot 29		1st Lift	Troxler / 3430 / 30173 / 07/26/2023	1591 / 555	Villarreal Sr., Robert									
440	Water Main: Mockingbird Trail, Lot 29		2nd Lift	Troxler / 3430 / 30173 / 07/26/2023	1591 / 555	Villarreal Sr., Robert									
441	Water Main: Oriole Ln, Lot 76		1st Lift	Troxler / 3430 / 30173 / 07/26/2023	1595 / 555	Villarreal Sr., Robert									
442	Water Main: Oriole Ln, Lot 76		2nd Lift	Troxler / 3430 / 30173 / 07/26/2023	1595 / 555	Villarreal Sr., Robert									
Remarks			Comments												
C: Compliant			Tests are "Direct Transmission" (Method A) unless probe depth is noted as "Backscatter". Gauge calibration data on file with the testing agency.												

Testing performed when called in.  
 InTEC did not observe the installation of the material.  
 Testing directed by the City Inspector when present.  
 Test results apply only to the specific locations and materials noted and may not represent any other locations or elevations.



InTEC of San Antonio  
 12028 Radium  
 San Antonio, TX 78216  
 Phone: 210-525-9033

# Compaction Evaluation

Report Date: 01/07/2026  
 Test Method: ASTM D6938, Tex 115E

Client:  
 V.K. Knowlton Construction & Utilities, Ltd.  
 18225 FM 2252  
 San Antonio, TX 78266

Project:  
 S242024  
 Miralomas Garden Homes Unit 3  
 29.763718, -98.809387  
 Kendall County, TX

Test Results															
Test #	Retest Of	Test Date	Proctor ID	Method	Soil Classification	Optimum Moisture (%)	Maximum Dry Density (pcf)	In Place Moisture (%)	In Place Dry Density (pcf)	In Place Wet Density (pcf)	Probe Depth (in)	Percent Compaction	Min Comp. (%)	Optimum Moisture Tolerance (%)	Remark
443		08/14/24	U28464		GC	8.9	130.7	7.4	130.1	139.7	6	99.5	95	-2 / 2	C
444		08/14/24	U28464		GC	8.9	130.7	7.3	130.5	140.0	6	99.8	95	-2 / 2	C
445		08/14/24	U28464		GC	8.9	130.7	8.1	130.3	140.9	6	99.7	95	-2 / 2	C
446		08/14/24	U28464		GC	8.9	130.7	7.5	130.2	140.0	6	99.6	95	-2 / 2	C
452		12/12/24	U28464		GC	8.9	130.7	9.0	131.4	143.2	6	100.5	95	-2 / 2	C
453		12/12/24	U28464		GC	8.9	130.7	8.3	130.5	141.3	6	99.8	95	-2 / 2	C
454		12/12/24	U28464		GC	8.9	130.7	7.7	132.4	142.6	6	101.3	95	-2 / 2	C
455		12/12/24	U28464		GC	8.9	130.7	8.1	131.7	142.4	6	100.8	95	-2 / 2	C
Test Information															
Test #	Test Location	Elevation	Reference	Gauge Specs			Gauge Standardization			Field Technician					
				Make / Model / SN / Calibrated	Density Standard/Moisture Standard										
443	Water Main: Oriole Ln, Lot 68		1st Lift	Troxler / 3430 / 30173 / 07/26/2023	1595 / 555				Villarreal Sr., Robert						
444	Water Main: Oriole Ln, Lot 68		2nd Lift	Troxler / 3430 / 30173 / 07/26/2023	1595 / 555				Villarreal Sr., Robert						
445	Water Main: Hibiscus, Lot 65		1st Lift	Troxler / 3430 / 30173 / 07/26/2023	1595 / 555				Villarreal Sr., Robert						
446	Water Main: Hibiscus, Lot 65		2nd Lift	Troxler / 3430 / 30173 / 07/26/2023	1595 / 555				Villarreal Sr., Robert						
452	Water Main: Hibiscus, Lot 13		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2293 / 642				Pereida, Gerald						
453	Water Main: Hibiscus, Lot 16		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2293 / 642				Pereida, Gerald						
454	Water Main: Hibiscus, Lot 19		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2293 / 642				Pereida, Gerald						
455	Water Main: Oriole Ln, Lot 66		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2293 / 642				Pereida, Gerald						
Remarks				Comments											
C: Compliant				Tests are "Direct Transmission" (Method A) unless probe depth is noted as "Backscatter". Gauge calibration data on file with the testing agency.											

Testing performed when called in.  
 InTEC did not observe the installation of the material.  
 Testing directed by the City Inspector when present.  
 Test results apply only to the specific locations and materials noted and may not represent any other locations or elevations.



InTEC of San Antonio  
 12028 Radium  
 San Antonio, TX 78216  
 Phone: 210-525-9033

# Compaction Evaluation

Report Date: 01/07/2026  
 Test Method: ASTM D6938, Tex 115E

Client:  
 V.K. Knowlton Construction & Utilities, Ltd.  
 18225 FM 2252  
 San Antonio, TX 78266

Project:  
 S242024  
 Miralomas Garden Homes Unit 3  
 29.763718, -98.809387  
 Kendall County, TX

Test Results															
Test #	Retest Of	Test Date	Proctor ID	Method	Soil Classification	Optimum Moisture (%)	Maximum Dry Density (pcf)	In Place Moisture (%)	In Place Dry Density (pcf)	In Place Wet Density (pcf)	Probe Depth (in)	Percent Compaction	Min Comp. (%)	Optimum Moisture Tolerance (%)	Remark
456		12/12/24	U28464		GC	8.9	130.7	8.8	131.6	143.2	6	100.7	95	-2 / 2	C
460		12/12/24	U28464		GC	8.9	130.7	7.9	128.9	139.1	6	98.6	95	-2 / 2	C
461		12/12/24	U28464		GC	8.9	130.7	7.6	129.4	139.2	6	99.0	95	-2 / 2	C
462		12/12/24	U28464		GC	8.9	130.7	8.7	132.4	143.9	6	101.3	95	-2 / 2	C
463		12/12/24	U28464		GC	8.9	130.7	8.4	132.4	143.5	6	101.3	95	-2 / 2	C
468		12/13/24	U28464		GC	8.9	130.7	9.2	132.1	144.3	6	101.1	95	-2 / 2	C
469		12/13/24	U28464		GC	8.9	130.7	8.1	128.8	139.2	6	98.5	95	-2 / 2	C
470		12/13/24	U28464		GC	8.9	130.7	8.6	129.5	140.6	6	99.1	95	-2 / 2	C
Test Information															
Test #	Test Location	Elevation	Reference	Gauge Specs Make / Model / SN / Calibrated	Gauge Standardization Density Standard/Moisture Standard	Field Technician									
456	Water Main: Oriole Ln, Lot 68		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2293 / 642	Pereida, Gerald									
460	Water Main: Hibiscus, Lot 14		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2293 / 642	Pereida, Gerald									
461	Water Main: Hibiscus, Lot 16		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2293 / 642	Pereida, Gerald									
462	Water Main: Hibiscus, Lot 18		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2293 / 642	Pereida, Gerald									
463	Water Main: Oriole Ln, Lot 11		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2293 / 642	Pereida, Gerald									
468	Water Main: Oriole Ln, Lot 78		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2291 / 643	Pereida, Gerald									
469	Water Main: Oriole Ln, Lot 75		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2291 / 643	Pereida, Gerald									
470	Water Main: Oriole Ln, Lot 72		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2291 / 643	Pereida, Gerald									
Remarks			Comments												
C: Compliant			Tests are "Direct Transmission" (Method A) unless probe depth is noted as "Backscatter". Gauge calibration data on file with the testing agency.												

Testing performed when called in.  
 InTEC did not observe the installation of the material.  
 Testing directed by the City Inspector when present.  
 Test results apply only to the specific locations and materials noted and may not represent any other locations or elevations.



InTEC of San Antonio  
 12028 Radium  
 San Antonio, TX 78216  
 Phone: 210-525-9033

# Compaction Evaluation

Report Date: 01/07/2026  
 Test Method: ASTM D6938, Tex 115E

Client:  
 V.K. Knowlton Construction & Utilities, Ltd.  
 18225 FM 2252  
 San Antonio, TX 78266

Project:  
 S242024  
 Miralomas Garden Homes Unit 3  
 29.763718, -98.809387  
 Kendall County, TX

Test Results															
Test #	Retest Of	Test Date	Proctor ID	Method	Soil Classification	Optimum Moisture (%)	Maximum Dry Density (pcf)	In Place Moisture (%)	In Place Dry Density (pcf)	In Place Wet Density (pcf)	Probe Depth (in)	Percent Compaction	Min Comp. (%)	Optimum Moisture Tolerance (%)	Remark
471		12/13/24	U28464		GC	8.9	130.7	8.6	129.2	140.3	6	98.9	95	-2 / 2	C
476		01/02/25	U28464		GC	8.9	130.7	7.9	129.8	140.1	6	99.3	95	-2 / 2	C
477		01/02/25	U28464		GC	8.9	130.7	8.7	130.4	141.7	6	99.8	95	-2 / 2	C
478		01/02/25	U28464		GC	8.9	130.7	8.6	129.5	140.6	6	99.1	95	-2 / 2	C
482		01/02/25	U28464		GC	8.9	130.7	9.1	128.3	140.0	6	98.2	95	-2 / 2	C
483		01/02/25	U28464		GC	8.9	130.7	8.4	130.7	141.7	6	100.0	95	-2 / 2	C
484		01/02/25	U28464		GC	8.9	130.7	8.3	129.1	139.8	6	98.8	95	-2 / 2	C
493		01/09/25	U28464		GC	8.9	130.7	7.9	131.4	141.8	6	100.5	95	-2 / 2	C

Test Information						
Test #	Test Location	Elevation	Reference	Gauge Specs Make / Model / SN / Calibrated	Gauge Standardization Density Standard/Moisture Standard	Field Technician
471	Water Main: Oriole Ln, Lot 70		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2291 / 643	Pereida, Gerald
476	Water Main: Oriole Ln, Lot 8		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 643	Pereida, Gerald
477	Water Main: Oriole Ln, Lot 6		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 643	Pereida, Gerald
478	Water Main: Oriole Ln, Lot 4		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 643	Pereida, Gerald
482	Water Main: Oriole Ln, Lot 79		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 643	Pereida, Gerald
483	Water Main: Oriole Ln, Lot 77		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 643	Pereida, Gerald
484	Water Main: Oriole Ln, Lot 74		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 643	Pereida, Gerald
493	Water Main: Mockingbird Trail, Lot 65		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 644	Pereida, Gerald

Remarks	Comments
C: Compliant	Tests are "Direct Transmission" (Method A) unless probe depth is noted as "Backscatter". Gauge calibration data on file with the testing agency.

Testing performed when called in.  
 InTEC did not observe the installation of the material.  
 Testing directed by the City Inspector when present.  
 Test results apply only to the specific locations and materials noted and may not represent any other locations or elevations.



InTEC of San Antonio  
 12028 Radium  
 San Antonio, TX 78216  
 Phone: 210-525-9033

# Compaction Evaluation

Report Date: 01/07/2026  
 Test Method: ASTM D6938, Tex 115E

Client:  
 V.K. Knowlton Construction & Utilities, Ltd.  
 18225 FM 2252  
 San Antonio, TX 78266

Project:  
 S242024  
 Miralomas Garden Homes Unit 3  
 29.763718, -98.809387  
 Kendall County, TX

Test Results															
Test #	Retest Of	Test Date	Proctor ID	Method	Soil Classification	Optimum Moisture (%)	Maximum Dry Density (pcf)	In Place Moisture (%)	In Place Dry Density (pcf)	In Place Wet Density (pcf)	Probe Depth (in)	Percent Compaction	Min Comp. (%)	Optimum Moisture Tolerance (%)	Remark
494		01/09/25	U28464		GC	8.9	130.7	8.1	129.9	140.4	6	99.4	95	-2 / 2	C
495		01/09/25	U28464		GC	8.9	130.7	7.9	128.9	139.1	6	98.6	95	-2 / 2	C
501		01/09/25	U28464		GC	8.9	130.7	8.3	131.1	142.0	6	100.3	95	-2 / 2	C
502		01/09/25	U28464		GC	8.9	130.7	7.9	129.6	139.8	6	99.2	95	-2 / 2	C
503		01/09/25	U28464		GC	8.9	130.7	8.5	128.7	139.6	6	98.5	95	-2 / 2	C
509		01/10/25	U28464		GC	8.9	130.7	10.3	128.6	141.8	6	98.4	95	-2 / 2	C
510		01/10/25	U28464		GC	8.9	130.7	9.4	127.8	139.8	6	97.8	95	-2 / 2	C
511		01/10/25	U28464		GC	8.9	130.7	10.2	132.4	145.9	6	101.3	95	-2 / 2	C
Test Information															
Test #	Test Location	Elevation	Reference	Gauge Specs Make / Model / SN / Calibrated	Gauge Standardization Density Standard/Moisture Standard	Field Technician									
494	Water Main: Mockingbird Trail, Lot 62		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 644	Pereida, Gerald									
495	Water Main: Mockingbird Trail, Lot 59		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 644	Pereida, Gerald									
501	Water Main: Mockingbird Trail, Lot 24		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 644	Pereida, Gerald									
502	Water Main: Mockingbird Trail, Lot 26		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 644	Pereida, Gerald									
503	Water Main: Mockingbird Trail, Lot 29		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 644	Pereida, Gerald									
509	Water Main: Mockingbird Trail, Lot 34		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2291 / 643	Pereida, Gerald									
510	Water Main: Mockingbird Trail, Lot 37		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2291 / 643	Pereida, Gerald									
511	Water Main: Mockingbird Trail, Lot 40		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2291 / 643	Pereida, Gerald									
Remarks			Comments												
C: Compliant			Tests are "Direct Transmission" (Method A) unless probe depth is noted as "Backscatter". Gauge calibration data on file with the testing agency.												

Testing performed when called in.  
 InTEC did not observe the installation of the material.  
 Testing directed by the City Inspector when present.  
 Test results apply only to the specific locations and materials noted and may not represent any other locations or elevations.



InTEC of San Antonio  
 12028 Radium  
 San Antonio, TX 78216  
 Phone: 210-525-9033

# Compaction Evaluation

Report Date: 01/07/2026  
 Test Method: ASTM D6938, Tex 115E

Client:  
 V.K. Knowlton Construction & Utilities, Ltd.  
 18225 FM 2252  
 San Antonio, TX 78266

Project:  
 S242024  
 Miralomas Garden Homes Unit 3  
 29.763718, -98.809387  
 Kendall County, TX

## Test Results

Test #	Retest Of	Test Date	Proctor ID	Method	Soil Classification	Optimum Moisture (%)	Maximum Dry Density (pcf)	In Place Moisture (%)	In Place Dry Density (pcf)	In Place Wet Density (pcf)	Probe Depth (in)	Percent Compaction	Min Comp. (%)	Optimum Moisture Tolerance (%)	Remark
512		01/10/25	U28464		GC	8.9	130.7	10.8	130.7	144.8	6	100.0	95	-2 / 2	C
513		01/10/25	U28464		GC	8.9	130.7	10.9	131.6	145.9	6	100.7	95	-2 / 2	C
514		01/10/25	U28464		GC	8.9	130.7	9.9	129.2	142.0	6	98.9	95	-2 / 2	C
515		01/10/25	U28464		GC	8.9	130.7	8.9	130.4	142.0	6	99.8	95	-2 / 2	C
516		01/10/25	U28464		GC	8.9	130.7	10.2	129.1	142.3	6	98.8	95	-2 / 2	C

## Test Information

Test #	Test Location	Elevation	Reference	Gauge Specs Make / Model / SN / Calibrated	Gauge Standardization Density Standard/Moisture Standard	Field Technician
512	Water Main: Mockingbird Trail, Lot 43		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2291 / 643	Pereida, Gerald
513	Water Main: Mockingbird Trail, Lot 49		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2291 / 643	Pereida, Gerald
514	Water Main: Mockingbird Trail, Lot 50		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2291 / 643	Pereida, Gerald
515	Water Main: Mockingbird Trail, Lot 53		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2291 / 643	Pereida, Gerald
516	Water Main: Mockingbird Trail, Lot 56		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2291 / 643	Pereida, Gerald

Remarks	Comments
C: Compliant	Tests are "Direct Transmission" (Method A) unless probe depth is noted as "Backscatter". Gauge calibration data on file with the testing agency.

Testing performed when called in.  
 InTEC did not observe the installation of the material.  
 Testing directed by the City Inspector when present.  
 Test results apply only to the specific locations and materials noted and may not represent any other locations or elevations.



InTEC of San Antonio  
 12028 Radium  
 San Antonio, TX 78216  
 Phone: 210-525-9033

# Compaction Evaluation

Report Date: 01/07/2026  
 Test Method: ASTM D6938, Tex 115E

Client:  
 V.K. Knowlton Construction & Utilities, Ltd.  
 18225 FM 2252  
 San Antonio, TX 78266

Project:  
 S242024  
 Miralomas Garden Homes Unit 3  
 29.763718, -98.809387  
 Kendall County, TX

Test Results															
Test #	Retest Of	Test Date	Proctor ID	Method	Soil Classification	Optimum Moisture (%)	Maximum Dry Density (pcf)	In Place Moisture (%)	In Place Dry Density (pcf)	In Place Wet Density (pcf)	Probe Depth (in)	Percent Compaction	Min Comp. (%)	Optimum Moisture Tolerance (%)	Remark
457		12/12/24	U28464		GC	8.9	130.7	8.3	127.8	138.4	6	97.8	95	-2 / 2	C
458		12/12/24	U28464		GC	8.9	130.7	8.2	129.6	140.2	6	99.2	95	-2 / 2	C
459		12/12/24	U28464		GC	8.9	130.7	8.4	130.1	141.0	6	99.5	95	-2 / 2	C
464		12/12/24	U28464		GC	8.9	130.7	7.9	128.8	139.0	6	98.5	95	-2 / 2	C
465		12/12/24	U28464		GC	8.9	130.7	8.3	131.1	142.0	6	100.3	95	-2 / 2	C
466		12/12/24	U28464		GC	8.9	130.7	7.6	129.4	139.2	6	99.0	95	-2 / 2	C
467		12/12/24	U28464		GC	8.9	130.7	7.6	128.6	138.4	6	98.4	95	-2 / 2	C
472		12/13/24	U28464		GC	8.9	130.7	9.1	127.8	139.4	6	97.8	95	-2 / 2	C

Test Information						
Test #	Test Location	Elevation	Reference	Gauge Specs Make / Model / SN / Calibrated	Gauge Standardization Density Standard/Moisture Standard	Field Technician
457	Water Services: Hibiscus, Lot 19/18		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2293 / 642	Pereida, Gerald
458	Water Services: Hibiscus, Lot 14/15		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2293 / 642	Pereida, Gerald
459	Water Services: Oriole Ln, Lot 68/67		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2293 / 642	Pereida, Gerald
464	Water Services: Hibiscus, Lot 19		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2293 / 642	Pereida, Gerald
465	Water Services: Hibiscus, Lot 17/18		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2293 / 642	Pereida, Gerald
466	Water Services: Hibiscus, Lot 15/16		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2293 / 642	Pereida, Gerald
467	Water Services: Oriole Ln, Lot 11/12		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2293 / 642	Pereida, Gerald
472	Water Services: Oriole Ln, Lot 78/77		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2291 / 643	Pereida, Gerald

Remarks	Comments
C: Compliant	Tests are "Direct Transmission" (Method A) unless probe depth is noted as "Backscatter". Gauge calibration data on file with the testing agency.

Testing performed when called in.  
 InTEC did not observe the installation of the material.  
 Testing directed by the City Inspector when present.  
 Test results apply only to the specific locations and materials noted and may not represent any other locations or elevations.



InTEC of San Antonio  
 12028 Radium  
 San Antonio, TX 78216  
 Phone: 210-525-9033

# Compaction Evaluation

Report Date: 01/07/2026  
 Test Method: ASTM D6938, Tex 115E

Client:  
 V.K. Knowlton Construction & Utilities, Ltd.  
 18225 FM 2252  
 San Antonio, TX 78266

Project:  
 S242024  
 Miralomas Garden Homes Unit 3  
 29.763718, -98.809387  
 Kendall County, TX

Test Results															
Test #	Retest Of	Test Date	Proctor ID	Method	Soil Classification	Optimum Moisture (%)	Maximum Dry Density (pcf)	In Place Moisture (%)	In Place Dry Density (pcf)	In Place Wet Density (pcf)	Probe Depth (in)	Percent Compaction	Min Comp. (%)	Optimum Moisture Tolerance (%)	Remark
473		12/13/24	U28464		GC	8.9	130.7	8.7	128.4	139.6	6	98.2	95	-2 / 2	C
474		12/13/24	U28464		GC	8.9	130.7	8.4	129.9	140.8	6	99.4	95	-2 / 2	C
475		12/13/24	U28464		GC	8.9	130.7	9.3	128.7	140.7	6	98.5	95	-2 / 2	C
479		01/02/25	U28464		GC	8.9	130.7	7.9	129.8	140.1	6	99.3	95	-2 / 2	C
480		01/02/25	U28464		GC	8.9	130.7	8.6	128.8	139.9	6	98.5	95	-2 / 2	C
481		01/02/25	U28464		GC	8.9	130.7	9.2	131.4	143.5	6	100.5	95	-2 / 2	C
485		01/03/25	U28464		GC	8.9	130.7	8.2	128.7	139.3	6	98.5	95	-2 / 2	C
486		01/03/25	U28464		GC	8.9	130.7	8.8	127.6	138.8	6	97.6	95	-2 / 2	C
Test Information															
Test #	Test Location	Elevation	Reference	Gauge Specs Make / Model / SN / Calibrated	Gauge Standardization Density Standard/Moisture Standard	Field Technician									
473	Water Services: Oriole Ln, Lot 76/75		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2291 / 643	Pereida, Gerald									
474	Water Services: Oriole Ln, Lot 74/73		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2291 / 643	Pereida, Gerald									
475	Water Services: Oriole Ln, Lot 72/71		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2291 / 643	Pereida, Gerald									
479	Water Services: Oriole Ln, Lot 4/5		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 643	Pereida, Gerald									
480	Water Services: Oriole Ln, Lot 6/7		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 643	Pereida, Gerald									
481	Water Services: Oriole Ln, Lot 8/9		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 643	Pereida, Gerald									
485	Water Services: Oriole Ln, Lot 4		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 643	Pereida, Gerald									
486	Water Services: Oriole Ln, Lot 5/6		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 643	Pereida, Gerald									
Remarks			Comments												
C: Compliant			Tests are "Direct Transmission" (Method A) unless probe depth is noted as "Backscatter". Gauge calibration data on file with the testing agency.												

Testing performed when called in.  
 InTEC did not observe the installation of the material.  
 Testing directed by the City Inspector when present.  
 Test results apply only to the specific locations and materials noted and may not represent any other locations or elevations.



InTEC of San Antonio  
 12028 Radium  
 San Antonio, TX 78216  
 Phone: 210-525-9033

# Compaction Evaluation

**Report Date:** 01/07/2026  
**Test Method:** ASTM D6938, Tex 115E

**Client:**  
 V.K. Knowlton Construction & Utilities, Ltd.  
 18225 FM 2252  
 San Antonio, TX 78266

**Project:**  
 S242024  
 Miralomas Garden Homes Unit 3  
 29.763718, -98.809387  
 Kendall County, TX

Test Results															
Test #	Retest Of	Test Date	Proctor ID	Method	Soil Classification	Optimum Moisture (%)	Maximum Dry Density (pcf)	In Place Moisture (%)	In Place Dry Density (pcf)	In Place Wet Density (pcf)	Probe Depth (in)	Percent Compaction	Min Comp. (%)	Optimum Moisture Tolerance (%)	Remark
487		01/03/25	U28464		GC	8.9	130.7	9.2	130.5	142.5	6	99.8	95	-2 / 2	C
488		01/03/25	U28464		GC	8.9	130.7	8.4	129.4	140.3	6	99.0	95	-2 / 2	C
Test Information															
Test #	Test Location	Elevation	Reference	Gauge Specs Make / Model / SN / Calibrated	Gauge Standardization Density Standard/Moisture Standard	Field Technician									
487	Water Services: Oriole Ln, Lot 7/8		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 643	Pereida, Gerald									
488	Water Services: Oriole Ln, Lot 9/10		1st Lift	Troxler / 3430 / 38292 / 07/22/2024	2292 / 643	Pereida, Gerald									
Remarks			Comments												
C: Compliant			Tests are "Direct Transmission" (Method A) unless probe depth is noted as "Backscatter". Gauge calibration data on file with the testing agency.												

Testing performed when called in.  
 InTEC did not observe the installation of the material.  
 Testing directed by the City Inspector when present.  
 Test results apply only to the specific locations and materials noted and may not represent any other locations or elevations.