
# RIVERSTONE UNIT 11680-52

# PD JOB NO. 22-11800298

# RIVERSTONE UNIT - F1

# SAN ANTONIO, TEXAS

# CIVIL CONSTRUCTION PLANS

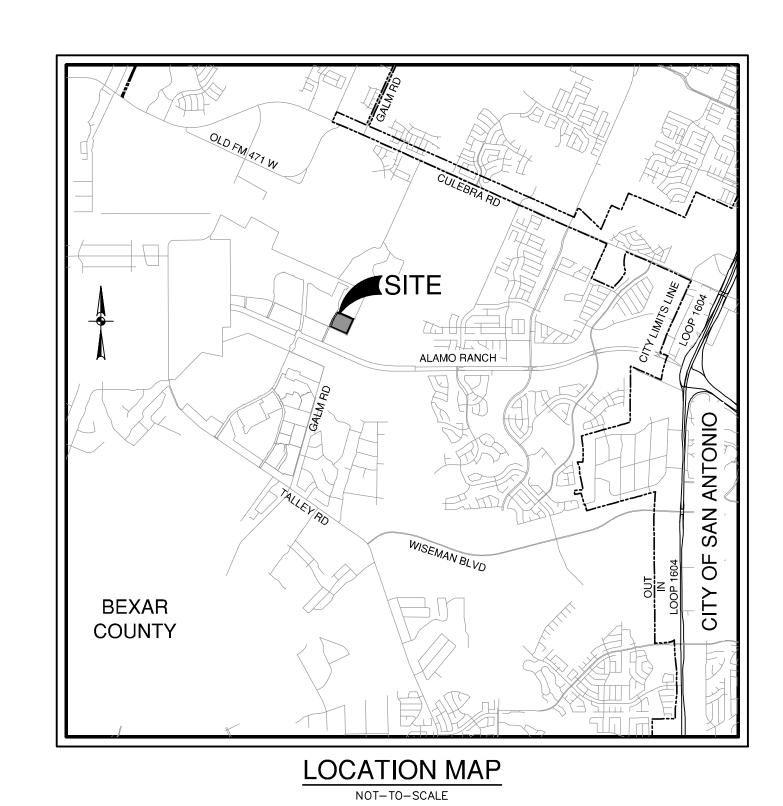

PREPARED FOR:


CONTINENTAL HOMES OF TEXAS, L.P. 5419 N LOOP E SAN ANTONIO, TX 78218

> JUNE 2022 (UPDATED JANUARY 2023)



#### SHEET INDEX

Sheet Description	Sheet No.
COVER SHEET	C0.00
MASTER DRAINAGE PLAN	C1.00
DRAIN A PLAN & PROFILE (STA. 1+00.00 TO STA. 3+40.00)	C1.01
DRAIN A PLAN & PROFILE (STA. 3+40.00 TO END)	C1.02
LEON RIVER RIDGE PLAN & PROFILE	C2.00
MUDSTONE CREEK PLAN & PROFILE	C2.01
HONEY ONYX TRAIL PLAN & PROFILE	C2.02
GILA GYPSUM PLAN & PROFILE	C2.03
_AVACA COVE DR PLAN & PROFILE	C2.04
STREET DETAILS	C2.10
STREET DETAILS	C2.11
STREET DETAILS	C2.12
OVERALL SIGNAGE PLAN	C3.00
SIGNAGE DETAILS	C3.10
SIGNAGE DETAILS	C3.11
SIGNAGE DETAILS	C3.12
OVERALL WATER DISTRIBUTION PLAN	C4.00
WATER DISTRIBUTION DETAILS	C4.10
WATER DISTRIBUTION PLAN NOTES	C4.11
OVERALL SANITARY SEWER PLAN	C5.00
SANITARY SEWER LINE A PLAN & PROFILE	C5.01
SANITARY SEWER LINE B PLAN & PROFILE	C5.02
SANITARY SEWER LINE B & F PLAN & PROFILE	C5.03
SANITARY SEWER LINE C PLAN & PROFILE	C5.04
SANITARY SEWER LINE D & G PLAN & PROFILE	C5.05
SANITARY SEWER LINE E PLAN & PROFILE	C5.06
SANITARY SEWER DETAILS	C5.10
SANITARY SEWER NOTES	C5.11
OVERALL UTILITY PLAN	C6.00
OVERALL GRADING PLAN	C7.00
STORM WATER POLLUTION PREVENTION PLAN	C8.00
STORM WATER POLLUTION PREVENTION PLAN DETAILS	C8.10




#### WATER (SAWS PRESSURE ZONE 8)


DEVELOPER'S NAME: CONTIN		ES OF T	EXAS, L.P.	
ADDRESS: <u>5419 N LOOP</u>	1604 E			
CITY: SAN ANTONIO	STATE:_	TX	ZIP:	78218
PHONE# <u>(210)-496-2668</u>		_FAX#_	(210)-496	-2668
SAWS BLOCK MAP# 72602	_TOTAL EDI	)'S <u>86</u>	_ TOTAL ACR	EAGE <u>17.12</u> 5
TOTAL LINEAR FOOTAGE OF	PIPE:12"-10	26 LF <u>8 LF</u>	PLAT NO. 22	<u>2–11800298</u>
NUMBER OF LOTS 86	SAWS	JOB NO	). 22-1143	

SEWER: MEDIO CREEK WATERSHED - MEDIO CREEK W.R.C.

Γ	
	DEVELOPER'S NAME: CONTINENTAL HOMES OF TEXAS, L.P.
	ADDRESS: 5419 N LOOP 1604 E
	CITY: SAN ANTONIO STATE: TX ZIP: 78218
	PHONE# <u>(210)-496-2668</u> FAX# <u>(210)-496-2668</u>
	SAWS BLOCK MAP# 74602 TOTAL EDU'S 86 TOTAL ACREAGE 17.125
	TOTAL LINEAR FOOTAGE OF PIPE:8" 3,688.88 LF PLAT NO.22-11800298
	NUMBER OF LOTS 86 SAWS JOB NO. 22-1637

				F	IVERSTON	E UNIT F1 - F	PROPOOSE	D CONDIT	IONS DRAI	NAGE SUMN	1ARY TABI	.E									
						Ov	erland Flov	N		SI	nallow Coi	ncentrated		Channel	Flow (6 fps)	Total					
Point	Structure	Area	Total Flow Length (ft)	Total Area (ac)	n-Value	Character of Ground	Slope %	L (ft)	Tc (min)	Slope %	L (ft)	Surface	Tc (min)	L (ft)	Tc (min)	Tc (min)	С	I	Q (cfs)	Frequency (yrs)	
1	Street Capacity Check Leon River Ridge	А	1368	4.31	0.3	Avg. Grass	2.52%	100	12	3.50%	317	Unpaved	1.7	951	2.6	16	0.72	5.10 7.07	15.8 <b>21.9</b>	5 <b>25</b>	
_	Street Capacity Check	_							1.5									8.79 5.28	27.3	5	
2	Mudstone Creek	В	961	5.84	0.3	Avg. Grass	2.00%	100	12	2.00%	152	Unpaved	1.1	709	2.0	15	0.72	7.32 9.12	<b>30.8</b> 38.3	<b>25</b> 100	
3	Intersection Check	С	383	1.07	0.3	Avg. Grass	2.00%	100	12	2.00%	33	Unpaved	0.2	250	0.7	12	0.72	5.86 8.19	4.5 <b>6.3</b>	5 <b>25</b>	
																			10.24	7.9	100
	D : A	<b>D</b>	1127	2 20			0.500/	100	4.7	2.500/	054	]	1.6	176	0.5	22	0.72	4.33	10.3	5	
4	Drain A	D	1127	3.30	0.3	Avg. Grass	0.50%	100	17	3.50%	851	Unpaved	4.6	176 0.5	22	22	22	0.72	5.98 7.41	<b>14.2</b> 17.6	<b>25</b>

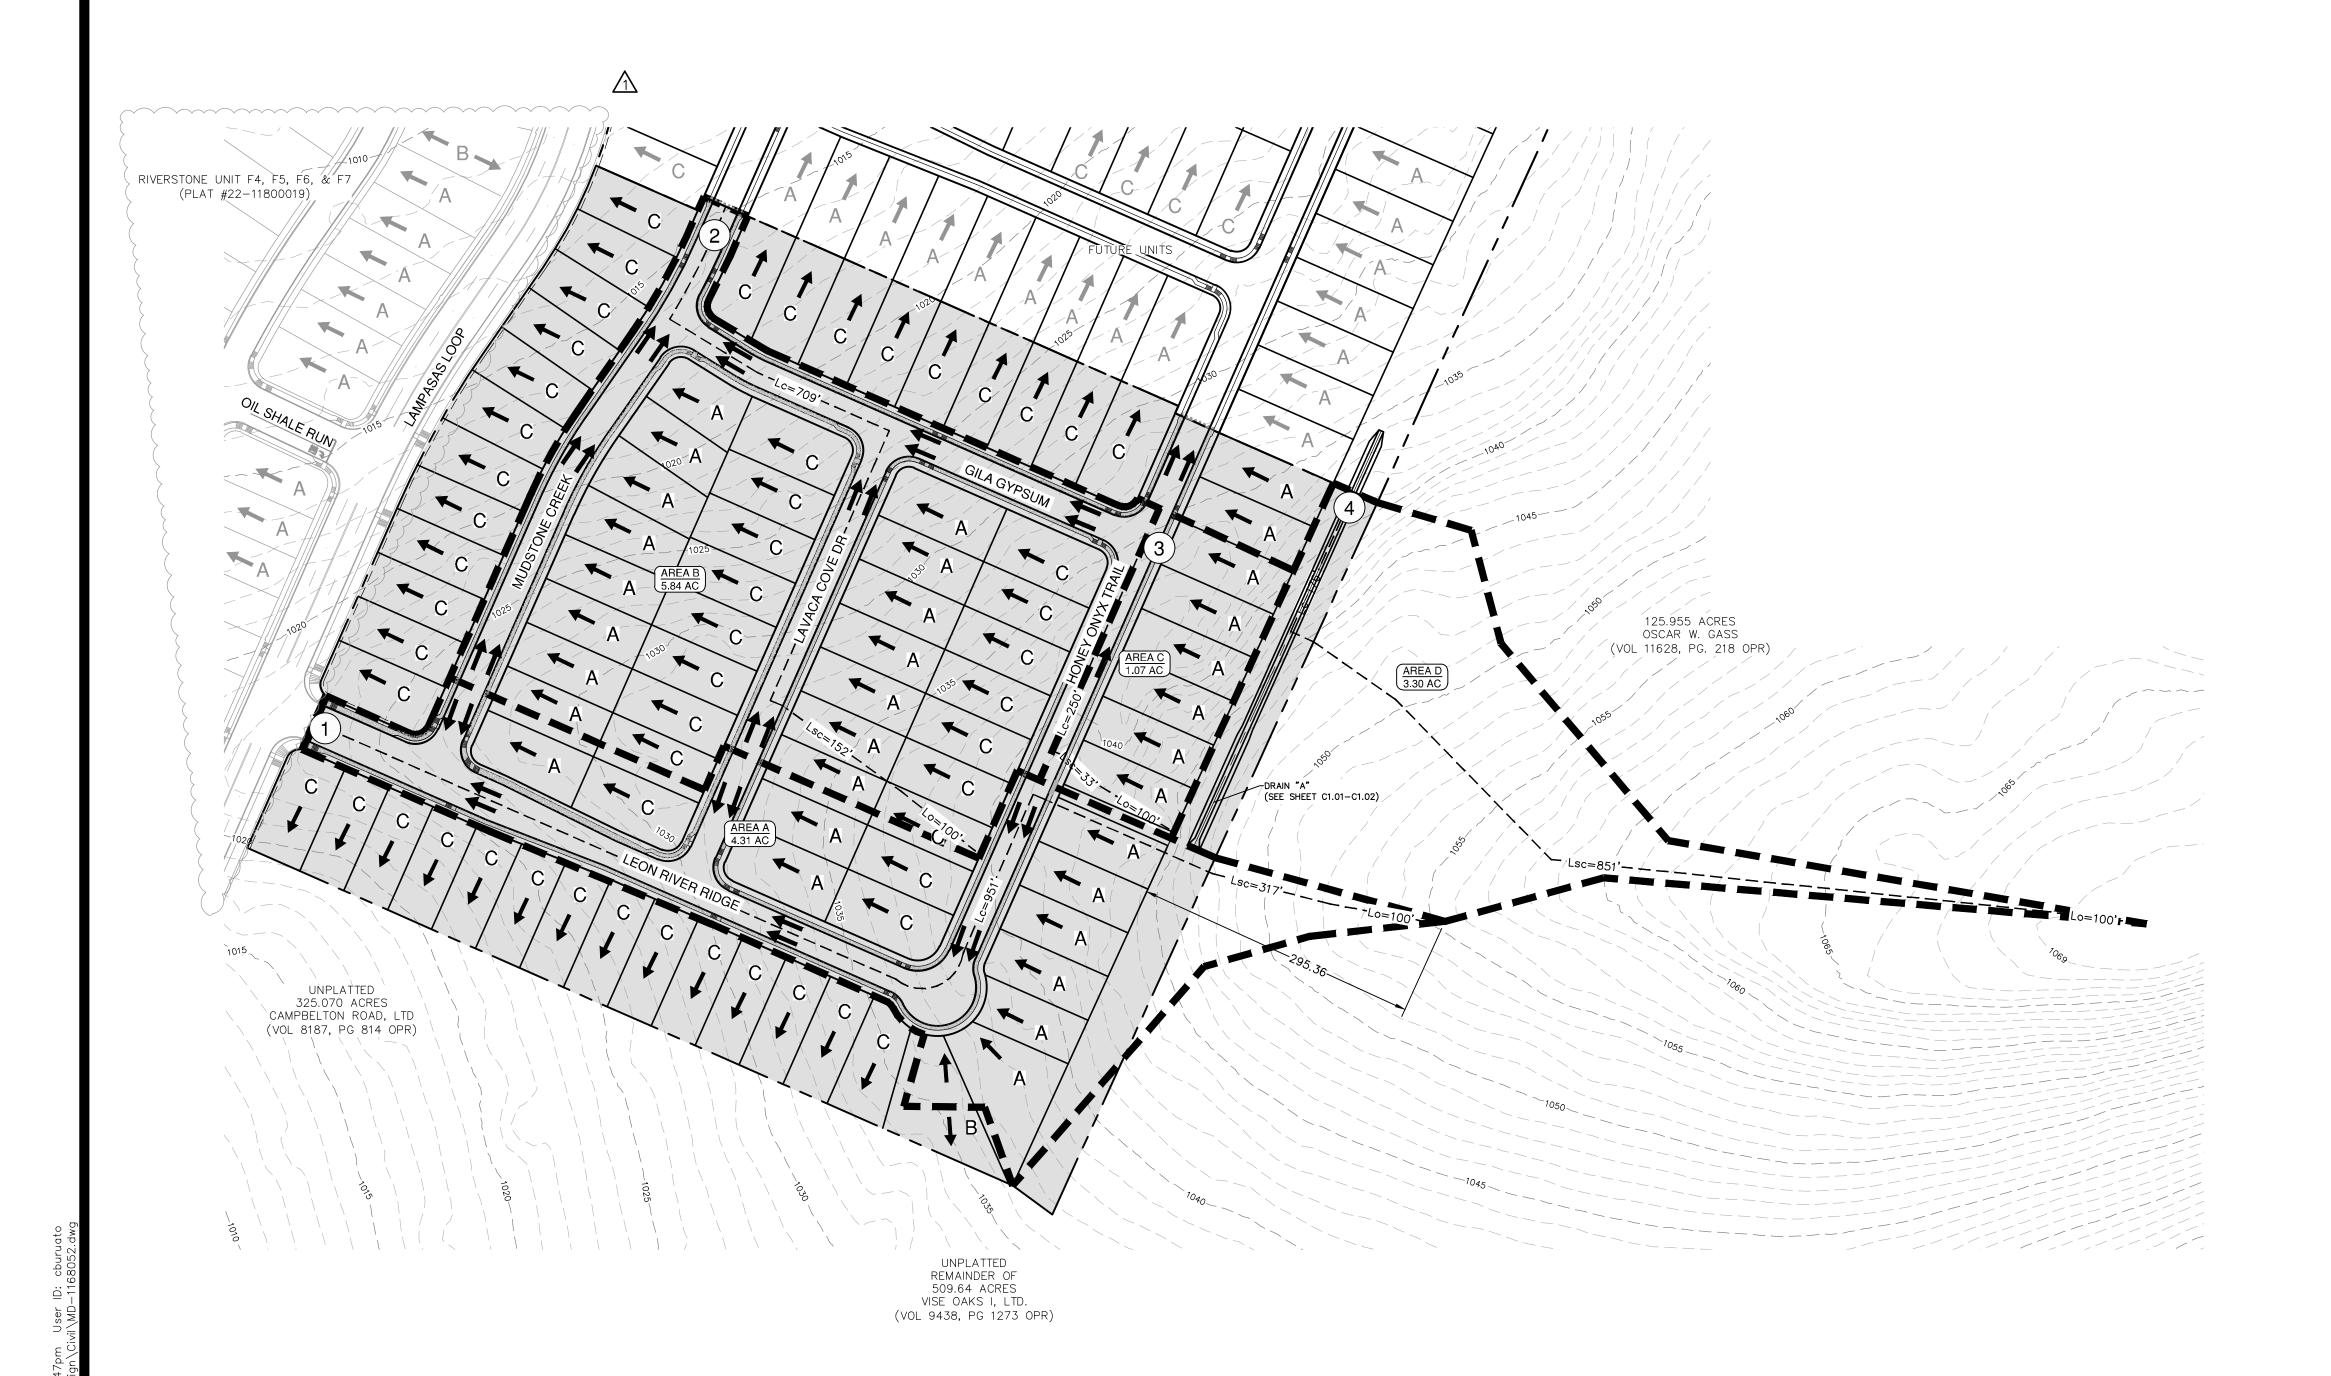

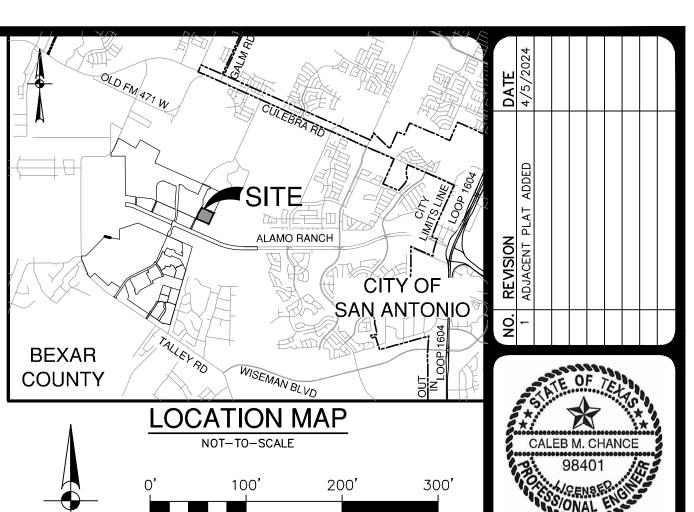

#### MASTER DRAINAGE LEGEND


PROJECT LIMITS EXISTING CONTOUR 100 YR FLOODPLAIN RUNOFF FLOW PATH DRAINAGE AREA BOUNDARY A,B,CFHA LOT GRADING TYPE PROPOSED DIRECTION OF FLOW 11 A DRAINAGE CALCULATION POINT DRAINAGE AREA


SCALE: 1"= 100'

**8**0


RIVERSTONE L SAN ANTONIO, 1

PLAT NO. 22-11800298 JOB NO. 11680-52 DESIGNER\_\_\_\_

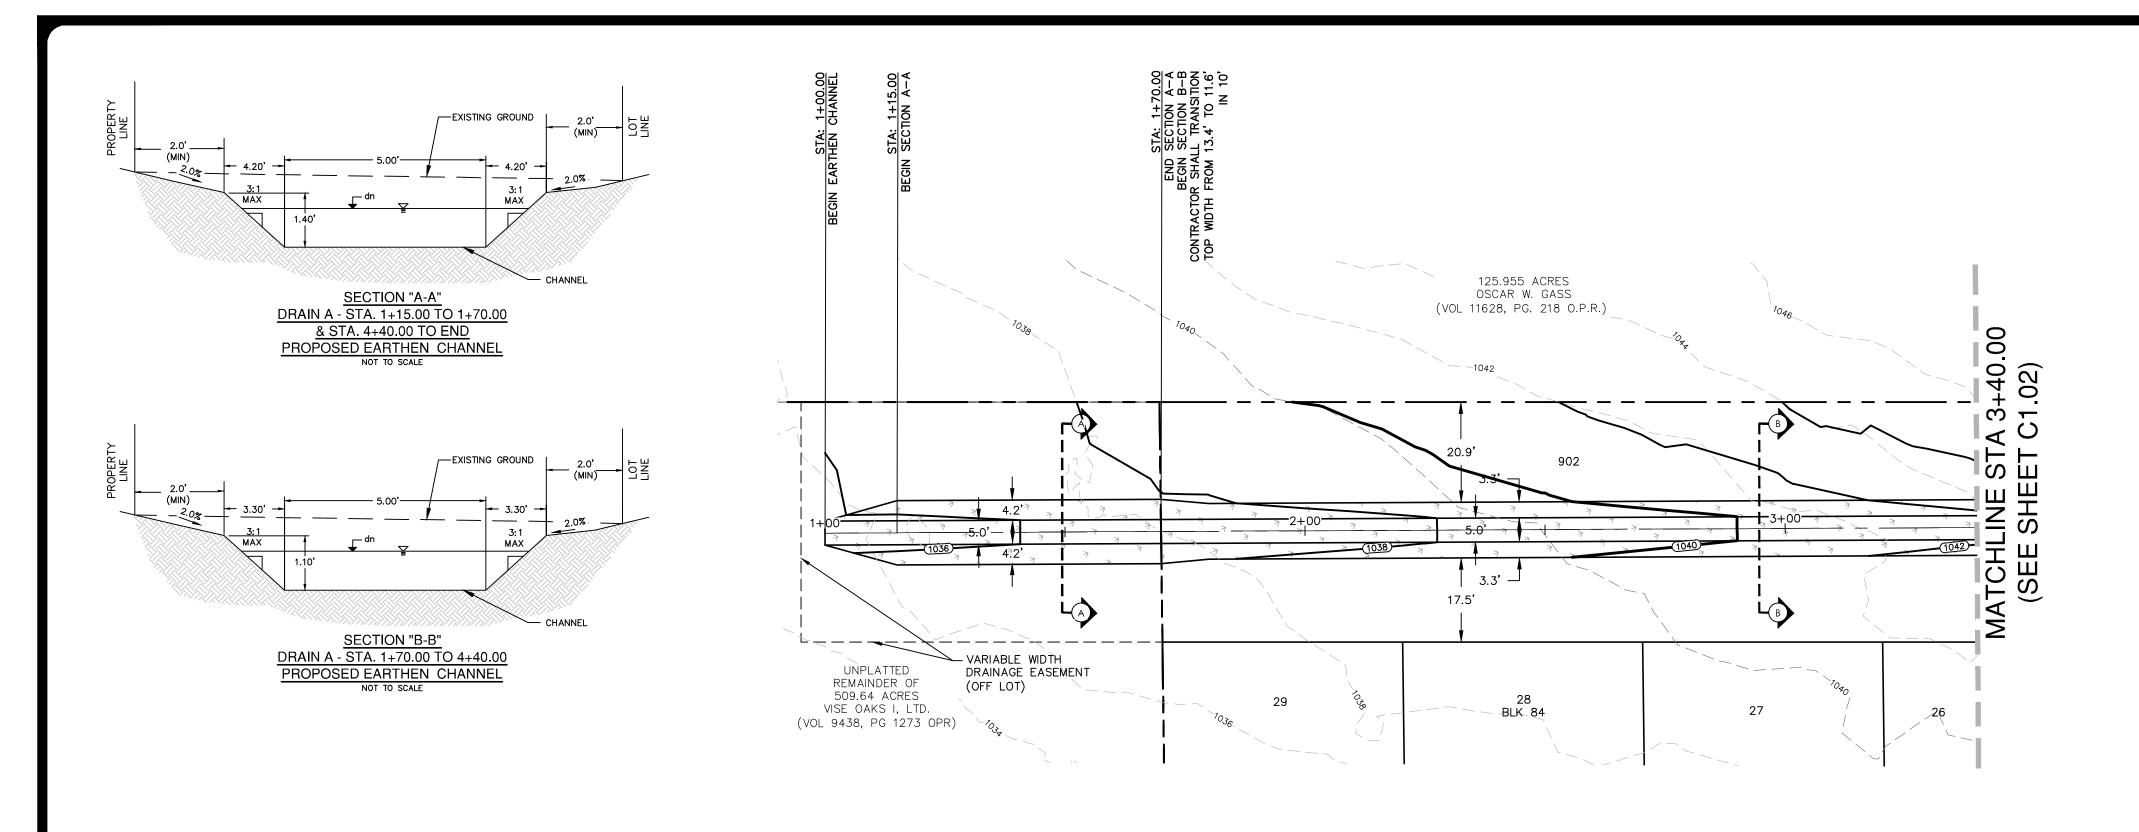


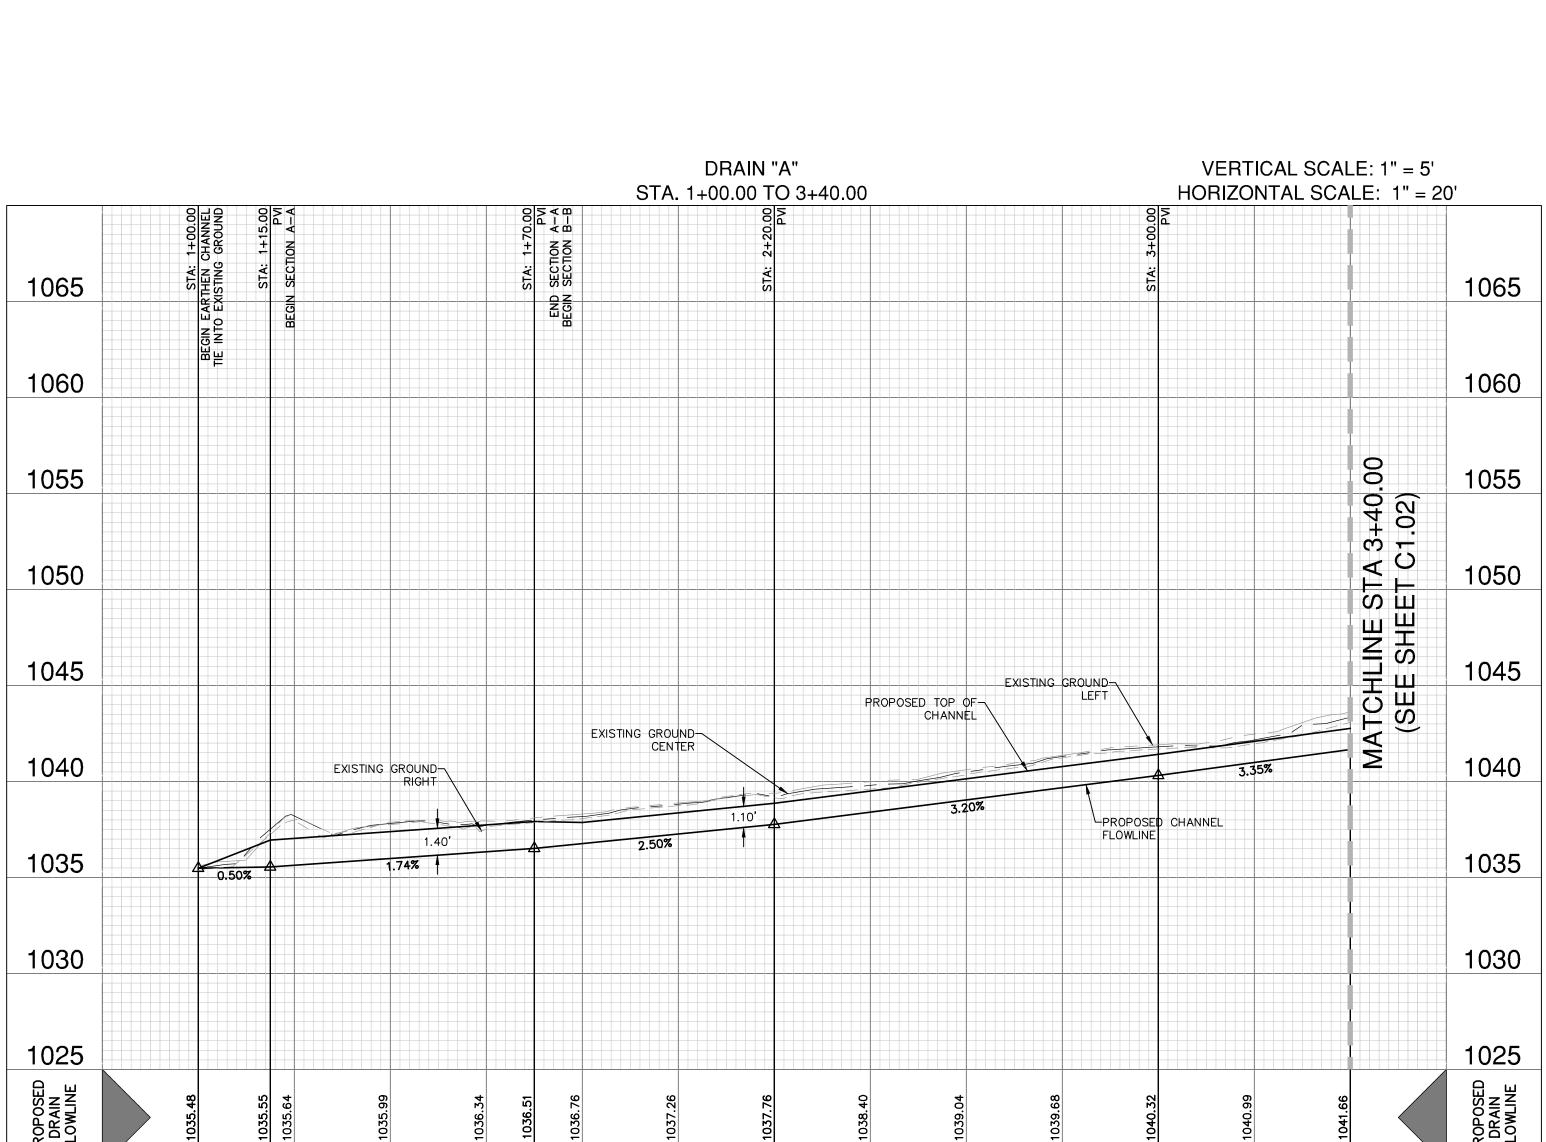





#### DRAINAGE LEGEND

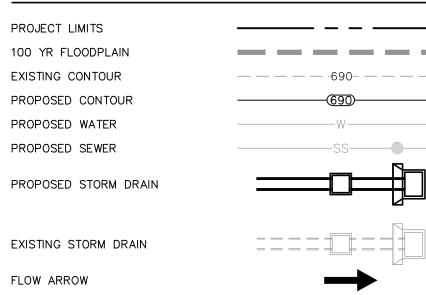

**HYDRAULIC** CALCULATIONS EARTHEN CHANNEL STA. 1+00.00 TO 1+15.00

Q25 = 14.2 cfsBw = 5'n = 0.035S = 0.50%D = 1.40'

dn = 0.86'

V = 2.19 fps

Q25 = 14.2 cfsBw = 5n = 0.035S = 1.74%D = 1.40'dn = 0.61

HYDRAULIC

CALCULATIONS

**EARTHEN CHANNE** 

STA. 1+15.00 TO 1+70.00

HYDRAULIC CALCULATIONS **EARTHEN CHANNEL** STA. 1+70.00 TO 2+20.00 Q25 = 14.2 cfsBw = 5'n = 0.035S = 2.50%D = 1.10'dn = 0.55V = 3.85 fps

#### <u>HYDRAULIC</u> **CALCULATIONS** EARTHEN CHANNEL STA. 2+20.00 TO 3+00.00

Q25 = 14.2 cfsBw = 5'n = 0.035S = 3.20%D = 1.10'dn = 0.52'

V = 4.19 fps

CALCULATIONS **EARTHEN CHANNEL** STA. 3+00.00 TO 3+70.00 Q25 = 14.2 cfsBw = 5'n = 0.035S = 3.35%D = 1.10'dn = 0.51'V = 4.26 fps

<u>HYDRAULIC</u>

#### **DRAINAGE & GRADING NOTES:**

- 1. A BEXAR COUNTY ROW PERMIT MUST BE OBTAINED BEFORE WORKING IN BEXAR COUNTY ROW. CONTRACTOR SHALL COORDINATE A TRAFFIC CONTROL PLAN FOR ALL WORK WITHIN THE ROW. ADDITIONAL WARNING SIGNS MAY BE RECOMMENDED BY THE ENGINEER ONCE THE ROADWAYS ARE CONSTRUCTED.
- 2. THE CONTRACTOR WILL BE RESPONSIBLE FOR DETERMINING EXACT LOCATION OF ALL UTILITIES AND DRAINAGE STRUCTURES WHETHER SHOWN ON THE PLANS OR NOT. THE CONTRACTOR SHALL UNCOVER EXISTING UTILITIES PRIOR TO CONSTRUCTION TO VERIFY SIZE, GRADE, AND LOCATION. THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY OF ANY DEVIATIONS FROM PLANS PRIOR TO BEGINNING CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES, WHETHER SHOWN ON THE PLANS OR NOT, SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO REPAIR, AT HIS EXPENSE.
- 3. ALL CONCRETE FOR TXDOT DRAINAGE STRUCTURES SHALL MEET TXDOT SPECIFICATIONS. ALL OTHER CONCRETE SHALL BE CLASS "A" 3000 PS CYLINDER STRENGTH IN 28 DAYS.
- CULVERT, HEADWALL, AND WINGWALL CONSTRUCTION DETAILS, AND BOX CULVERT BEDDING AND EXCAVATION LIMITS. CONTRACTOR SHALL GROUT ALL CURB INLETS AND JUNCTION BOXES TO PROVIDE FOR POSITIVE DRAINAGE.
- 6. EARTHEN CHANNELS WILL BE VEGETATED BY SEEDING OR SODDING. 85% OF THE CHANNEL SURFACE MUST HAVE ESTABLISHED VEGETATION
- BEFORE THE CITY OF SAN ANTONIO WILL ACCEPT. 7. CONTRACTOR SHALL MATCH TOP OF CHANNEL TO NATURAL GROUND AND MAINTAIN A MINIMUM CHANNEL DEPTH OF "D" AS SHOWN IN THE

#### TRENCH EXCAVATION SAFETY PROTECTION:

CONTRACTOR AND/ OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN / GEOTECHNICAL / SAFETY / EQUIPMENT CONSULTANT. IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN TH PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND /O PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFÉTY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OF CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

#### CAUTION!!

CONTRACTOR SHALL BE REQUIRED TO LOCATE ALL PUBLIC OR PRIVATE UTILITIES INCLUDING BUT NOT LIMITING TO: WATER, SEWER, TELEPHONE AND FIBER OPTIC LINES, SITE LIGHTING ELECTRIC, SECONDARY ELECTRIC, PRIMARY

4. REFERENCE DRAINAGE DETAILS FOR PIPE TRENCH DETAILS, BO

_AT NO.	22-11800298
)B NO	11680-52
ATE	MAY 2022
SIGNER_	СВ
HECKED_	BL DRAWN CB

C1.01

1+80

1+40

1+60


2+20 2+40 2+60 2+80 3+00


2+00

ELECTRICAL DUCTBANKS, LANDSCAPE IRRIGATION FACILITIES, AND GAS LINES. ANY UTILITY CONFLICTS THAT ARISE SHOULD BE COMMUNICATED TO TH ENGINEER IMMEDIATELY AND PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL CONTACT 1-800-DIG-TESS A MINIMUM OF 48 HOURS PRIOR TO TH START OF CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THE REPAIR SHALL B AT CONTRACTOR'S SOLE EXPENSE WHETHER THE UTILITY IS SHOWN ON THESE PLANS OR NOT.


CALEB M. CHANCE

O

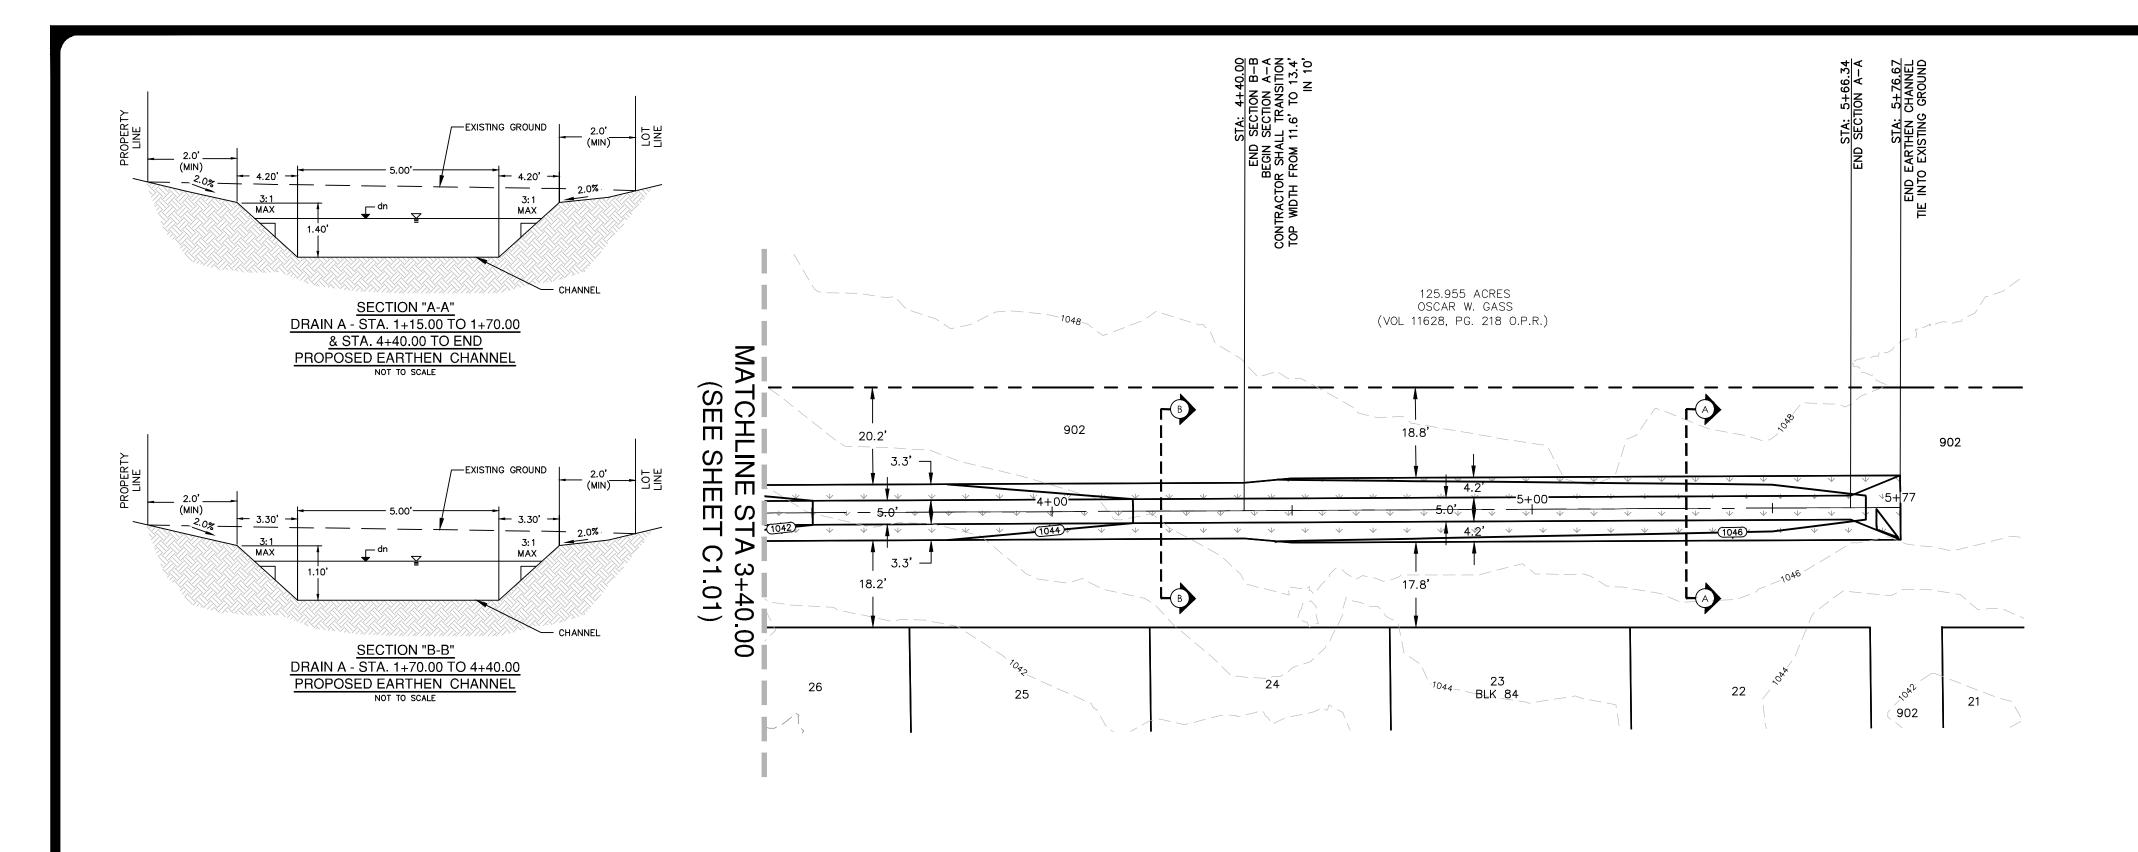


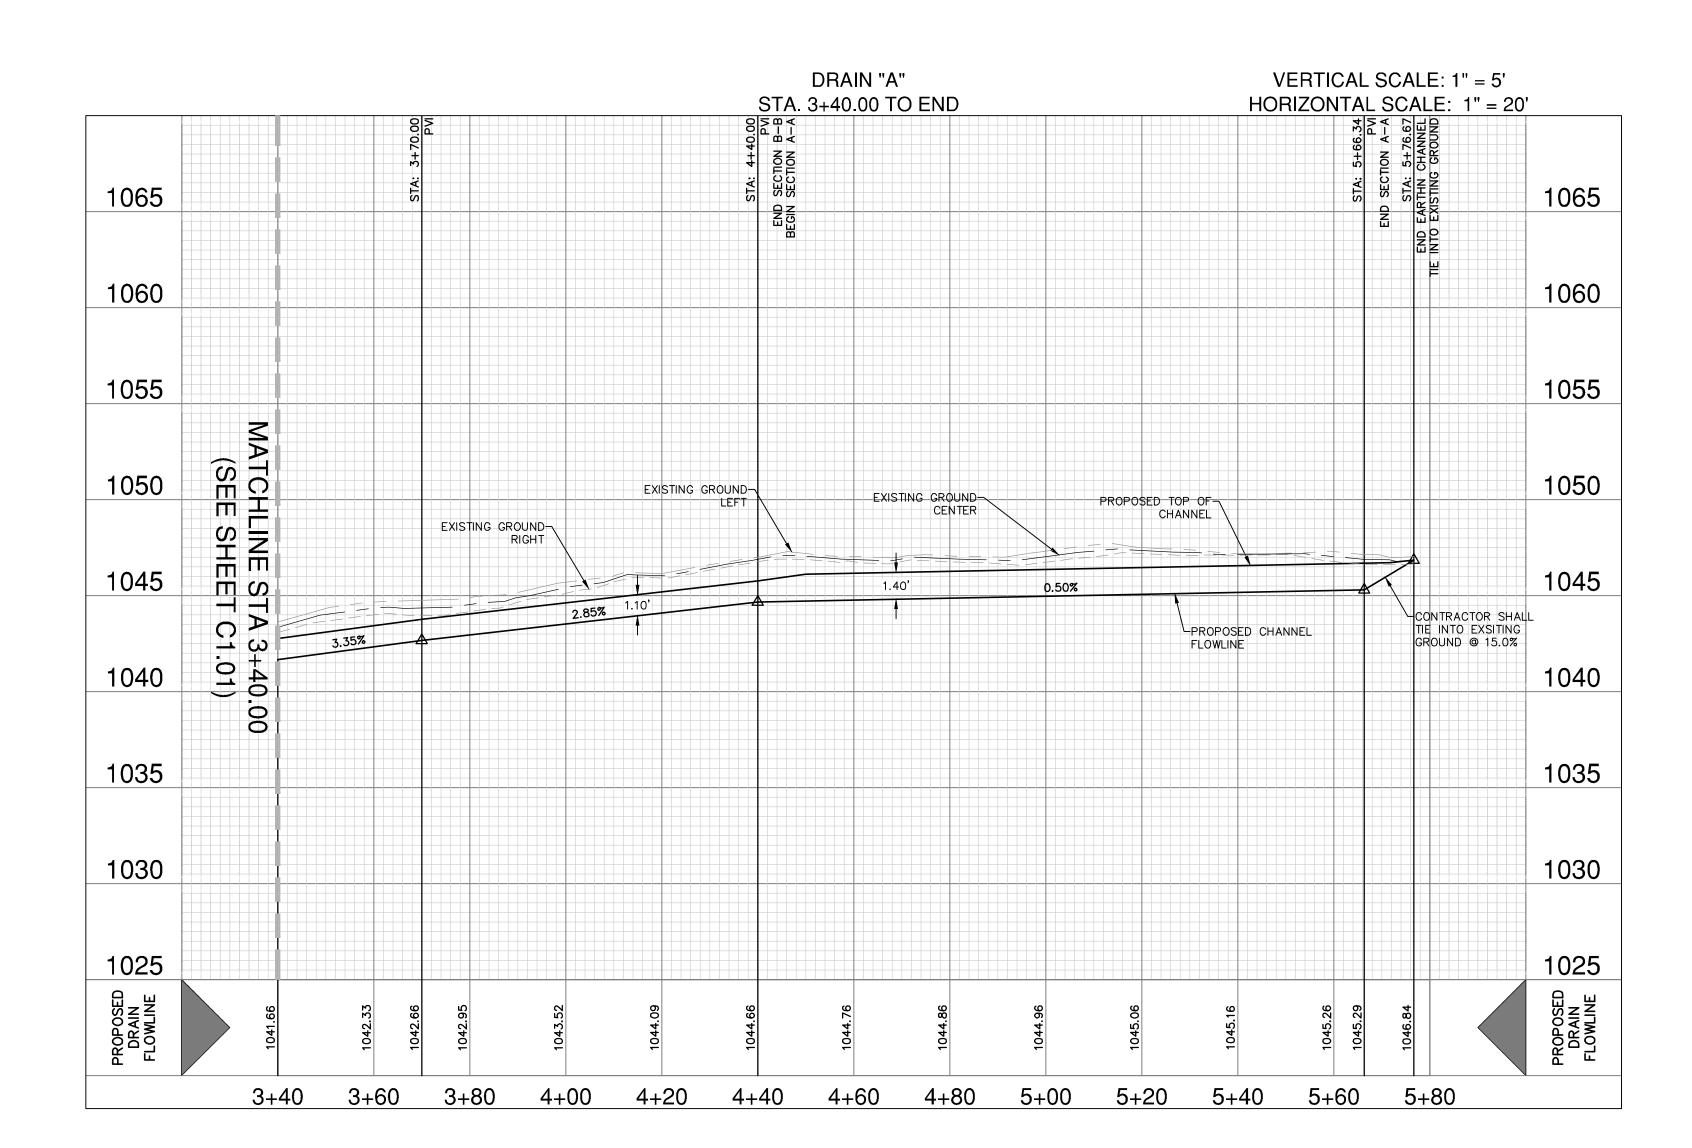





#### DRAINAGE LEGEND

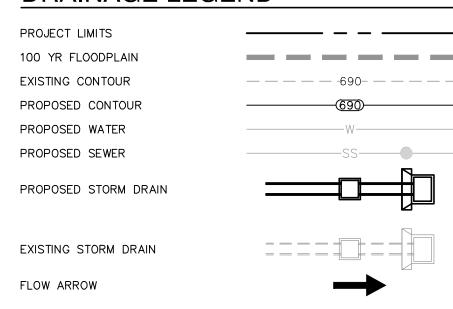



0

**HYDRAULIC** CALCULATIONS **EARTHEN CHANNEL** STA. 3+00.00 TO 3+70.00

Q25 = 14.2 cfsn = 0.035S = 3.35%

D = 1.10'dn = 0.51'V = 4.26 fps

EARTHEN CHANNEL STA. 3+70.00 TO 4+40.00 Q25 = 14.2 cfsBw = 5'n = 0.035S = 2.85%D = 1.10'dn = 0.53V = 4.03 fps

HYDRAULIC CALCULATIONS

#### HYDRAULIC CALCULATIONS EARTHEN CHANNEL STA. 4+40.00 TO 5+66.34

Q25 = 14.2 cfsBw = 5'n = 0.035S = 0.50%D = 1.40'dn = 0.86V = 2.19 fps

#### **DRAINAGE & GRADING NOTES:**

- 1. A BEXAR COUNTY ROW PERMIT MUST BE OBTAINED BEFORE WORKING IN BEXAR COUNTY ROW. CONTRACTOR SHALL COORDINATE A TRAFFIC CONTROL PLAN FOR ALL WORK WITHIN THE ROW. ADDITIONAL WARNING SIGNS MAY BE RECOMMENDED BY THE ENGINEER ONCE THE ROADWAYS ARE CONSTRUCTED.
- 2. THE CONTRACTOR WILL BE RESPONSIBLE FOR DETERMINING EXACT LOCATION OF ALL UTILITIES AND DRAINAGE STRUCTURES WHETHER SHOWN ON THE PLANS OR NOT. THE CONTRACTOR SHALL UNCOVER EXISTING UTILITIES PRIOR TO CONSTRUCTION TO VERIFY SIZE, GRADE, AND LOCATION. THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY OF ANY DEVIATIONS FROM PLANS PRIOR TO BEGINNING CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES, WHETHER SHOWN ON THE PLANS OR NOT, SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO REPAIR, AT HIS EXPENSE.
- 3. ALL CONCRETE FOR TXDOT DRAINAGE STRUCTURES SHALL MEET TXDOT SPECIFICATIONS. ALL OTHER CONCRETE SHALL BE CLASS "A" 3000 PS CYLINDER STRENGTH IN 28 DAYS.
- CULVERT, HEADWALL, AND WINGWALL CONSTRUCTION DETAILS, AND BOX CULVERT BEDDING AND EXCAVATION LIMITS.
- CONTRACTOR SHALL GROUT ALL CURB INLETS AND JUNCTION BOXES TO PROVIDE FOR POSITIVE DRAINAGE.
- 6. EARTHEN CHANNELS WILL BE VEGETATED BY SEEDING OR SODDING 85% OF THE CHANNEL SURFACE MUST HAVE ESTABLISHED VEGETATION BEFORE THE CITY OF SAN ANTONIO WILL ACCEPT.
- 7. CONTRACTOR SHALL MATCH TOP OF CHANNEL TO NATURAL GROUND AND MAINTAIN A MINIMUM CHANNEL DEPTH OF "D" AS SHOWN IN THE

#### TRENCH EXCAVATION SAFETY PROTECTION:

CONTRACTOR AND/ OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN / GEOTECHNICAL / SAFETY / EQUIPMENT CONSULTANT. IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN TH PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND /O PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFÉTY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OF CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.


#### CAUTION!!


CONTRACTOR SHALL BE REQUIRED TO LOCATE ALL PUBLIC OR PRIVATE UTILITIES INCLUDING BUT NOT LIMITING TO: WATER, SEWER, TELEPHONE AND FIBER OPTIC LINES, SITE LIGHTING ELECTRIC, SECONDARY ELECTRIC, PRIMARY ELECTRICAL DUCTBANKS, LANDSCAPE IRRIGATION FACILITIES, AND GAS LINES. ANY UTILITY CONFLICTS THAT ARISE SHOULD BE COMMUNICATED TO TH ENGINEER IMMEDIATELY AND PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL CONTACT 1-800-DIG-TESS A MINIMUM OF 48 HOURS PRIOR TO TH START OF CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES SHALL B THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THE REPAIR SHALL B AT CONTRACTOR'S SOLE EXPENSE WHETHER THE UTILITY IS SHOWN ON THESE PLANS OR NOT.


4. REFERENCE DRAINAGE DETAILS FOR PIPE TRENCH DETAILS, BO


<sub>r NO.</sub> 22-11800298 11680-52 DESIGNER CB

CHECKED BL DRAWN CB C1.02

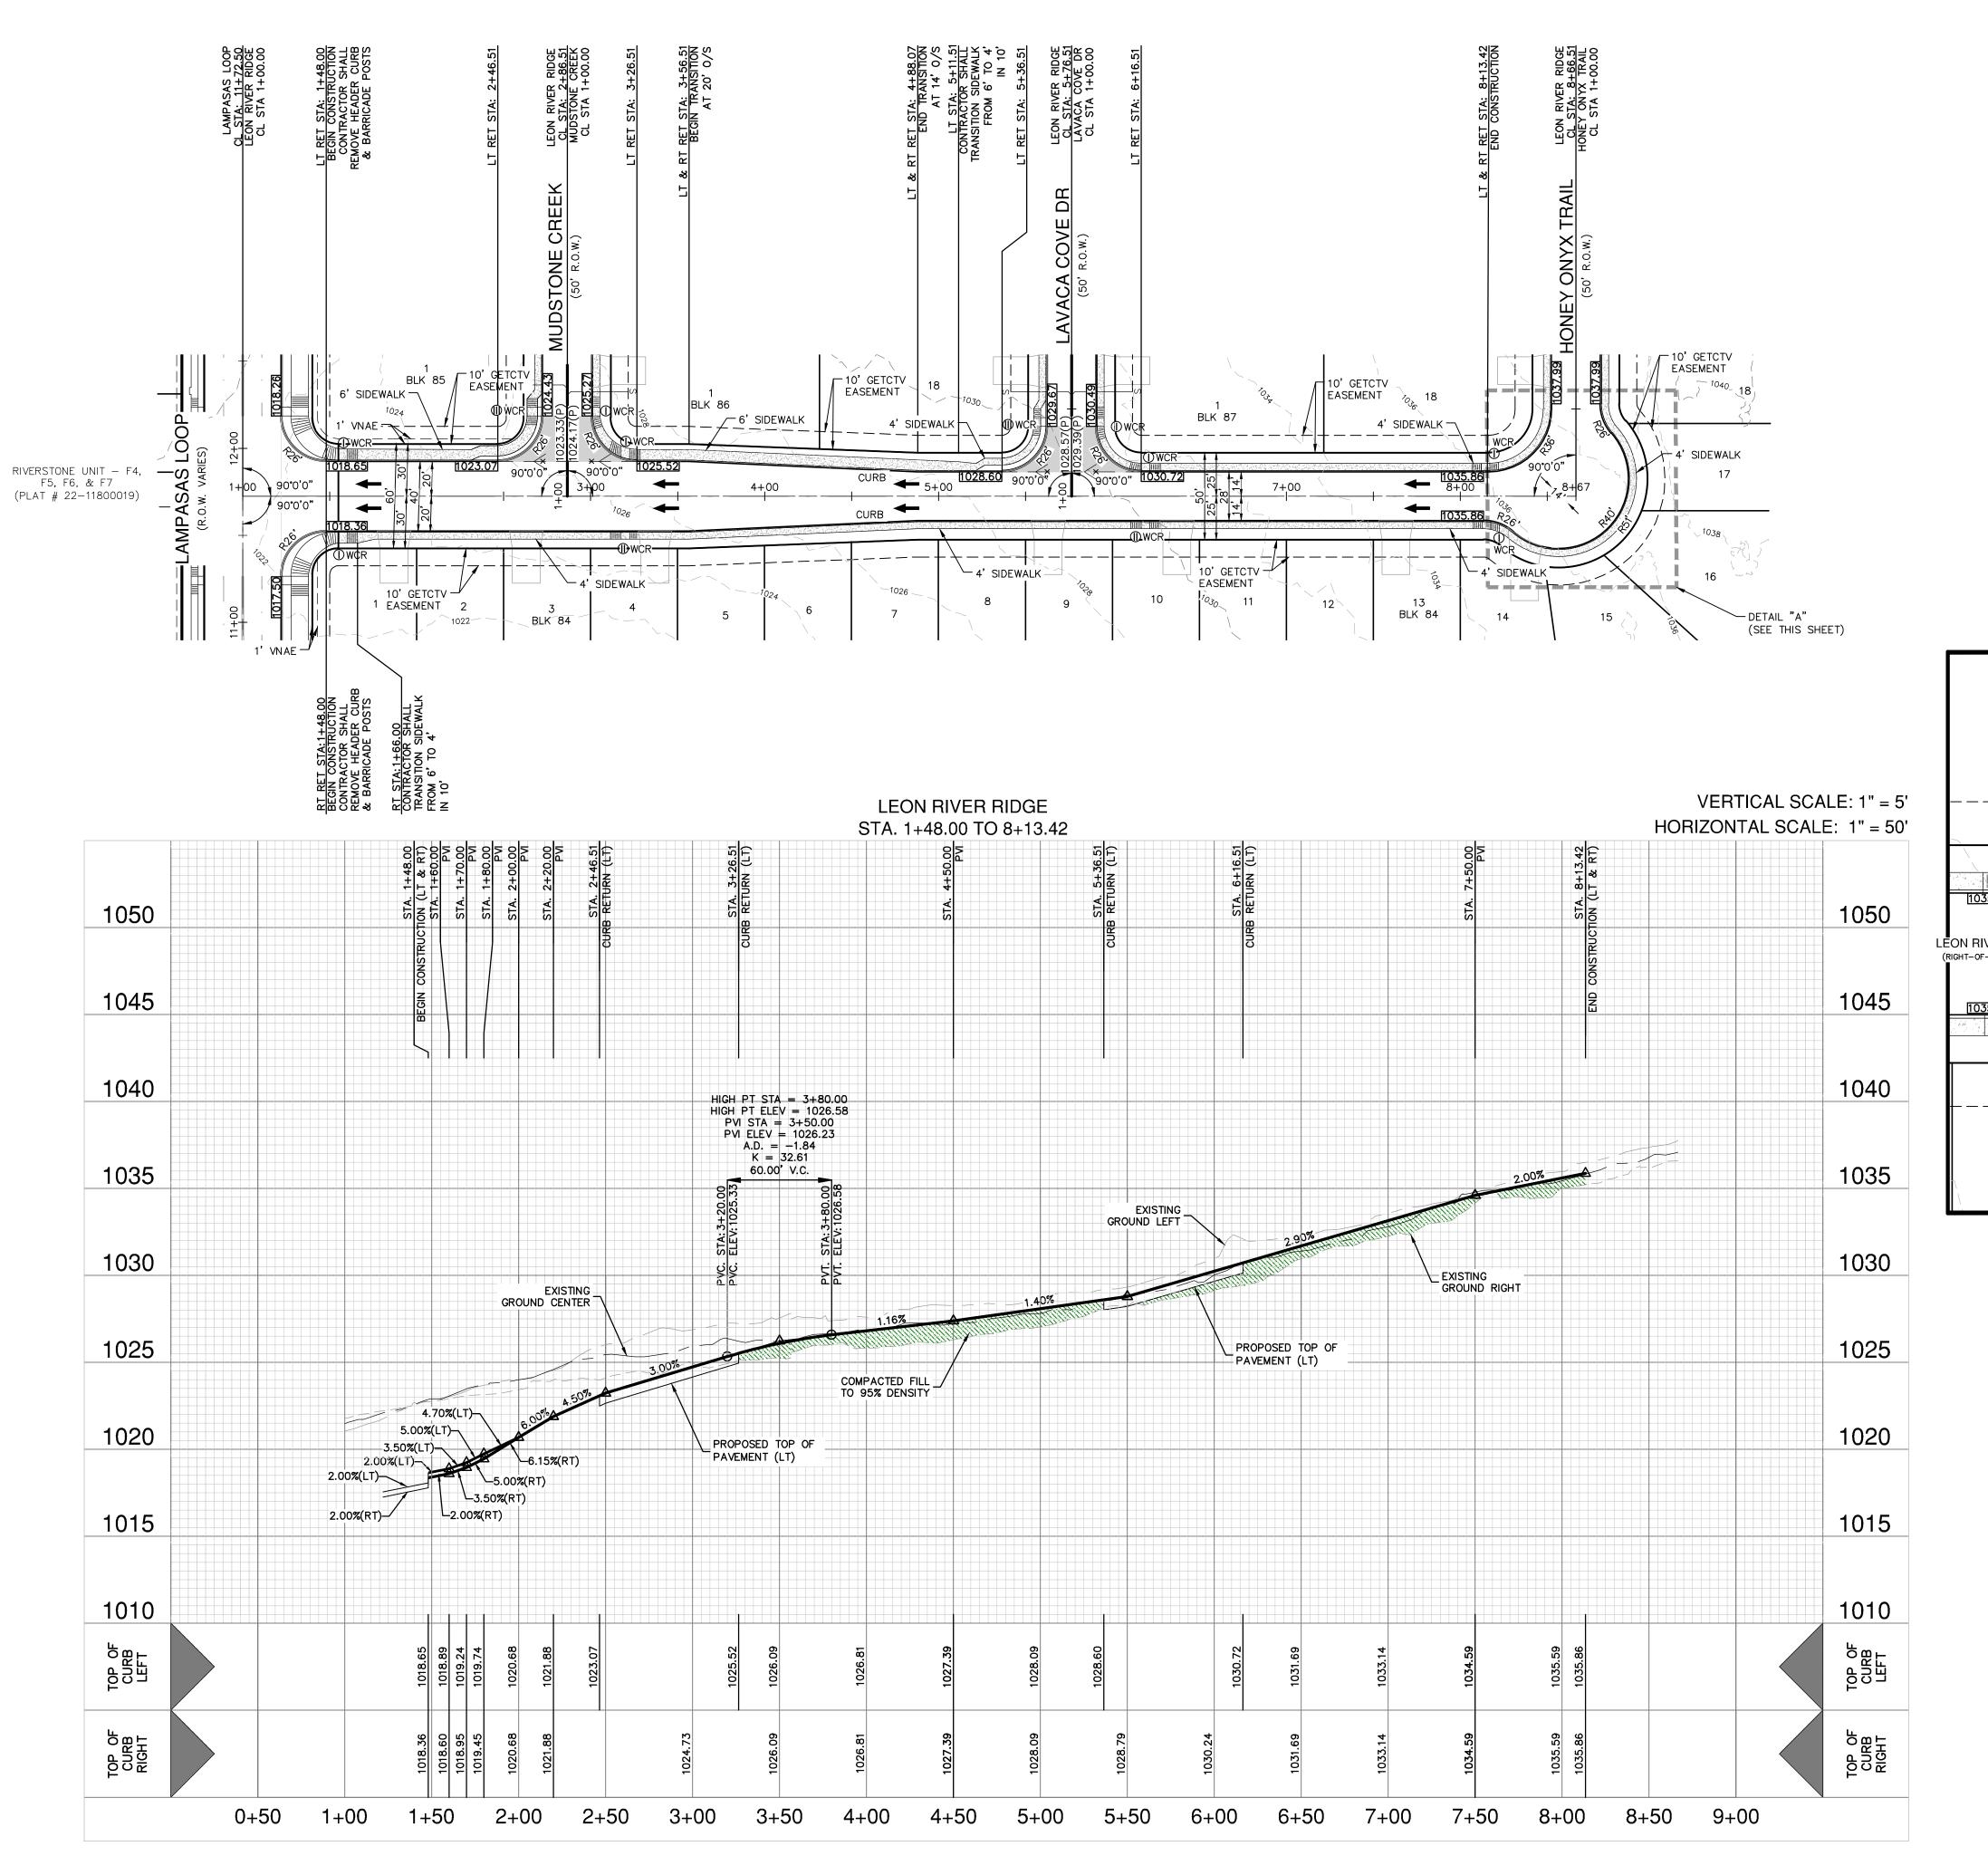


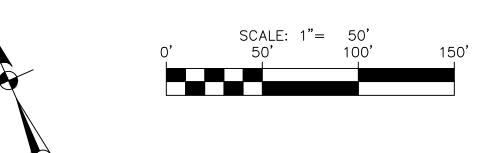

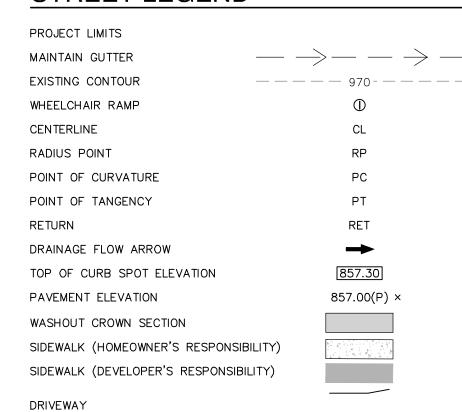



PAPE-DAWSON ENGINEERS

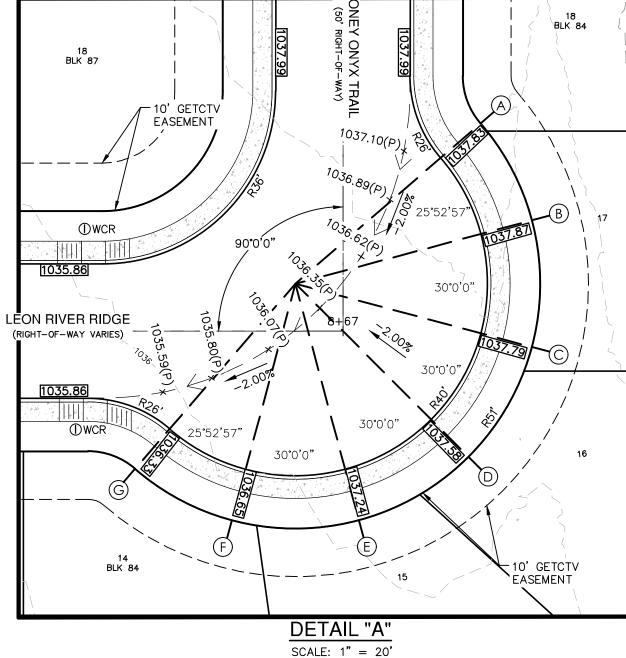

#### STREET NOTES:

- 1. A BEXAR COUNTY ROW PERMIT MUST BE OBTAINED BEFORE WORKING IN BEXAR COUNTY ROW. CONTRACTOR SHALL COORDINATE A TRAFFIC CONTROL PLAN FOR ALL WORK WITHIN THE ROW. ADDITIONAL WARNING SIGNS MAY BE RECOMMENDED BY THE ENGINEER ONCE THE ROADWAYS ARE CONSTRUCTED.
- 2. CONTRACTOR SHALL MATCH EXISTING PAVEMENT AT TIE—IN. IF EXISTING PAVEMENT ELEVATION DIFFERS SIGNIFICANTLY, CONTRACTOR SHALL NOTIFY THE ENGINEER PRIOR TO CONTINUING WORK.
- 3. SIDEWALKS SHALL BE CONSTRUCTED 3—FT FROM THE BACK OF CURB FOR ALL LOCATIONS WHERE THE SIDEWALK IS SHOWN OFFSET. REFER TO STREET DETAIL SHEET FOR SIDEWALK AND RAMP DETAILS.
- 4. NO PERMANENT STRUCTURES HIGHER THAN 3 FEET, AND LOWER THAN 8 FEET ABOVE THE PAVEMENT, INCLUDING STRUCTURES, WALLS, FENCES, AND VEGETATION, SHALL BE CONSTRUCTED OR ALLOWED WITHIN THE CLEAR VISION EASEMENT. CONTRACTOR SHALL GRADE AREAS WITHIN CLEAR VISION EASEMENTS SUCH THAT THE ELEVATION WITHIN THE CLEAR VISION EASEMENT IS NOT HIGHER THAN 3 FEET ABOVE THE ADJACENT TOP OF PAVEMENT.
- 5. DRIVEWAYS SHOWN ON THIS PLAN ARE FOR THE SOLE PURPOSE OF INDICATING A POTENTIAL CONFLICT WITH CURB RAMP, DRAINAGE INFRASTRUCTURE, OR OTHER CONFLICT. DRIVEWAY LOCATION IS SUBJECT TO CHANGE BASED ON HOME SELECTION AND FINAL LOT DESIGN.
- 6. CHANGES IN THE SIDEWALK LOCATION FOR A MAXIMUM LINEAR DISTANCE OF TWO HUNDRED (200) FEET ARE PERMITTED TO BE APPROVED BY THE FIELD INSPECTOR WITHOUT AMENDING THE STREET PLAN OR UTILITY LAYOUT PER UDC SECTION 35-506 (Q)(6).

IVERSTONE SAN ANTONIO AN + 4

RIDGE PL/ +48.00 TO


PLAT NO. 22-11800298


JOB NO. 11680-52

DATE MAY 2022

DESIGNER CB

CHECKED BL DRAWN CB
SHEET C2.00

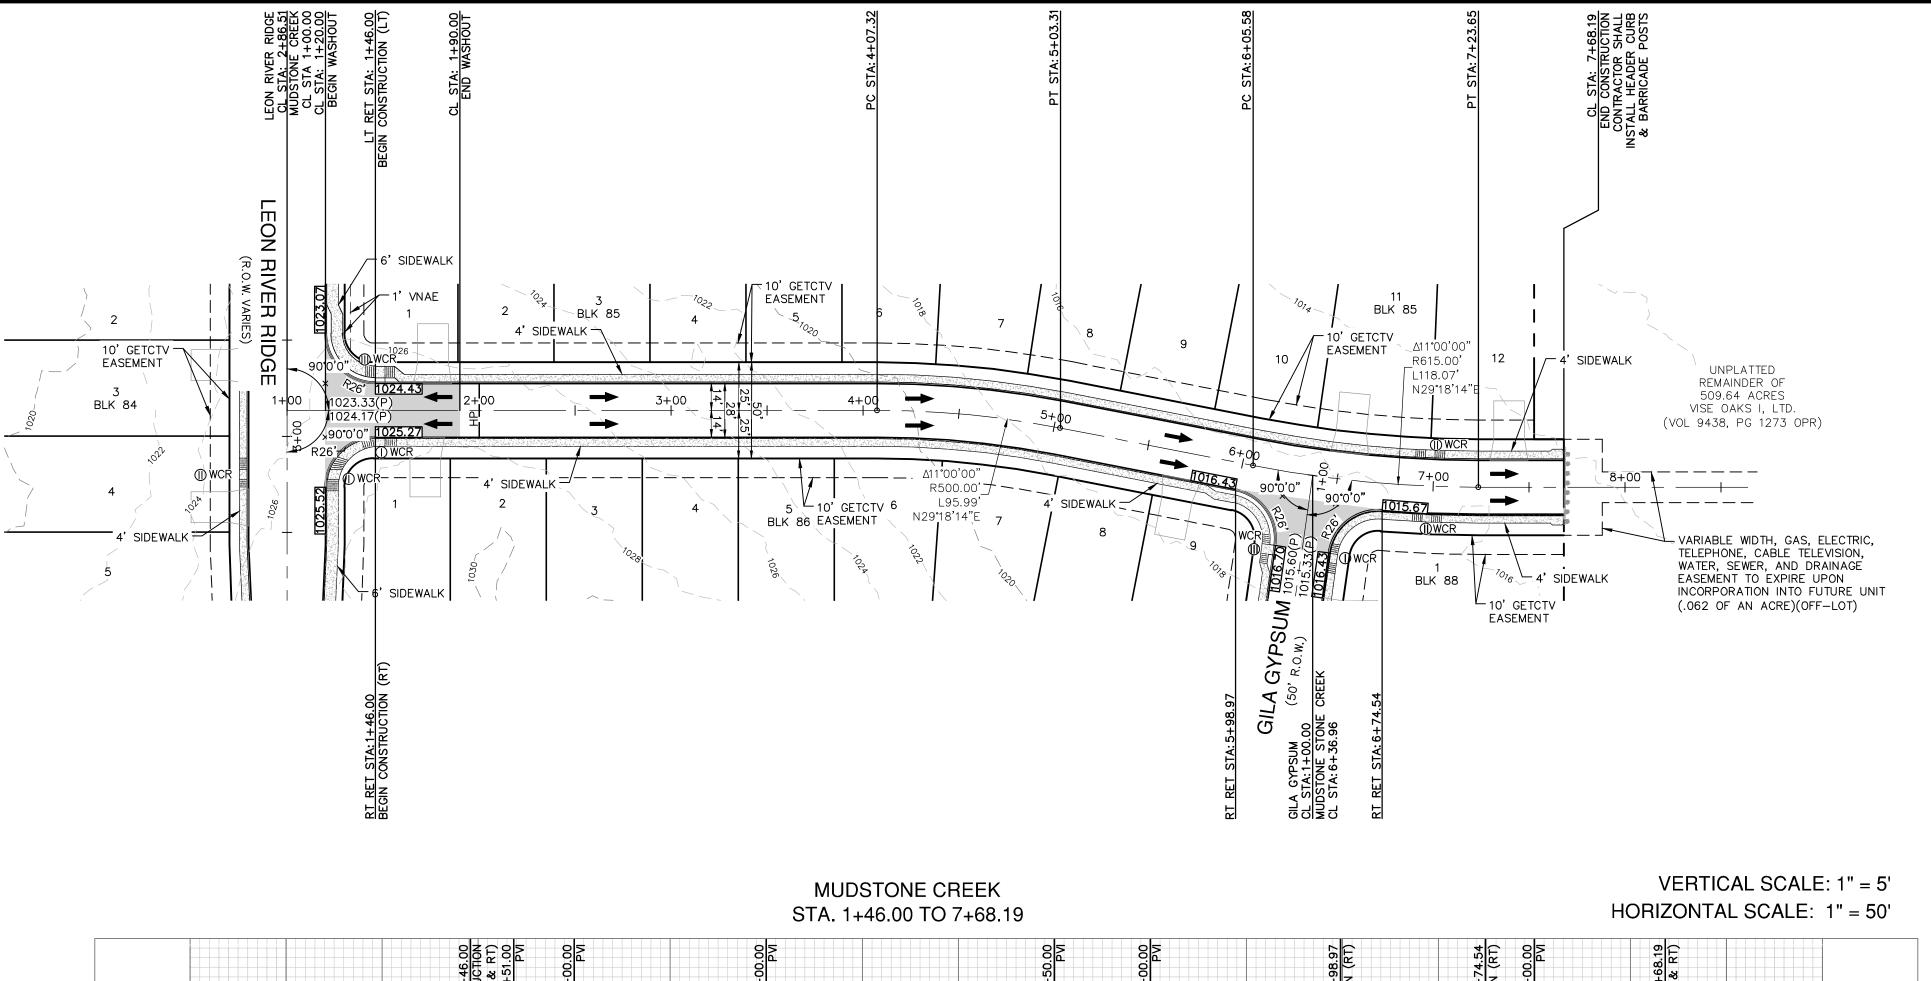

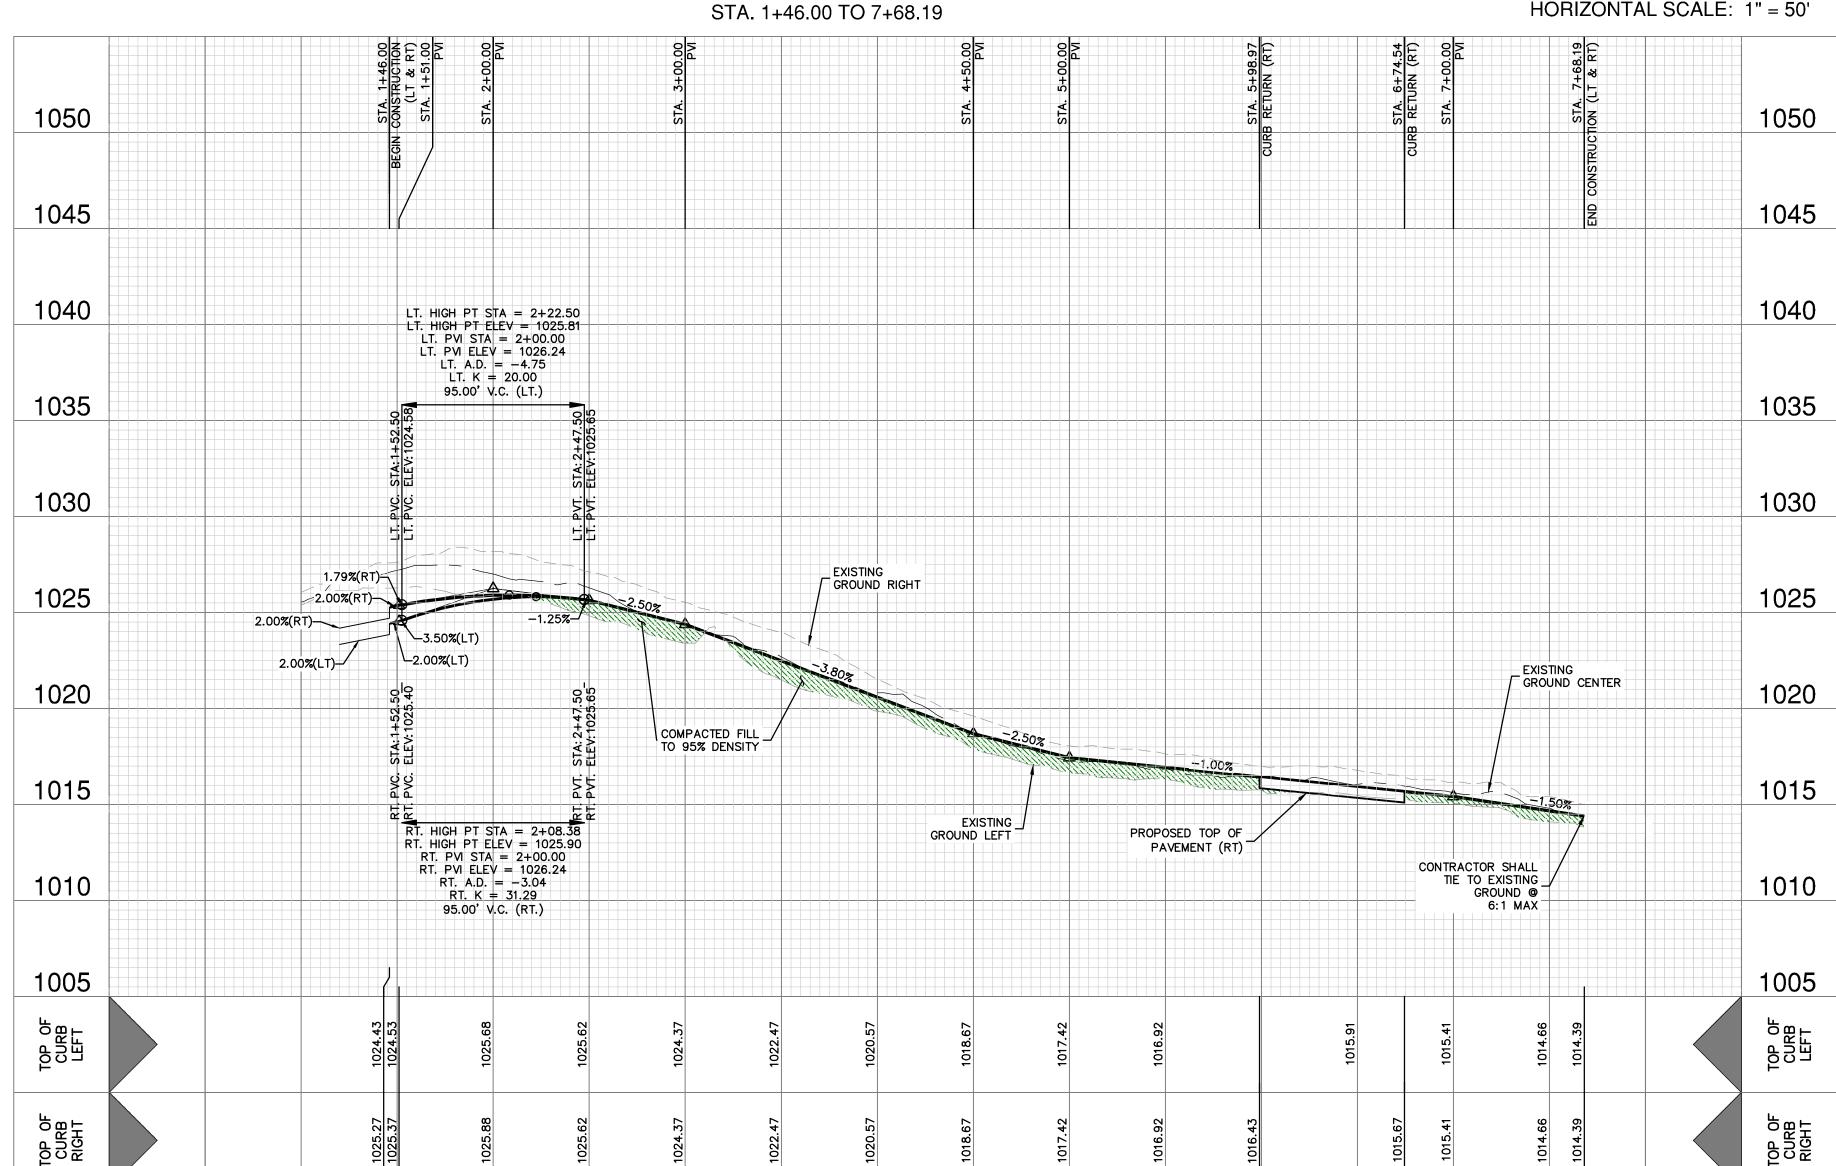

1+50

2+00

2+50

3+00

3+50

4+00

4+50

5+00


5+50

6+00

6+50

7+00


7+50



#### STREET LEGEND

(HOMEOWNER'S RESPONSIBILITY)

OTTLET LEGEND	
PROJECT LIMITS	
MAINTAIN GUTTER	$\rightarrow$ $   -$
EXISTING CONTOUR $$	970
WHEELCHAIR RAMP	0
CENTERLINE	CL
RADIUS POINT	RP
POINT OF CURVATURE	PC
POINT OF TANGENCY	PT
	RET
DRAINAGE FLOW ARROW	<b>→</b>
TOP OF CURB SPOT ELEVATION	857.30
PAVEMENT ELEVATION	857.00(P) ×
WASHOUT CROWN SECTION	
SIDEWALK (HOMEOWNER'S RESPONSIBILITY)	
SIDEWALK (DEVELOPER'S RESPONSIBILITY)	
DRIVEWAY	
5'x5' ADA PASSING SPACE	






PAPE-DAWSON ENGINEERS


#### STREET NOTES:


- 1. A BEXAR COUNTY ROW PERMIT MUST BE OBTAINED BEFORE WORKING BEXAR COUNTY ROW. CONTRACTOR SHALL COORDINATE A TRAFFIC CONTROL PLAN FOR ALL WORK WITHIN THE ROW. ADDITIONAL WARNING SIGNS MAY BE RECOMMENDED BY THE ENGINEER ONCE THE ROADWAYS ARE CONSTRUCTED.
- 2. CONTRACTOR SHALL MATCH EXISTING PAVEMENT AT TIE-IN. IF EXISTING PAVEMENT ELEVATION DIFFERS SIGNIFICANTLY, CONTRACTOR SHALL NOTIFY THE ENGINEER PRIOR TO CONTINUING WORK.
- 3. SIDEWALKS SHALL BE CONSTRUCTED 3-FT FROM THE BACK OF CUR FOR ALL LOCATIONS WHERE THE SIDEWALK IS SHOWN OFFSET. REFER TO STREET DETAIL SHEET FOR SIDEWALK AND RAMP DETAILS.
- 4. NO PERMANENT STRUCTURES HIGHER THAN 3 FEET, AND LOWER THAN 8 FEET ABOVE THE PAVEMENT, INCLUDING STRUCTURES, WALLS, FENCES, AND VEGETATION, SHALL BE CONSTRUCTED OR ALLOWED WITHIN THE CLEAR VISION EASEMENT. CONTRACTOR SHALL GRADE AREAS WITHIN CLEAR VISION EASEMENTS SUCH THAT THE ELEVATION WITHIN THE CLEAR VISION EASEMENT IS NOT HIGHER THAN 3 FEET ABOVE THE ADJACENT TOP OF PAVEMENT.
- 5. DRIVEWAYS SHOWN ON THIS PLAN ARE FOR THE SOLE PURPOSE OF INDICATING A POTENTIAL CONFLICT WITH CURB RAMP, DRAINAGE INFRASTRUCTURE, OR OTHER CONFLICT. DRIVEWAY LOCATION IS SUBJECT TO CHANGE BASED ON HOME SELECTION AND FINAL LOT DESIGN.
- 6. CHANGES IN THE SIDEWALK LOCATION FOR A MAXIMUM LINEAR DISTANCE OF TWO HUNDRED (200) FEET ARE PERMITTED TO BE APPROVED BY THE FIELD INSPECTOR WITHOUT AMENDING THE STREET PLAN ( UTILITY LAYOUT PER UDC SECTION 35-506 (Q)(6).

<sub>r NO</sub> 22-11800298 11680-52 DESIGNER CHECKED BL DRAWN CB

C2.01

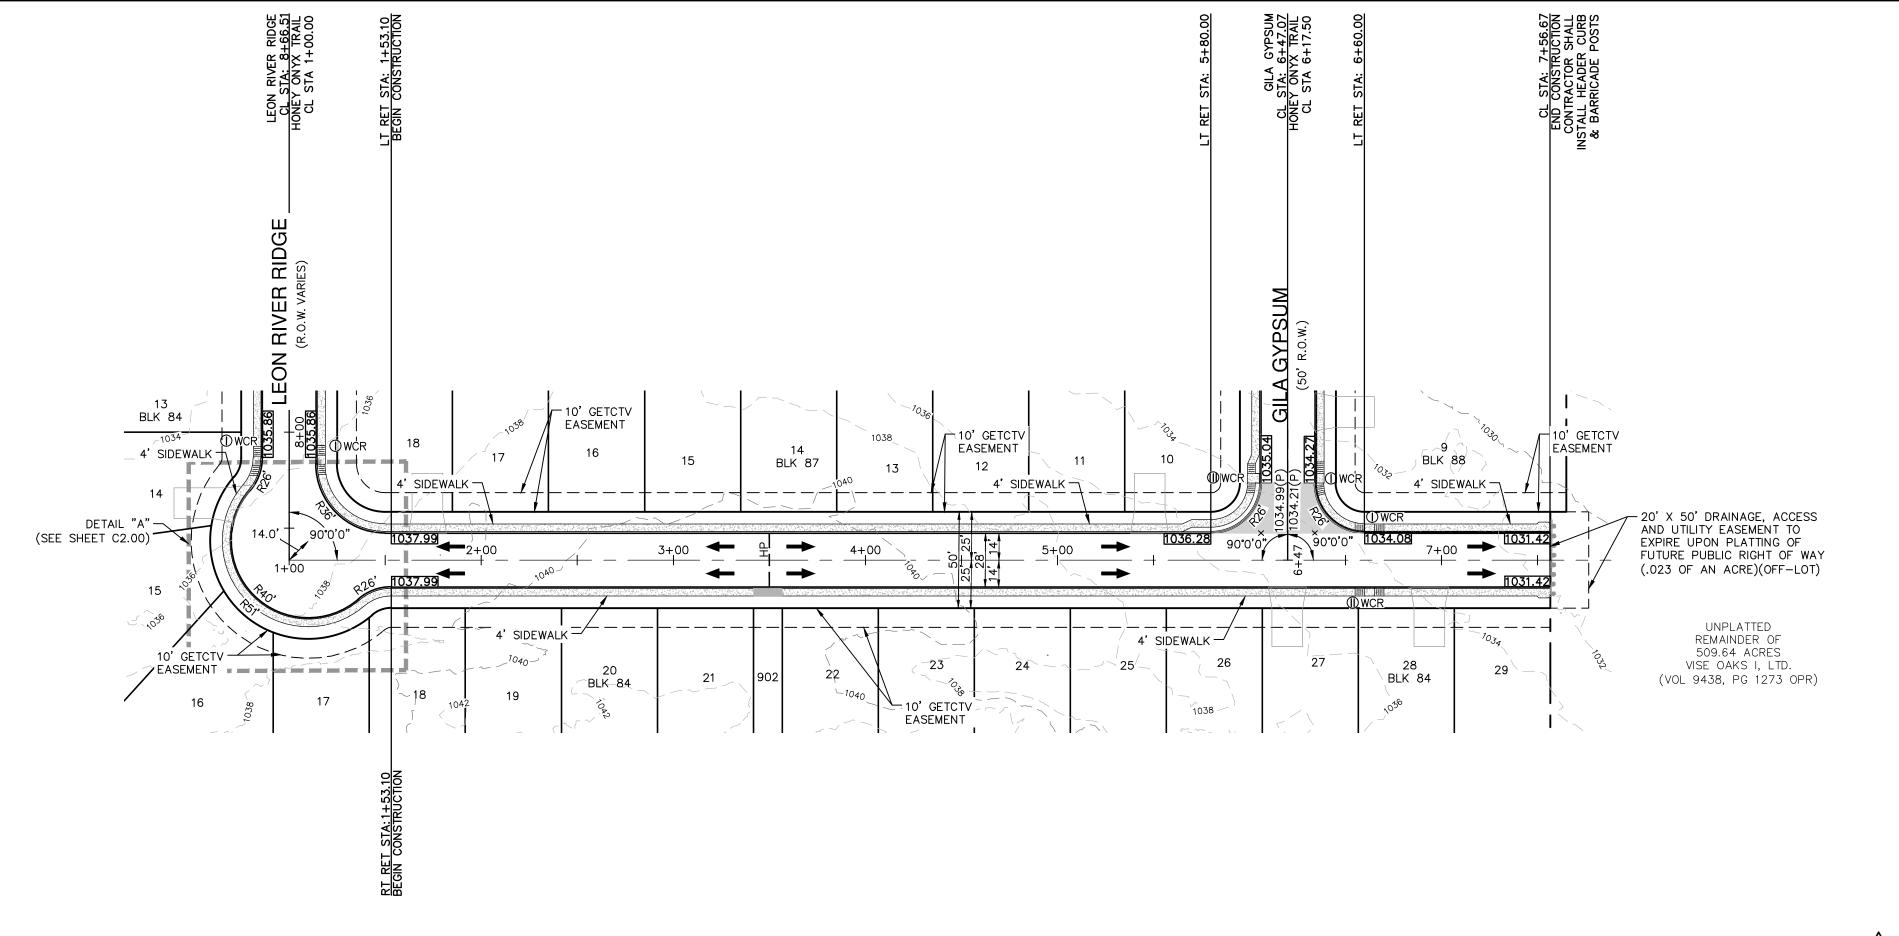

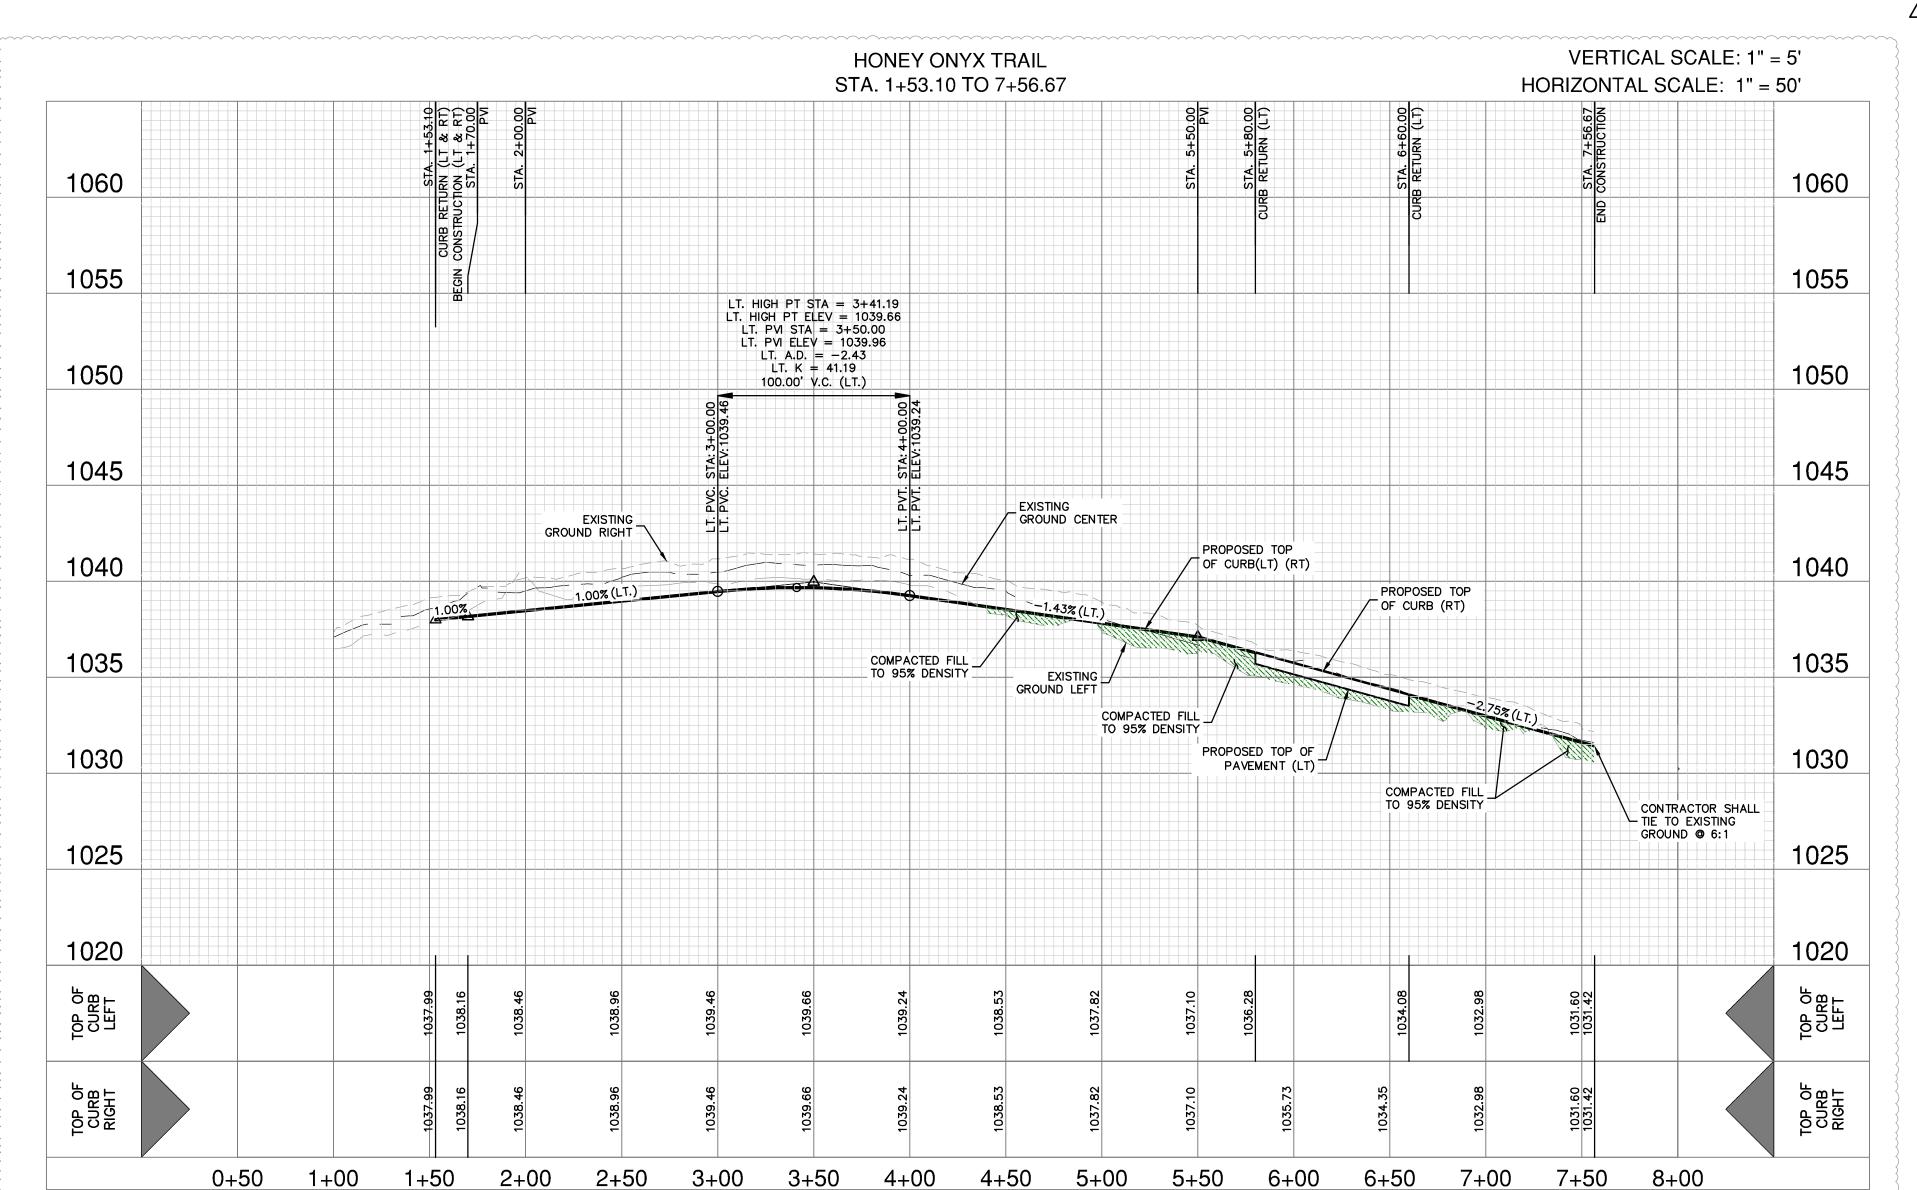



(HOMEOWNER'S RESPONSIBILITY)

PROJECT LIMITS	
MAINTAIN GUTTER ——	<i>→</i> — -
EXISTING CONTOUR — —	——— 970-——
WHEELCHAIR RAMP	$\oplus$
CENTERLINE	CL
RADIUS POINT	RP
POINT OF CURVATURE	PC
POINT OF TANGENCY	PT
	RET
DRAINAGE FLOW ARROW	<b>-</b>
TOP OF CURB SPOT ELEVATION	857.30
PAVEMENT ELEVATION	857.00(P) ×
WASHOUT CROWN SECTION	
SIDEWALK (HOMEOWNER'S RESPONSIBILITY)	
SIDEWALK (DEVELOPER'S RESPONSIBILITY)	
DRIVEWAY	
5'x5' ADA PASSING SPACE	






0

### STREET NOTES:

- 1. A BEXAR COUNTY ROW PERMIT MUST BE OBTAINED BEFORE WORKING BEXAR COUNTY ROW. CONTRACTOR SHALL COORDINATE A TRAFFIC CONTROL PLAN FOR ALL WORK WITHIN THE ROW. ADDITIONAL WARNING SIGNS MAY BE RECOMMENDED BY THE ENGINEER ONCE THE ROADWAYS ARE CONSTRUCTED.
- 2. CONTRACTOR SHALL MATCH EXISTING PAVEMENT AT TIE-IN. IF EXISTING PAVEMENT ELEVATION DIFFERS SIGNIFICANTLY, CONTRACTOR SHALL NOTIFY THE ENGINEER PRIOR TO CONTINUING WORK.
- 3. SIDEWALKS SHALL BE CONSTRUCTED 3-FT FROM THE BACK OF CURB FOR ALL LOCATIONS WHERE THE SIDEWALK IS SHOWN OFFSET. REFER TO STREET DETAIL SHEET FOR SIDEWALK AND RAMP DETAILS.
- 4. NO PERMANENT STRUCTURES HIGHER THAN 3 FEET, AND LOWER THAN 8 FEET ABOVE THE PAVEMENT, INCLUDING STRUCTURES, WALLS, FENCES, AND VEGETATION, SHALL BE CONSTRUCTED OR ALLOWED WITHIN THE CLEAR VISION EASEMENT. CONTRACTOR SHALL GRADE AREAS WITHIN CLEAR VISION EASEMENTS SUCH THAT THE ELEVATION WITHIN THE CLEAR VISION EASEMENT IS NOT HIGHER THAN 3 FEET ABOVE THE ADJACENT TOP OF PAVEMENT.
- 5. DRIVEWAYS SHOWN ON THIS PLAN ARE FOR THE SOLE PURPOSE OF INDICATING A POTENTIAL CONFLICT WITH CURB RAMP, DRAINAGE INFRASTRUCTURE, OR OTHER CONFLICT. DRIVEWAY LOCATION IS SUBJECT TO CHANGE BASED ON HOME SELECTION AND FINAL LOT DESIGN.
- 6. CHANGES IN THE SIDEWALK LOCATION FOR A MAXIMUM LINEAR DISTANCE OF TWO HUNDRED (200) FEET ARE PERMITTED TO BE APPROVED BY THE FIELD INSPECTOR WITHOUT AMENDING THE STREET PLAN ( UTILITY LAYOUT PER UDC SECTION 35-506 (Q)(6).

NO 22-11800298 11680-52 ESIGNER CB CHECKED\_BL\_DRAWN\_CB

C2.02

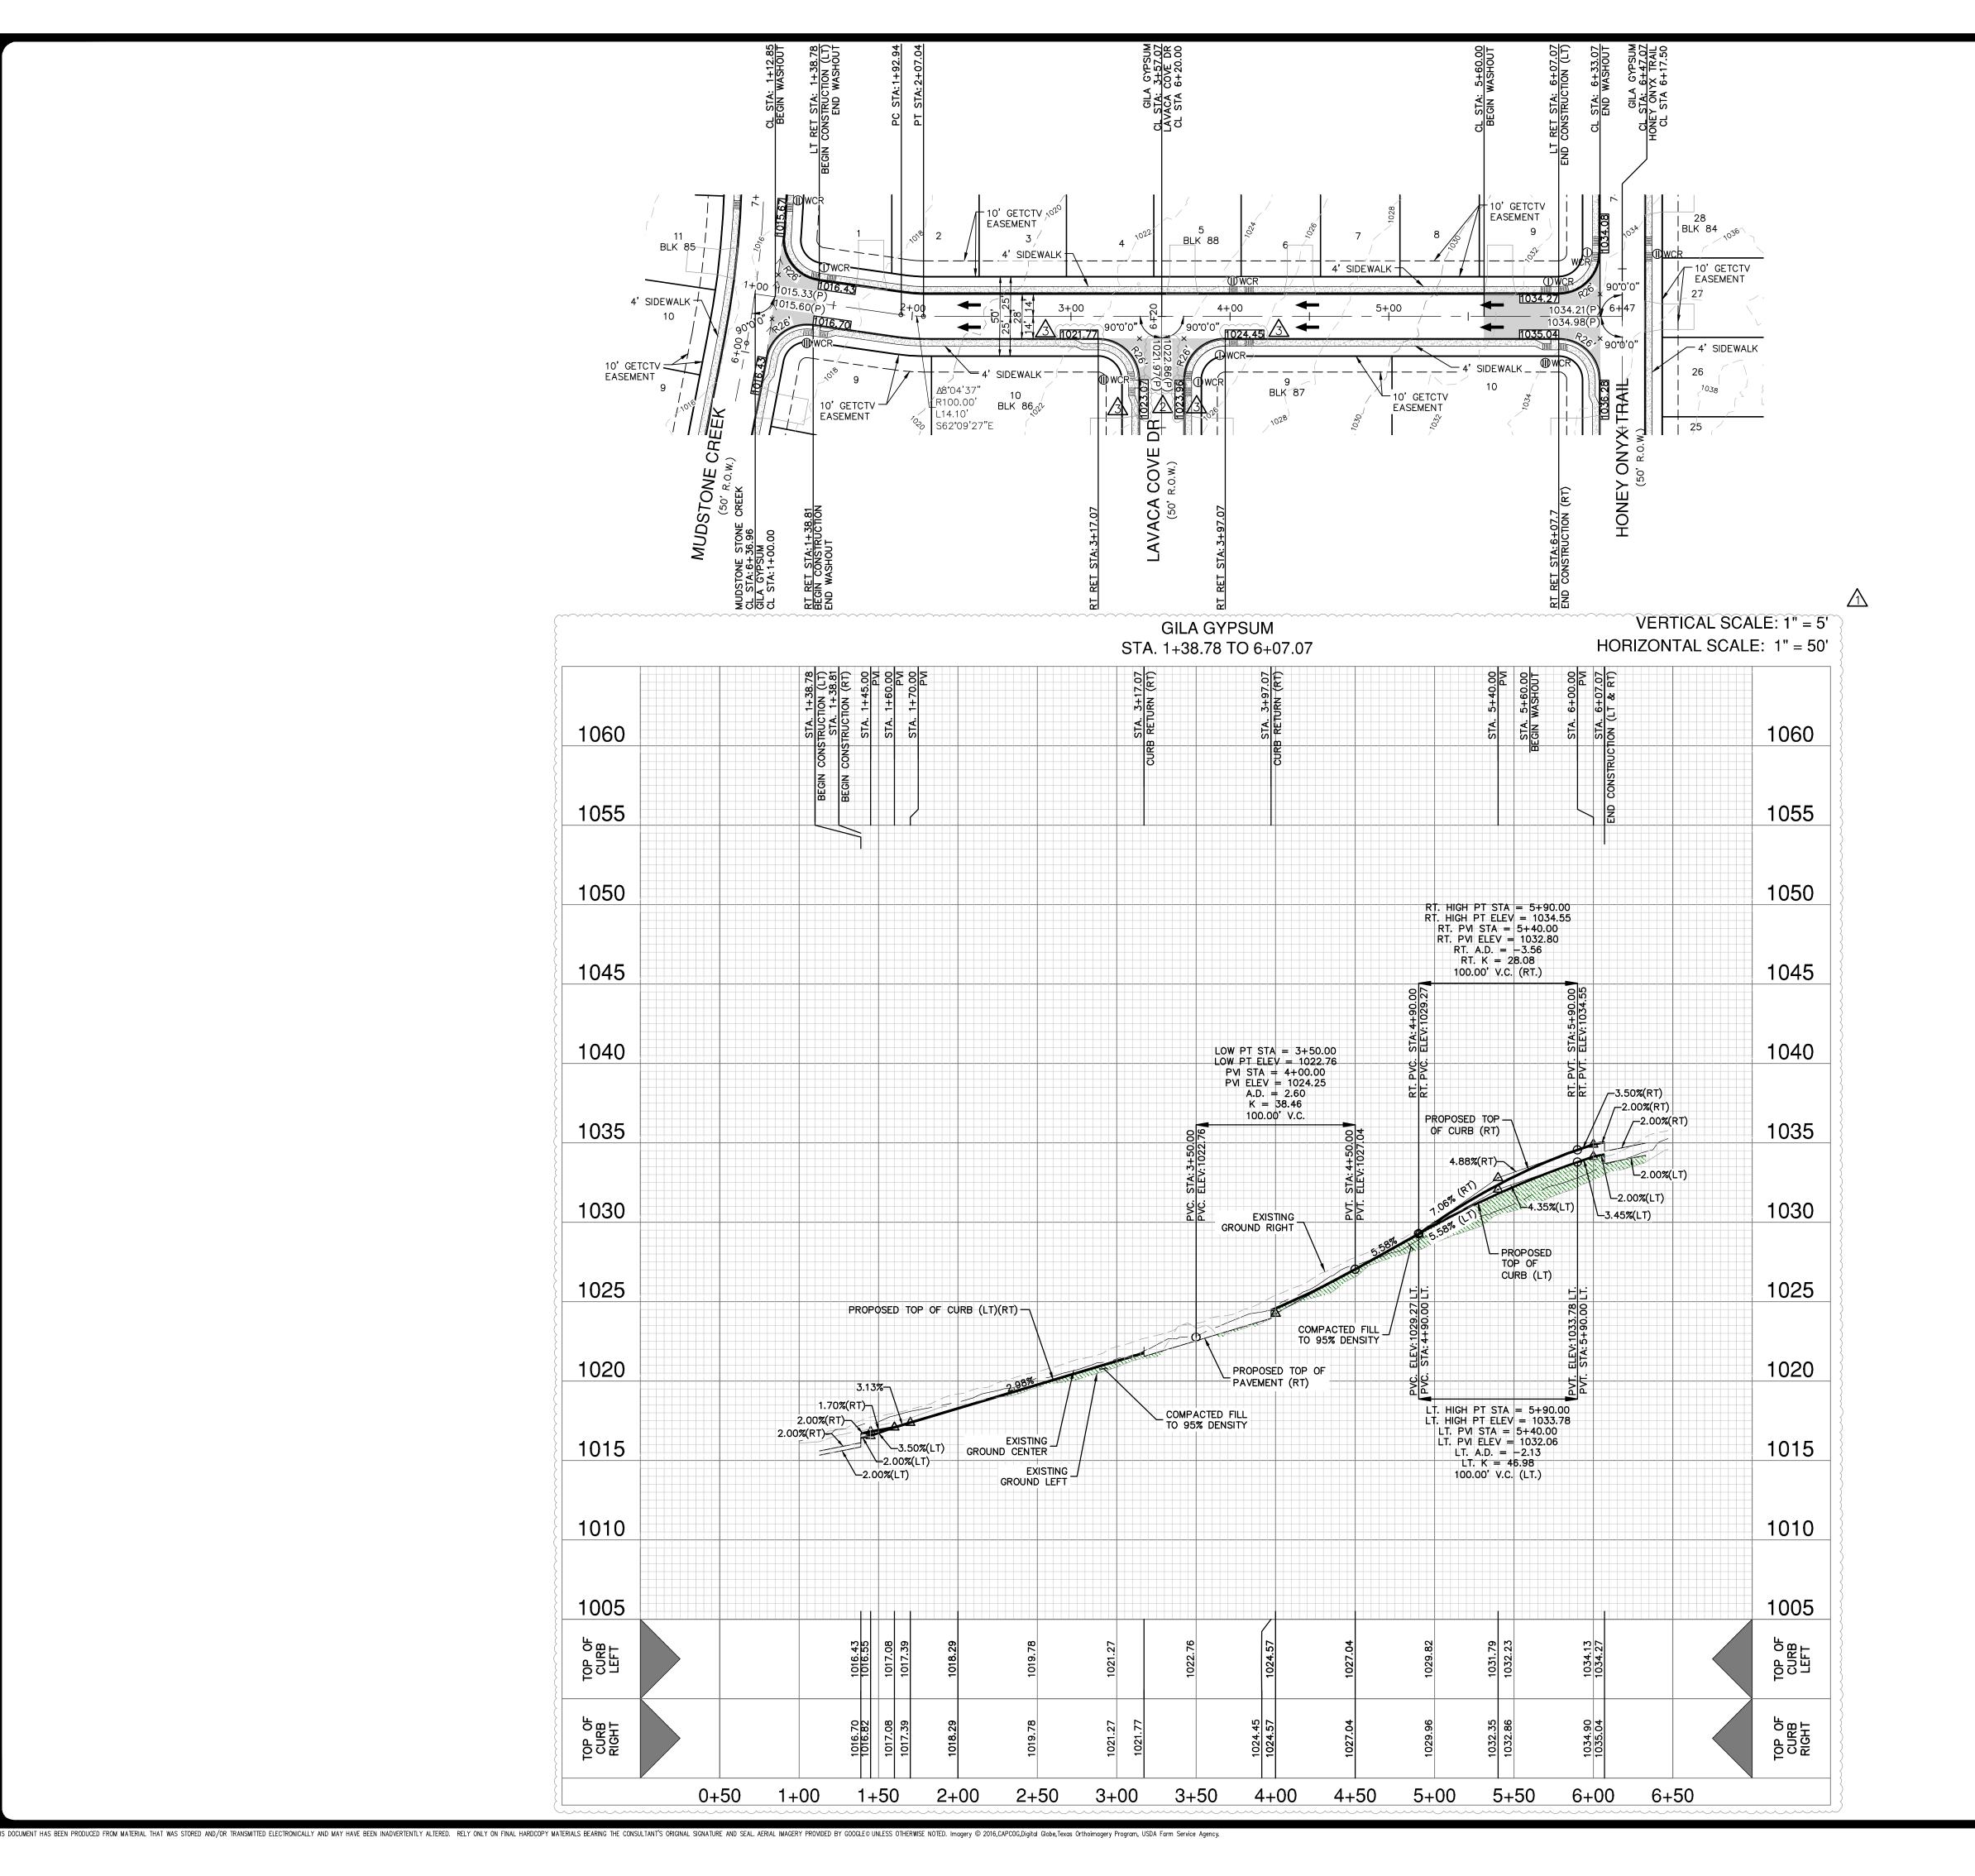



OTTLET LEGEND	
PROJECT LIMITS	
MAINTAIN GUTTER -	$- \rightarrow \rightarrow$
EXISTING CONTOUR -	970
WHEELCHAIR RAMP	$\oplus$
CENTERLINE	CL
RADIUS POINT	RP
POINT OF CURVATURE	PC
POINT OF TANGENCY	PT
RETURN	RET
DRAINAGE FLOW ARROW	-
TOP OF CURB SPOT ELEVATION	857.30
PAVEMENT ELEVATION	857.00(P) ×
WASHOUT CROWN SECTION	
SIDEWALK (HOMEOWNER'S RESPONSIBILI	TY)
SIDEWALK (DEVELOPER'S RESPONSIBILIT	Y)
DRIVEWAY	

CALEB M. CHANCE

PAPE-DAWSON ENGINEERS


જ્વં<del>,</del>‡

## STREET NOTES:


- 1. A BEXAR COUNTY ROW PERMIT MUST BE OBTAINED BEFORE WORKING BEXAR COUNTY ROW. CONTRACTOR SHALL COORDINATE A TRAFFIC CONTROL PLAN FOR ALL WORK WITHIN THE ROW. ADDITIONAL WARNING SIGNS MAY BE RECOMMENDED BY THE ENGINEER ONCE THE ROADWAYS ARE CONSTRUCTED.
- 2. CONTRACTOR SHALL MATCH EXISTING PAVEMENT AT TIE-IN. IF EXISTING PAVEMENT ELEVATION DIFFERS SIGNIFICANTLY, CONTRACTOR SHALL NOTIFY THE ENGINEER PRIOR TO CONTINUING WORK.
- 3. SIDEWALKS SHALL BE CONSTRUCTED 3-FT FROM THE BACK OF CURB FOR ALL LOCATIONS WHERE THE SIDEWALK IS SHOWN OFFSET. REFER TO STREET DETAIL SHEET FOR SIDEWALK AND RAMP DETAILS.
- 4. NO PERMANENT STRUCTURES HIGHER THAN 3 FEET, AND LOWER THAN 8 FEET ABOVE THE PAVEMENT, INCLUDING STRUCTURES, WALLS, FENCES, AND VEGETATION, SHALL BE CONSTRUCTED OR ALLOWED WITHIN THE CLEAR VISION EASEMENT. CONTRACTOR SHALL GRADE AREAS WITHIN CLEAR VISION EASEMENTS SUCH THAT THE ELEVATION WITHIN THE CLEAR VISION EASEMENTS IS NOT HIGHER THAN 3 FEET ABOVE THE ADJACENT TOP OF PAVEMENT.
- 5. DRIVEWAYS SHOWN ON THIS PLAN ARE FOR THE SOLE PURPOSE OF INDICATING A POTENTIAL CONFLICT WITH CURB RAMP, DRAINAGE INFRASTRUCTURE, OR OTHER CONFLICT. DRIVEWAY LOCATION IS SUBJECT TO CHANGE BASED ON HOME SELECTION AND FINAL LOT DESIGN.
- 6. CHANGES IN THE SIDEWALK LOCATION FOR A MAXIMUM LINEAR DISTANCE OF TWO HUNDRED (200) FEET ARE PERMITTED TO BE APPROVED BY THE FIELD INSPECTOR WITHOUT AMENDING THE STREET PLAN ( UTILITY LAYOUT PER UDC SECTION 35-506 (Q)(6).

<sub>r NO</sub> 22-11800298 11680-52 DESIGNER CB CHECKED BL DRAWN CB

C2.03

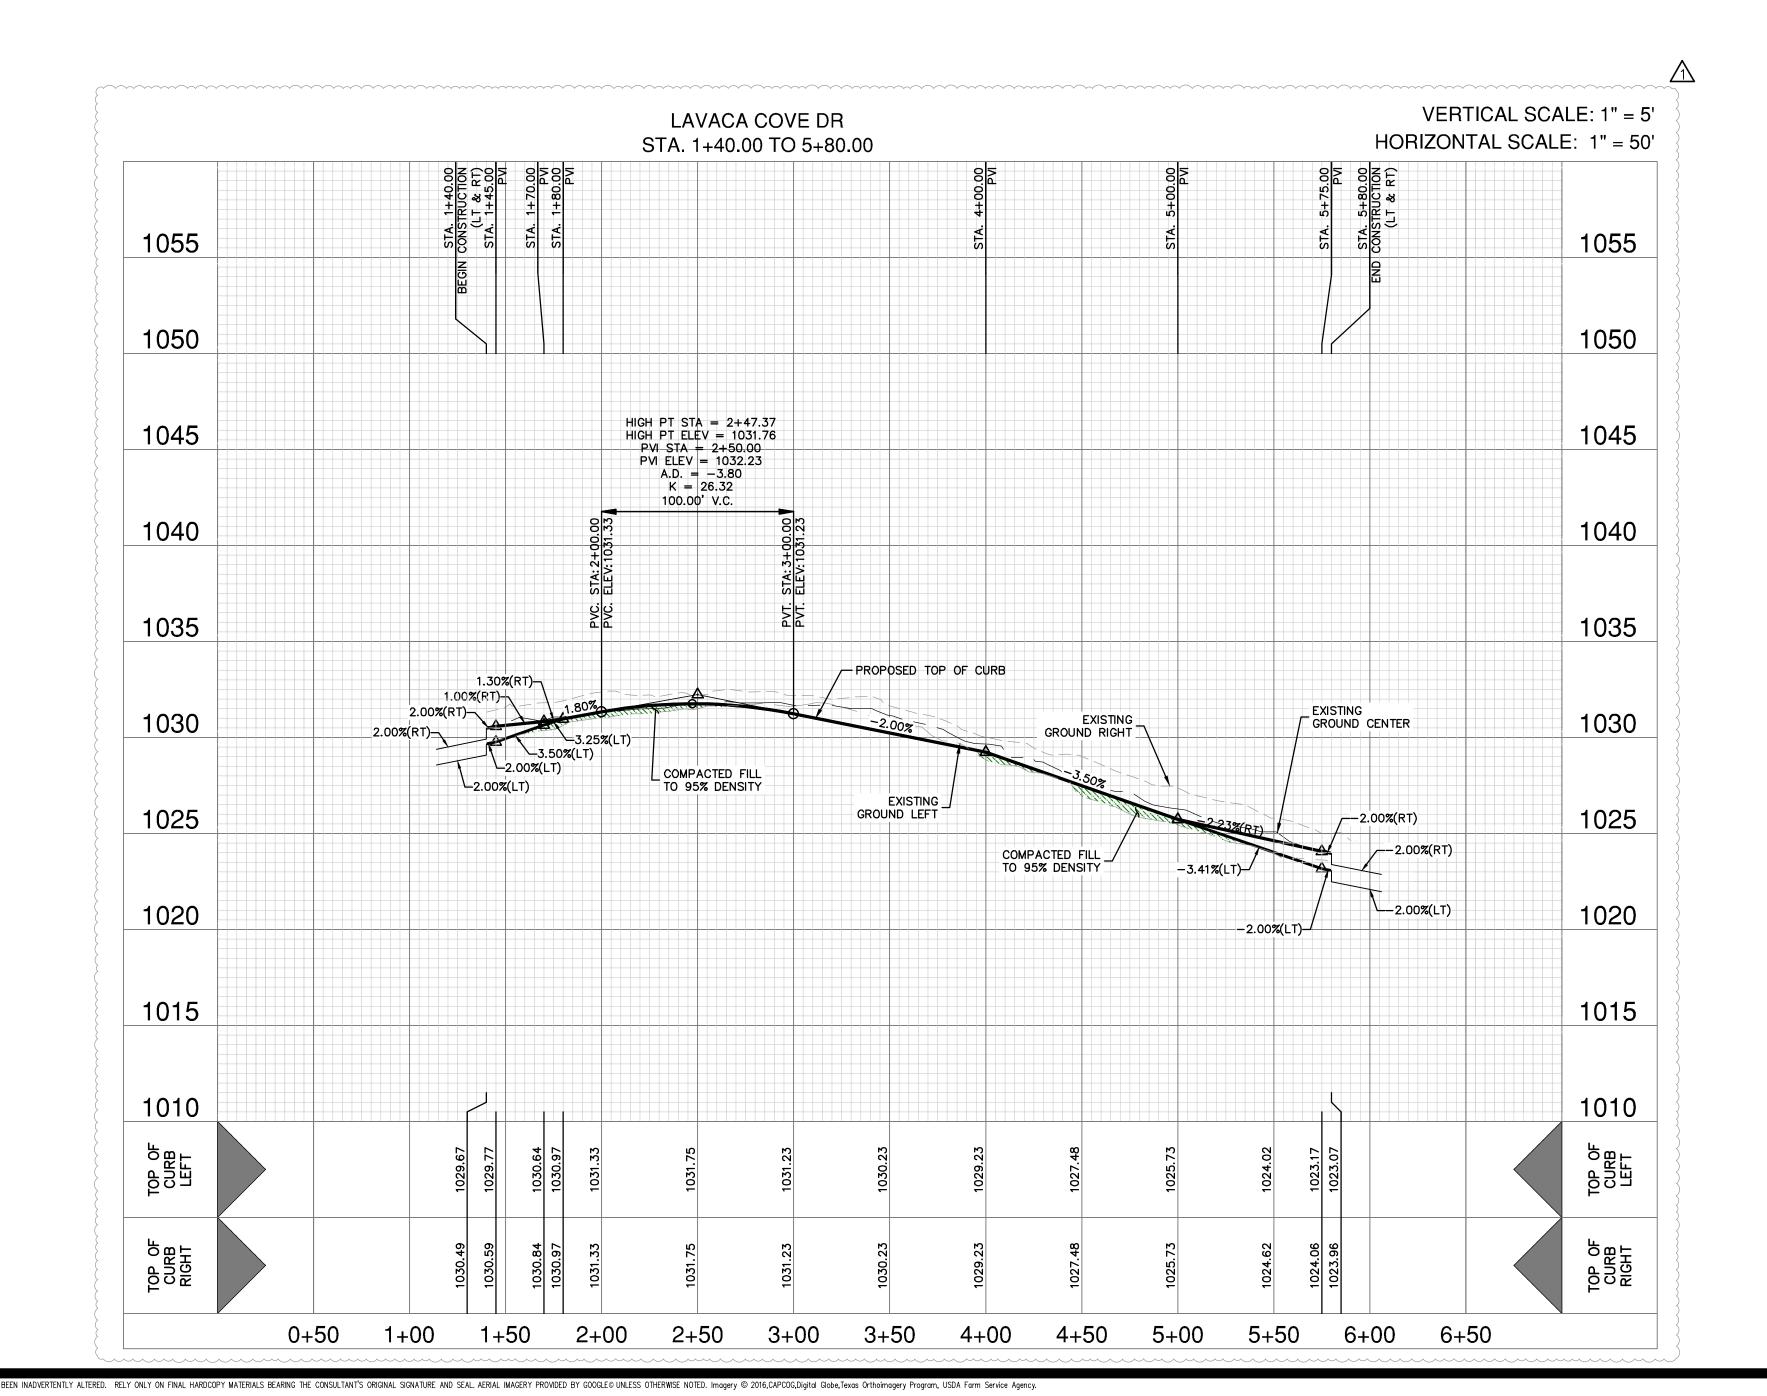





OTTREET LEGENTS	
PROJECT LIMITS	
MAINTAIN GUTTER	$- \rightarrow \rightarrow$
EXISTING CONTOUR — -	970
WHEELCHAIR RAMP	•
CENTERLINE	CL
RADIUS POINT	RP
POINT OF CURVATURE	PC
POINT OF TANGENCY	PT
RETURN	RET
DRAINAGE FLOW ARROW	<b>→</b>
TOP OF CURB SPOT ELEVATION	857.30
PAVEMENT ELEVATION	857.00(P) ×
WASHOUT CROWN SECTION	
SIDEWALK (HOMEOWNER'S RESPONSIBILITY)	
SIDEWALK (DEVELOPER'S RESPONSIBILITY)	
DRIVEWAY	
DKIVEWAI	





PAPE-DAWSON ENGINEERS

2. CONTRACTOR SHALL MATCH EXISTING PAVEMENT AT TIE-IN. IF EXISTING PAVEMENT ELEVATION DIFFERS SIGNIFICANTLY, CONTRACTOR SHALL NOTIFY THE ENGINEER PRIOR TO CONTINUING WORK. 3. SIDEWALKS SHALL BE CONSTRUCTED 3-FT FROM THE BACK OF CURB FOR ALL LOCATIONS WHERE THE SIDEWALK IS SHOWN OFFSET. REFER

TO STREET DETAIL SHEET FOR SIDEWALK AND RAMP DETAILS. 4. NO PERMANENT STRUCTURES HIGHER THAN 3 FEET, AND LOWER THAN 8 FEET ABOVE THE PAVEMENT, INCLUDING STRUCTURES, WALLS, FENCES, AND VEGETATION, SHALL BE CONSTRUCTED OR ALLOWED WITHIN THE CLEAR VISION EASEMENT. CONTRACTOR SHALL GRADE AREAS WITHIN CLEAR VISION EASEMENTS SUCH THAT THE ELEVATION WITHIN THE CLEAR VISION EASEMENT IS NOT HIGHER THAN 3 FEET ABOVE THE ADJACENT TOP OF PAVEMENT.

1. A BEXAR COUNTY ROW PERMIT MUST BE OBTAINED BEFORE WORKING BEXAR COUNTY ROW. CONTRACTOR SHALL COORDINATE A TRAFFIC CONTROL PLAN FOR ALL WORK WITHIN THE ROW. ADDITIONAL WARNING SIGNS MAY BE RECOMMENDED BY THE ENGINEER ONCE THE ROADWAYS

STREET NOTES:

ARE CONSTRUCTED.

5. DRIVEWAYS SHOWN ON THIS PLAN ARE FOR THE SOLE PURPOSE OF INDICATING A POTENTIAL CONFLICT WITH CURB RAMP, DRAINAGE INFRASTRUCTURE, OR OTHER CONFLICT. DRIVEWAY LOCATION IS SUBJECT TO CHANGE BASED ON HOME SELECTION AND FINAL LOT DESIGN.

6. CHANGES IN THE SIDEWALK LOCATION FOR A MAXIMUM LINEAR DISTANCE OF TWO HUNDRED (200) FEET ARE PERMITTED TO BE APPROVED BY THE FIELD INSPECTOR WITHOUT AMENDING THE STREET PLAN C UTILITY LAYOUT PER UDC SECTION 35-506 (Q)(6).

<sub>r NO</sub> 22-11800298 11680-52 DESIGNER CB

CHECKED BL DRAWN CB C2.04

		PAVEME	NT SECTIO	ON DETAIL			
STREET NAME	STATION	TYPE "D" HMAC	CRUSHED LIMESTONE BASE	SUBGRADE	GEOGRID (TENSAR TRIAX TX5)	CBR	STRUCTURAL NUMBER
GILA GYPSUM	1+38.78 TO 6+07.07	2"	10"	*	NO	4	2.28
HONEY ONYX TRAIL	1+53.10 TO 7+56.67	2"	10"	*	NO	4	2.28
LAVACA COVE DR	1+40.00 TO 5+80.00	2"	10"	*	NO	4	2.28
LEON RIVER RIDGE	1+48.00 TO 4+88.07	3"	19"	*	NO	4	3.98
LEON RIVER RIDGE	4+88.07 TO 8+13.42	2"	10"	*	NO	4	2.28
MUDSTONE CREEK	1+46.00 TO 7+68.19	2"	10"	*	NO	4	2.28

#### SUBGRADE NOTES (\*):

- 1. CUT AND FILL DATA ARE NOT AVAILABLE AT THIS TIME
- 2. BASED ON THE REVIEW OF GEOLOGIC AND SOILS MAP, WE ANTICIPATE THE FINAL PAVEMENT SUBGRADE PLASTICITY INDEX VALUE TO BE LESS THAN OR EQUAL TO 20.
- 3. IF THE SUBGRADE PLASTICITY INDEX VALUES ARE LESS THAN OR EQUAL TO 20, AS PER CITY OF SAN ANTONIO OR BEXAR COUNTY REQUIREMENTS, SUBGRADE STABILIZATION IS NOT NEEDED.
- 4. IF FILL IS USED TO RAISE THE GRADE, FILL MATERIAL UNDERNEATH THE PAVEMENT SHOULD BE APPROVED FILL MATERIAL, FREE OF DELETERIOUS MATERIAL AND WITH A MINIMUM CBR VALUE OF 4.0 AND A MAXIMUM PLASTICITY INDEX VALUE OF 20. THE MATERIAL SHOULD BE PLACED AS PER APPLICABLE CITY OR COUNTY
- 5. HOWEVER, IF THE FINAL STREET SUBGRADE PLASTICITY INDEX VALUES ARE GREATER THAN 20, THEN ONE OF THE FOLLOWING OPTIONS MAY BE FOLLOWED:
- •REMOVE THE CLAYS SOILS (WITH PLASTICITY INDEX VALUES GREATER THAN 20) AND REPLACE WITH FILL MATERIAL WITH PLASTICITY INDEX VALUES LESS THAN OR EQUAL TO 20. IF SUBGRADE STABILIZATION IS REQUIRED, THE FOLLOWING SPECIFICATIONS MUST BE MET. THE CONTRACTOR SHALL COORDINATE WITH THE GEOTECHNICAL ENGINEER IN THE FIELD FOR SUBGRADE TREATMENT.


#### •TREAT THE SUBGRADE:


- THE SUBGRADE SHOULD BE TREATED TO A DEPTH OF 6 INCHES USING 6  $\frac{1}{2}$  PERCENT LIME CONTENT
- THE SUBGRADE SOILS SHOULD BE TESTED FOR SOIL SULFATE CONTENT PRIOR TO TREATMENT. IF THE SOIL SULFATE CONTENT IS OVER 3000 PPM, AN ALTERNATE PROCEDURE WILL BE REQUIRED.
- THE SUBGRADE MAY ALSO BE TREATED USING CEMENT.
- APPLICATION RATES SHOULD BE DETERMINED AT THE TIME OF CONSTRUCTION.
- LIME APPLICATION RATE OF 27 LBS PER SQ YARD FOR 6— INCH DEPTH OF TREATMENT MAY BE USED FOR PLANNING AND BUDGETING PURPOSES. THE LIME/CEMENT APPLICATION RATES SHOULD BE DETERMINED AT THE TIME OF CONSTRUCTION.


#### **GENERAL NOTES:**

- I. CONTRACTOR SHALL REFERENCE THE PROJECT PAVEMENT DESIGN REPORT NO. S191159—P—R1 PREPARED BY INTEC DATED 5/20/21
- 2. CONTRACTOR SHALL RETAIN A GEOTECHNICAL ENGINEER TO VERIFY THE SUB GRADE CONDITION PRIOR TO PLACING ANY BASE MATERIAL. GEOTECHNICAL ENGINEER SHALL DETERMINE THE SUB GRADE CONDITION AND IF LIME STABILIZATION IS REQUIRED.
- 3. GEOTECHNICAL ENGINEER SHOULD VERIFY THE STREET SUBGRADE AT THE TIME OF CONSTRUCTION PRIOR TO PLACEMENT OF AGGREGATE BASE.
- 4. THE FLEXIBLE BASE COURSE SHOULD BE CRUSHED LIMESTONE CONFORMING TO TXDOT STANDARD SPECIFICATIONS, ITEM 247, TYPE A, GRADES 1 OR 2.
- 5. THE MOISTURE CONTENT OF THE FILL SHOULD BE MAINTAINED WITHIN THE RANGE OF OPTIMUM WATER CONTENT TO 3 PERCENTAGE POINTS ABOVE THE OPTIMUM WATER CONTENT UNTIL PERMANENTLY COVERED.
- 6. IN THE EVENT THAT THE CLAY FILL USED IS DIFFERENT THAN THE EXISTING SUBGRADE, THE RECOMMENDATIONS IN THE GEOTECHNICAL REPORT COULD BE INVALIDATED AND THE DESIGN ENGINEER MUST BE CONSULTED TO DETERMINE IF ADDITIONAL CBR TESTING AND THICKER PAVEMENT SECTIONS ARE REQUIRED.
- 7. WHERE PAVEMENT SUBGRADE IS LOCATED WITHIN 2-FEET OF THE EXISTING GROUND SURFACE (STRATUM 1 CLAYS), MOISTURE CONDITIONED SUBGRADE WILL BE REQUIRED. GEOTECHNICAL ENGINEER SHOULD VERIFY THE STREET SUBGRADE AT THE TIME OF CONSTRUCTION PRIOR TO PLACEMENT OF AGGREGATE BASE TO DETERMINE WHERE THE MOISTURE CONDITIONED SUBGRADE IS NEEDED. REFERENCE GEOTECHNICAL ENGINEERING REPORT FOR MORE INFORMATION.


PAVEMENT DESIGN IS IN ACCORDANCE WITH THE GEOTECHNICAL ENGINEERING REPORT PREPARED FOR RIVERSTONE SUBDIVISION BY INTEC. PROJECT NUMBER: \$191159-P-R1 DATED: 5/20/21

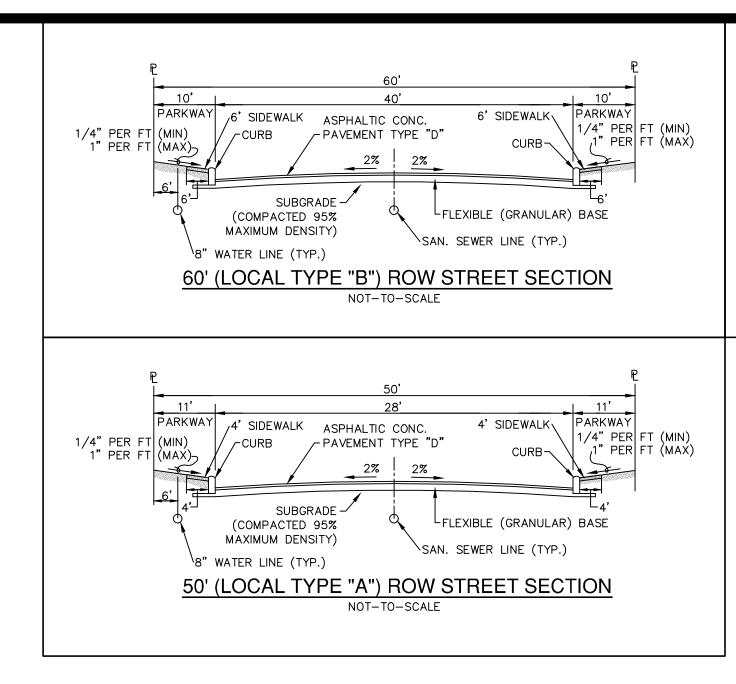

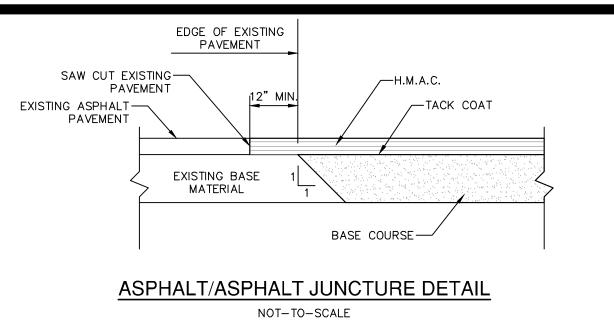


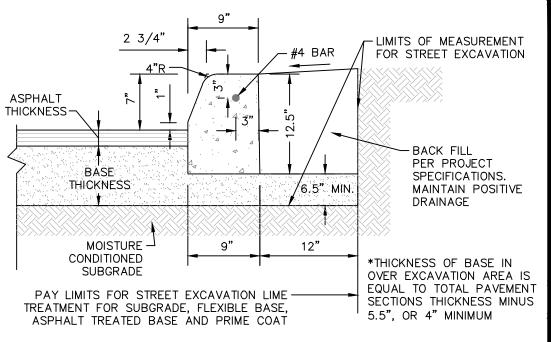


## CONCRETE CURB DETAIL NOT-TO-SCALE

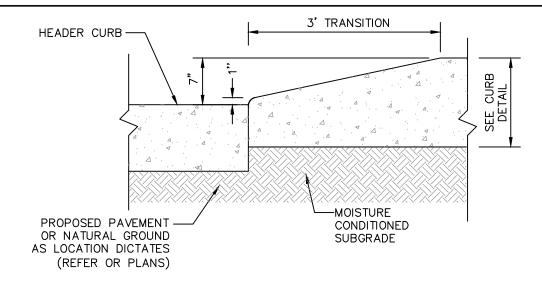

# CURB TRANSITION DETAIL (FROM HEADER CURB TO STANDARD CURB NOT-TO-SCALE

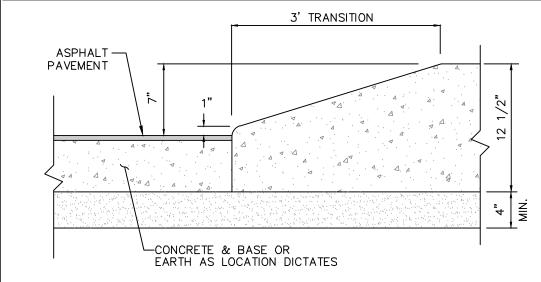

# CURB TRANSITION DETAIL (FROM PAVEMENT TO STANDARD CURB) NOT-TO-SCALE

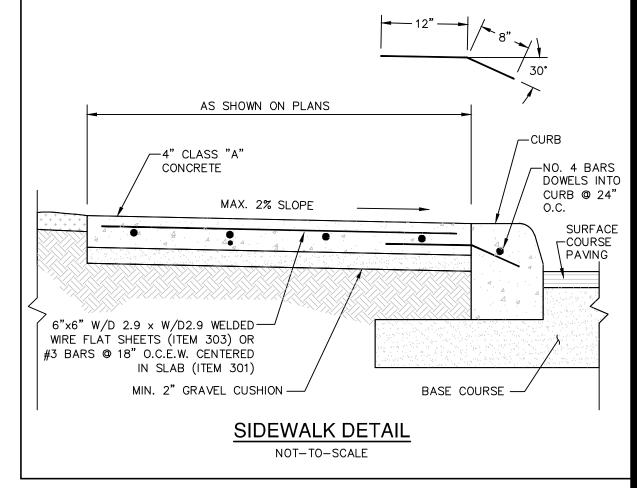

# RSTONE UNIT - F1 SAN ANTONIO, TEXAS

CALEB M. CHANCE

80

PLAT NO. 22-11800298

JOB NO. 11680-52


DATE MAY 2022


DESIGNER CB

CHECKED BL DRAWN CB

SHEET C2.10

05, 2023, 7:32am User ID: cburuato

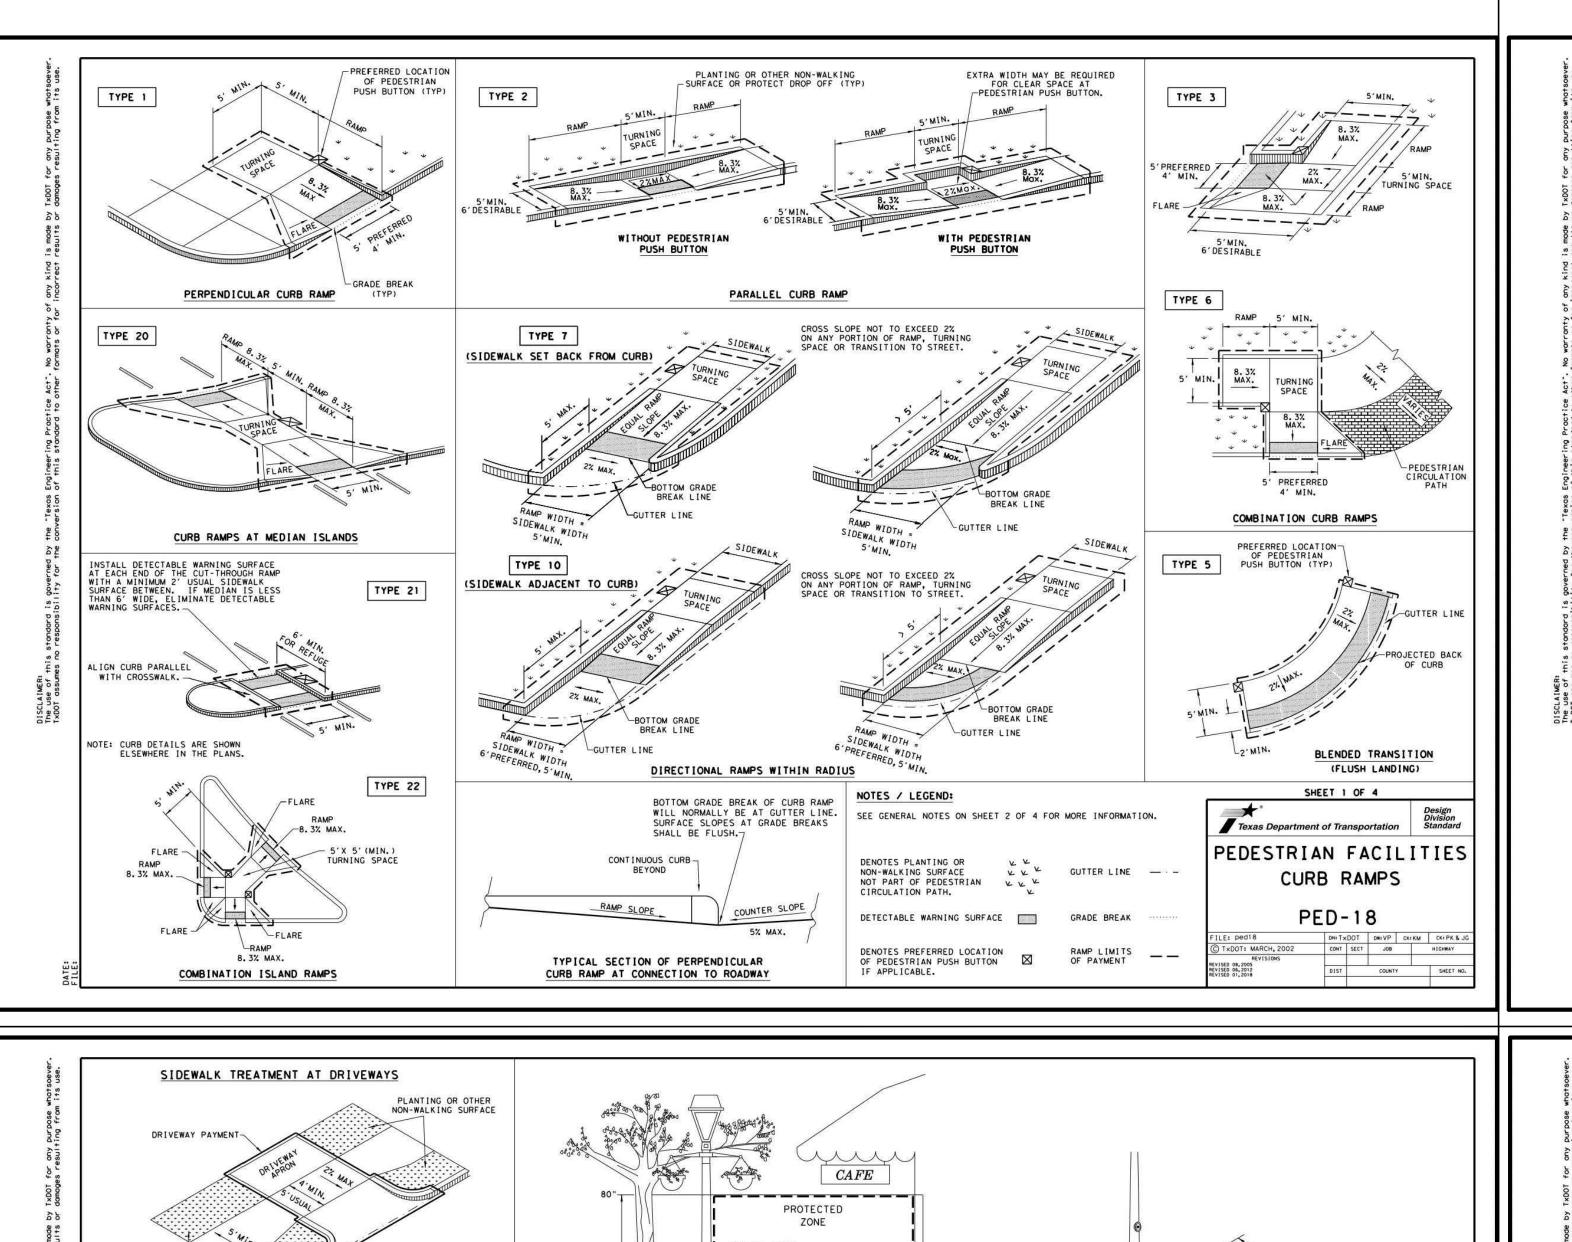

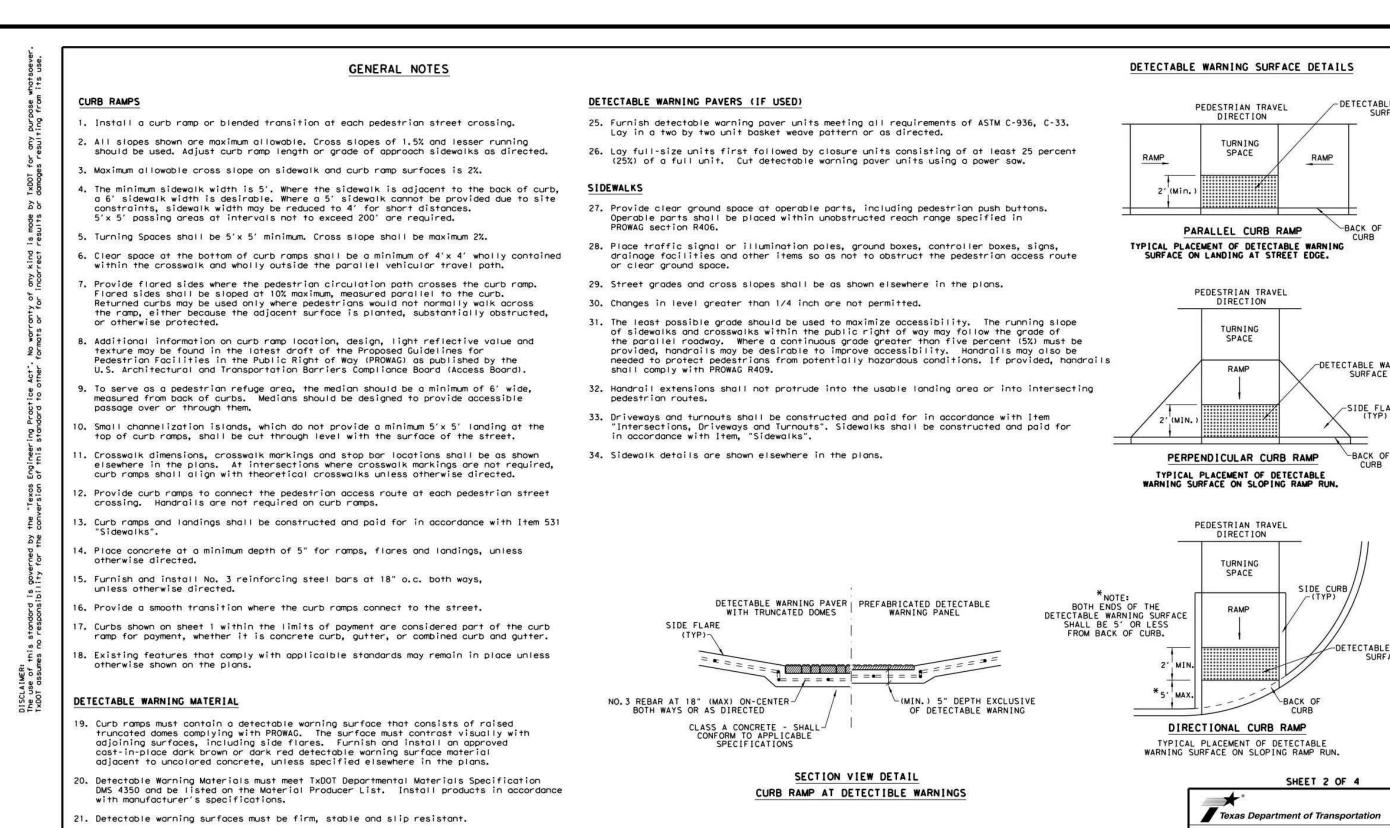



22. Detectable warning surfaces shall be a minimum of 24 inches in depth in the direction of pedestrian travel, and extend the full width of the curb ramp or landing where the


3. Detectable warning surfaces shall be located so that the edge nearest the curb line is at the back of curb and neither end of that edge is greater than 5 feet from the back of curb. Detectable warning surfaces may be curved along the corner radius.

Shaded areas on Sheet 1 of 4 indicate the approximate location for the detectable warning surface for each curb ramp type.

pedestrian access route enters the street.

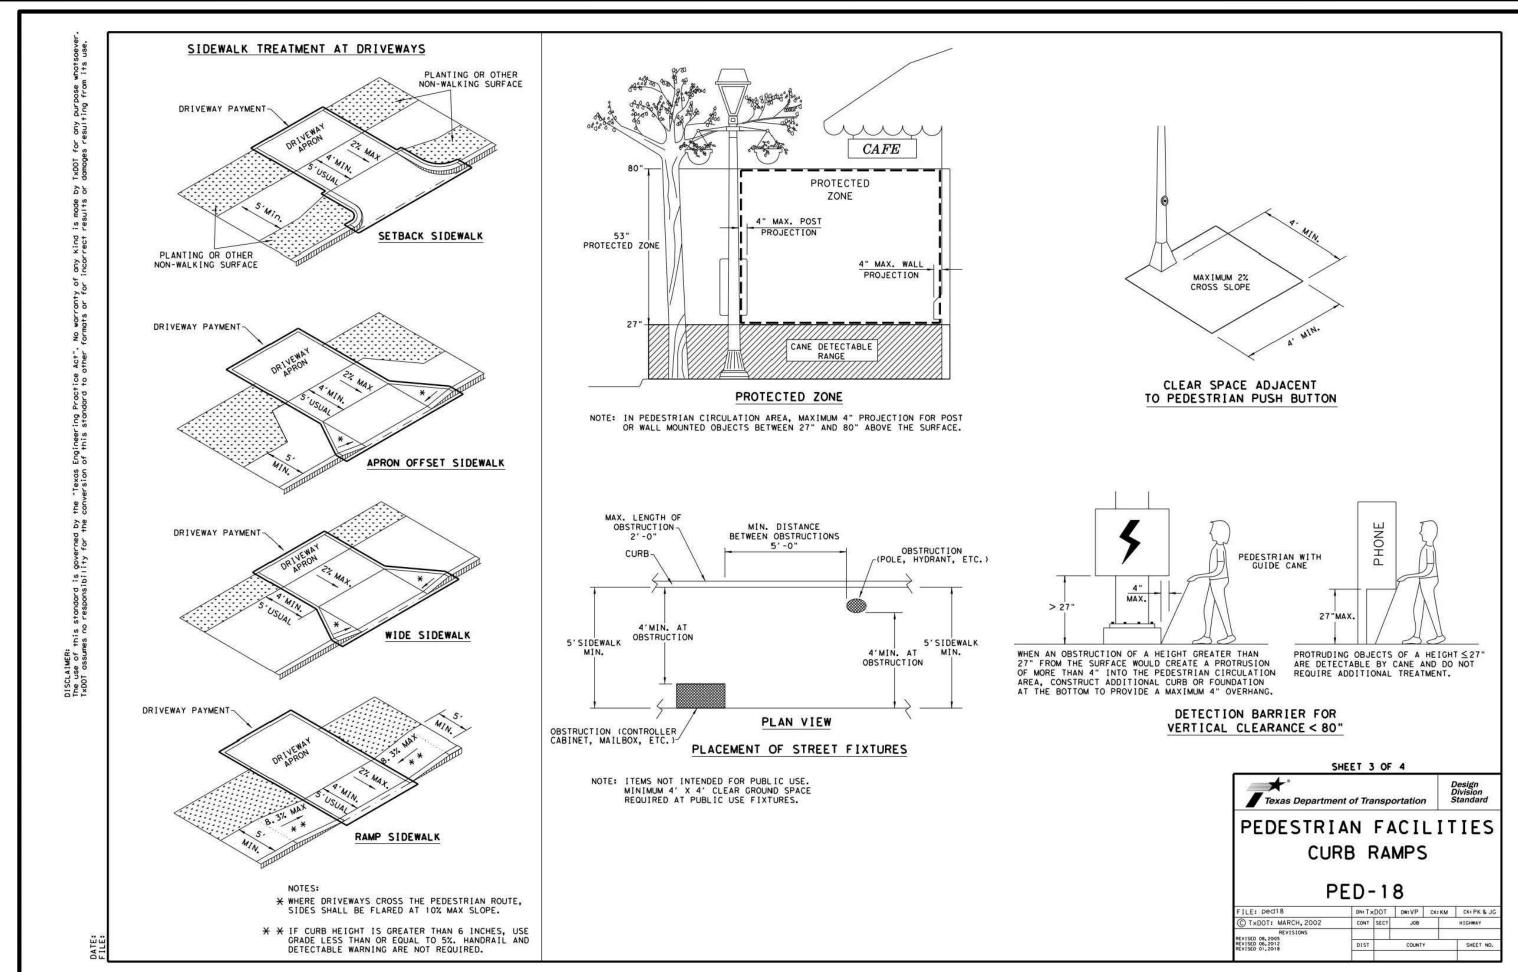

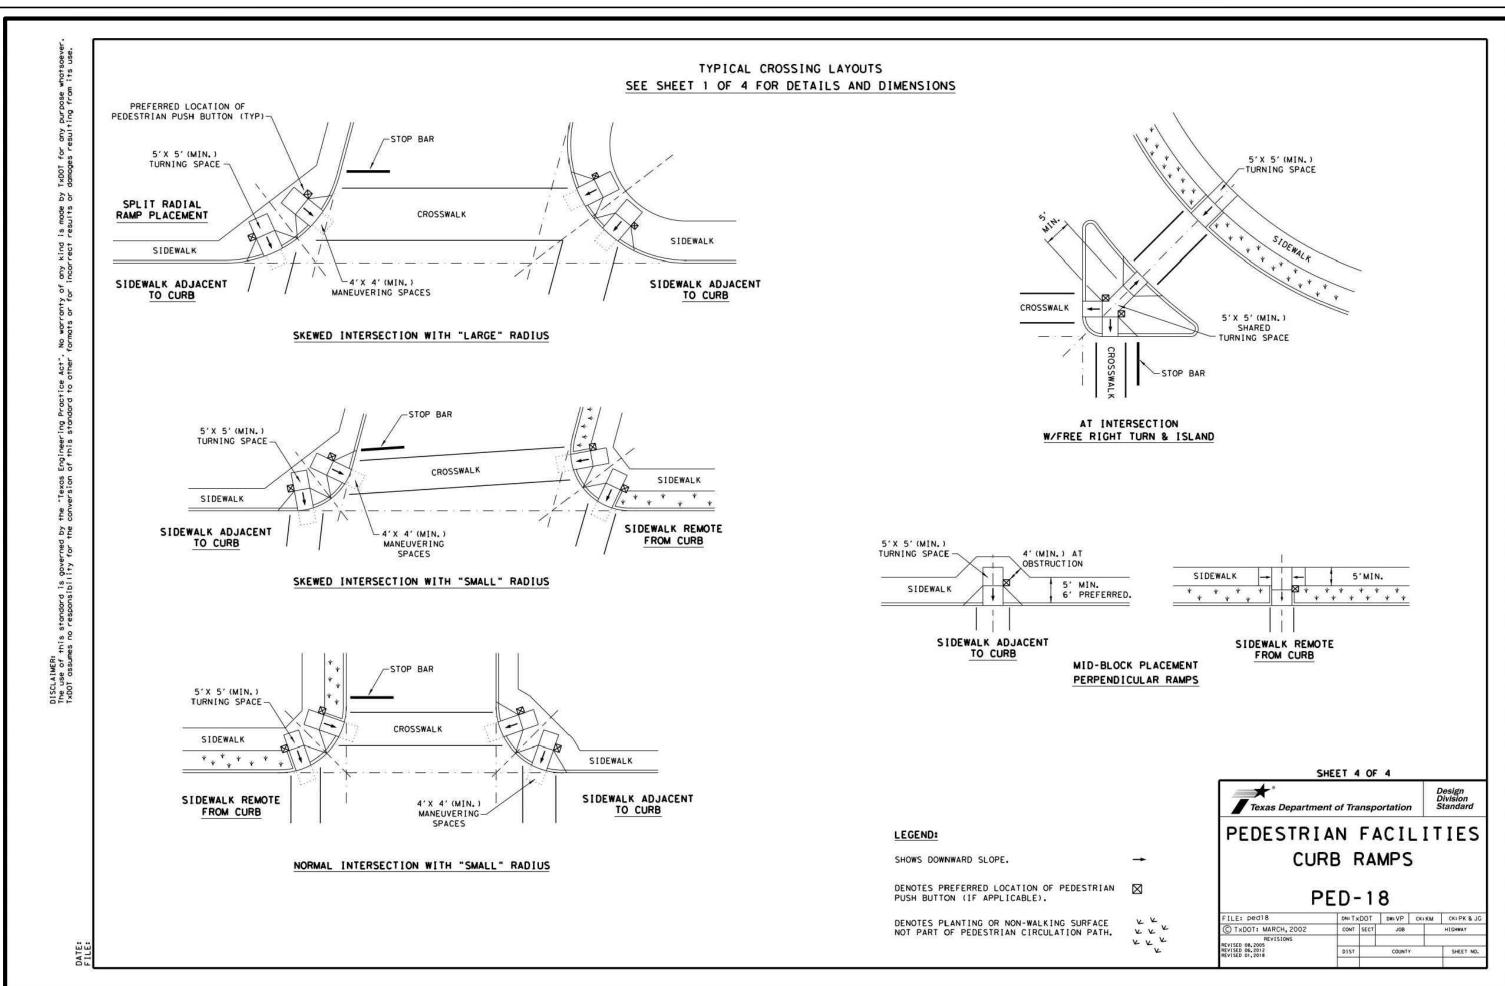

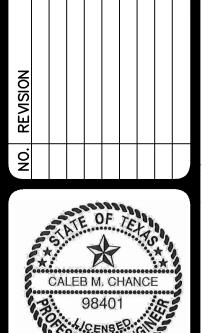

DETECTABLE WARNING SURFACE

DETECTABLE WARNING SURFACE

-DETECTABLE WARNING SURFACE

SHEET 2 OF 4


PEDESTRIAN FACILITIES

CURB RAMPS

DN:TxDOT DW:VP CK:KM CK:PK &

R N

. NO 22-11800298 11680-52 ESIGNER CHECKED BL DRAWN CB C2.11

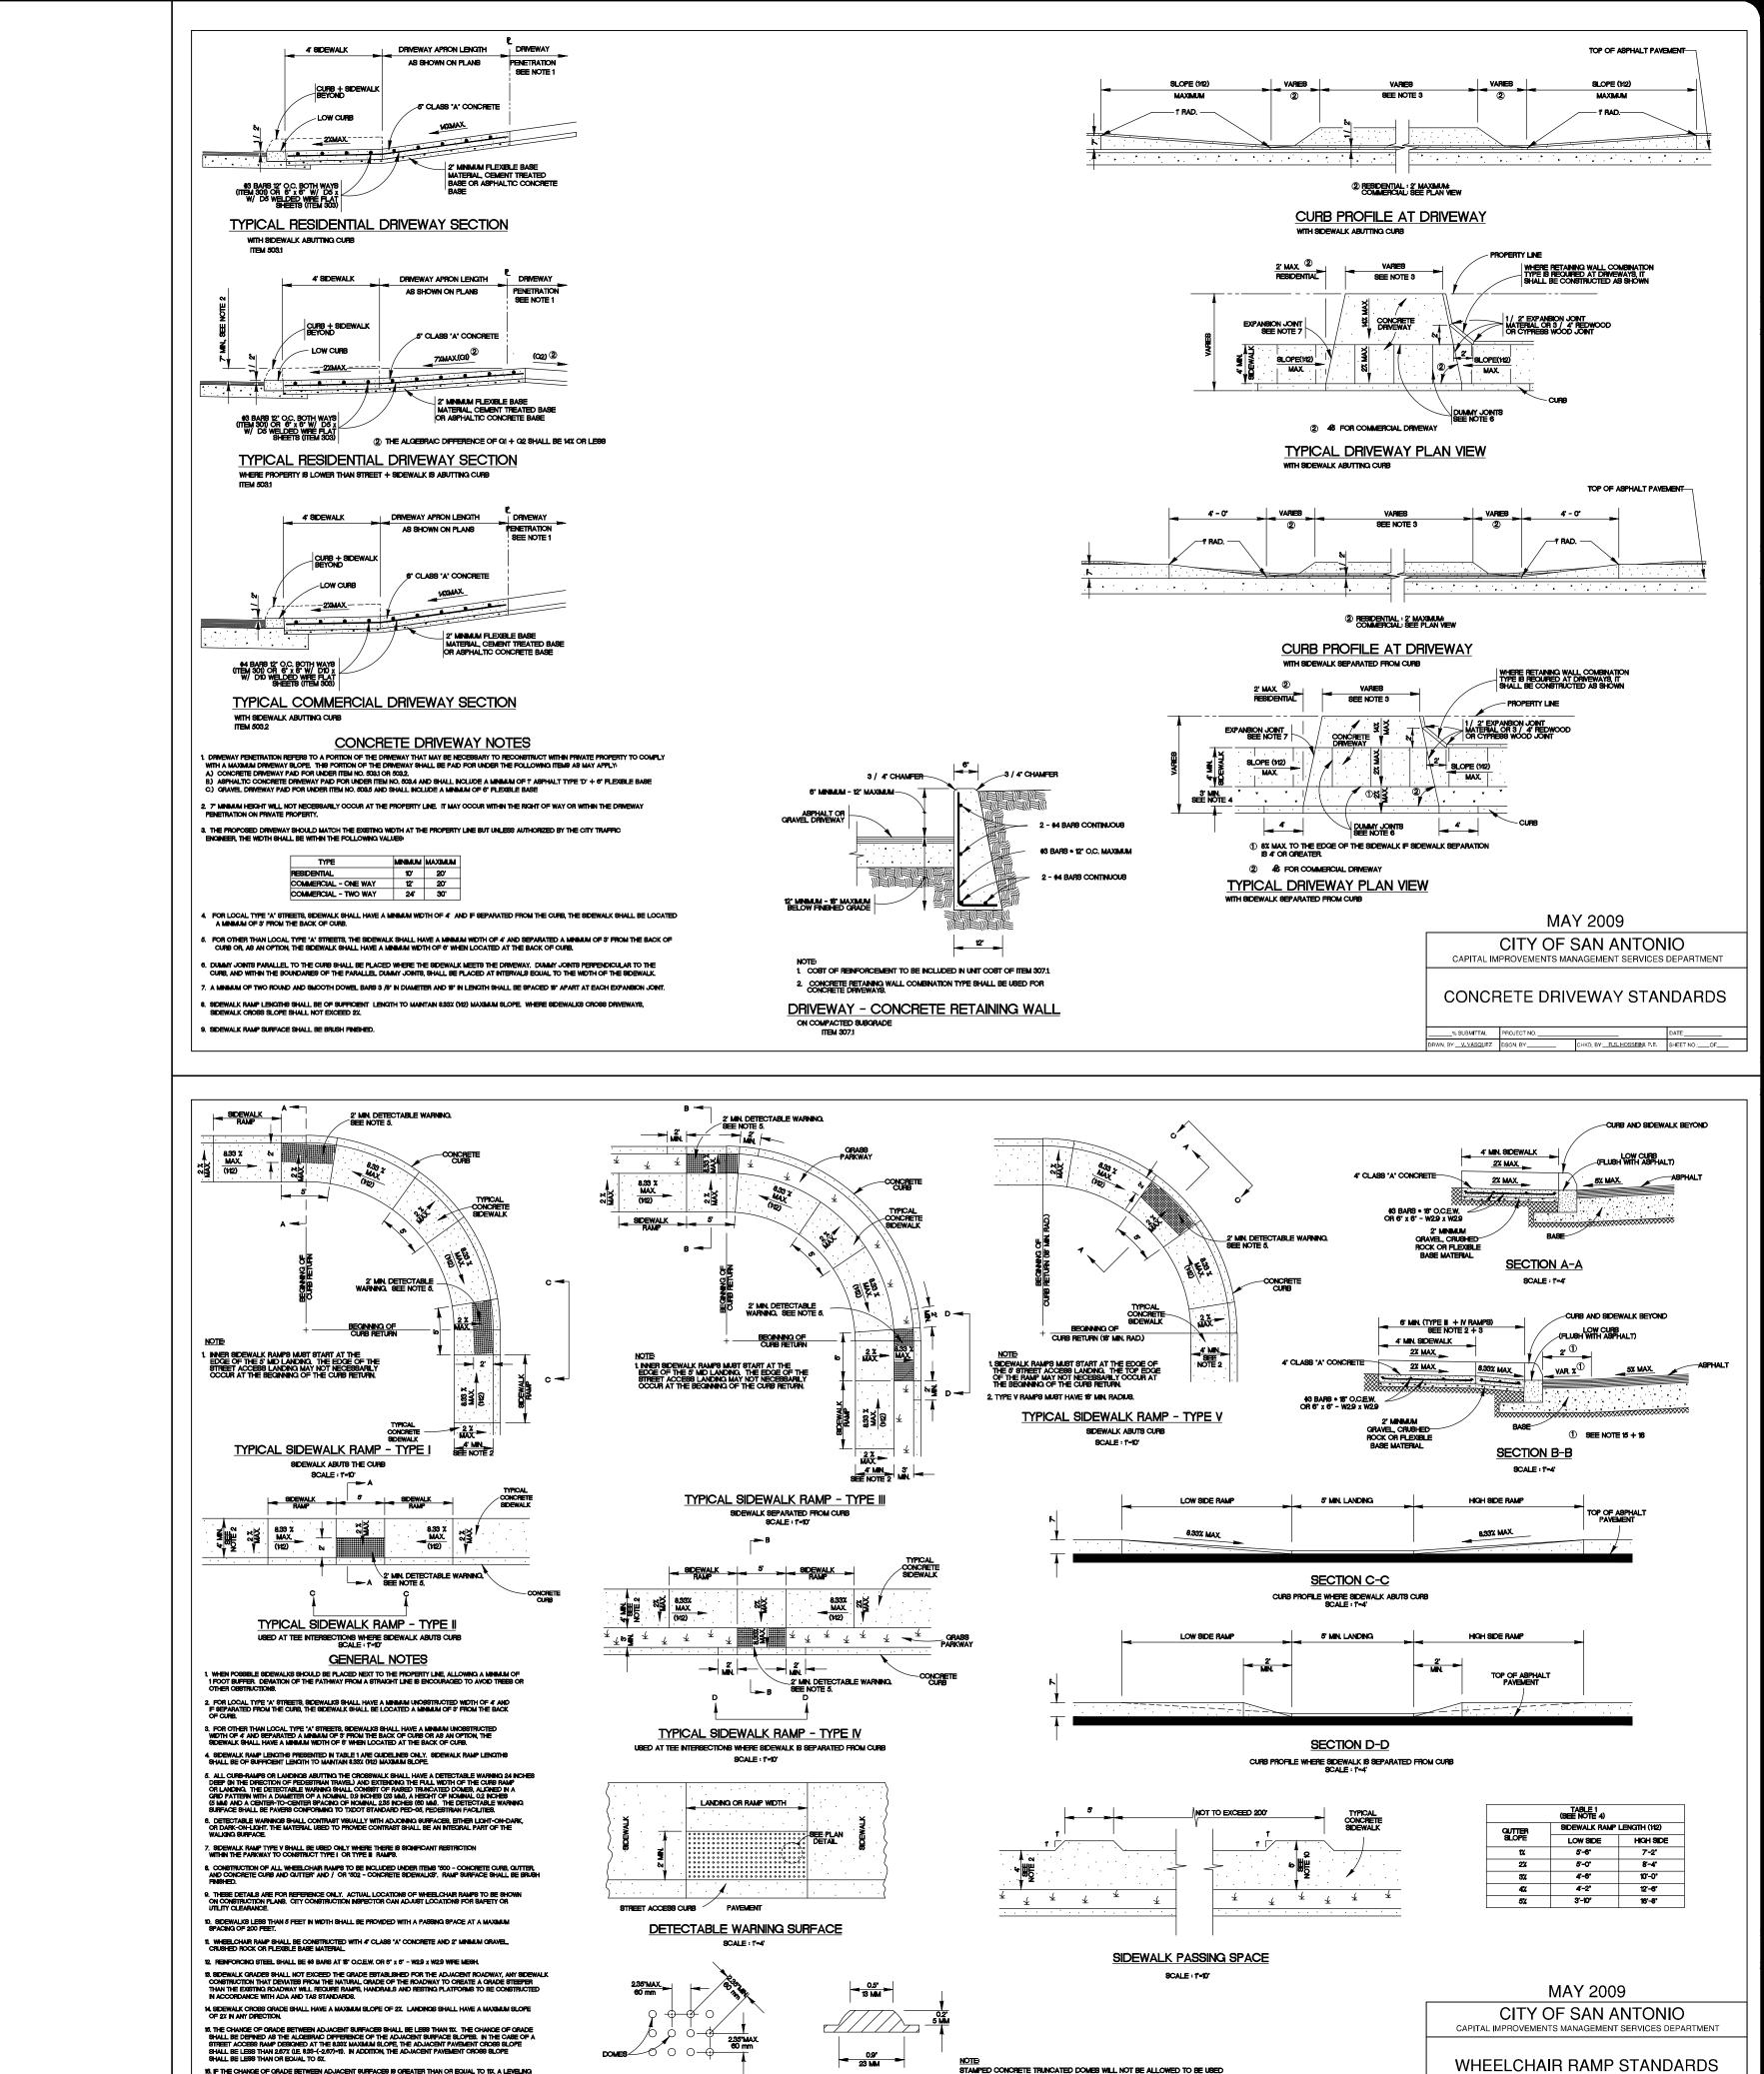

18, IF THE CHANCE OF GRADE BETWEEN ADJACENT BUFFACES IS GREATER THAN OR EQUAL TO 11X, A LEVELING STRIP, 2 FEET IN LENGTH, SHALL BE PROVIDED TO TRANSITION THE ADJACENT SURFACES.

PLAN DETAIL

DOME SECTION

STAMPED CONCRETE TRUNCATED DOMES WILL NOT BE ALLOWED TO BE USED FOR DETECTABLE WARRING ON WHEELCHAIR RAMPS, CONTRACTOR MUST SUBMIT TRUNCATED DOME PROPRIATION THAT IS TO BE USED ON WHEELCHAIR RAMPS TO THE PROJECT MANAGER FOR APPROVAL AT LEAST 30 DATS PRIOR TO INSTALLATION.

RIVERSTONE UNIT - F1 SAN ANTONIO, TEXAS

CALEB M. CHANCE

0

22-11800298

OB NO. 11680-52

OATE MAY 2022


DESIGNER CB


CHECKED BL DRAWN CB


\_\_\_\_\_\_С2.12


 PROJECT NO.:
 DATE:


 DSGN. BY:
 CHKD. BY: R.S. HOSSEINL P.E. SHEET NO.:

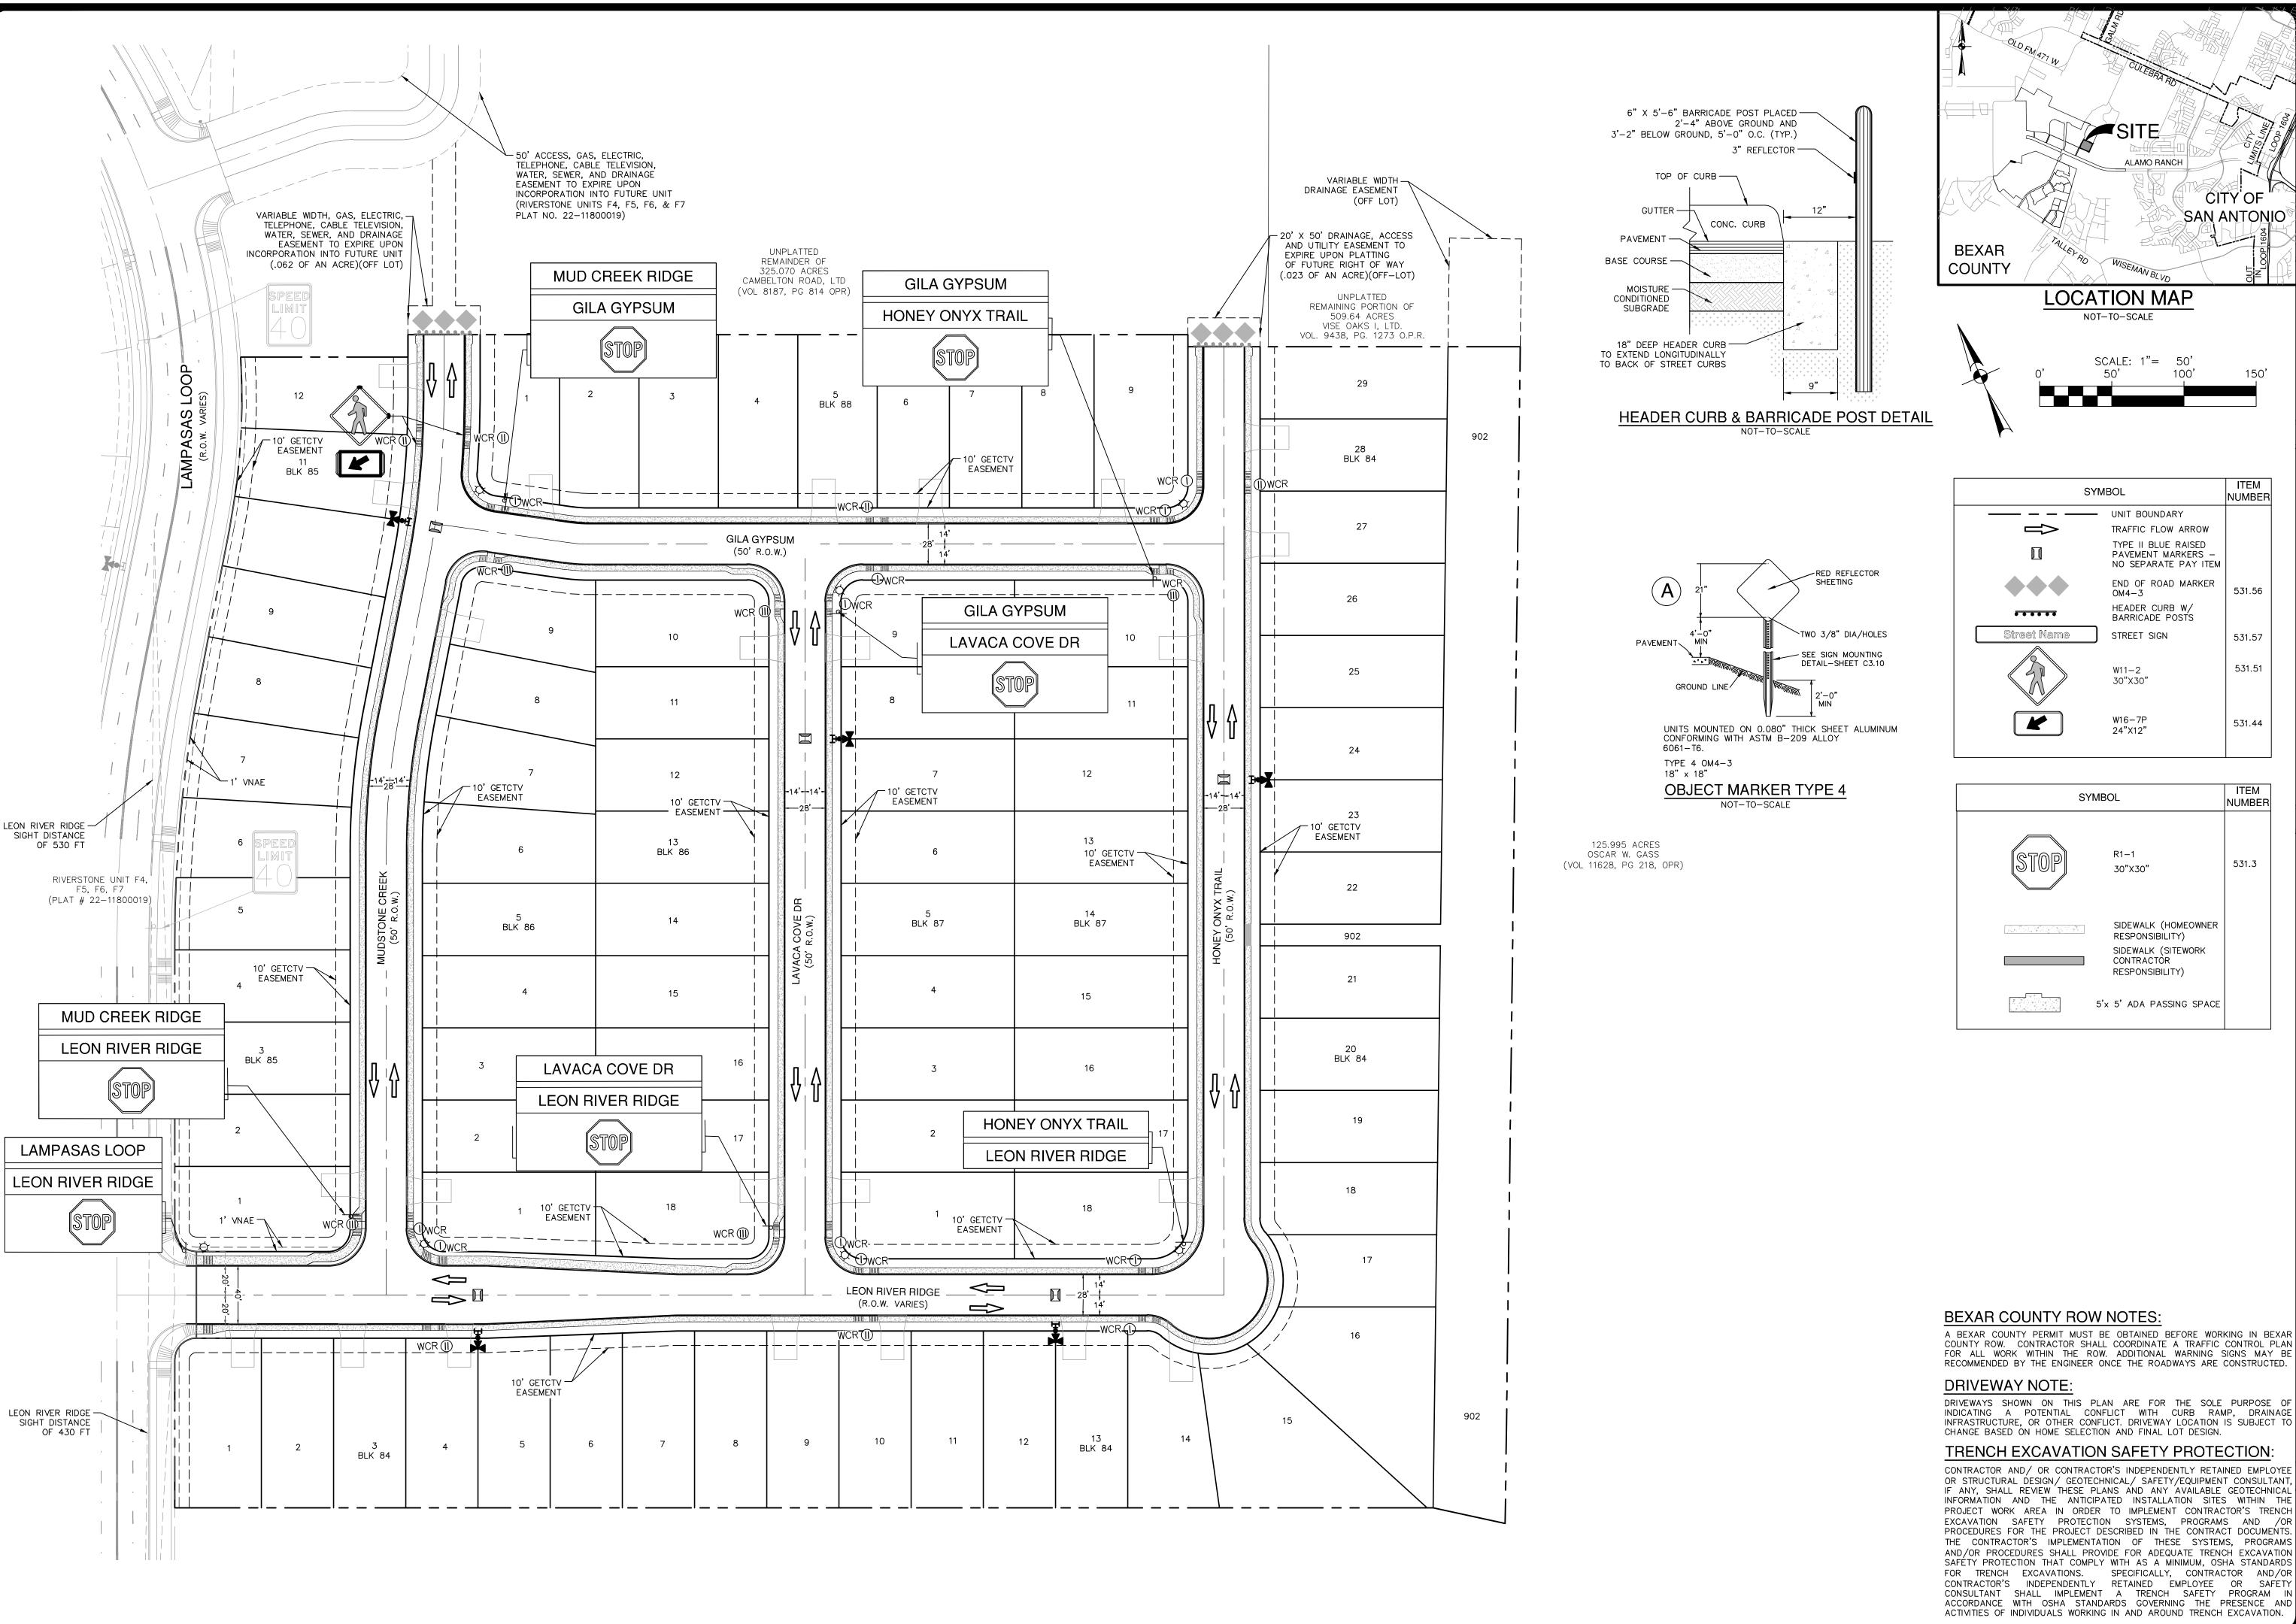

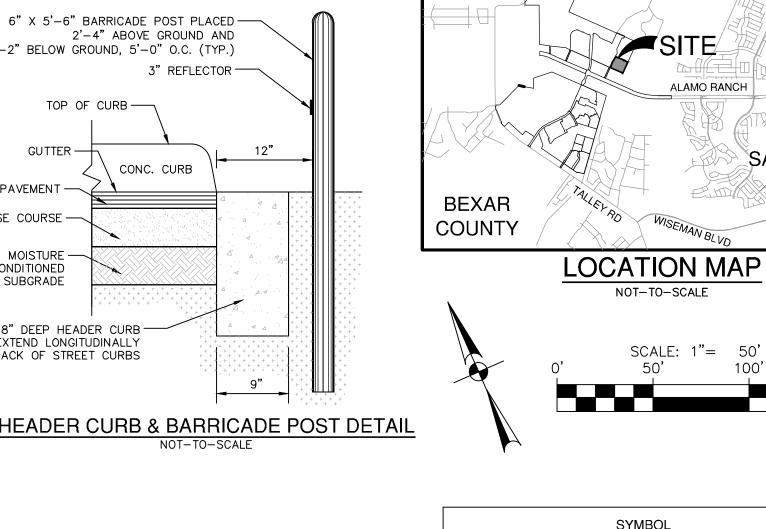

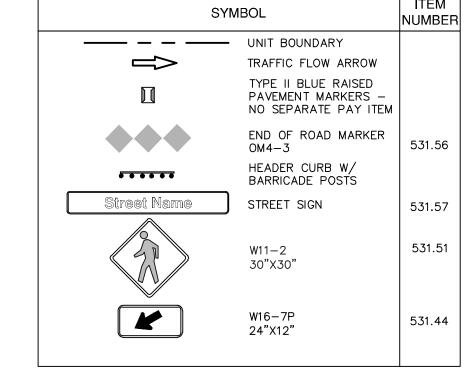

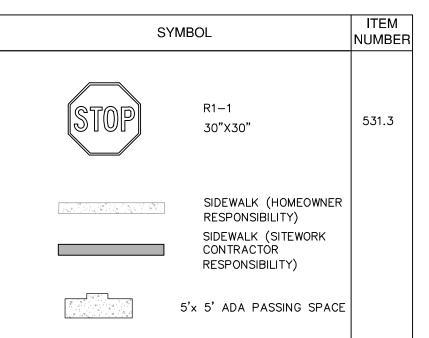

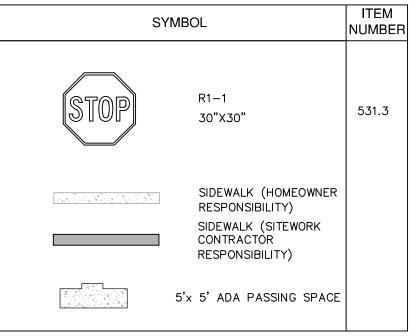

RIVERSTONE I SAN ANTONIO,

CALEB M. CHANCE


98401


0


11680-52 DATE NOVEMBER 2022


PLAT NO. 22-11800298 CHECKED BL DRAWN CV

C3.00

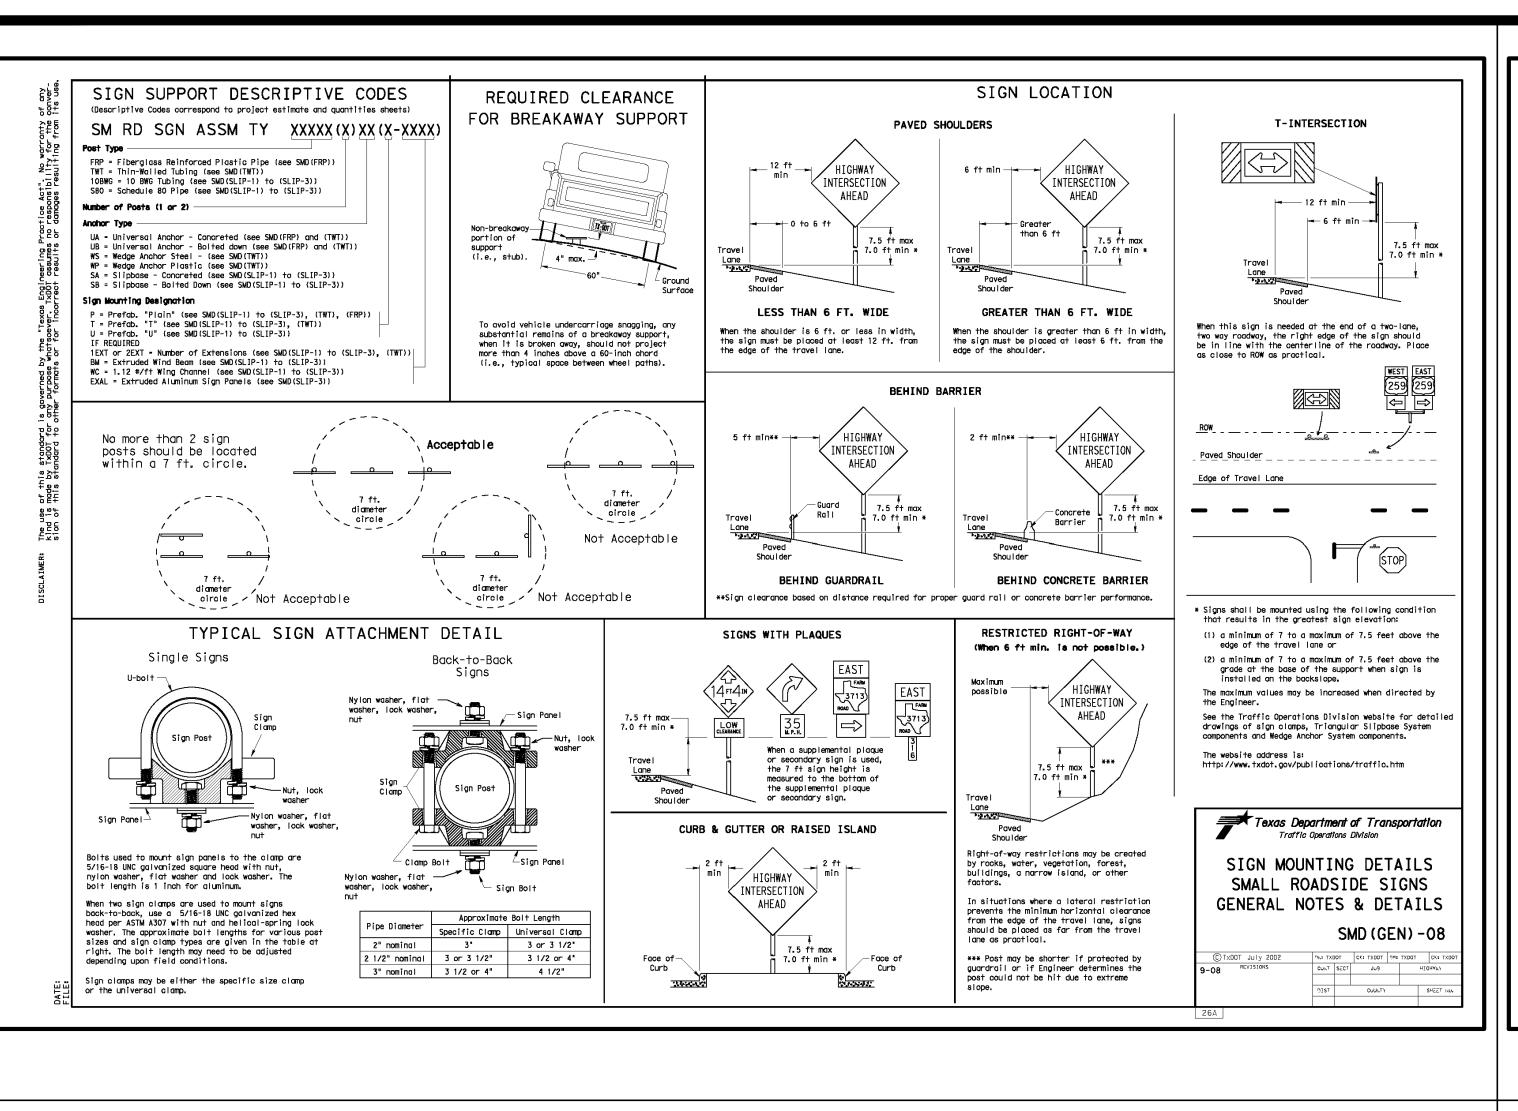

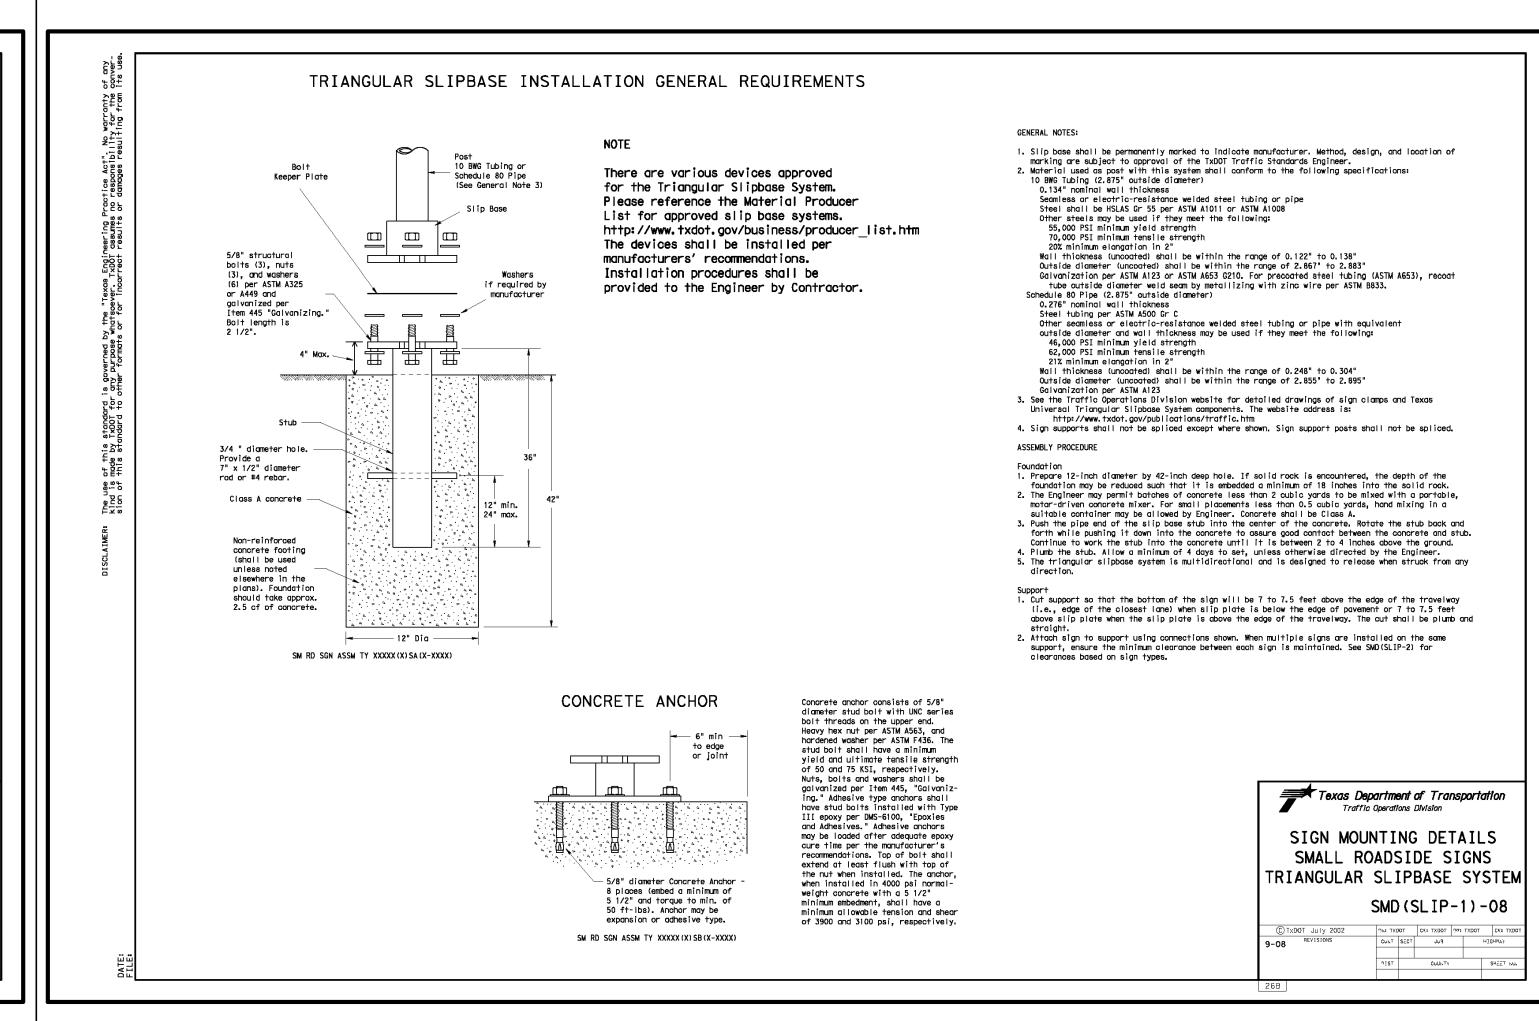


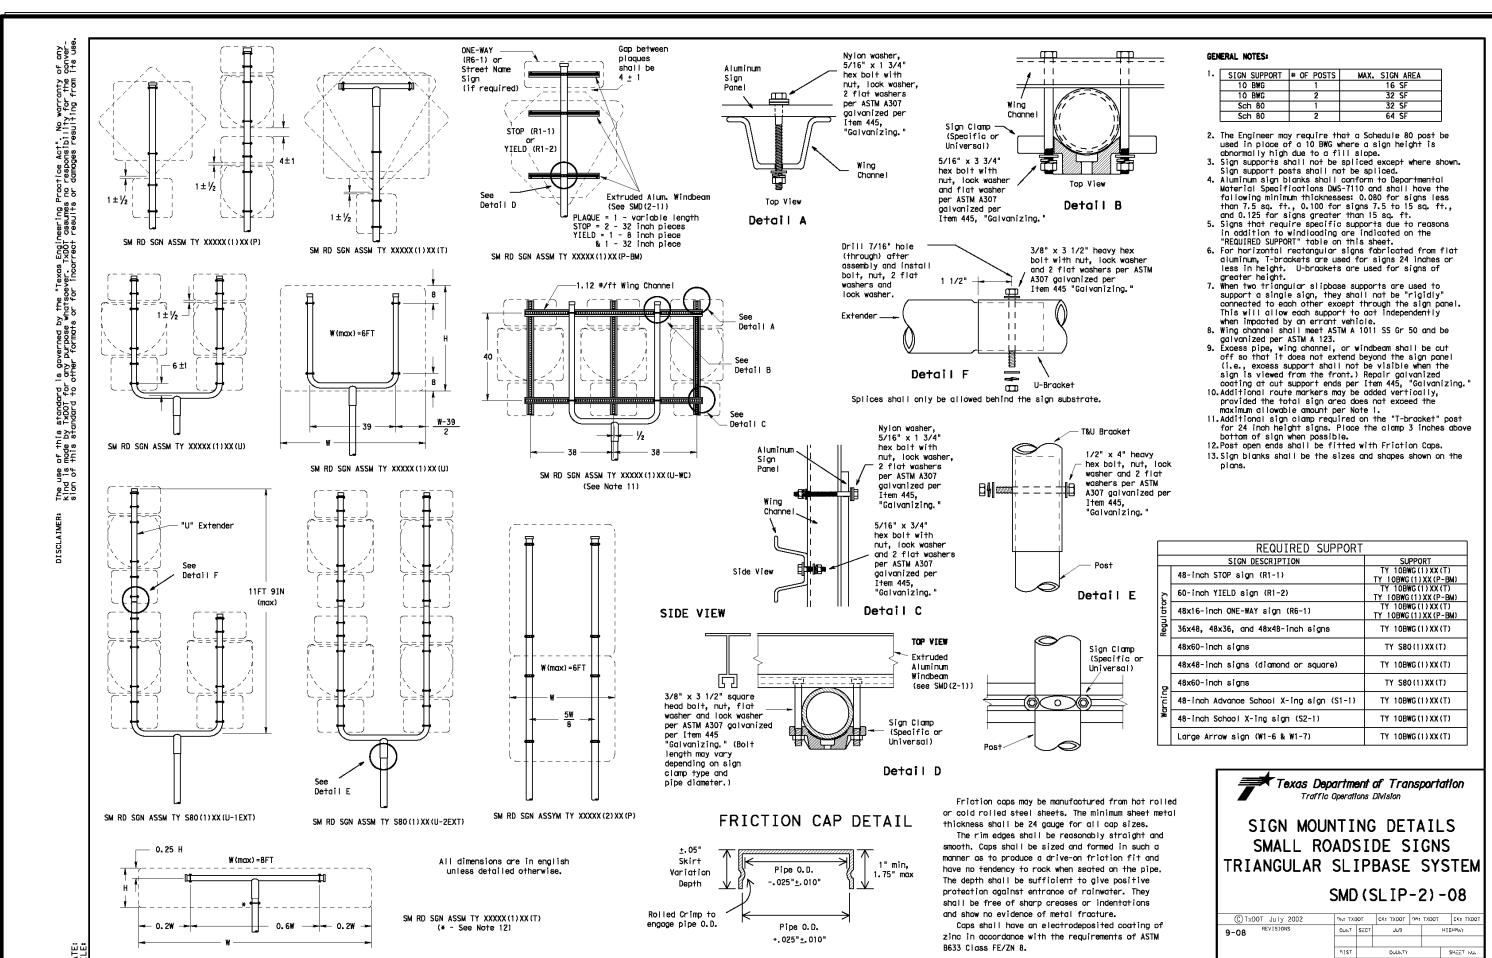

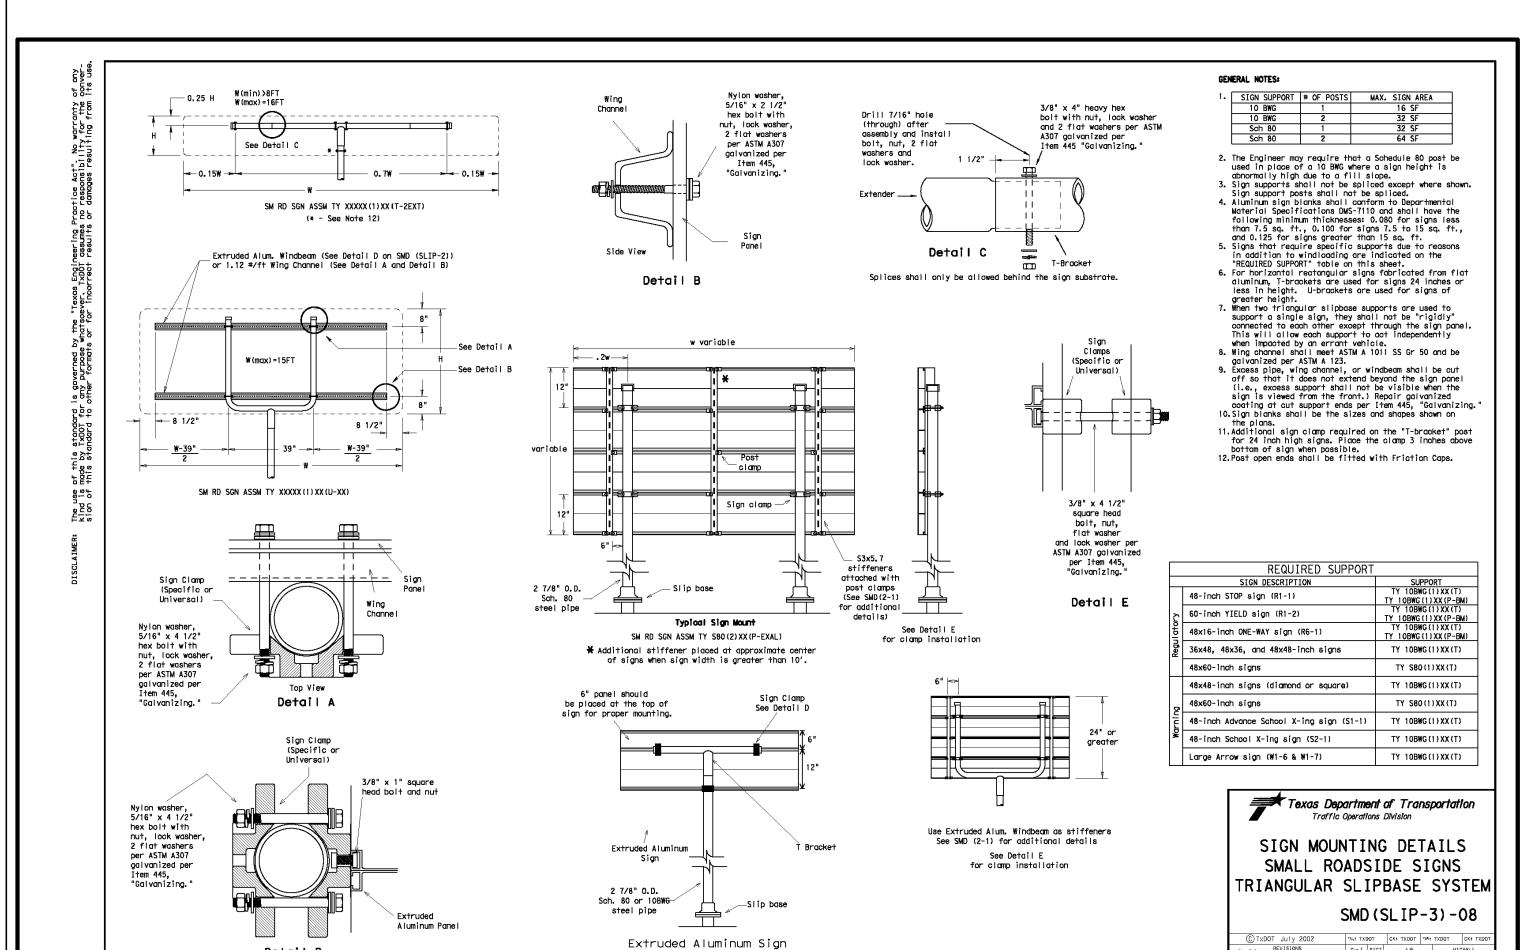

With T Bracket


EXTRUDED ALUMINUM SIGN WITH T BRACKET





CALEB M. CHANCE


22-1180029 11680-52 HECKED BL DRAWN CE


DESIGNER C3.10

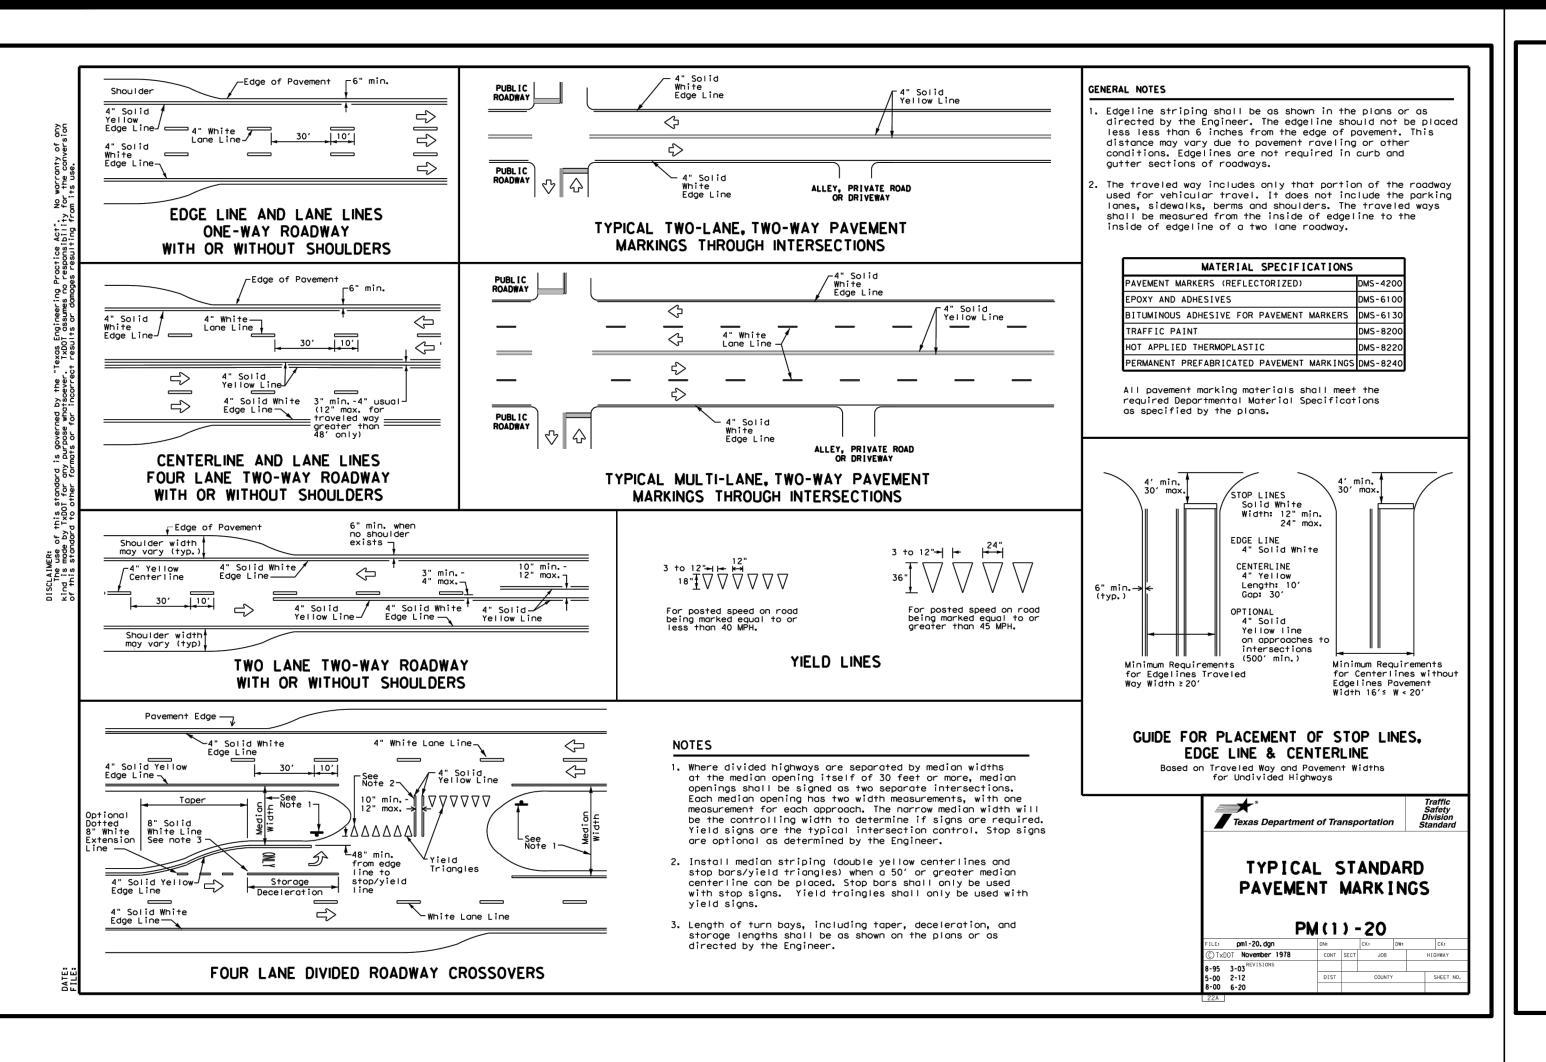

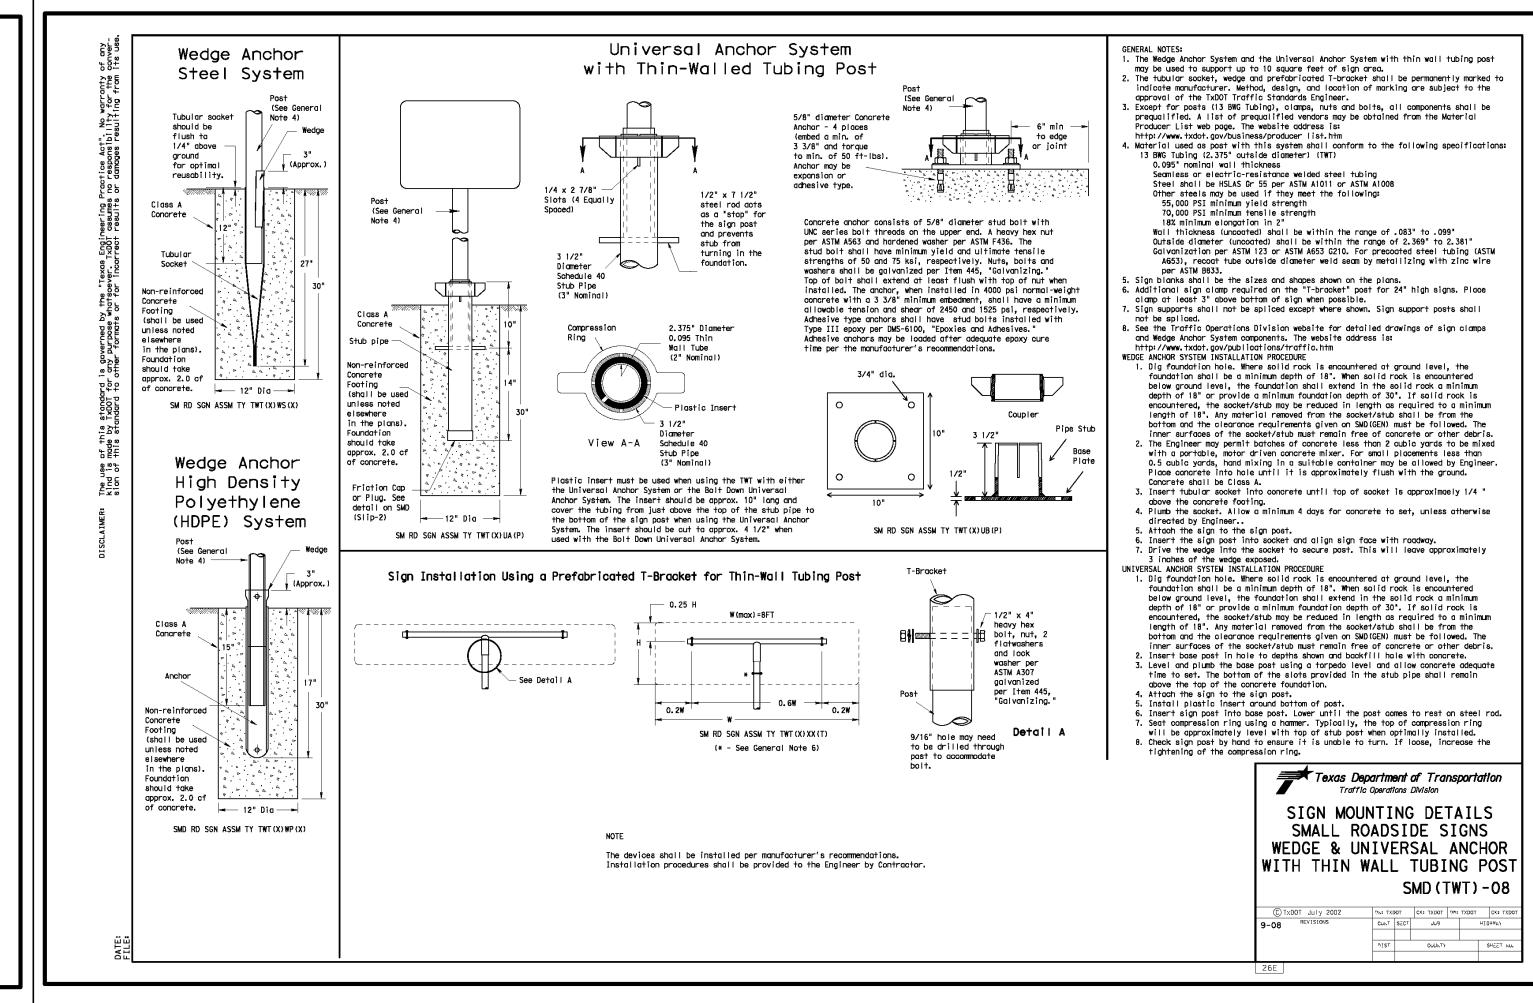

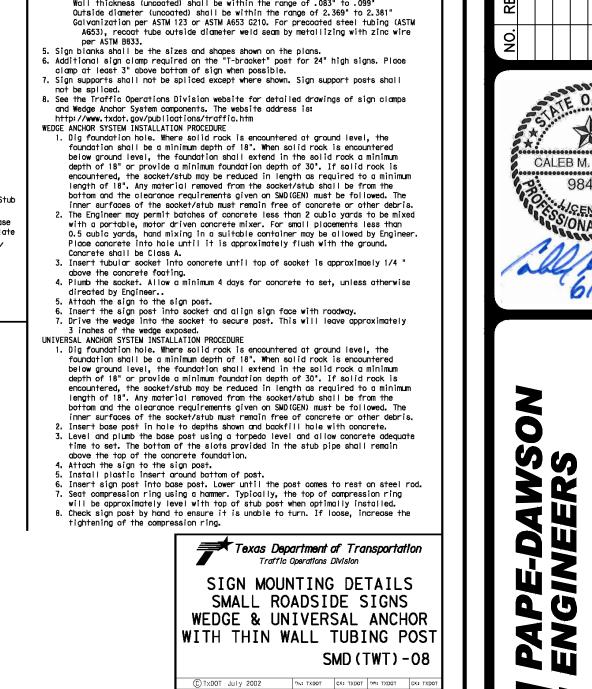

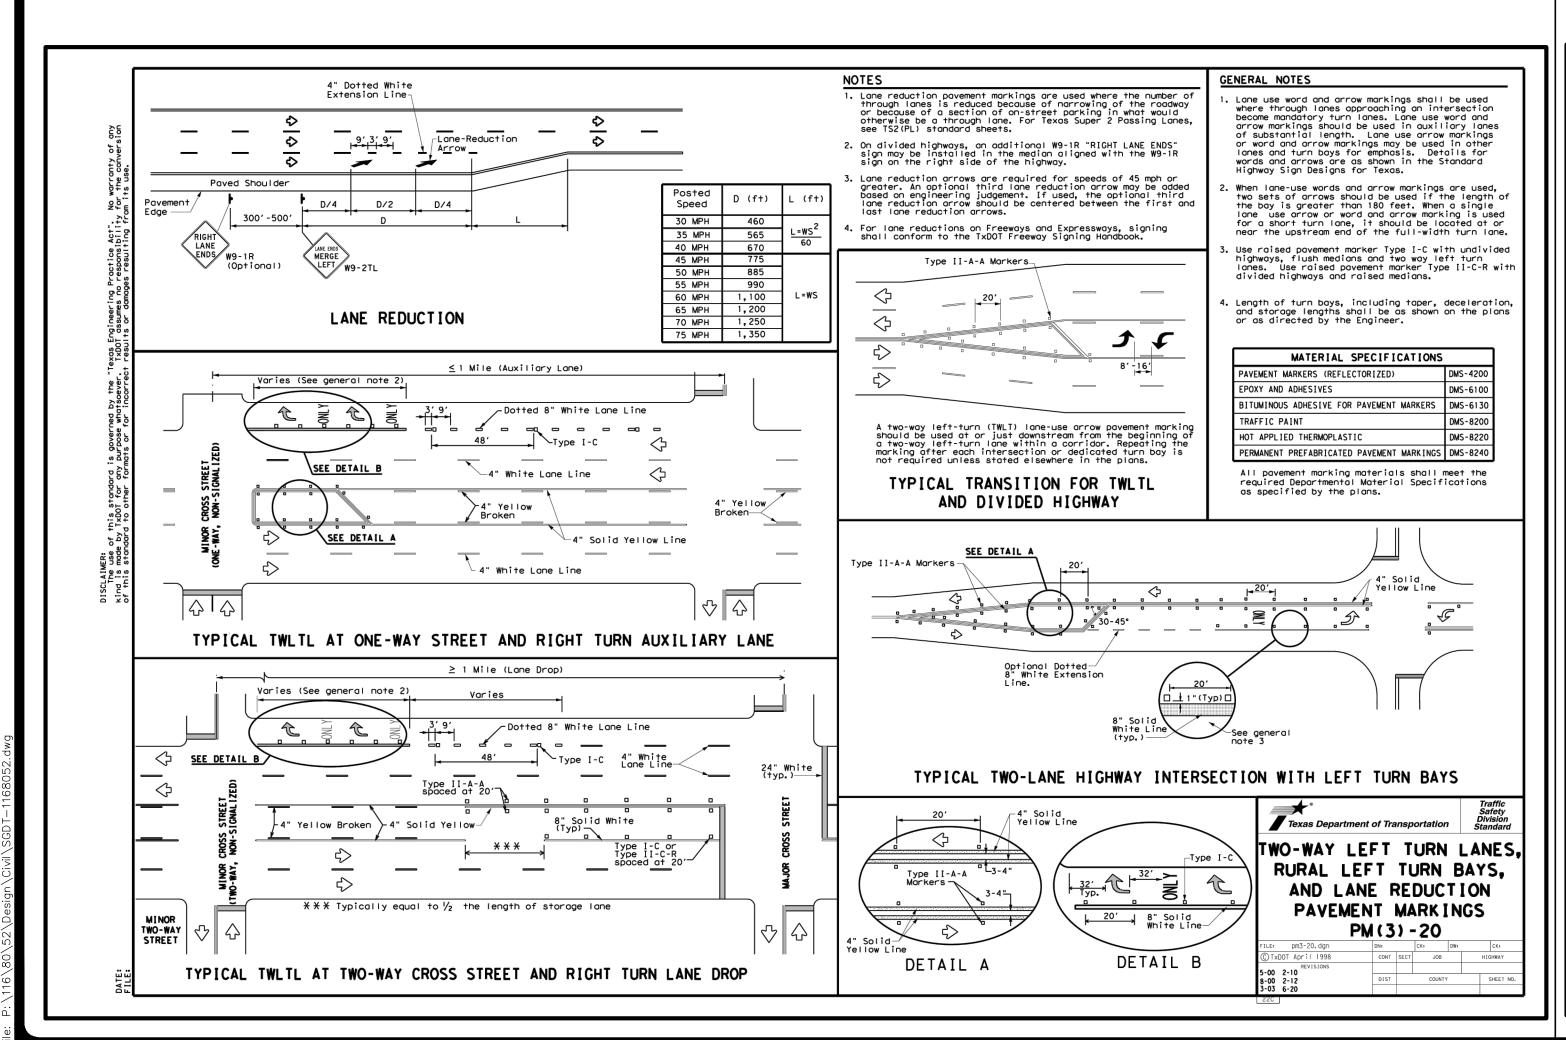


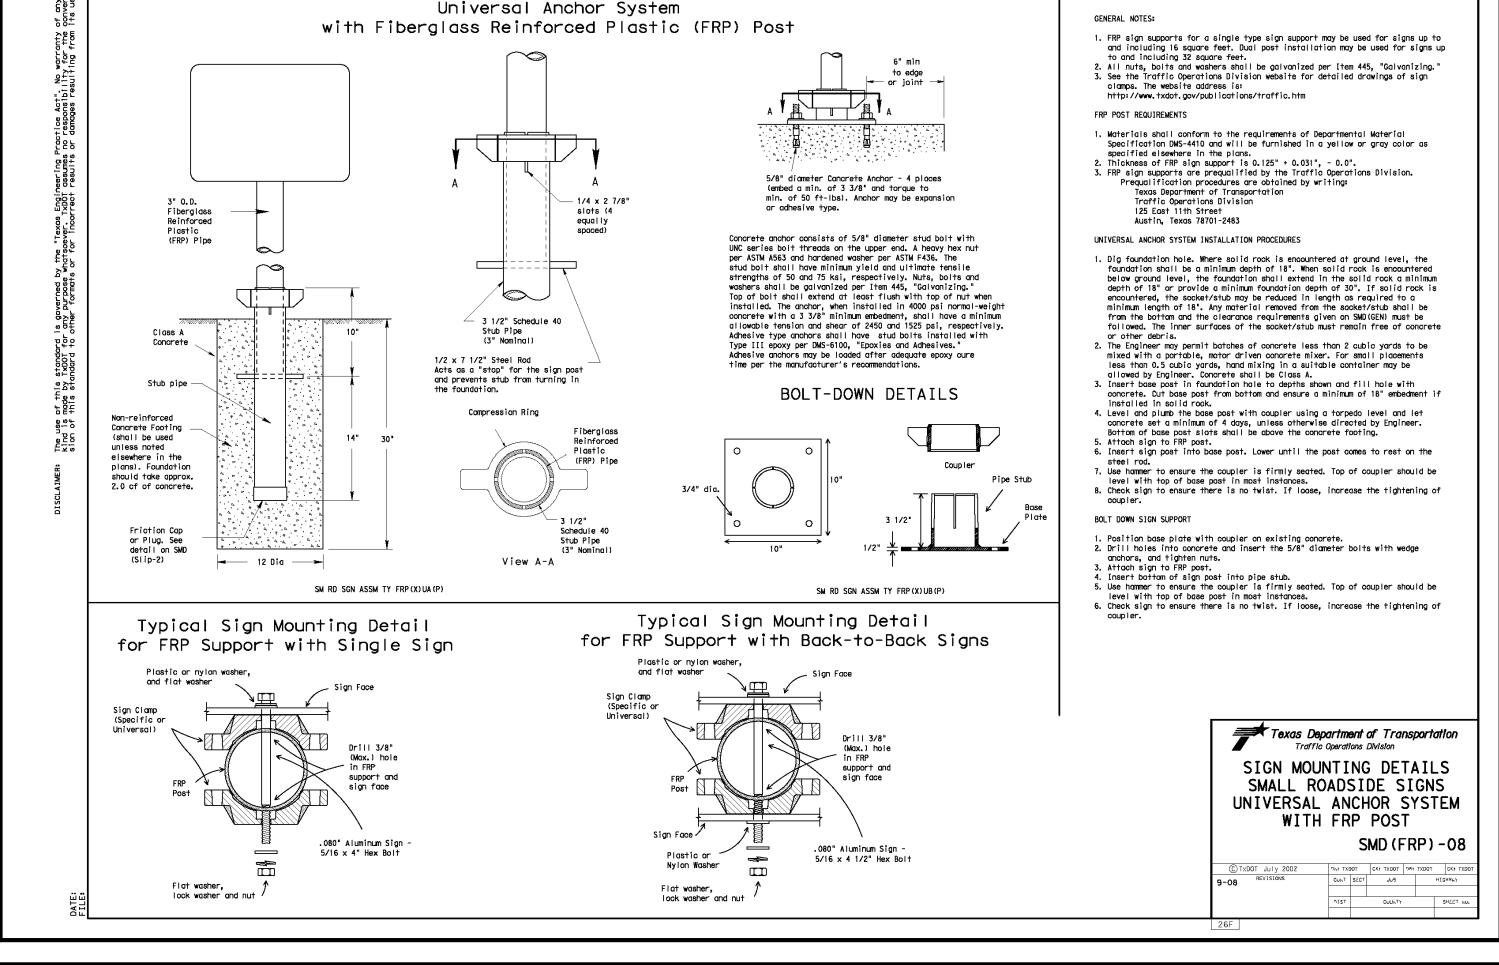



CALEB M. CHANCE

22-1180029 11680-52 DESIGNER IECKED BL DRAWN CE

C3.11

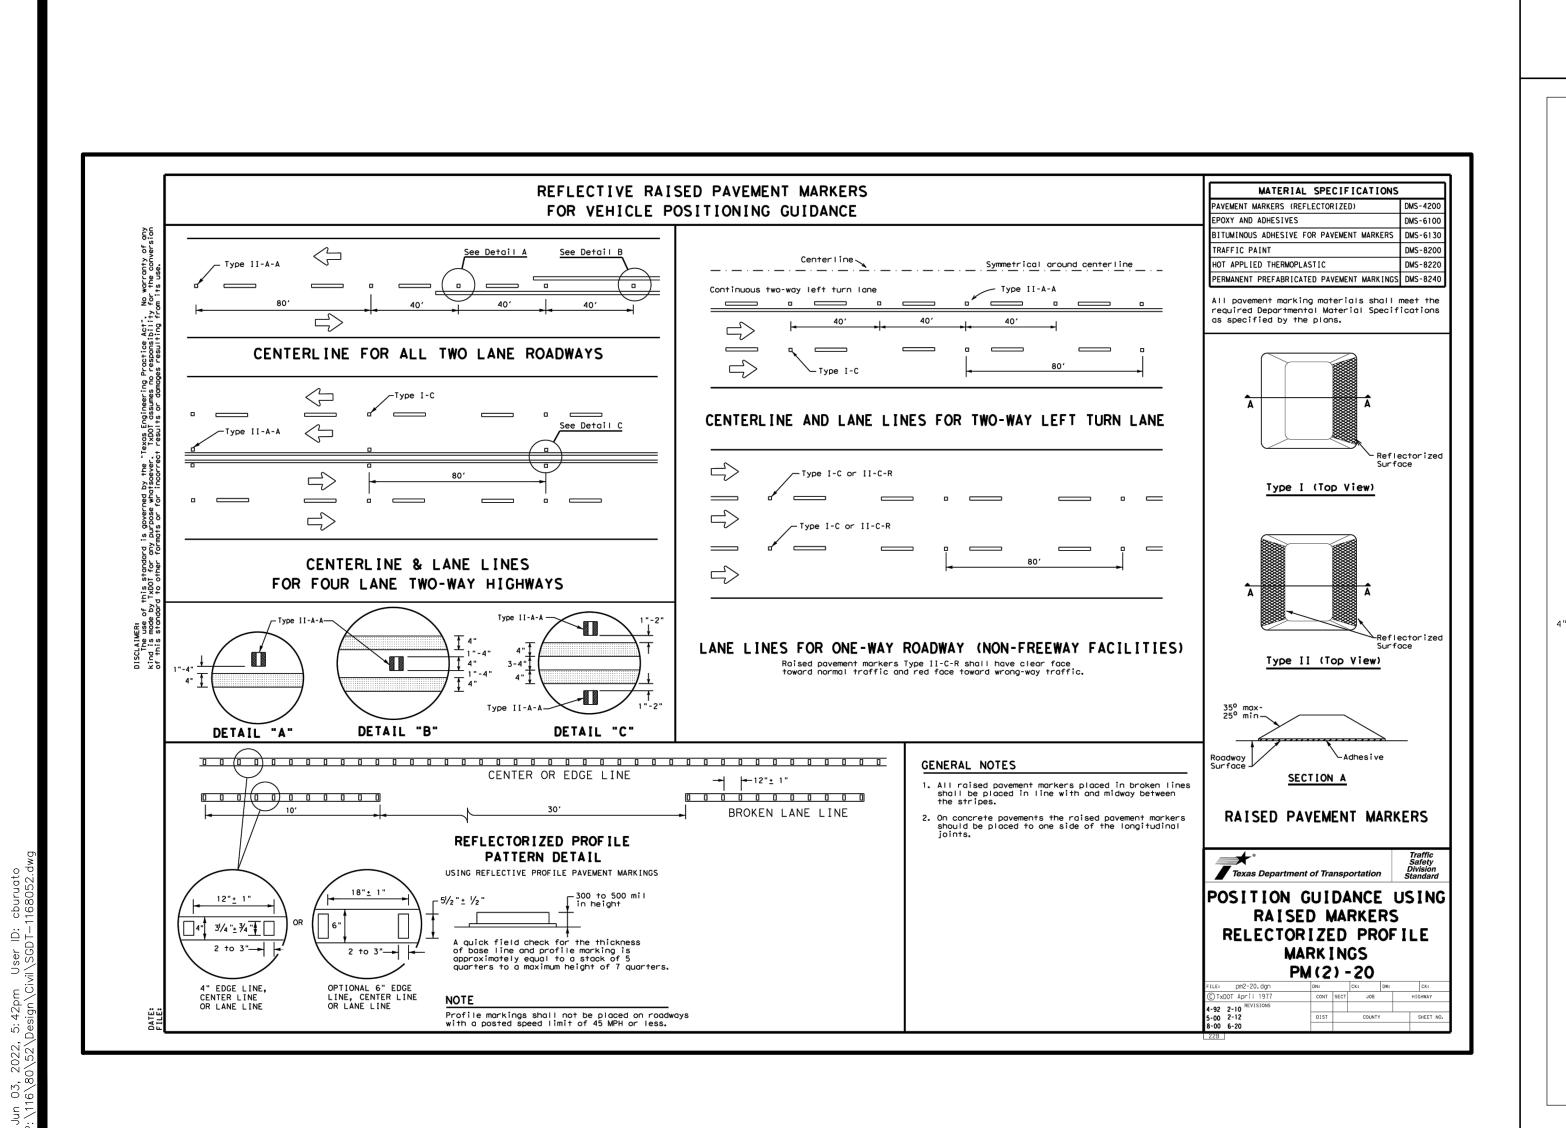

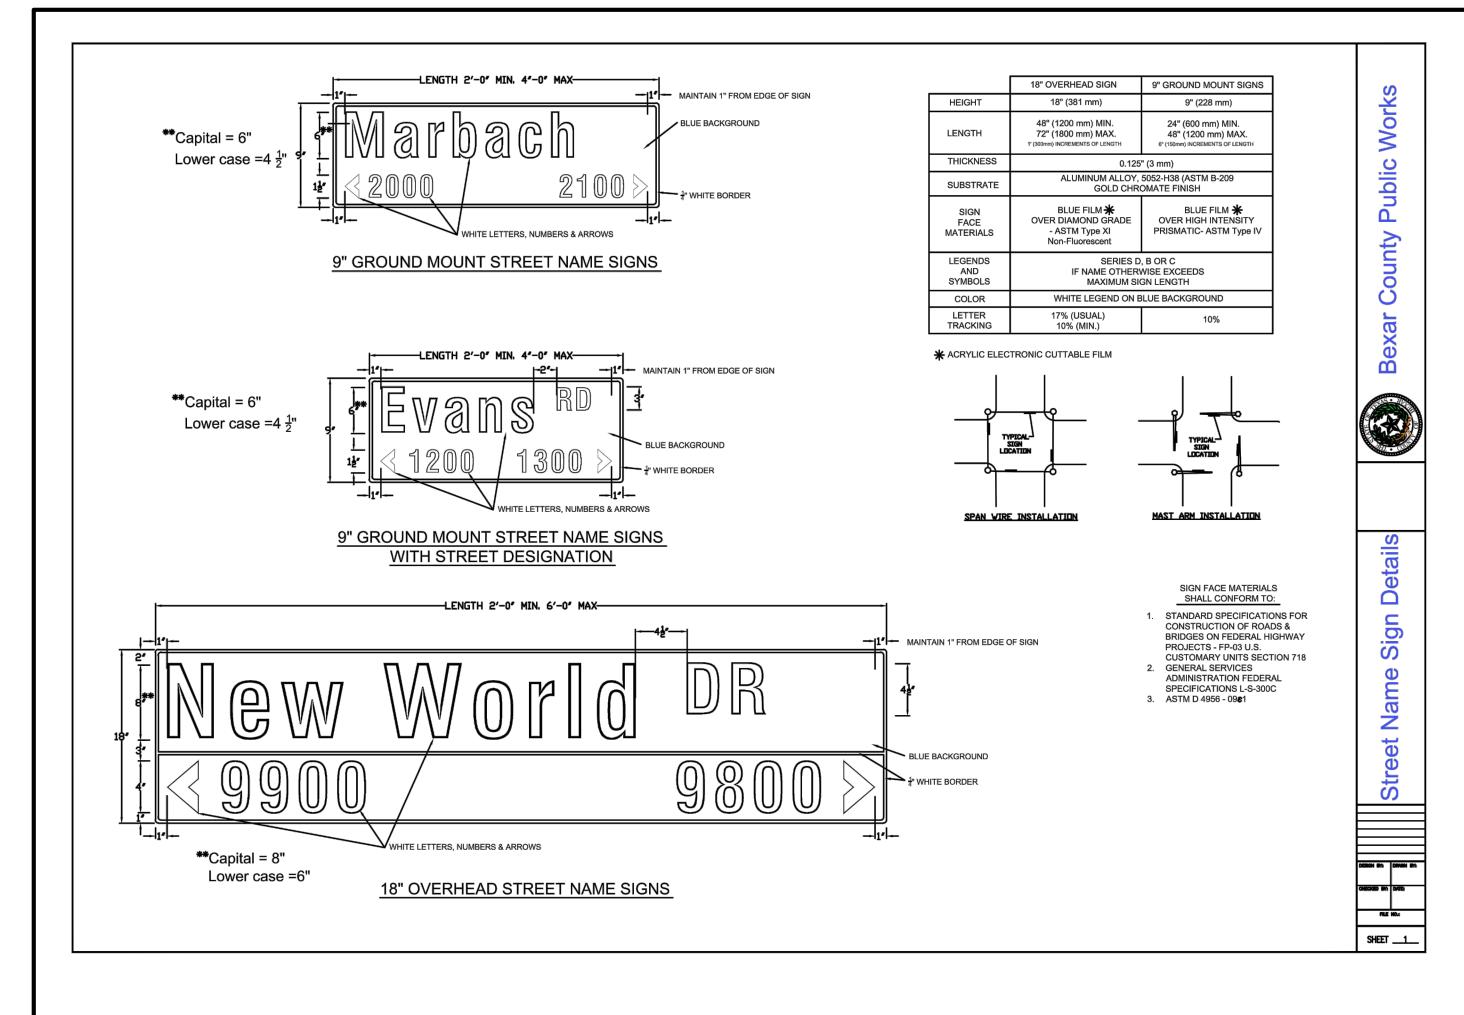

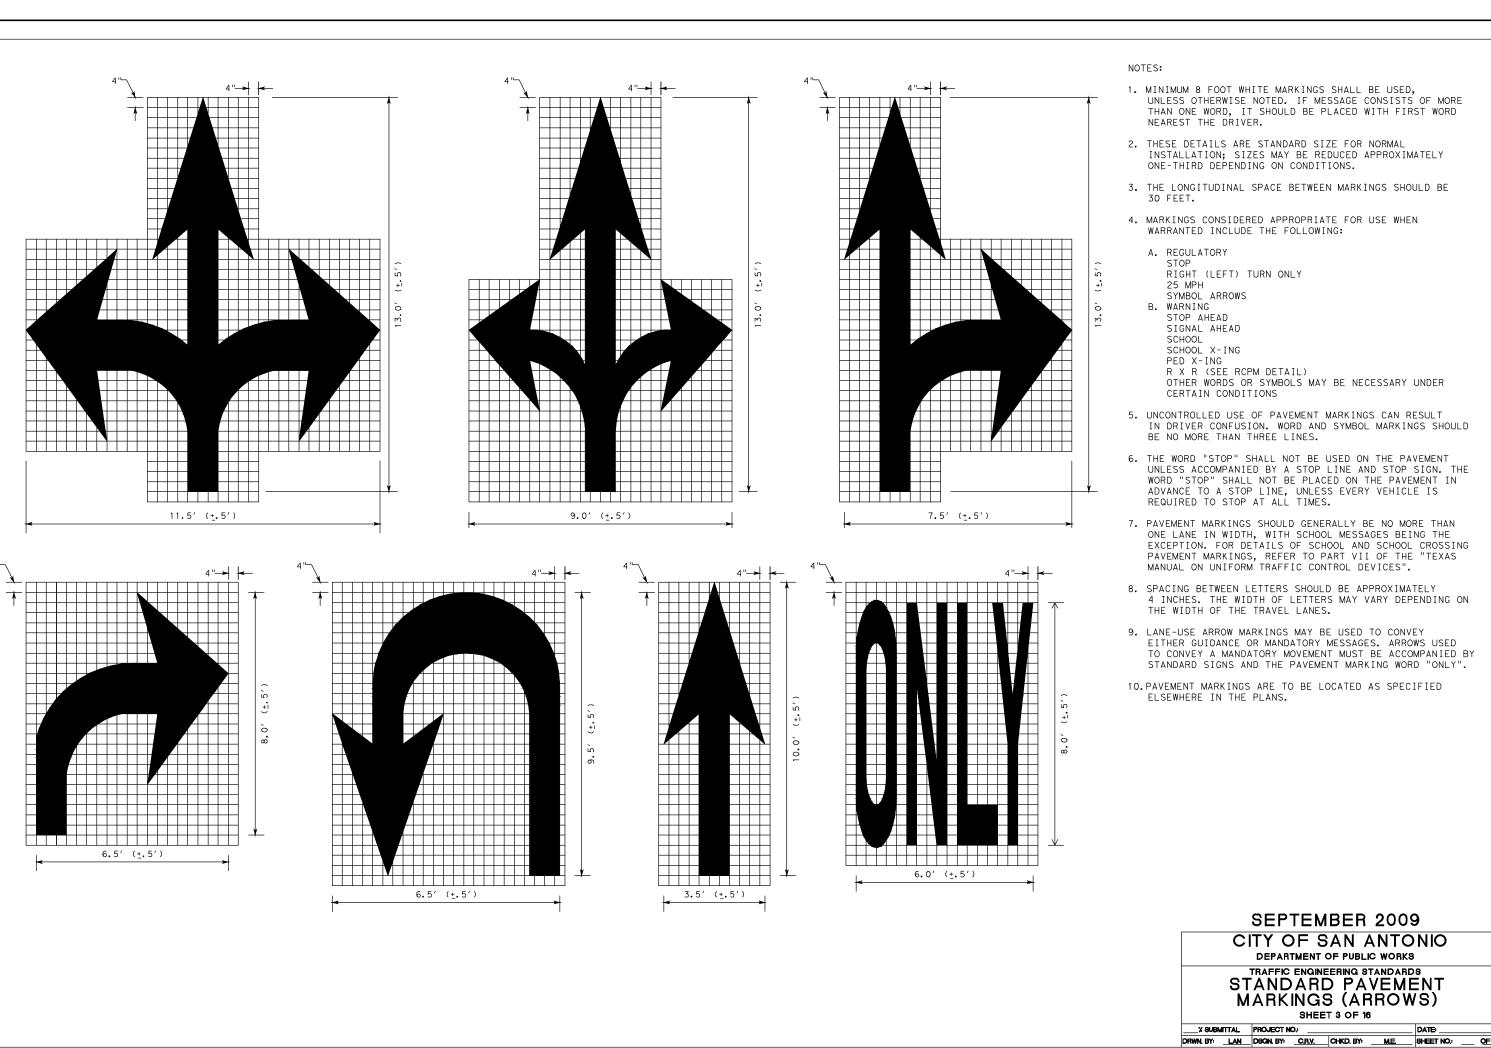


0

CALEB M. CHANCE

<sub>r NO.</sub> 22-11800298 11680-52 DESIGNER CB CHECKED BL DRAWN CB

C3.12

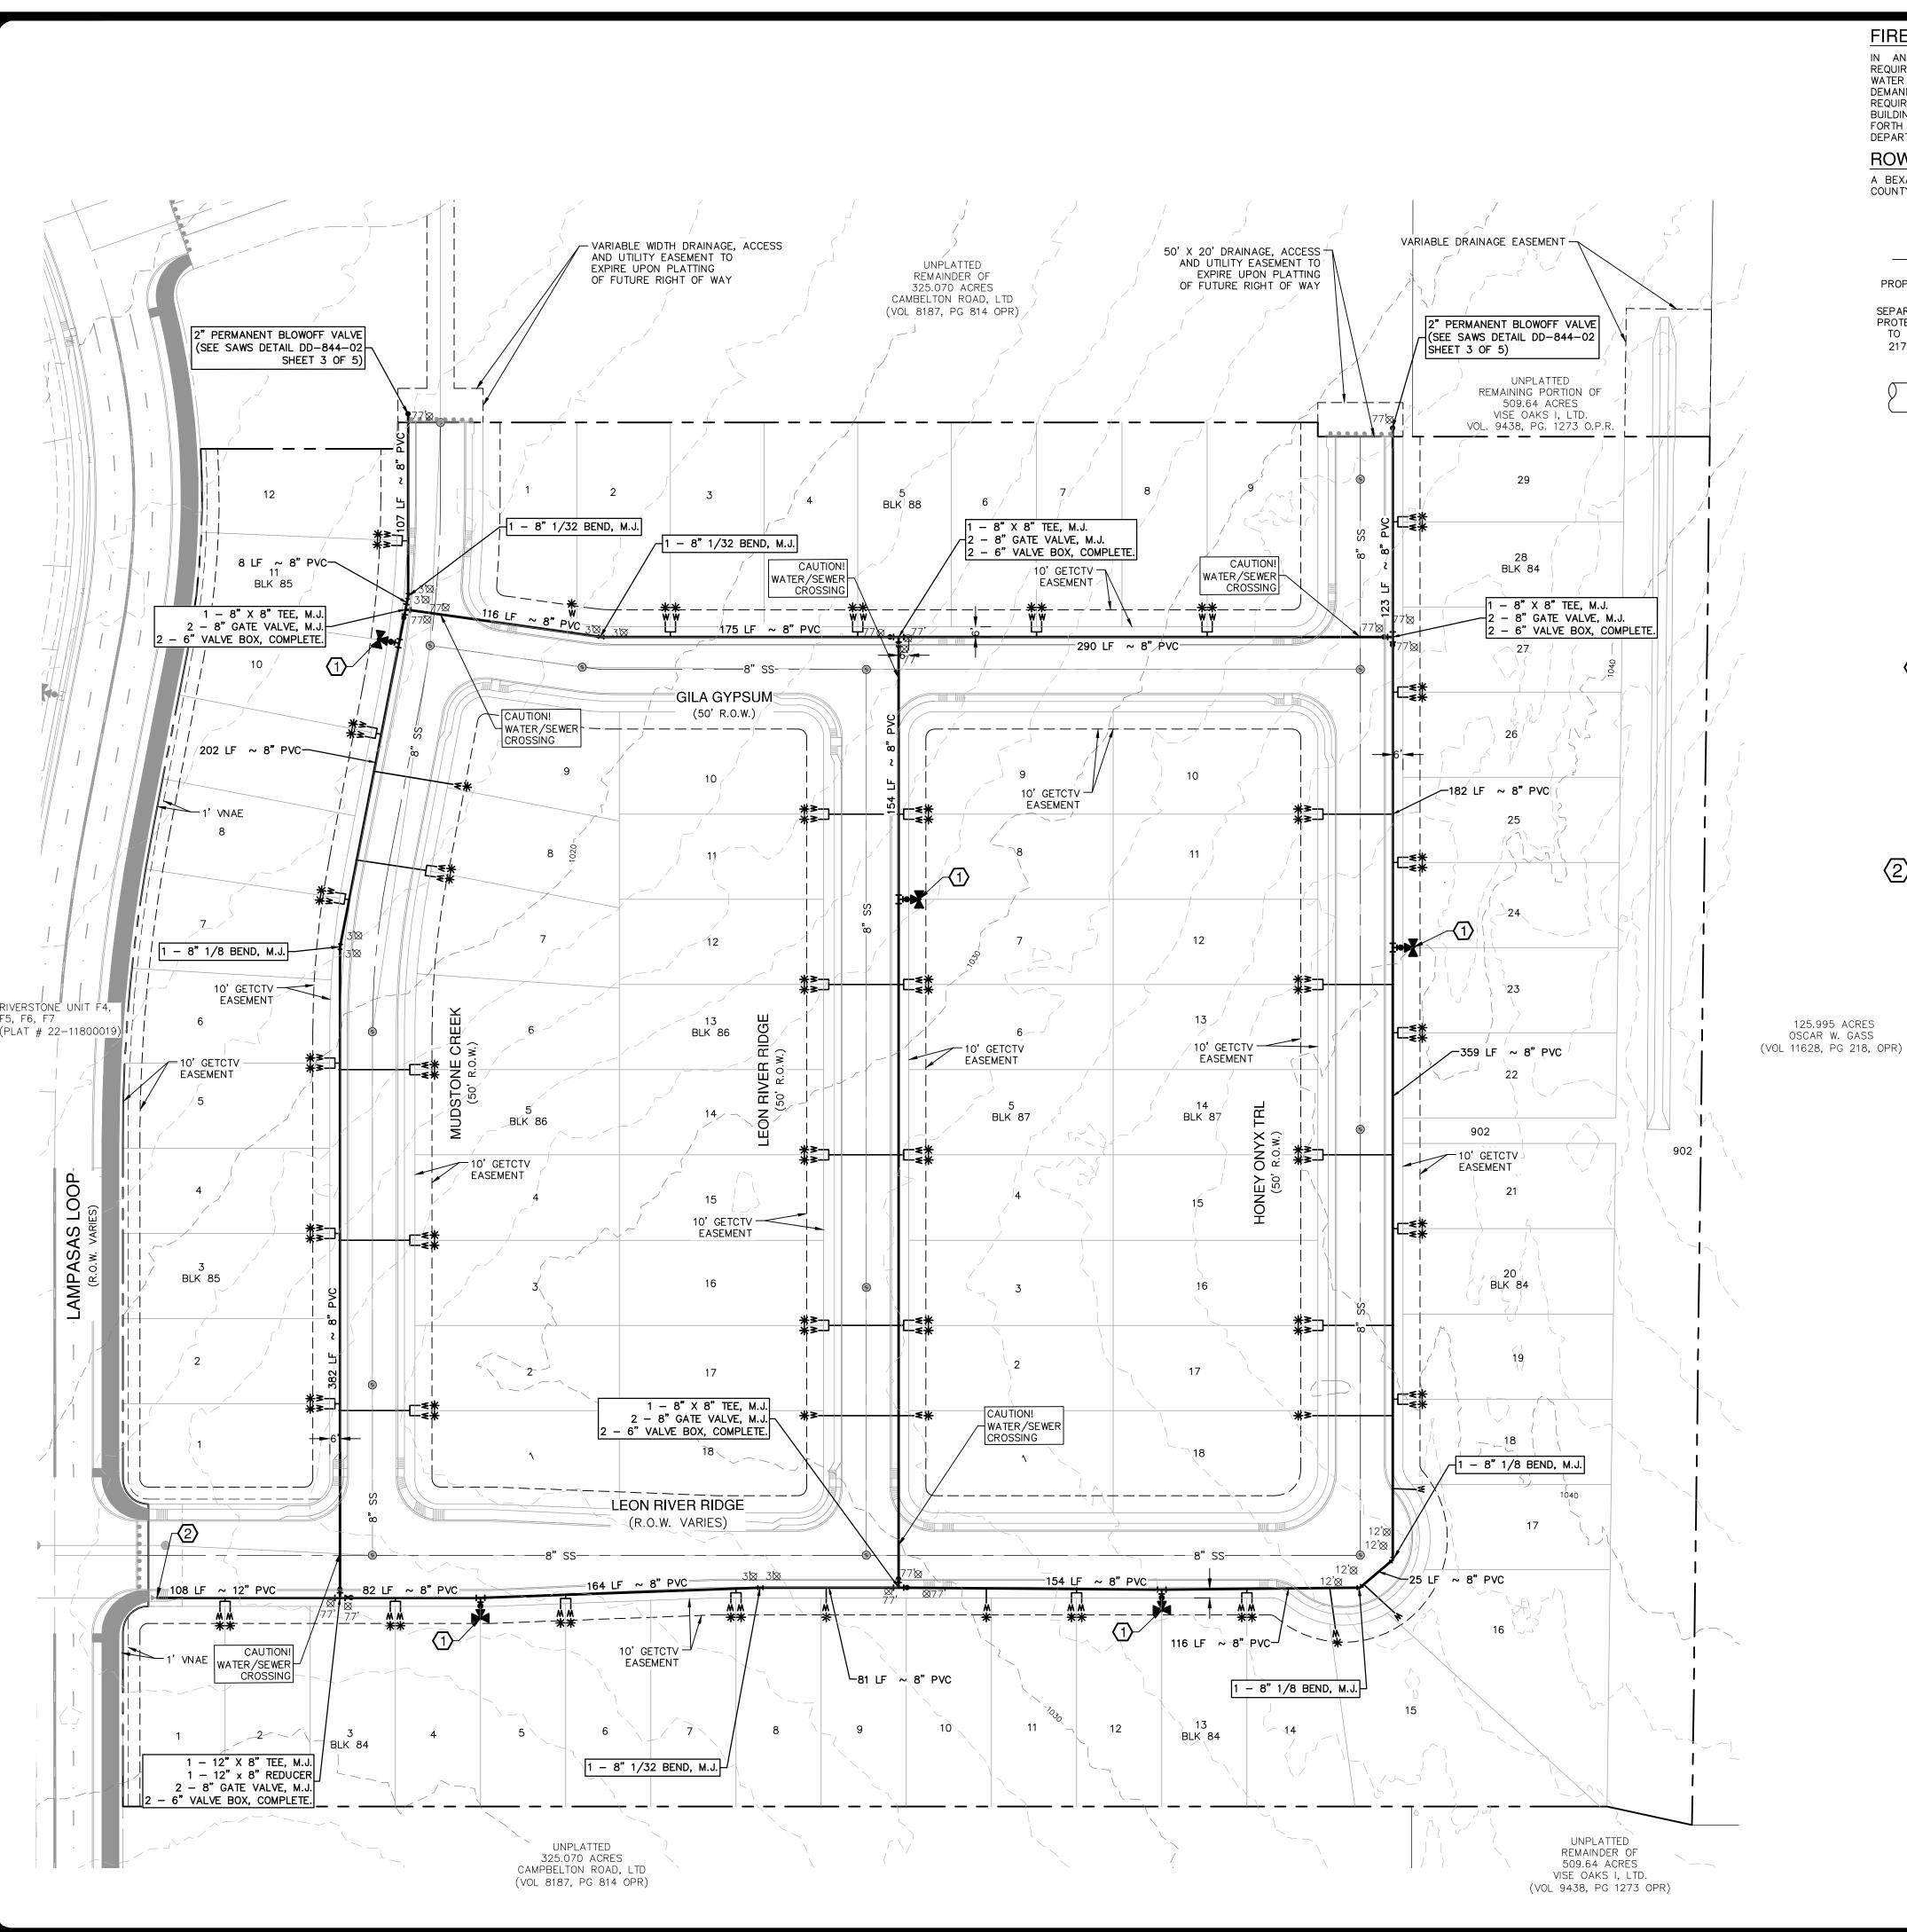


FIRE FLOW NOTE:

IN AN EFFORT TO MEET THE CITY OF SAN ANTONIO'S FIRE FLOW REQUIREMENTS FOR THE PROPOSED RESIDENTIAL DEVELOPMENT, THE PUBLIC WATER MAIN SYSTEM HAS BEEN DESIGNED FOR A MINIMUM FIRE FLOW DEMAND OF 1750 GPM AT 25 PSI RESIDUAL PRESSURE. THE FIRE FLOW REQUIREMENTS FOR INDIVIDUAL STRUCTURES WILL BE REVIEWED DURING THE BUILDING PERMIT PROCESS IN ACCORDANCE WITH THE PROCEDURES SET FORTH BY THE CITY OF SAN ANTONIO DIRECTOR OF DEVELOPMENT SERVICES DEPARTMENT AND THE SAN ANTONIO FIRE DEPARTMENT FIRE MARSHAL.

**ROW PERMIT NOTE:** 

A BEXAR COUNTY PERMIT MUST BE OBTAINED BEFORE WORKING IN BEXAR COUNTY RIGHTS-OF-WAY.

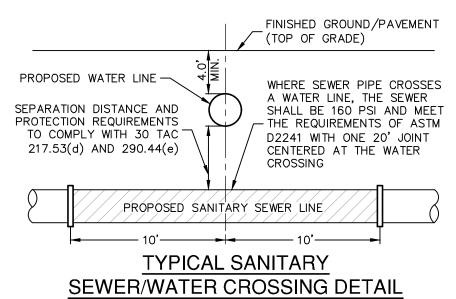


#### **KEYED NOTES**


1 ~ STANDARD FIRE HYDRANT 1 - 8" X 6" ANCHOR TEE, M.J. 6" D.I. PIPE, CUT AS REQ'D 1 - 6" 1/4 ANCHOR BEND, M.J. 1 - 6" GATE VALVE, M.J. 1 - 6" VALVE BOX, COMPLETE (SEE SAWS DETAIL DD-834-01 SHEET 2 OF 2)

FOR CHLORINATION INJECTION 2 - 1" CORPORATION STOP, C.C.XI.P 1 - 1" COPPER TUBING, CUT AS REQUIRED 2 - 1" COMP. 1 1/4 COUPLING, CORP. STOP 2 - 1 1/4" THD. SOLID CAPS, THR. 12" VALVE CONSTRUCTED WITH SAWS JOB NUMBER 22-1100 SHALL REMAIN CLOSED UNTIL NEW MAINS HAVE BEEN DISINFECTED BY CONTRACTOR AND ACCEPTED BY SAWS CONTRACTOR SHALL TIE TO EXISTING 12" (SAWS JOB NO. 22-1100) ÀFTER DISINFECTION BY CONTRACTOR AND ACCEPTANCE BY SAWS 2" TEMPORARY BLOWOFF ASSEMBLY SEE SAWS DWG DD-844-01 SHEET 1 OF 4 1-12" SOLID SLEEVE, MJ

125.995 ACRES OSCAR W. GASS

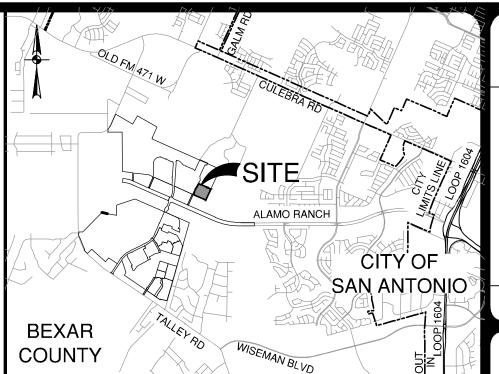



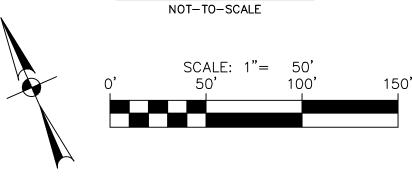

#### WATER LEGEND

PROJECT LIMITS FIRE HYDRANT EXISTING WATER \_\_\_\_w\_\_ EXISTING SEWER PROPOSED SEWER NEW WATER NEW 3/4" SINGLE SERVICE WITH 5/8" METER NEW 1" DUAL SERVICE WITH 5/8" METER ¬∟≼∗ SINGLE IRRIGATION SERVICE (REF. PLAN VIEW FOR SIZE) JOINT RESTRAINT

#### PRESSURE REDUCING VALVE NOTE:

PRESSURE REDUCING VALVE TO BE INSTALLED ON CUSTOMER'S SIDE OF METER BY HOMEBUILDER.

#### PRESSURE NOTE:

CONTRACTOR TO VERIFY THAT NO PORTION OF THE TRACT IS BELOW GROUND ELEVATION OF 985 FEET WHERE THE STATIC PRESSURE WILL NORMALLY EXCEED 80 PSI. AT ALL SUCH LOCATIONS WHERE THE GROUND LEVEL IS BELOW 985 FEET, THE DEVELOPER OR BUILDER SHALL INSTALL AT EACH LOT, ON THE CUSTOMER'S SIDE OF THE METER, AN APPROVED TYPE PRESSURE REGULATOR IN CONFORMANCE WITH THE PLUMBING CODE OF THE CITY OF SAN ANTONIO. NO DUAL SERVICES ALLOWED FOR ANY LOT(S) IF \*PRV IS/ARE REQUIRED FOR SUCH LOT(S), ONLY SINGLE SERVICE CONNECTIONS SHALL BE ALLOWED. \*NOTE: A PRESSURE REGULATOR IS ALSO KNOWN AS A PRESSURE REDUCING VALVE (PRV).

#### JOINT RESTRAINT NOTE:

CONTRACTOR SHALL INSTALL RETAINER GLANDS AT ALL FITTINGS AN PROVIDE JOINT RESTRAINING HARNESSES OR FIELD LOCK GASKETS AT ALL JOINTS WITHIN THE LENGTH SHOWN. CONTRACTOR SHALL INSURE THAT AL TEES, BENDS, VALVES, ETC. HAVE A MINIMUM OF 5 FT OF PIPE WITH NO JOINTS ON EACH SIDE OF THE FITTING. JOINT RESTRAINTS AND RETAINER GLANDS SHALL BE CALCULATED BY SAWS APPROVED PROGRAMS. THERE WILL BE NO SEPARATE PAY ITEM FOR RETAINER GLANDS AND OTHER JOINT RESTRAINING HARNESSES AND GASKETS, BUT SHALL BE SUBSIDIARY TO THE UNIT COST PER LINEAL FOOT OF PIPE INSTALLED.

#### TRENCH EXCAVATION SAFETY PROTECTION:

CONTRACTOR AND/ OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYE OR STRUCTURAL DESIGN/ GEOTECHNICAL/ SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN TH PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND /O PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENT THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFÉTY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OF CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AN ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION. WATER (SAWS PRESSURE ZONE 8)


ADDRESS: 5419 N LOOP	1604 E			
CITY: SAN ANTONIO	STATE:_	TX	ZIP:	78218
PHONE# <u>(210)-496-2668</u>		_ FAX#	(210)-496-	-2668
SAWS BLOCK MAP# 72602	_TOTAL EDU	's 86	TOTAL ACRI	EAGE <u>17.12</u> 5
TOTAL LINEAR FOOTAGE OF	PIPE: <u>12"-10</u>	26 LF <u>B LF</u> F	PLAT NO. <u>22</u>	<u>-1180029</u> 8
NUMBER OF LOTS 86	SAWS	JOB NO.	22-1143	


CALEB M. CHANCE

98401

PLAT NO. 22-1180029 11680-52 DESIGNER CHECKED BL DRAWN CB

ER

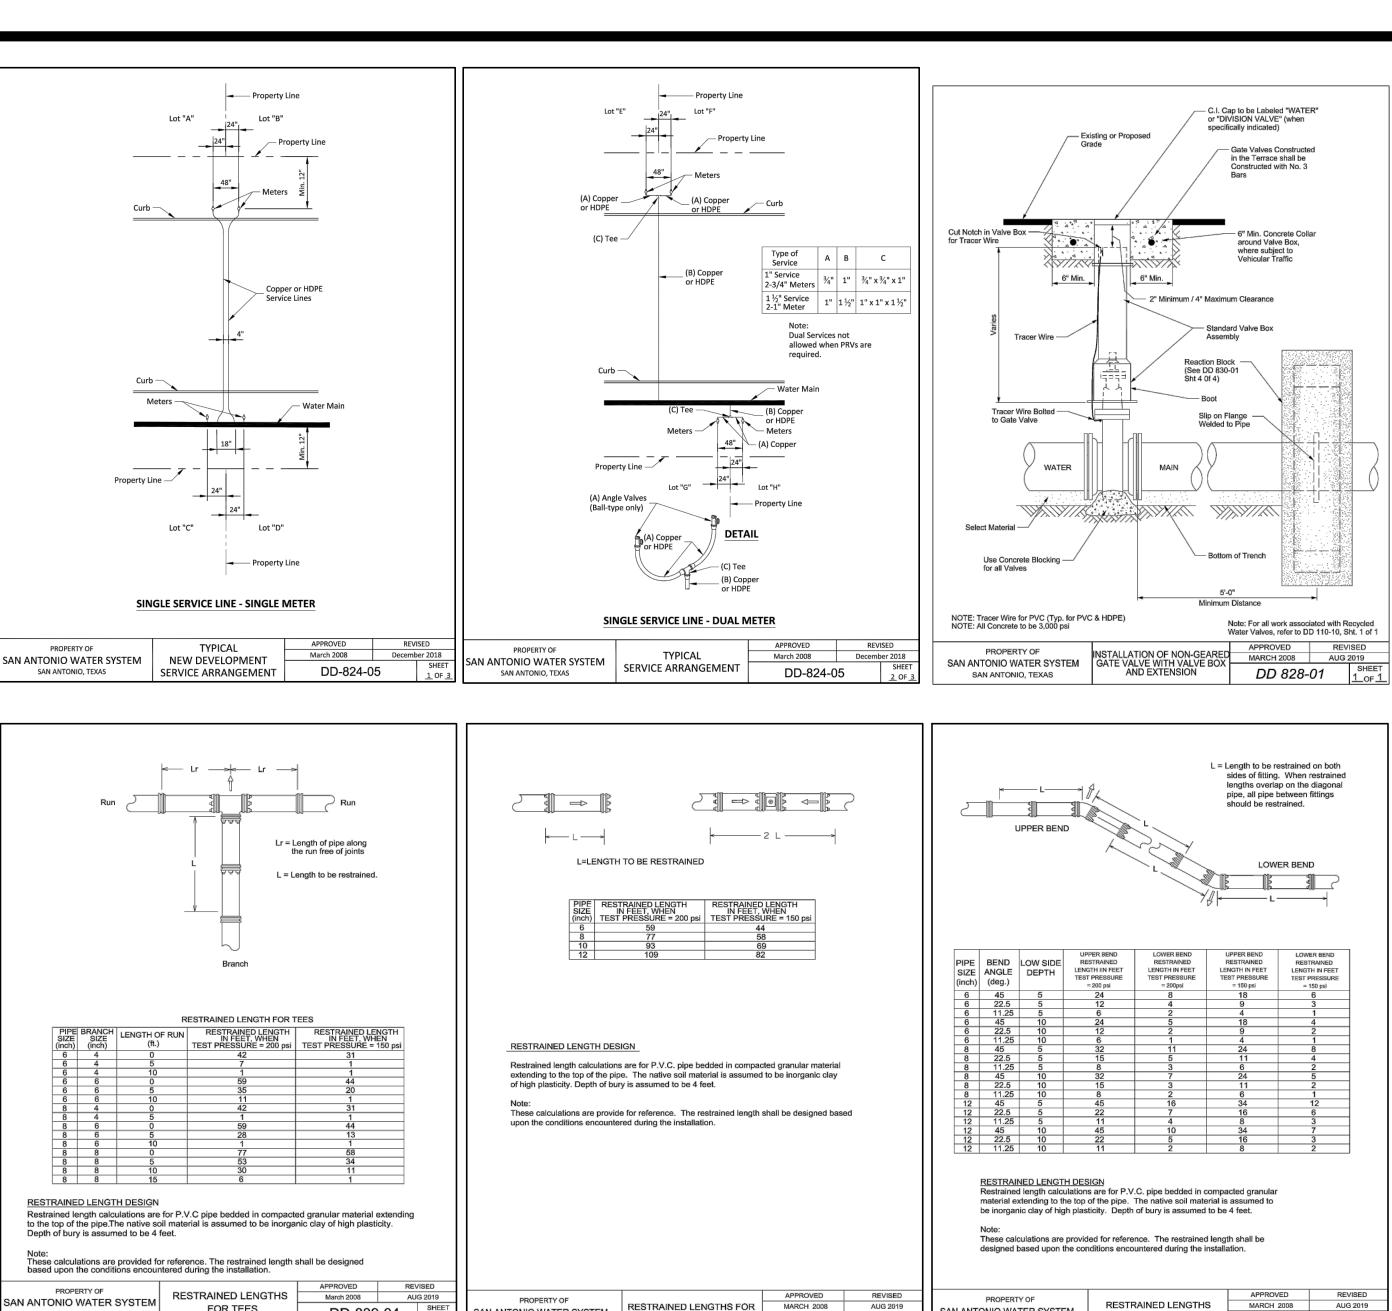

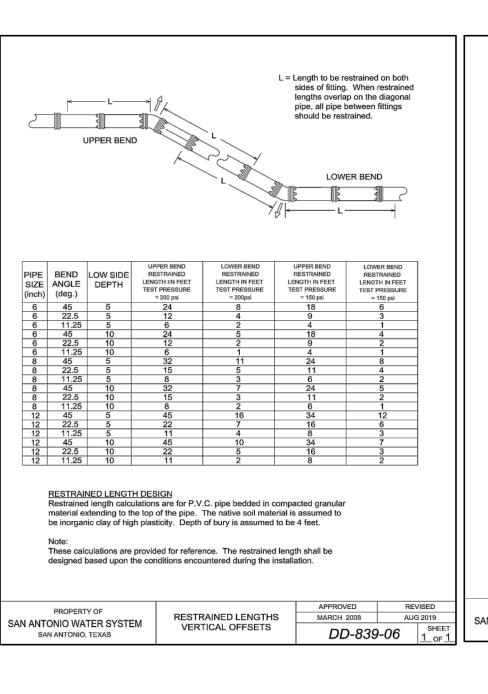

C.I. Cap to be Labeled "WATER" or "DIVISION VALVE" (when specifically indicated)

in the Terrace shall be Constructed with No. 3 Bars

Note: For all work associated with Recycled Water Valves, refer to DD 110-10, Sht. 1 of 1

DD 828-01

Tracer Wire -

Tracer Wire Bolted — to Gate Valve

Valve Marker -

Valve Marker is 3" Steel

pipe painted as shown
2. Valve Measurements shall be referenced to Marker
3. SAWS Decal shall be noted

on the marker and facing the diection of the valve

SAN ANTONIO WATER SYSTEM

SAN ANTONIO, TEXAS

VALVE MARKER

SECTION A-A


VALVE MARKER


Top closed and welded

MARCH 2008

DD-828-04

AUG 2019

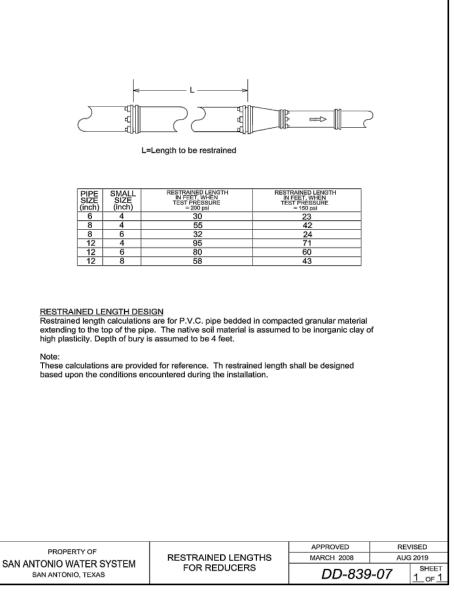

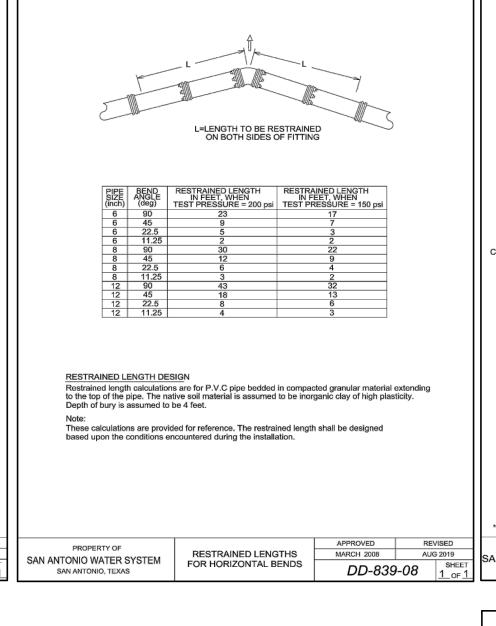

ALTERNATE INSTALLATION
Plan View Shown with Bend

FIRE HYDRANT

(JOINT RESTRAINT)

INSTALLATION

Use:
(A) Anchoring Tee with M.J. Fitting or M.J. Valve
(B) Std. M.J. Tee with Anchoring Coupling or Anchoring

12" Min.

Optional Extension for Grade —— Adjustment, Maximum of 1 @ 6 Inch or 12 Inch.

3000 psi Concrete Pad 16"x16"x4" ----

NOTE: Operation of Hydrant shall be Full Opened or Full Closed Throttleling is Prohibited.

SAN ANTONIO WATER SYSTEM

6" Gate Valve, M.J.


Joint Restraint

- 6" ¼ Bend, M.J.

6" Gate Valve, M.J. — with Box \*

MAY 2013 AUG 2019

DD-834-01

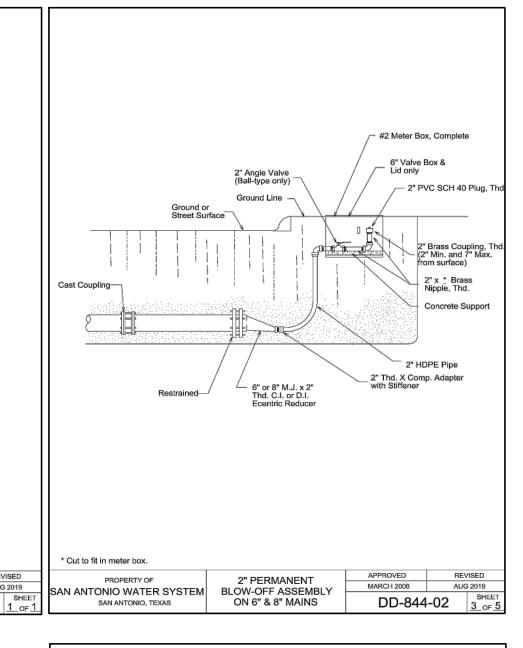


PRV will meet ANSI/ASSE #1003-82 Water Pressure Reducing Valve Requirements


Note: For Tapping Schedule, See DD-824-01 Sheet 3 of 3.

SAN ANTONIO WATER SYSTEM

SAN ANTONIO, TEXAS

3/4" THRU 2" SERVICE PRESSURE REDUCING VALVE

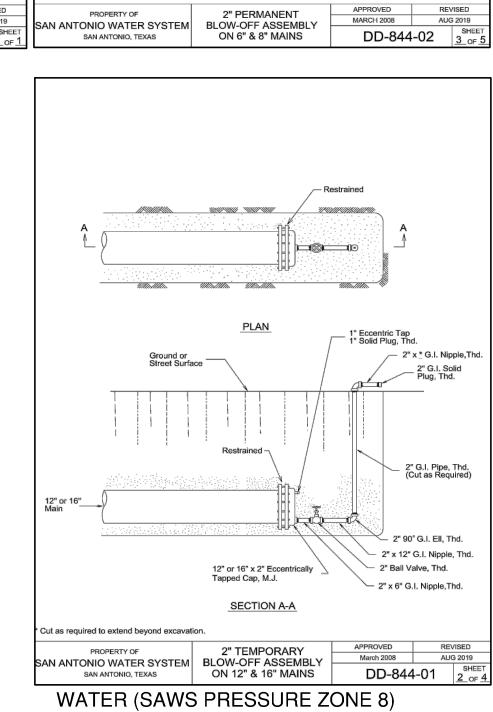

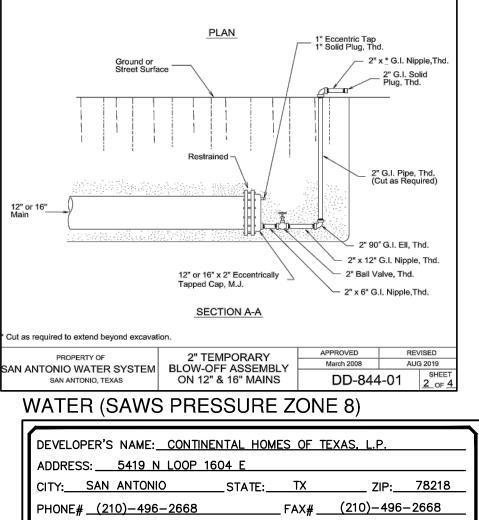

SAN ANTONIO, TEXAS	ON 12" & 16" MAINS	DD-844-01	SHEET 2_ OF 4
WATER (SAWS	S PRESSURE Z	ONE 8)	
DEVELOPEDIO NAME	CONTINENTAL HOMES	OF TEVAC I D	
ADDRESS: 5419 N	CONTINENTAL HOMES	OF TEXAS, L.P.	
	0STATE:	TX ZIP:	78218
	<u>–2668</u> F <i>F</i>		
SAWS BLOCK MAP#_	72602 TOTAL EDU'S_	86 TOTAL ACRE	AGE <u>17.12</u> 5
TOTAL LINEAR FOOTA	<u>72602</u> TOTAL EDU'S 8"-3,126 AGE OF PIPE: <u>12"-108 L</u>	<u>F</u> PLAT NO. <u>22</u> –	·11800298
NUMBER OF LOTS	86 SAWS JO	DB NO. 22-1143	J  <b> </b>

CALEB M. CHANCE 98401

1" to 1' - 6"

APPROVED REVISED
MARCH 2008 APRIL 2014

DD-833-03

,<sub>LAT NO.</sub> 22-11800298 OB NO. 11680-52 MAY 2022 ESIGNER HECKED<u>BL</u> DRAWN<u>CB</u>

WATER MAIN-V—WATER MAIN 1-1/8 BEND--1-1/8 BEND ALL JOINTS ARE FULLY RESTRAINED IN ACCORDANCE WITH SAWS SPECIFICATION

1-1/8 BEND-

RESTRAINED LENGTHS

FOR TEES

\_6" GATE VALVE &

√6"- 1/4 ANCHOR BEND

NOTE: SAWS REQUIRES LEAD FREE (<0.25% ELEAD) FIRE HYDRANTS.

-MISC. UTILITY (I.E.: RCP/BOX

CULVERT, GAS OR ELECTRICAL

DUCTBANK)

-TEE, M.J., ANCHOR

BOX, COMPLETE

DD-839-04 SHEET 1 OF 2

AN ANTONIO WATER SYSTEM

PROPERTY LINE —

OUTSIDE SIDEWALK)

7' MAX.

5.5' MIN.

SIDEWALK

REFER TO SAWS DETAIL DD-834-01

FIRE HYDRANT INSTALLATION

FIRE HYDRANT (TO-

WATER MAIN

FACE OF CURB-

FINISHED GRADE

-WATER MAIN

SAN ANTONIO, TEXAS

TABLE DD-839-06. TYPICAL UTILITY/WATER CROSSING DETAIL

NOT-TO-SCALE

SAN ANTONIO WATER SYSTEM RESTRAINED LENGTHS FOR DEAD ENDS / INLINE VALVES

PROPOSED WATER LINE -

SEPARATION DISTANCE AND

PROTECTION REQUIREMENTS
TO COMPLY WITH 30 TAC

1-1/8 BEND-

217.53(d) AND 290.44(e)

MARCH 2008 AUG 2019

DD-839-05

FINISHED GROUND/PAVEMENT

WHERE SEWER PIPE CROSSES

SHALL BE 160 PSI AND MEET

THE REQUIREMENTS OF ASTM

FINISHED GRADE

-1-1/8 BEND

-MISC. UTILITY (I.E.: RCP/BOX

DUCTBANK)

CULVERT, GAS OR ELECTRICAL

\_\_WATER MAIN

A WATER LINE, THE SEWER

D2241 WITH ONE 20' JOINT

CENTERED AT THE WATER

(TOP OF GRADE)

CROSSING

PRÓPOSED SANITARY SEWER LINE

TYPICAL SANITARY

SEWER/WATER CROSSING DETAIL

#### SAWS CONSTRUCTION NOTES

(LAST REVISED JULY 2017)

#### SAWS GENERAL SECTION

- ALL MATERIALS AND CONSTRUCTION PROCEDURES WITHIN THE SCOPE OF THIS CONTRACT SHALL BE APPROVED BY THE SAN ANTONIO WATER SYSTEM (SAWS) AND COMPLY WITH THE PLANS, SPECIFICATIONS, GENERAL CONDITIONS AND WITH THE FOLLOWING AS APPLICABLE:
- A.CURRENT TEXAS COMMISSION ON ENVIRONMENTAL QUALITY (TCEQ) 'DESIGN CRITERIA FOR DOMESTIC WASTEWATER SYSTEM", TEXAS ADMINISTRATIVE CODE (TAC) TITLE 30 PART 1 CHAPTER 217 AND "PUBLIC DRINKING WATER", TAC TITLE 30 PART 1 CHAPTER 290.
- B. CURRENT TXDOT "STANDARD SPECIFICATIONS FOR CONSTRUCTION OF HIGHWAYS, STREETS AND DRAINAGE' C.CURRENT "SAN ANTONIO WATER SYSTEM STANDARD SPECIFICATIONS FOR WATER AND SANITARY SEWER CONSTRUCTION".
- D. CURRENT CITY OF SAN ANTONIO "STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION". E. CURRENT CITY OF SAN ANTONIO "UTILITY EXCAVATION CRITERIA MANUAL" (UECM).
- THE CONTRACTOR SHALL NOT PROCEED WITH ANY PIPE INSTALLATION WORK UNTIL THEY OBTAIN A COPY OF THE APPROVED COUNTER PERMIT OR GENERAL CONSTRUCTION PERMIT (GCP) FROM THE CONSULTANT AND HAS BEEN NOTIFIED BY SAWS CONSTRUCTION INSPECTION DIVISION TO PROCEED WITH THE WORK AND HAS ARRANGED A MEETING WITH THE INSPECTOR AND CONSULTANT FOR THE WORK REQUIREMENTS. WORK COMPLETED BY THE CONTRACTOR WITHOUT AN APPROVED COUNTER PERMIT AND/OR A GCP WILL BE SUBJECT TO REMOVAL AND REPLACEMENT AT THE EXPENSE OF THE CONTRACTORS AND/OR THE DEVELOPER.
- THE CONTRACTOR SHALL OBTAIN THE SAWS STANDARD DETAILS FROM THE SAWS WEBSITE, HTTP://WWW.SAWS.ORG/BUSINESS\_CENTER/SPECS. UNLESS OTHERWISE NOTED WITHIN THE DESIGN PLANS.
- THE CONTRACTOR IS TO MAKE ARRANGEMENTS WITH THE SAWS CONSTRUCTION (210) 233-2973, ON NOTIFICATION PROCEDURES THAT WILL BE USED TO NOTIFY AFFECTED HOME RESIDENTS AND/OR PROPERTY OWNERS 48 HOURS PRIOR TO BEGINNING ANY WORK.
- LOCATION AND DEPTH OF EXISTING UTILITIES AND SERVICE LATERALS SHOWN ON THE PLANS ARE UNDERSTOOD TO BE APPROXIMATE. ACTUAL LOCATIONS AND DEPTHS MUST BE FIFLD VERIFIED BY THE CONTRACTOR AT LEAST 1 WEEK PRIOR TO CONSTRUCTION. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO LOCATE UTILITY SERVICE LINES AS REQUIRED FOR CONSTRUCTION AND TO PROTECT THEM DURING CONSTRUCTION AT NO COST TO SAWS.
- THE CONTRACTOR SHALL VERIFY THE EXACT LOCATION OF UNDERGROUND UTILITIES AND DRAINAGE STRUCTURES AT LEAST 1-2 WEEKS PRIOR TO CONSTRUCTION WHETHER SHOWN ON PLANS OR NOT. PLEASE ALLOW UP TO 7 BUSINESS DAYS FOR LOCATES REQUESTING PIPE LOCATION MARKERS ON SAWS FACILITIES. THE FOLLOWING CONTACT INFORMATION ARE SUPPLIED FOR VERIFICATION PURPOSES:
- SAWS UTILITY LOCATES: HTTP://WWW.SAWS.ORG/SERVICE/LOCATES - COSA DRAINAGE (210) 207-0724 OR (210) 207-6026
- COSA TRAFFIC SIGNAL OPERATIONS (210) 206-8480 COSA TRAFFIC SIGNAL DAMAGES (210) 207-3951
- TEXAS STATE WIDE ONE CALL LOCATOR 1-800-545-6005 OR 811
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR RESTORING EXISTING FENCES, CURBS, STREETS, DRIVEWAYS, SIDEWALKS, LANDSCAPING AND STRUCTURES TO ITS ORIGINAL OR BETTER CONDITION IF DAMAGES ARE MADE AS A RESULT OF THE PROJECT'S CONSTRUCTION.
- . ALL WORK IN TEXAS DEPARTMENT OF TRANSPORTATION (TXDOT) AND/OR BEXAR COUNTY RIGHT-OF-WAY SHALL BE DONE IN ACCORDANCE WITH RESPECTIVE CONSTRUCTION SPECIFICATIONS AND PERMIT REQUIREMENTS.
- . THE CONTRACTOR SHALL COMPLY WITH CITY OF SAN ANTONIO OR OTHER GOVERNING MUNICIPALITY'S TREE ORDINANCES WHEN EXCAVATING NEAR TREES.
- 10. THE CONTRACTOR SHALL NOT PLACE ANY WASTE MATERIALS IN THE 100-YEAR FLOOD PLAIN WITHOUT FIRST OBTAINING AN APPROVED FLOOD PLAIN PERMIT.
- HOLIDAY WORK: CONTRACTORS WILL NOT BE ALLOWED TO PERFORM SAWS WORK ON SAWS RECOGNIZED HOLIDAYS. REQUEST SHOULD BE SENT CONSTWORKREQ@SAWS.ORG.
- WEEKEND WORK: CONTRACTORS ARE REQUIRED TO NOTIFY THE SAWS INSPECTION CONSTRUCTION DEPARTMENT 48 HOURS IN ADVANCE TO REQUEST WEEKEND WORK REQUEST SHOULD BE SENT TO CONSTWORKREQ@SAWS.ORG.
- . ANY AND ALL SAWS UTILITY WORK INSTALLED WITHOUT HOLIDAY/WEEKEND APPROVAL WILL BE SUBJECT TO BE UNCOVERED FOR PROPER INSPECTION.
- 12. COMPACTION NOTE (ITEM 804): THE CONTRACTOR SHALL BE RESPONSIBLE FOR MEETING THE COMPACTION REQUIREMENTS ON ALL TRENCH BACKFILL AND FOR PAYING FOR THE TESTS PERFORMED BY A THIRD PARTY, COMPACTION TESTS WILL BE DONE AT ONE LOCATION POINT RANDOMLY SELECTED. OR AS INDICATED BY THE SAWS INSPECTOR AND/OR THE TEST ADMINISTRATOR, PER EACH 12-INCH LOOSE LIFT PER 400 LINEAR FEET AT A MINIMUM. THIS PROJECT WILL NOT BE ACCEPTED AND FINALIZED BY SAWS WITHOUT THIS REQUIREMENT BEING MET AND VERIFIED BY PROVIDING ALL NECESSARY DOCUMENTED TEST RESULTS.
- 13. A COPY OF ALL TESTING REPORTS SHALL BE FORWARDED TO SAWS CONSTRUCTION INSPECTION DIVISION.

#### SAWS WATER NOTES

- PRIOR TO TIE-INS, ANY SHUTDOWNS OF EXISTING MAINS OF ANY SIZE MUST | 1. MACHINE CHLORINATION BY THE S.A.W.S. BE COORDINATED WITH THE SAWS CONSTRUCTION INSPECTION DIVISION AT LEAST ONE WEEK IN ADVANCE OF THE SHUTDOWN. THE CONTRACTOR MUST ALSO PROVIDE A SEQUENCE OF WORK AS RELATED TO THE TIE-INS; THIS IS AT NO ADDITIONAL COST TO SAWS OR THE PROJECT AND IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO SEQUENCE THE WORK ACCORDINGLY.
  - FOR WATER MAINS 12" OR HIGHER: SAWS EMERGENCY OPERATIONS CENTER (210) 233-2014
- ASBESTOS CEMENT (AC) PIPE, ALSO KNOWN AS TRANSITE PIPE WHICH IS KNOWN TO CONTAIN ASBESTOS- CONTAINING MATERIAL (ACM), MAY BE LOCATED WITHIN THE PROJECT LIMITS. SPECIAL WASTE MANAGEMENT PROCEDURES AND HEALTH AND SAFETY REQUIREMENTS WILL BE APPLICABLE WHEN REMOVAL AND/OR DISTURBANCE OF THIS PIPE OCCURS. SUCH WORK IS TO BE MADE UNDER SPECIAL SPECIFICATION ITEM NO. 3000, "SPECIAL SPECIFICATION FOR HANDLING ASBESTOS CEMENT PIPE".
- VALVE REMOVAL: WHERE THE CONTRACTOR IS TO ABANDON A WATER MAIN, THE CONTROL VALVE LOCATED ON THE ABANDONING BRANCH WILL BE REMOVED AND REPLACED WITH A CAP/PLUG. (NSPI)
- SUITABLE ANCHORAGE/THRUST BLOCKING OR JOINT RESTRAINT SHALL BE PROVIDED AT ALL OF THE FOLLOWING MAIN LOCATIONS: DEAD ENDS, PLUGS, CAPS, TEES, CROSSES, VALVES, AND BENDS, IN ACCORDANCE WITH THE STANDARD DRAWINGS DD-839 SERIES AND ITEM NO. 839, IN THE SAWS STANDARD SPECIFICATIONS FOR CONSTRUCTION.
- 5. ALL VALVES SHALL READ "OPEN RIGHT".
- 6. PRVS REQUIRED: CONTRACTOR TO VERIFY THAT NO PORTION OF THE TRACT IS BELOW GROUND ELEVATION OF 985 FEET WHERE THE STATIC PRESSURE WILL NORMALLY EXCEED 80 PSI. AT ALL SUCH LOCATIONS WHERE THE GROUND LEVEL IS BELOW 985 FEET, THE DEVELOPER OR BUILDER SHALL INSTALL AT EACH LOT, ON THE CUSTOMER'S SIDE OF THE METER, AN APPROVED TYPE PRESSURE REGULATOR IN CONFORMANCE WITH THE PLUMBING CODE OF THE CITY OF SAN ANTONIO. NO DUAL SERVICES ALLOWED FOR ANY LOT(S) IF \*PRV IS/ARE REQUIRED FOR SUCH LOT(S) ONLY SINGLE SERVICE CONNECTIONS SHALL BE ALLOWED. \*NOTE: PRESSURE REGULATOR IS ALSO KNOWN AS A PRESSURE REDUCING VALVE
- PIPE DISINFECTION WITH DRY HTH FOR PROJECTS LESS THAN 800 LINEAR FEET. (ITEM NO. 847.3): MAINS SHALL BE DISINFECTED WITH DRY HTH WHERE SHOWN IN THE CONTRACT DOCUMENTS OR AS DIRECTED BY THE INSPECTOR, AND SHALL NOT EXCEED A TOTAL LENGTH OF 800 FEET. THIS METHOD OF DISINFECTION WILL ALSO BE FOLLOWED FOR MAIN REPAIRS. TH CONTRACTOR SHALL UTILIZE ALL APPROPRIATE SAFETY MEASURE TO PROTECT HIS PERSONNEL DURING DISINFECTION OPERATIONS.
- 8. BACKFLOW PREVENTION DEVICES:
- ALL IRRIGATION SERVICES WITHIN RESIDENTIAL AREAS ARE REQUIRED TO HAVE BACKFLOW PREVENTION DEVICES. - ALL COMMERCIAL BACKFLOW PREVENTION DEVICES MUST BE APPROVED BY SAWS PRIOR TO INSTALLATION.
- FINAL CONNECTION TO THE EXISTING WATER MAIN SHALL NOT BE MADE | 14. SAWS REQUIRES LEAD FREE (< 0.25%) FIRE HYDRANTS. UNTIL THE WATER MAIN HAS BEEN PRESSURE TESTED, CHLORINATED, AND SAWS HAS RELEASED THE MAIN FOR TIE-IN AND USE.
- 10. DIVISION VALVES: DIVISION VALVES SHOWN ON PLANS OR NOT SHOWN ON PLANS BUT FOUND IN THE FIELD SHALL ONLY BE OPERATED BY SAWS DISTRIBUTION AND COLLECTION STAFF AND ONLY WITH PRIOR WRITTEN APPROVAL OF THE SAWS DIRECTOR OF PRODUCTION AND OPERATIONS AND PROPER COORDINATION WITH ALL SAWS DEPARTMENTS. CONTRACTOR SHALL PROVIDE WRITTEN NOTIFICATION TO THE INSPECTOR A MINIMUM OF TWO WEEKS IN ADVANCE TO START THE COORDINATION PROCESS AND WILL BE INFORMED BY THE INSPECTOR WHEN THE DIVISION VALVE WILL BE OPERATED BY THE SAWS DISTRIBUTION AND COLLECTION STAFF. THE DIVISION VALVE CAN ONLY BE OPERATED BY SAWS DISTRIBUTION AND COLLECTION STAFF MEMBER NOT THE INSPECTOR OR THE CONTRACTOR. OPERATION OF A DIVISION VALVE WITHOUT THE EXPRESS PRIOR WRITTEN APPROVAL OF THE SAWS DISTRIBUTION AND COLLECTION STAFF WILL CONSTITUTE A MATERIAL BREACH OF ANY WRITTEN SAWS CONTRACT OR PERMIT IN ADDITION TO SUBJECTING THE CONTRACTOR TO LIABILITY FOR ANY AND ALL FINES, FEES OR OTHER DAMAGES, DIRECT OR CONSEQUENTIAL, THAT MAY ARISE FROM OR BE CAUSED BY THE OPERATION OF THE VALVE WITHOUT PRIOR WRITTEN PERMISSION. PLEASE BE INFORMED THAT THE APPROVAL OF THE OPERATION OR OPENING OR CLOSING OF A DIVISION VALVE CAN TAKE SEVERAL WEEKS FOR APPROVAL. DIVISION VALVES WILL ALSO HAVE A VALVE LID LABELED DIVISION VALVE AND A LOCKING MECHANISM INSTALLED WITH A KEY. THE LOCK AND KEY MECHANISM WILL BE PAID FOR BY THE CONTRACTOR BUT

WILL BE INSTALLED BY SAWS DISTRIBUTION AND COLLECTION STAFF.


#### PROJECT WATER NOTES


- ALL 8", 12" AND 16" PIPE SHALL BE P.V.C. C-900 CLASS 235 DR 18.
- . ALL MAINS SHALL BE HYDROSTATICALLY TESTED BY THE CONTRACTOR, AS
- PROVIDED FOR IN THE SPECIAL CONDITIONS. THE WATER LINES WILL BE SET FROM THE STREET HUBS BEFORE THIS CONTRACT BEGINS. STREET CUT SHEETS WILL BE SUPPLIED TO THI
- CONTRACTOR. THERE SHOULD BE NO ADDITIONAL STAKES REQUIRED, AND IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO INSPECT THE SITE AND VERIFY THAT ALL STAKES REQUIRED FOR HIS WORK ARE IN PLACE AT THE TIME THE CONSTRUCTION BEGINS. IF ANY STAKES ARE MISSING TH ENGINEER SHOULD BE NOTIFIED IMMEDIATELY. AFTER CONSTRUCTION BEGINS, ALL CONSTRUCTION STAKES, MARKS, ETC., SHALL BE CAREFULLY PRESERVED BY THE CONTRACTOR, AND IN CASE OF DESTRUCTION OR REMOVAL BY THI CONTRACTOR, HIS EMPLOYEE OR ANY OTHER MEANS, SUCH STAKES, MARKS, ETC., SHALL BE REPLACED AT THE CONTRACTOR'S EXPENSE.
- THE CONTRACTOR SHALL FURNISH THE ENGINEER WITH ALL THE FINAL MEASUREMENTS, TAPS AND LENGTH OF SERVICE CONNECTIONS.
- THE LOT CORNERS WILL BE SET BY THE ENGINEER FOR INSTALLATION OF ALL WATER SERVICES. THESE LOT CORNERS SHALL BE CAREFULLY PRESERVED BY THE CONTRACTOR SO THE METER BOXES CAN BE SET IN PHASE II. ANY LOT CORNER DESTROYED OR REMOVED BY THE CONTRACTOR, HIS EMPLOYEES, OR BY ANY OTHER MEANS SHALL BE REPLACED AT THE CONTRACTOR'S EXPENSE.
- STREETS WILL HAVE BEEN EXCAVATED DOWN TO SUBGRADE AND THI PARKWAY WILL BE CUT DOWN TO TOP OF CURB BY THE STREET CONTRACTOR, PRIOR TO CONSTRUCTION OF THE WATER MAINS. IT WILL BE THE UTILITY CONTRACTOR'S RESPONSIBILITY TO PROVIDE A PAD FOR HIS EQUIPMENT.
- WATER METER BOXES IF APPLICABLE SHALL BE INSTALLED NINE FEET FROM FACE OF CURB TO CENTER OF THE METER BOX.
- . ALL GARBAGE OR SPOIL MATERIAL FROM THIS WORK SHALL BE REMOVED FROM THE SITE BY THE CONTRACTOR, AT HIS EXPENSE.
- IO. FINAL CONNECTION TO THE EXISTING WATER MAIN SHALL NOT BE MADE UNTIL WATER MAIN HAS BEEN PRESSURE TESTED, CHLORINATED AND THE S.A.W.S.
- RELEASES THE MAIN FOR TIE-IN AND USE. . UNIT PRICE BID FOR "STANDARD FIRE HYDRANT ASSEMBLY" SHALL INCLUDE FIRE HYDRANT, 6-INCH GATE VALVE AND 6-INCH VALVE BOX COMPLETE,
- ANCHOR BEND, AND ALL 6-INCH DI PIPE REQUIRED (DI PIPE REQUIRED SHALL INCLUDE ALL PIPE FROM THE TEE ON THE MAIN LINE TO THE FIRE HYDRANT). 2. WHEN SEWER LINES ARE INSTALLED IN THE VICINITY OF WATER MAINS, SUCH INSTALLATION SHALL BE IN STRICT ACCORDANCE WITH THE TEXAS NATURAL
- WATER SYSTEMS" (1988 OR ANY REVISIONS THERETO). 13. A CLEAR SPACE SHALL BE PROVIDED AROUND ALL FIRE HYDRANTS. THIS AREA SHOULD HAVE A MINIMUM DIAMETER OF 3.0' AND BE CLEAN OF

RESOURCE CONSERVATION COMMISSION "RULES AND REGULATIONS FOR PUBLIC

VERTICAL OBSTRUCTIONS, VALVES, AND METER BOXES.

15. UNLESS OTHERWISE NOTED ALL SERVICES SHALL BE 3/4" WITH 5/8" METER.






WATER (SAWS PRESSURE ZONE 8)

DEVELOPER'S NAME: <u>CONTINENTAL HOMES OF TEXAS, L.P.</u> ADDRESS: <u>5419 N LOOP 1604 E</u> CITY: SAN ANTONIO STATE: TX \_\_\_\_\_ ZIP:<u>78218</u>

PHONE# <u>(210)-496-2668</u> SAWS BLOCK MAP#<u>72602</u> TOTAL EDU'S<u>86</u> TOTAL ACREAGE<u>17.12</u>5 NUMBER OF LOTS <u>86</u> \_\_\_ SAWS JOB NO.<u>22-1143</u>


22-1180029 11680-52 DESIGNER CHECKED BL DRAWN CE

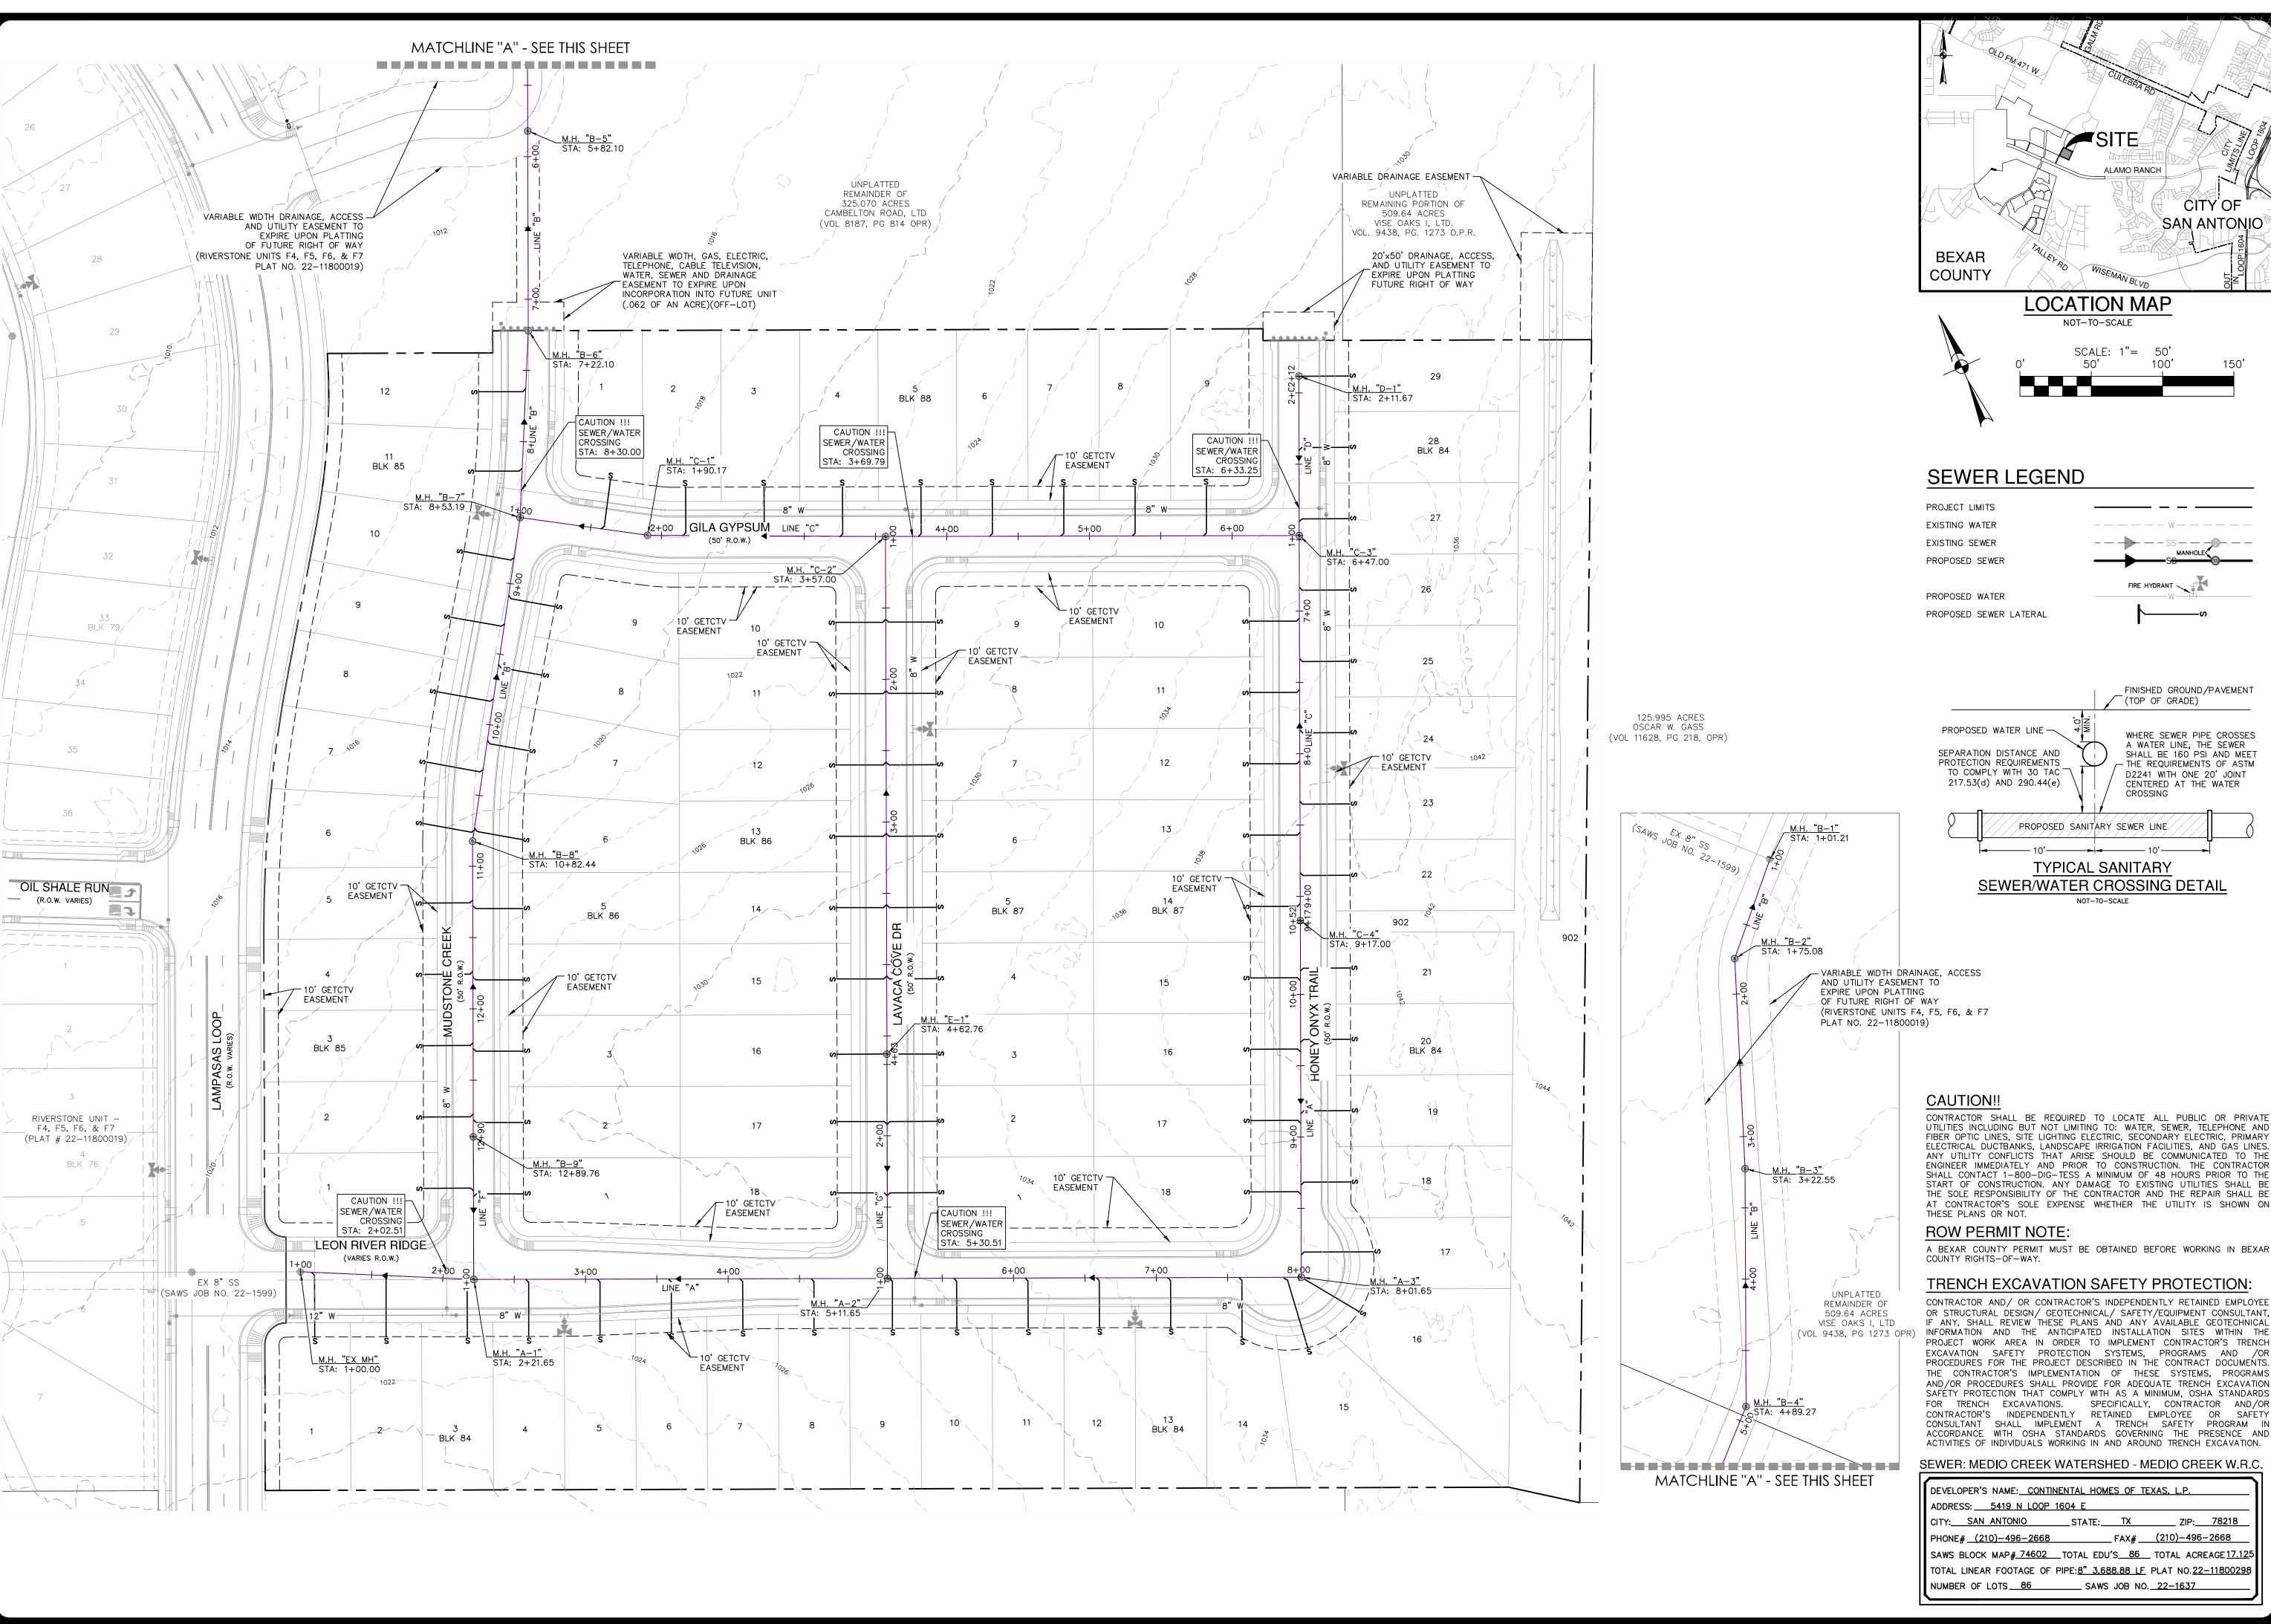



CALEB M. CHANCE 98401

. NO 22-11800298 11680-52 DESIGNER CHECKED BL DRAWN CB


C5.00

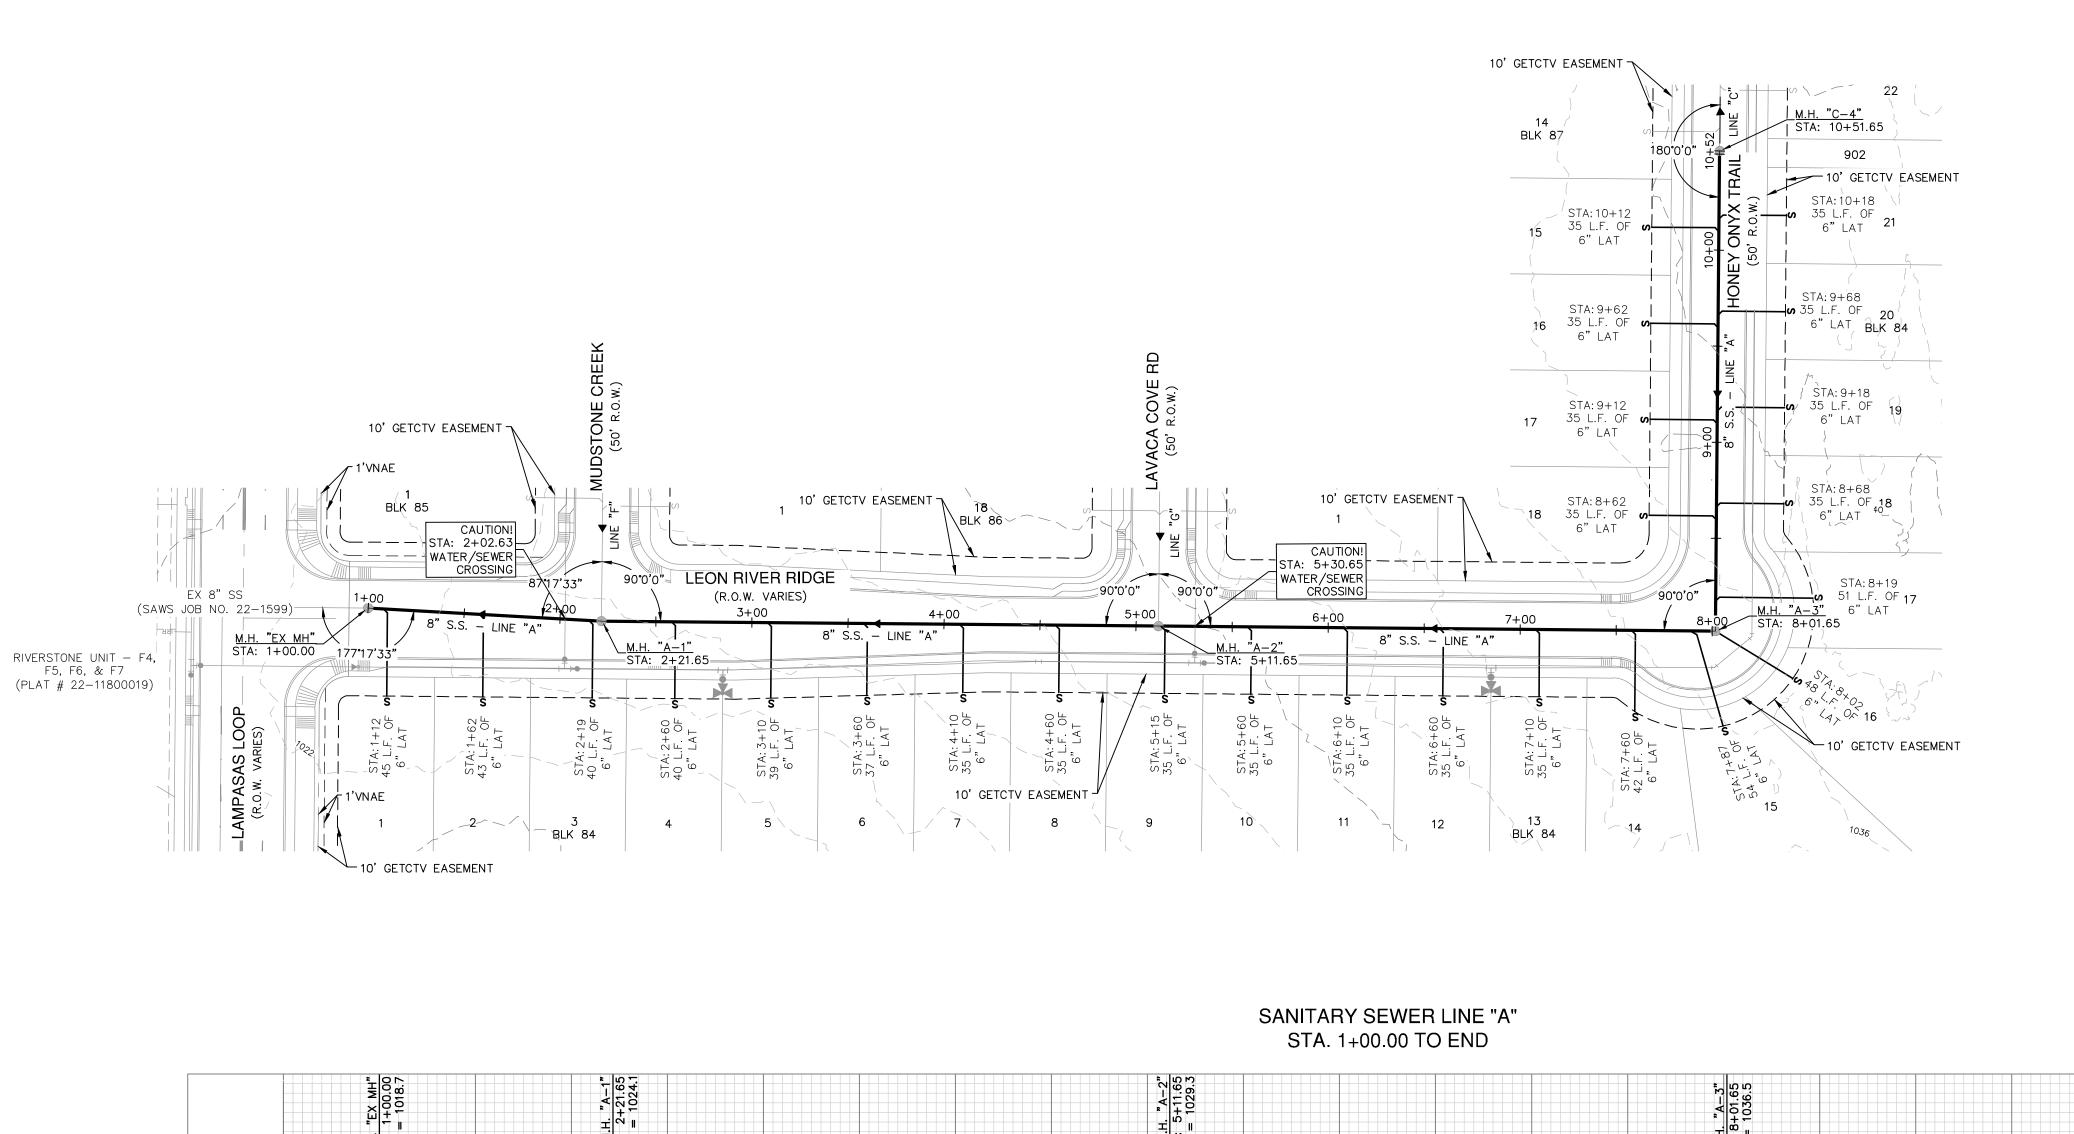

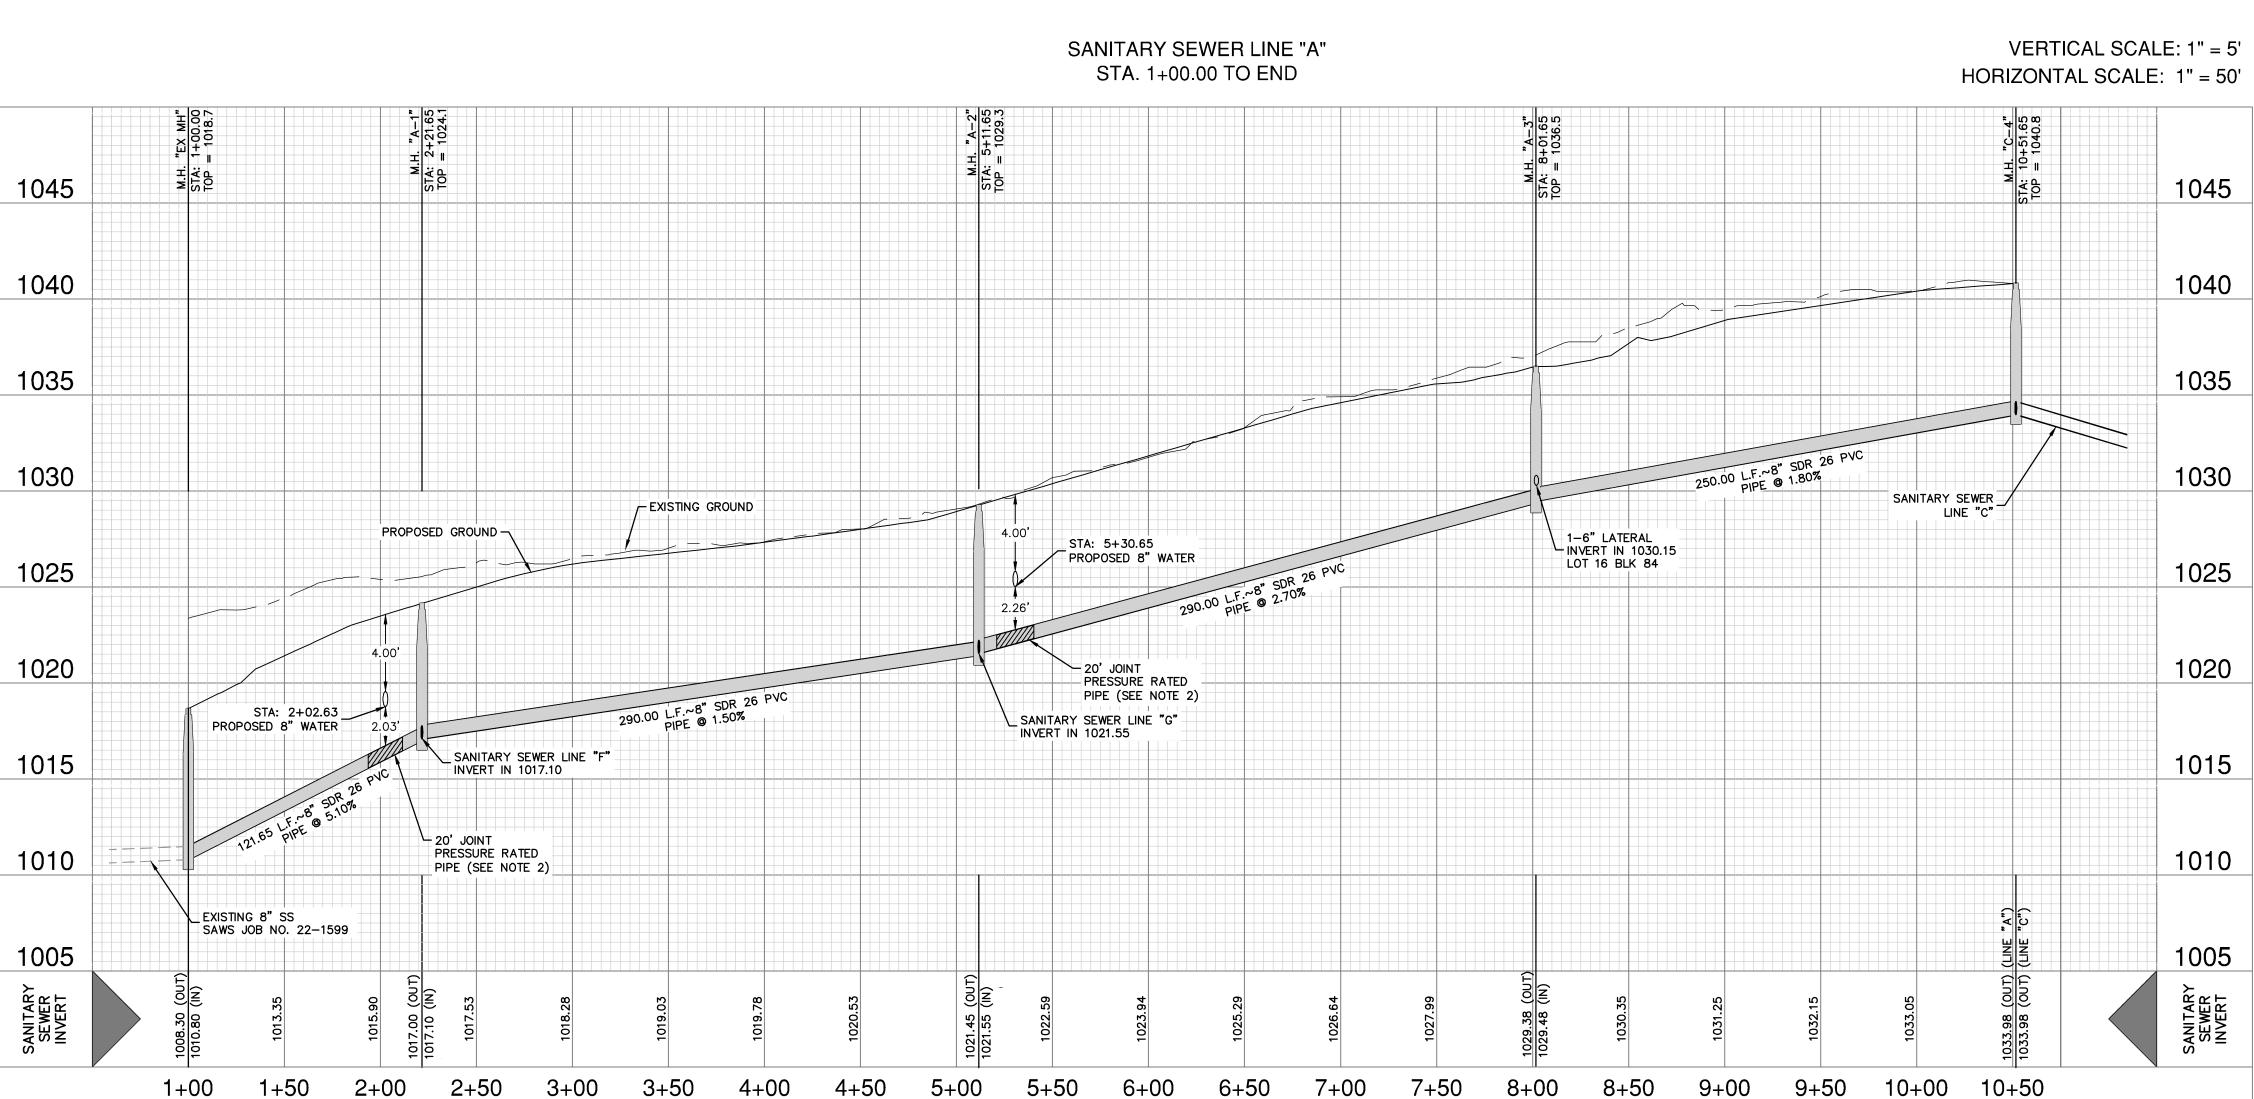

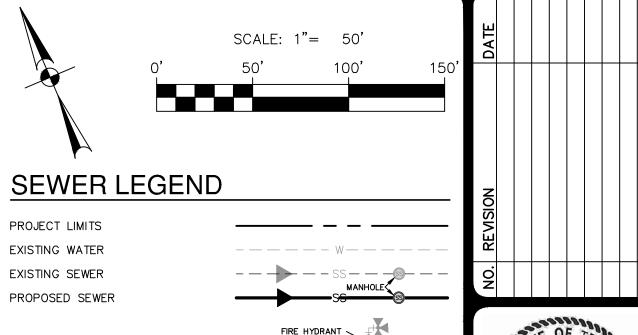

FF = XXXX.XX



PAPE-DAWSON ENGINEERS

PROFIL

σО

FINISHED GROUND/PAVEMENT (TOP OF GRADE) PROPOSED WATER LINE — WHERE SEWER PIPE CROSSES A WATER LINE, THE SEWER SHALL BE 160 PSI AND MEET SEPARATION DISTANCE AND PROTECTION REQUIREMENTS THE REQUIREMENTS OF ASTM TO COMPLY WITH 30 TAC D2241 WITH ONE 20' JOINT 217.53(d) AND 290.44(e) CENTERED AT THE WATER CROSSING PROPOSED SANITARY SEWER LINE TYPICAL SANITARY SEWER/WATER CROSSING DETAIL NOT-TO-SCALE

#### CAUTION!!

PROPOSED WATER

PROPOSED SEWER LATERAL

FINISHED FLOOR ELEVATION FOR SEWER


CONTRACTOR SHALL BE REQUIRED TO LOCATE ALL PUBLIC OR PRIVATE UTILITIES INCLUDING BUT NOT LIMITING TO: WATER, SEWER, TELEPHONE AND FIBER OPTIC LINES, SITE LIGHTING ELECTRIC, SECONDARY ELECTRIC, PRIMARY ELECTRICAL DUCTBANKS, LANDSCAPE IRRIGATION FACILITIES, AND GAS LINES. ANY UTILITY CONFLICTS THAT ARISE SHOULD BE COMMUNICATED TO TI ENGINEER IMMEDIATELY AND PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL CONTACT 1-800-DIG-TESS A MINIMUM OF 48 HOURS PRIOR TO TI START OF CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES SHALL E THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THE REPAIR SHALL BE AT CONTRACTOR'S SOLE EXPENSE WHETHER THE UTILITY IS SHOWN ( THESE PLANS OR NOT.


#### TRENCH EXCAVATION SAFETY PROTECTION:


CONTRACTOR AND / OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYE OR STRUCTURAL DESIGN/ GEOTECHNICAL/ SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN TH PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND /C PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFÉTY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM I ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AN ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.


DEVELOPER'S NAME: CONTINENTAL HOMES OF TEXAS, L.P.	
ADDRESS: 5419 N LOOP 1604 E	
CITY: SAN ANTONIO STATE: TX ZIP: 78218	
PHONE# <u>(210)-496-2668</u> FAX# <u>(210)-496-2668</u>	
SAWS BLOCK MAP# 74602 TOTAL EDU'S 86 TOTAL ACREAGE 17.125	
TOTAL LINEAR FOOTAGE OF PIPE: <u>8" 3,688.88 LF</u> PLAT NO. <u>22-11800298</u>	
NUMBER OF LOTS 86 SAWS JOB NO. 22-1637	


SEWER: MEDIO CREEK WATERSHED - MEDIO CREEK W.R.C. PLAT NO. 22-11800298 11680-52 MAY 2022 DESIGNER CB CHECKED BL DRAWN CB C5.01

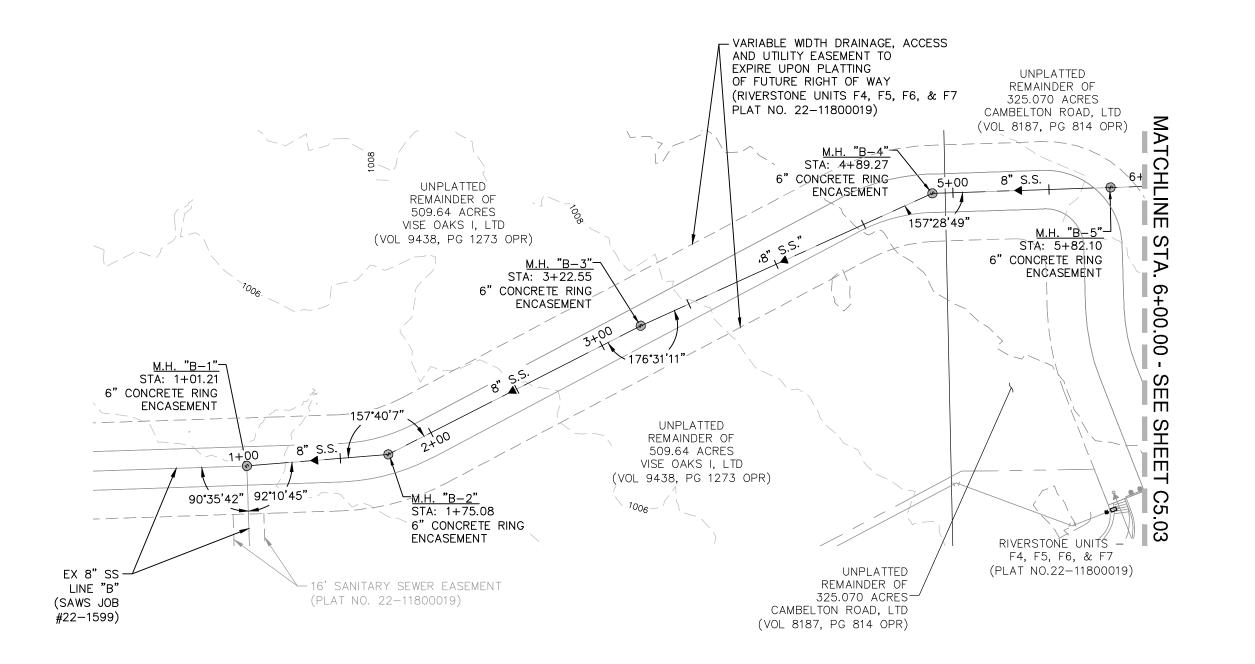

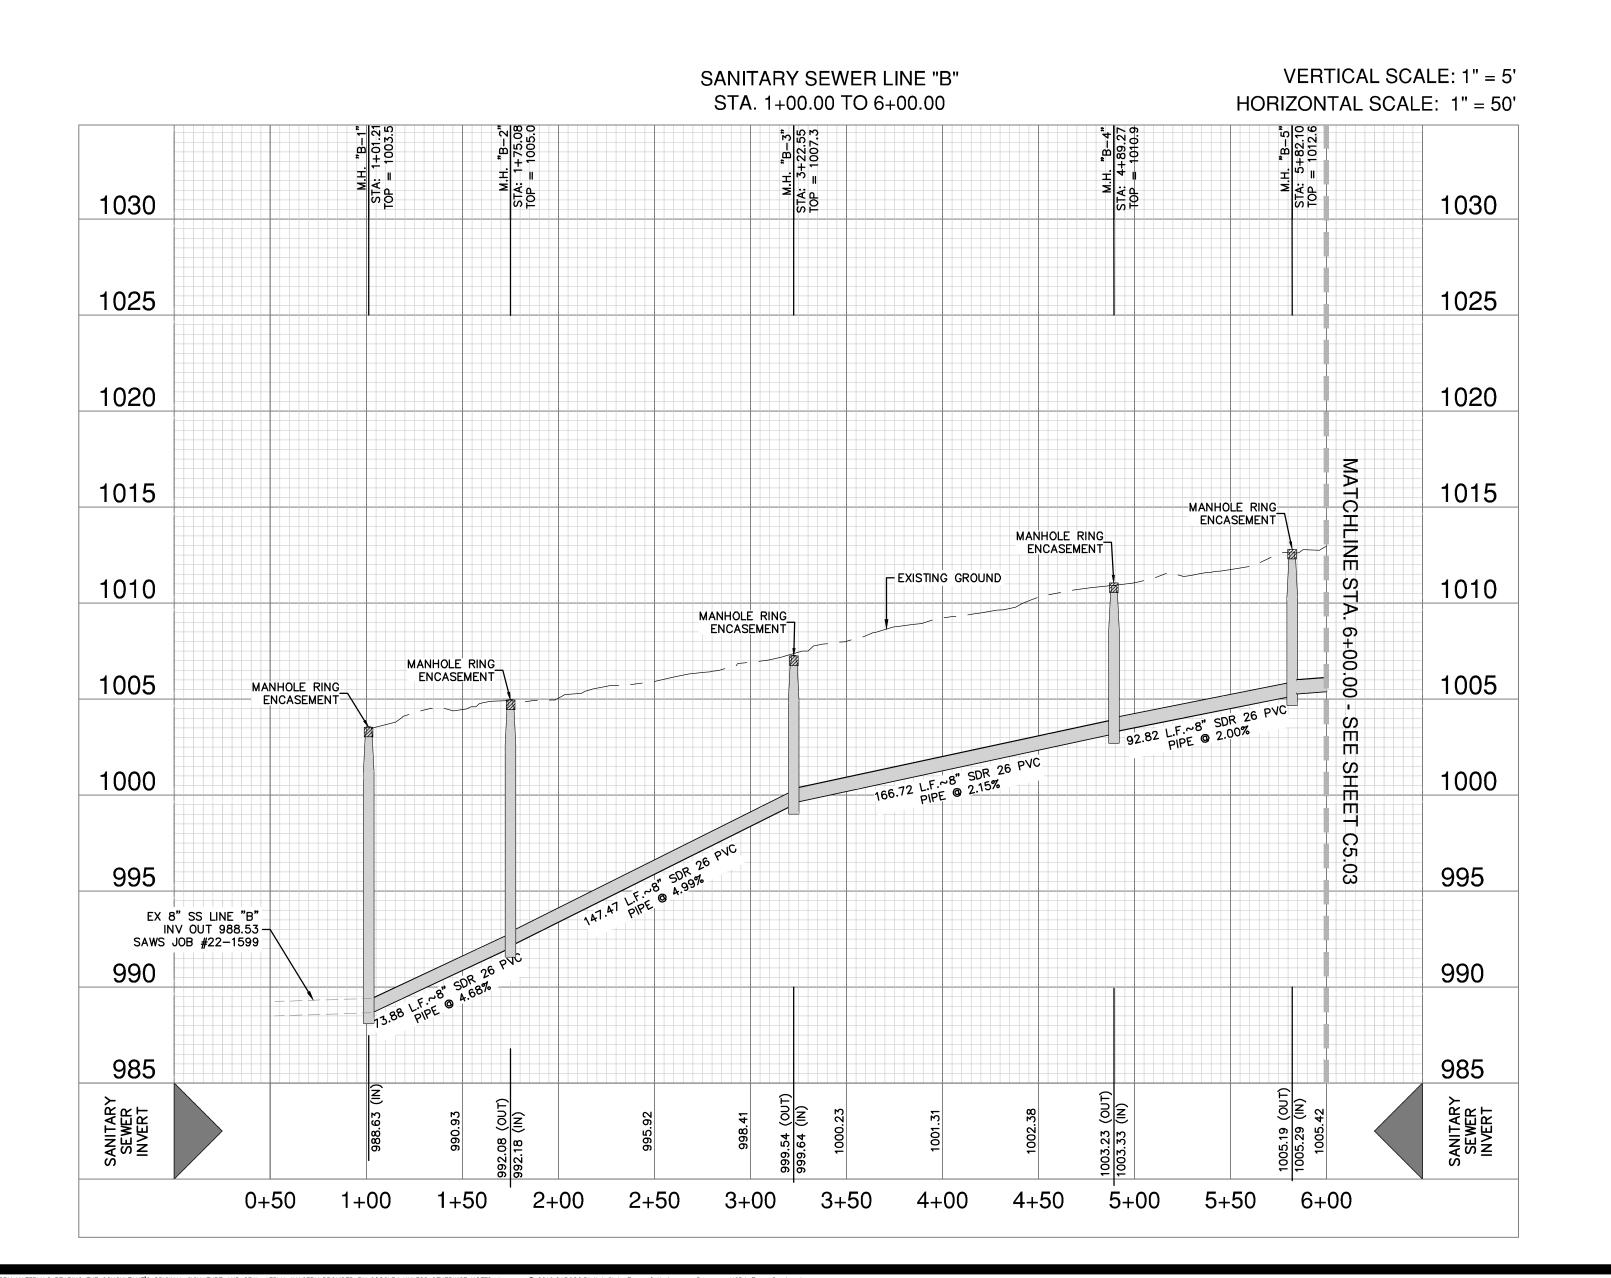




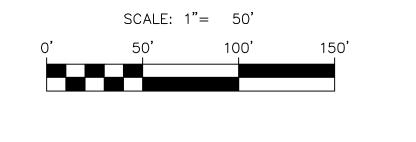

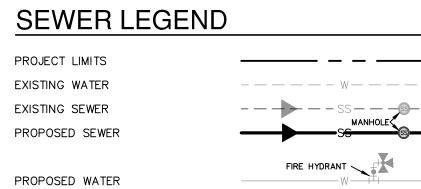

PROPOSED SEWER LATERAL FINISHED FLOOR ELEVATION FOR SEWER

FF = XXXX.XX



**8**0

PROFIL

FINISHED GROUND/PAVEMENT (TOP OF GRADE) PROPOSED WATER LINE -WHERE SEWER PIPE CROSSES A WATER LINE, THE SEWER SHALL BE 160 PSI AND MEET SEPARATION DISTANCE AND PROTECTION REQUIREMENTS THE REQUIREMENTS OF ASTM TO COMPLY WITH 30 TAC D2241 WITH ONE 20' JOINT 217.53(d) AND 290.44(e) CENTERED AT THE WATER CROSSING

> PROPOSED SANITARY SEWER LINE TYPICAL SANITARY SEWER/WATER CROSSING DETAIL

#### CAUTION!!

CONTRACTOR SHALL BE REQUIRED TO LOCATE ALL PUBLIC OR PRIVATE UTILITIES INCLUDING BUT NOT LIMITING TO: WATER, SEWER, TELEPHONE AND FIBER OPTIC LINES, SITE LIGHTING ELECTRIC, SECONDARY ELECTRIC, PRIMARY ELECTRICAL DUCTBANKS, LANDSCAPE IRRIGATION FACILITIES, AND GAS LINES. ANY UTILITY CONFLICTS THAT ARISE SHOULD BE COMMUNICATED TO TH ENGINEER IMMEDIATELY AND PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL CONTACT 1-800-DIG-TESS A MINIMUM OF 48 HOURS PRIOR TO THE START OF CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THE REPAIR SHALL BE AT CONTRACTOR'S SOLE EXPENSE WHETHER THE UTILITY IS SHOWN ON THESE PLANS OR NOT.


#### TRENCH EXCAVATION SAFETY PROTECTION:


CONTRACTOR AND/ OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/ GEOTECHNICAL/ SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND /OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFÉTY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.


#### SEWER: MEDIO CREEK WATERSHED - MEDIO CREEK W.R.C.


<b>  [</b>	
	DEVELOPER'S NAME: <u>CONTINENTAL HOMES OF TEXAS, L.P.</u>
/	ADDRESS: <u>5419 N LOOP 1604 E</u>
	CITY: SAN ANTONIO STATE: TX ZIP: 78218
	PHONE# <u>(210)-496-2668</u> FAX# <u>(210)-496-2668</u>
	SAWS BLOCK MAP# <u>74602</u> TOTAL EDU'S <u>86</u> TOTAL ACREAGE <u>17.12</u> 5
т	TOTAL LINEAR FOOTAGE OF PIPE: <u>8" 3,688.88 LF</u> PLAT NO. <u>22-11800298</u>
III ∧	NUMBER OF LOTS 86 SAWS JOB NO 22-1637

PLAT NO. 22-11800298 11680-52 DESIGNER CHECKED BL DRAWN CB

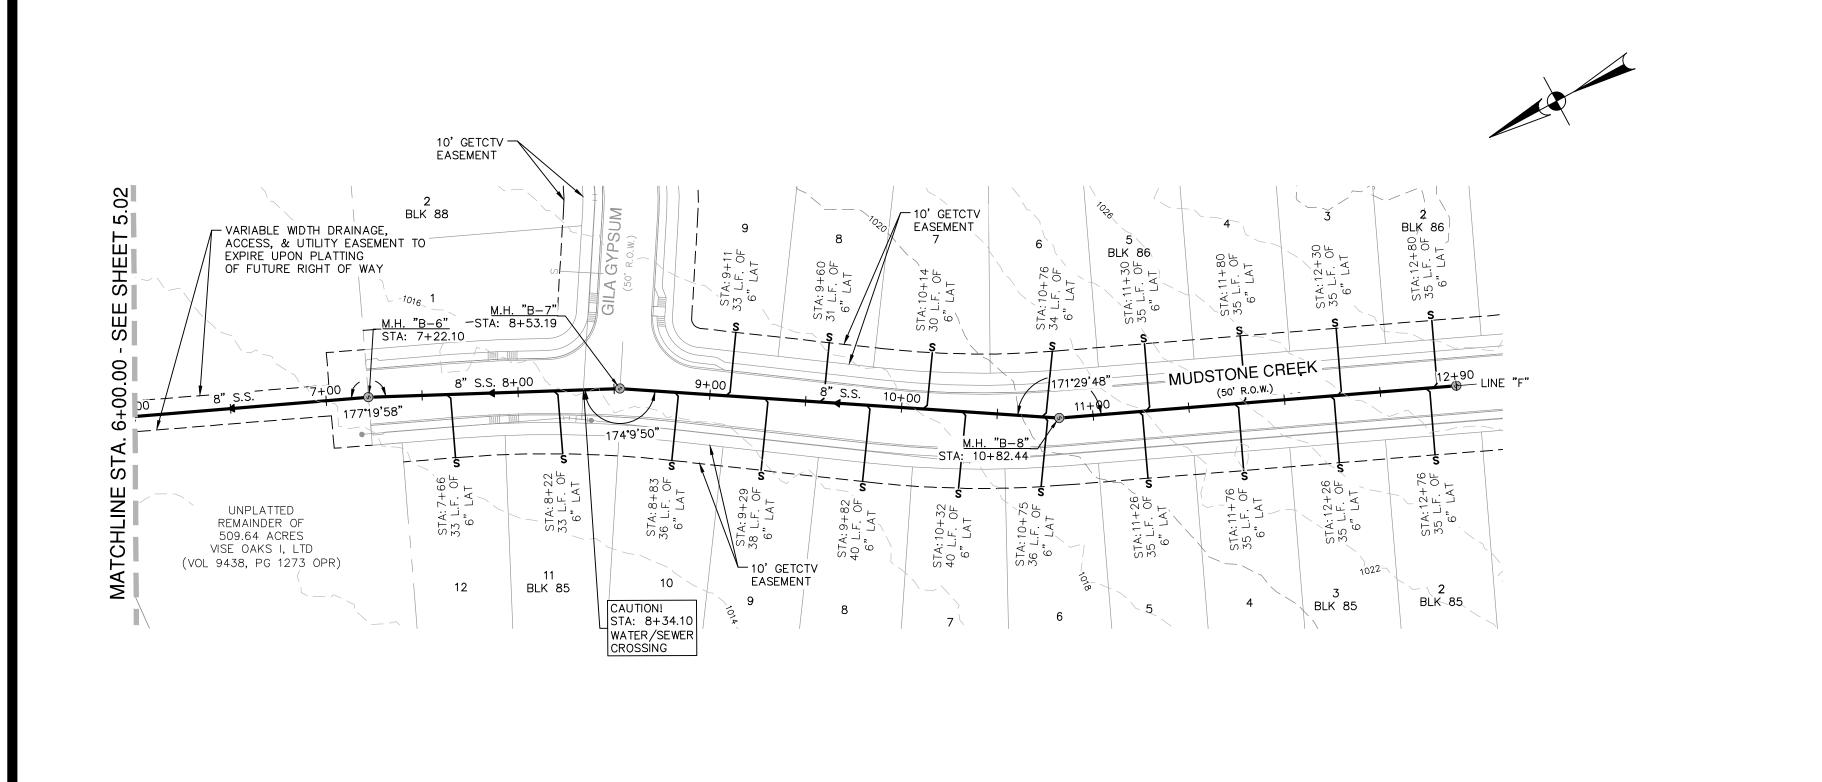


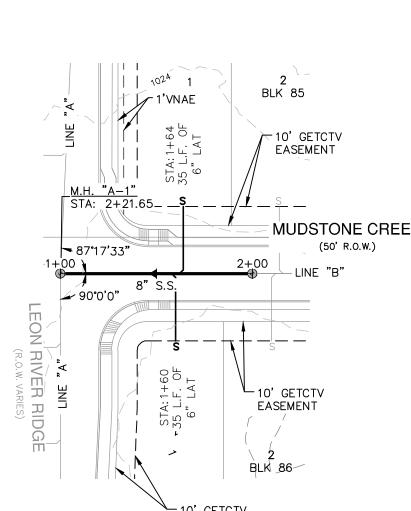

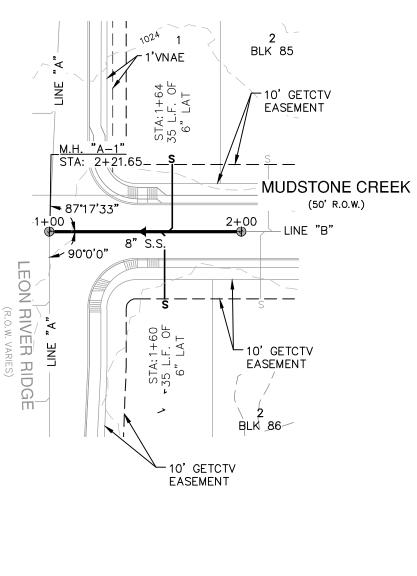

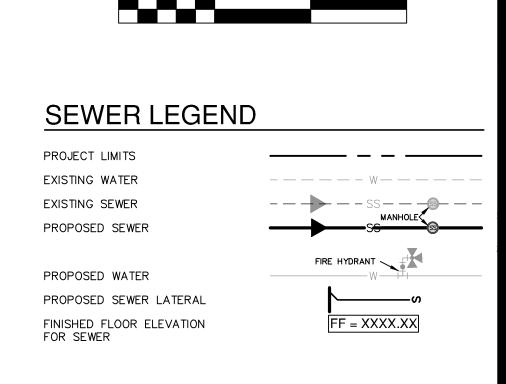

SCALE: 1"= 50'



PAPE-DAWSON ENGINEERS

<sub>r NO.</sub> 22-11800298

CHECKED BL DRAWN CB

DESIGNER

11680-52

FINISHED GROUND/PAVEMENT (TOP OF GRADE) WHERE SEWER PIPE CROSSES A WATER LINE, THE SEWER SHALL BE 160 PSI AND MEET THE REQUIREMENTS OF ASTM D2241 WITH ONE 20' JOINT CENTERED AT THE WATER CROSSING

PROPOSED SANITARY SEWER LINE TYPICAL SANITARY SEWER/WATER CROSSING DETAIL NOT-TO-SCALE

#### CAUTION!!

PROPOSED WATER LINE -

SEPARATION DISTANCE AND PROTECTION REQUIREMENTS

TO COMPLY WITH 30 TAC -

217.53(d) AND 290.44(e)

CONTRACTOR SHALL BE REQUIRED TO LOCATE ALL PUBLIC OR PRIVATE UTILITIES INCLUDING BUT NOT LIMITING TO: WATER, SEWER, TELEPHONE AND FIBER OPTIC LINES, SITE LIGHTING ELECTRIC, SECONDARY ELECTRIC, PRIMARY ELECTRICAL DUCTBANKS, LANDSCAPE IRRIGATION FACILITIES, AND GAS LINES. ANY UTILITY CONFLICTS THAT ARISE SHOULD BE COMMUNICATED TO ENGINEER IMMEDIATELY AND PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL CONTACT 1-800-DIG-TESS A MINIMUM OF 48 HOURS PRIOR TO THE START OF CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THE REPAIR SHALL BE AT CONTRACTOR'S SOLE EXPENSE WHETHER THE UTILITY IS SHOWN ON THESE PLANS OR NOT.


#### TRENCH EXCAVATION SAFETY PROTECTION:


CONTRACTOR AND/ OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/ GEOTECHNICAL/ SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND /OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

#### SEWIER- MEDIO CREEK WATERSHED - MEDIO CREEK W.B.C.

DEVELOPER'S NAME: CO	NTINENTAL HOMES OF	TEXAS, L.P.
ADDRESS: 5419 N LO	OP 1604 E	
CITY: SAN ANTONIO	STATE:TX_	ZIP: 78218
PHONE# <u>(210)-496-26</u>		
SAWS BLOCK MAP# 7460	02 TOTAL EDU'S 86	TOTAL ACREAGE 17.125
TOTAL LINEAR FOOTAGE		
NUMBER OF LOTS 86	SAWS IOD NO	O 22_1637

SEWER: MEDIO CREEK	WATERSHED - N	IEDIO CREEK W.
DEVELOPER'S NAME: CONTIN	NENTAL HOMES OF T	EXAS, L.P.
ADDRESS: 5419 N LOOP	1604 E	
CITY: SAN ANTONIO	STATE:TX	ZIP: <u>78218</u>
PHONE# <u>(210)-496-2668</u>	FAX#	(210)-496-2668
SAWS BLOCK MAP# 74602	_TOTAL EDU'S <u>86</u>	_ TOTAL ACREAGE 17.
TOTAL LINEAR FOOTAGE OF	PIPE: <u>8" 3,688.88 LF</u>	PLAT NO. 22-118002
NUMBER OF LOTS 86	SAWS JOB NO	). 22-1637

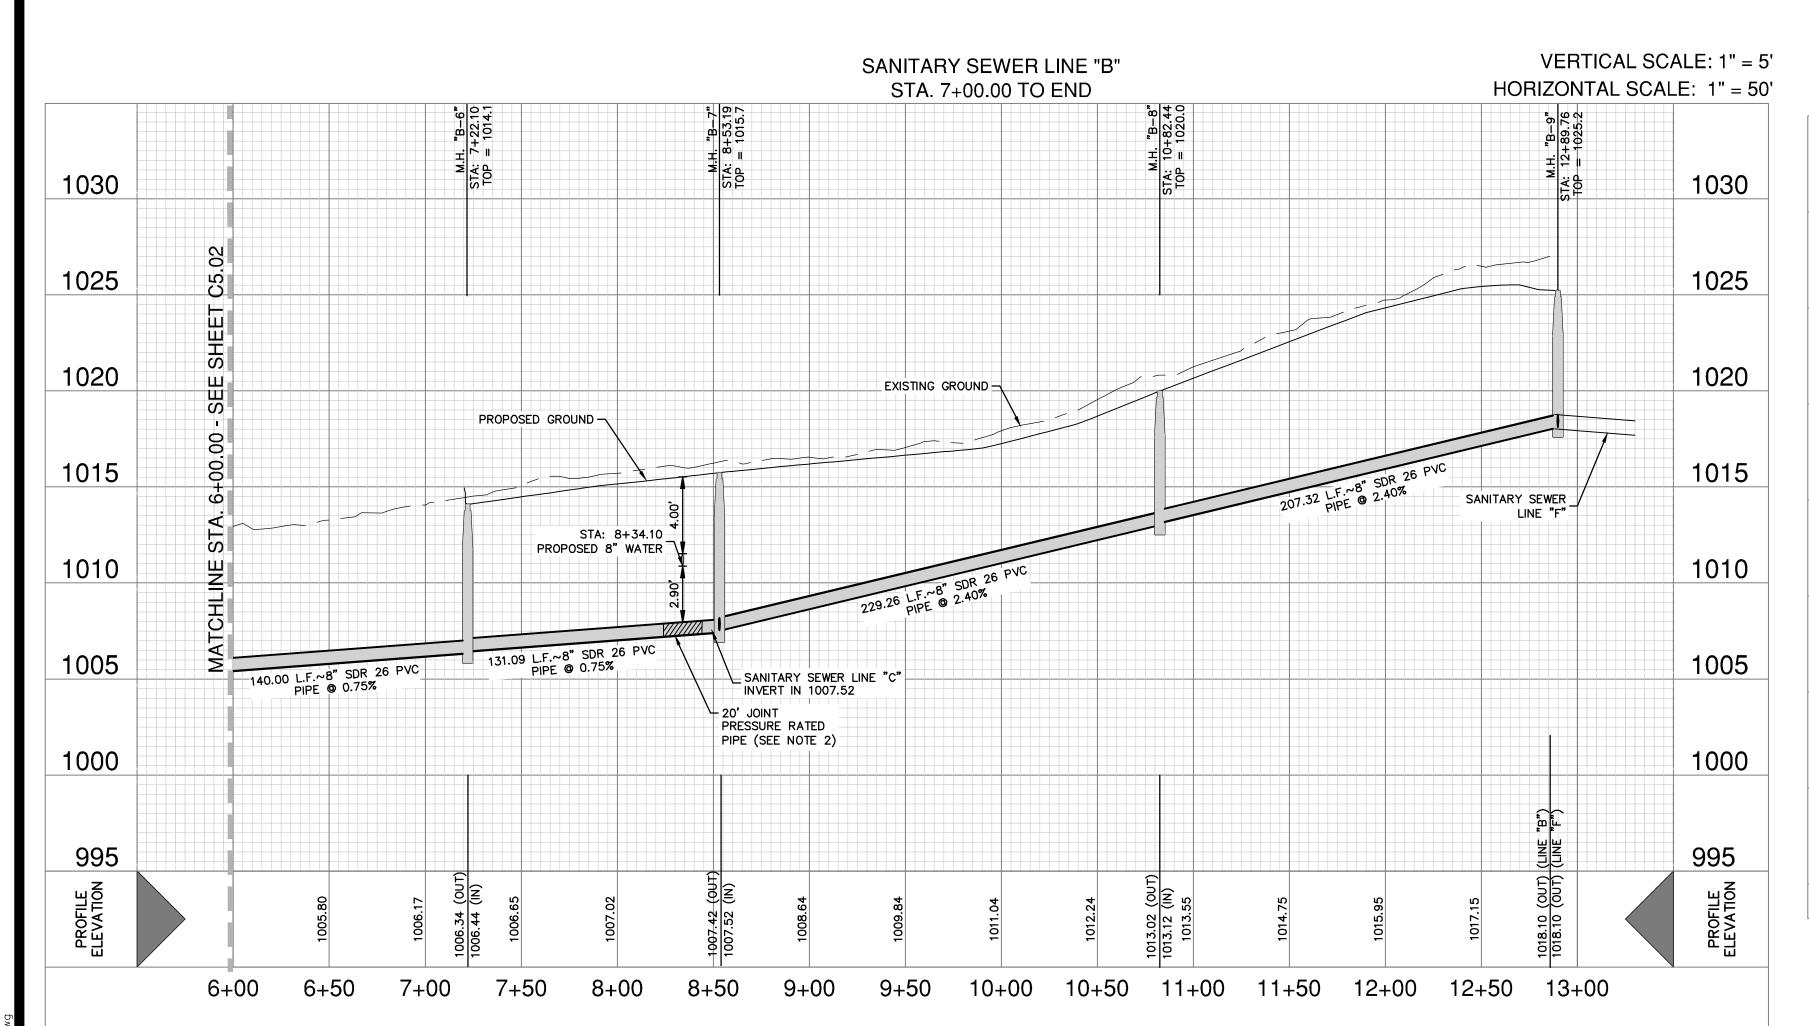


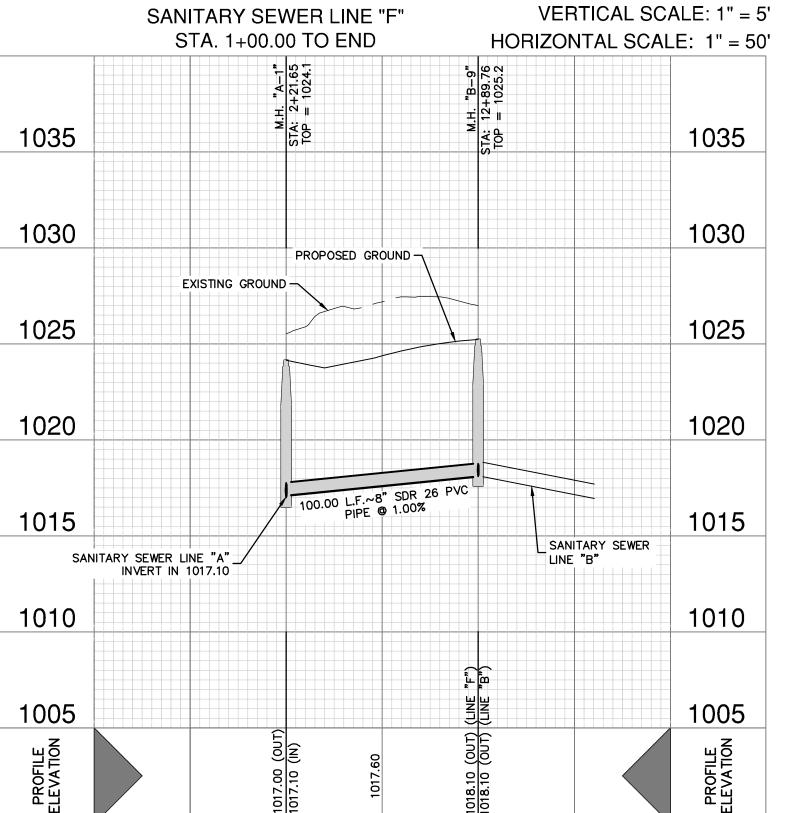


1+50

2+00

2+50

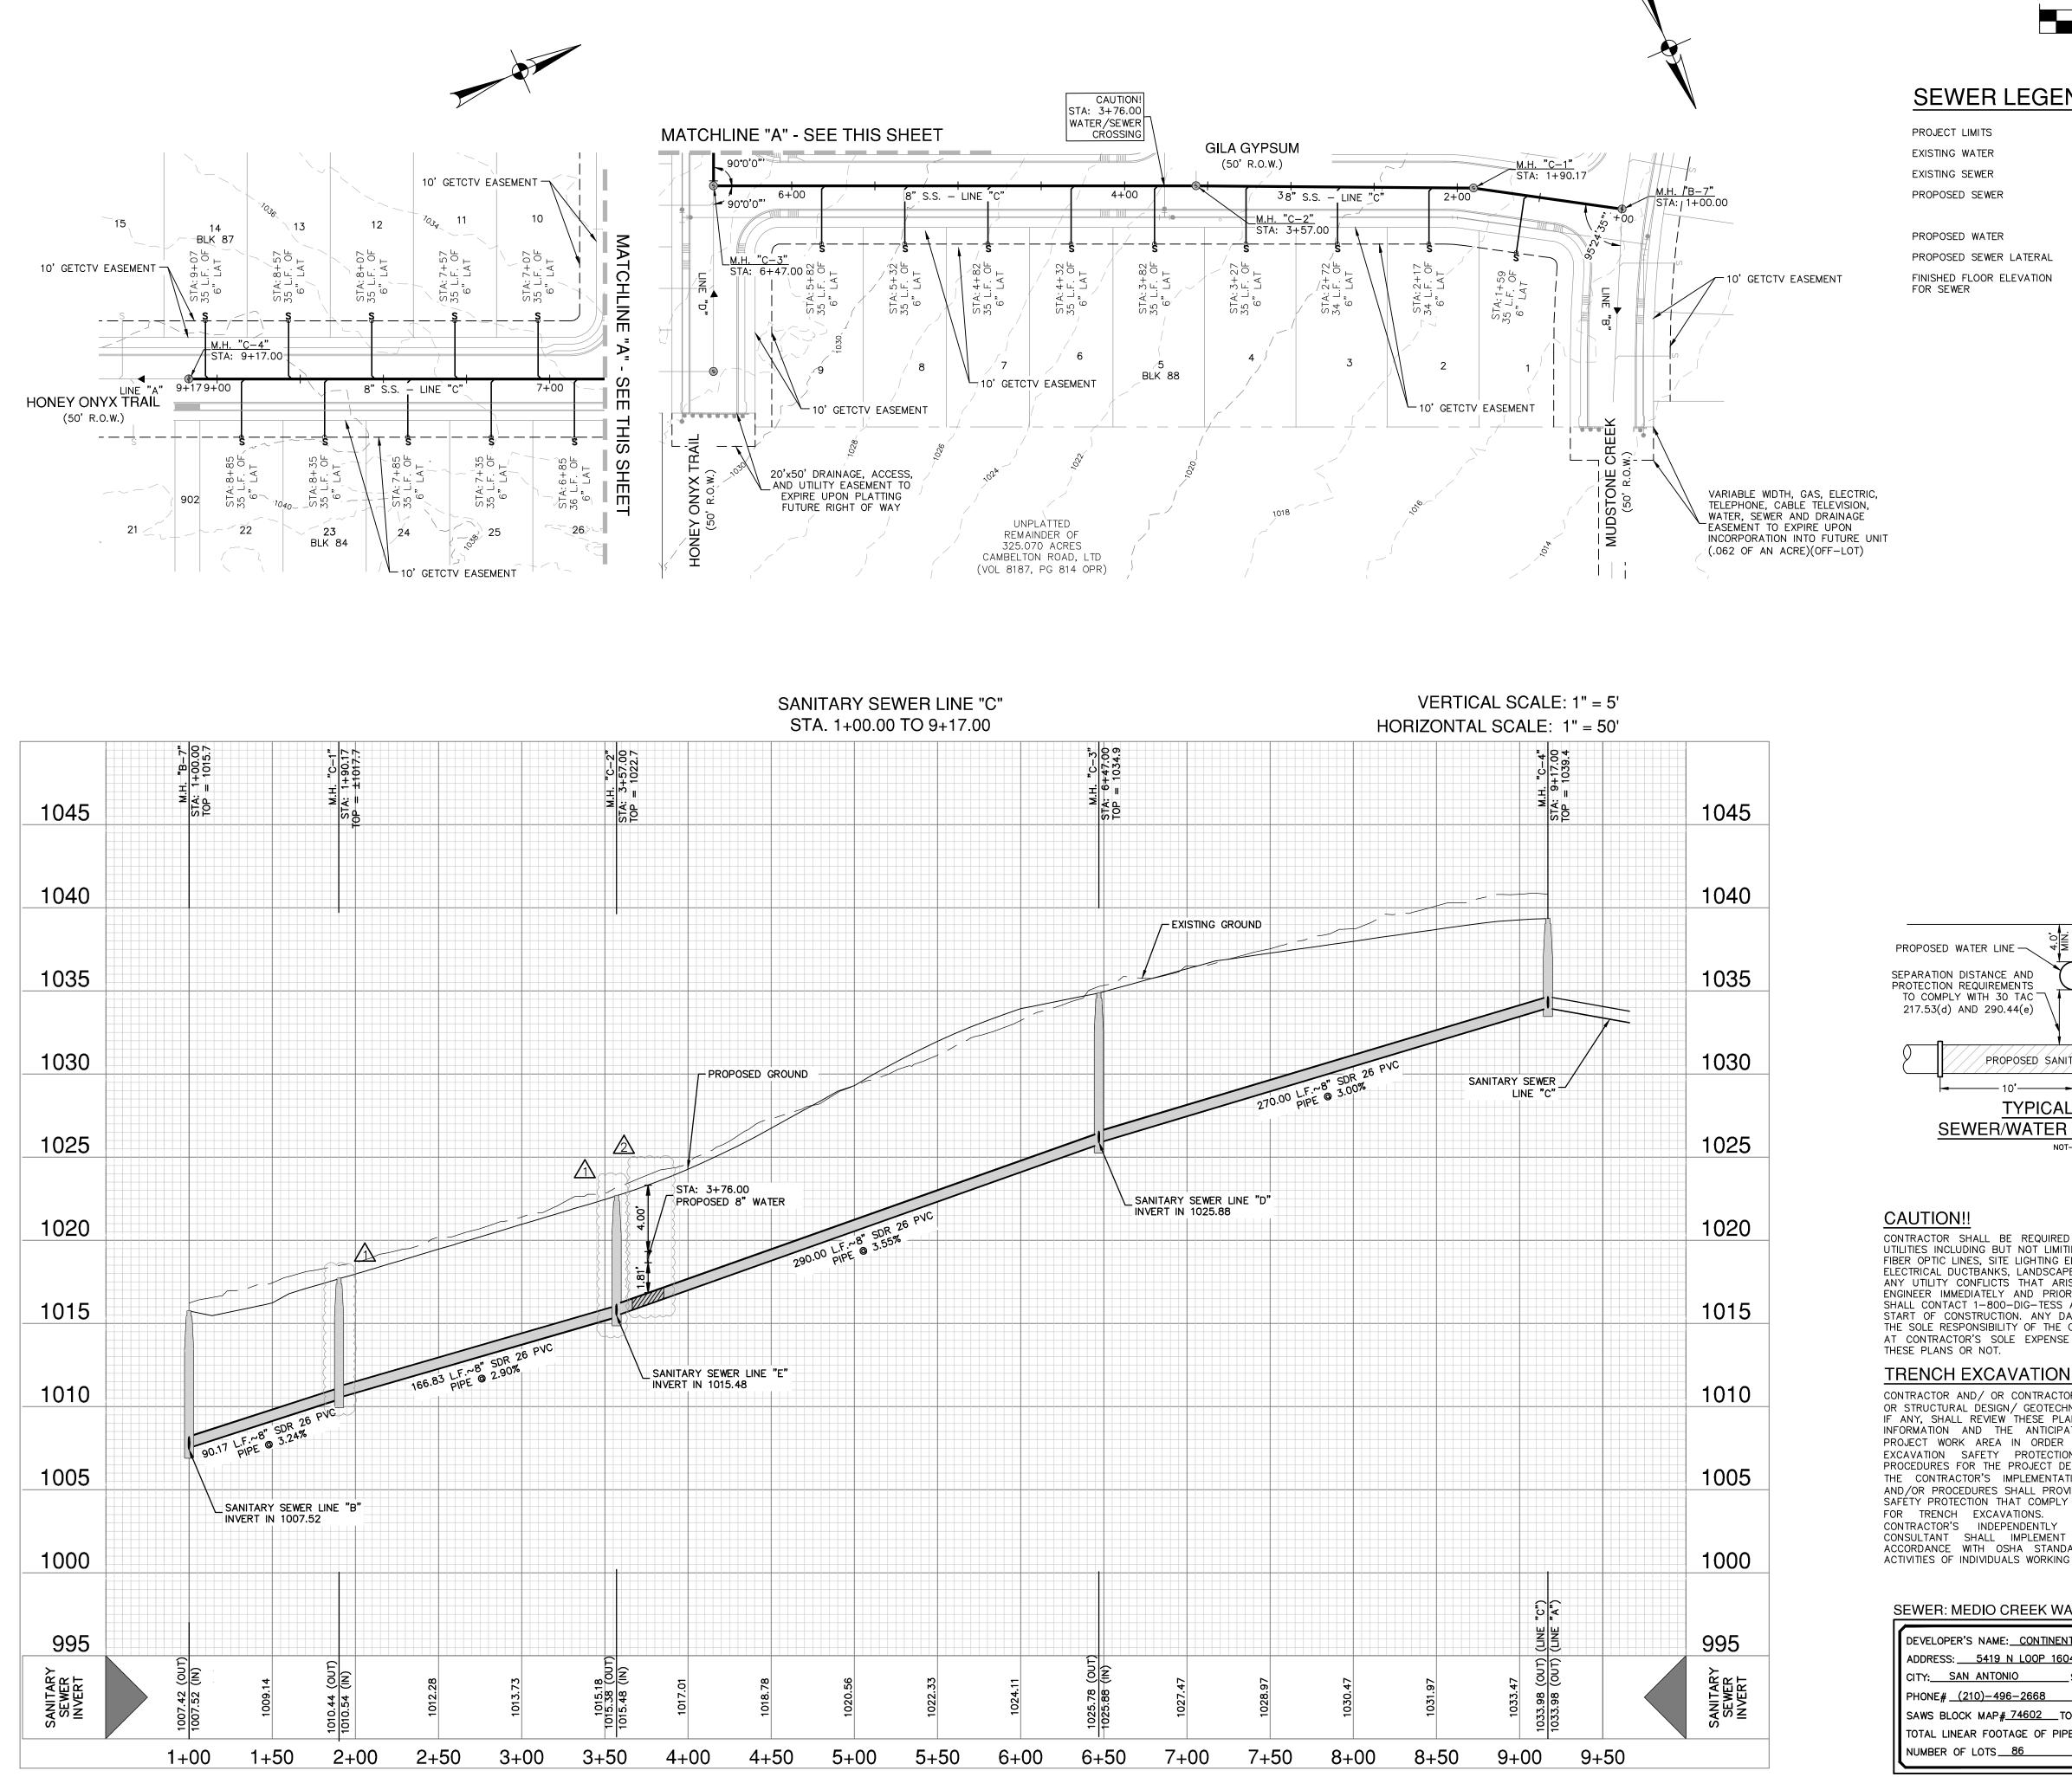

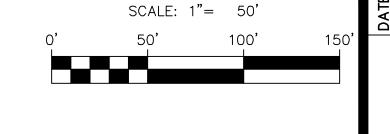

#### SEWER LEGEND

PROJECT LIMITS EXISTING WATER EXISTING SEWER

FOR SEWER

PROPOSED SEWER

PROPOSED WATER PROPOSED SEWER LATERAL FINISHED FLOOR ELEVATION

FF = XXXX.XX

CALEB M. CHANCE

PAPE-DAWSON ENGINEERS

PROFILI

Д-6

SANITARY SEWER LINE C STA. 1+00.00 TO

FINISHED GROUND/PAVEMENT (TOP OF GRADE) WHERE SEWER PIPE CROSSES A WATER LINE, THE SEWER
SHALL BE 160 PSI AND MEET
THE REQUIREMENTS OF ASTM D2241 WITH ONE 20' JOINT CENTERED AT THE WATER CROSSING PROPOSED SANITARY SEWER LINE

TYPICAL SANITARY SEWER/WATER CROSSING DETAIL NOT-TO-SCALE

#### CAUTION!!

CONTRACTOR SHALL BE REQUIRED TO LOCATE ALL PUBLIC OR PRIVATE UTILITIES INCLUDING BUT NOT LIMITING TO: WATER, SEWER, TELEPHONE AND FIBER OPTIC LINES, SITE LIGHTING ELECTRIC, SECONDARY ELECTRIC, PRIMARY ELECTRICAL DUCTBANKS, LANDSCAPE IRRIGATION FACILITIES, AND GAS LINES. ANY UTILITY CONFLICTS THAT ARISE SHOULD BE COMMUNICATED TO THE ENGINEER IMMEDIATELY AND PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL CONTACT 1-800-DIG-TESS A MINIMUM OF 48 HOURS PRIOR TO THE START OF CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THE REPAIR SHALL BE AT CONTRACTOR'S SOLE EXPENSE WHETHER THE UTILITY IS SHOWN ON THESE PLANS OR NOT.

#### TRENCH EXCAVATION SAFETY PROTECTION

CONTRACTOR AND/ OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/ GEOTECHNICAL/ SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND /OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFÉTY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

#### SEWER: MEDIO CREEK WATERSHED - MEDIO CREEK W.R.C.

DEVELOPER'S NAME: CONTINENTAL HOMES OF TEXAS, L.P.
ADDRESS: 5419 N LOOP 1604 E
CITY: SAN ANTONIO STATE: TX ZIP: 78218
PHONE# <u>(210)-496-2668</u> FAX# <u>(210)-496-2668</u>
SAWS BLOCK MAP# <u>74602</u> TOTAL EDU'S <u>86</u> TOTAL ACREAGE <u>17.12</u> 5


TOTAL LINEAR FOOTAGE OF PIPE:8" 3.688.88 LF PLAT NO.22-11800298


\_ SAWS JOB NO. <u>22-1637</u>


ESIGNER CB CHECKED BL DRAWN CB C5.04


. NO. 22-11800298


11680-52

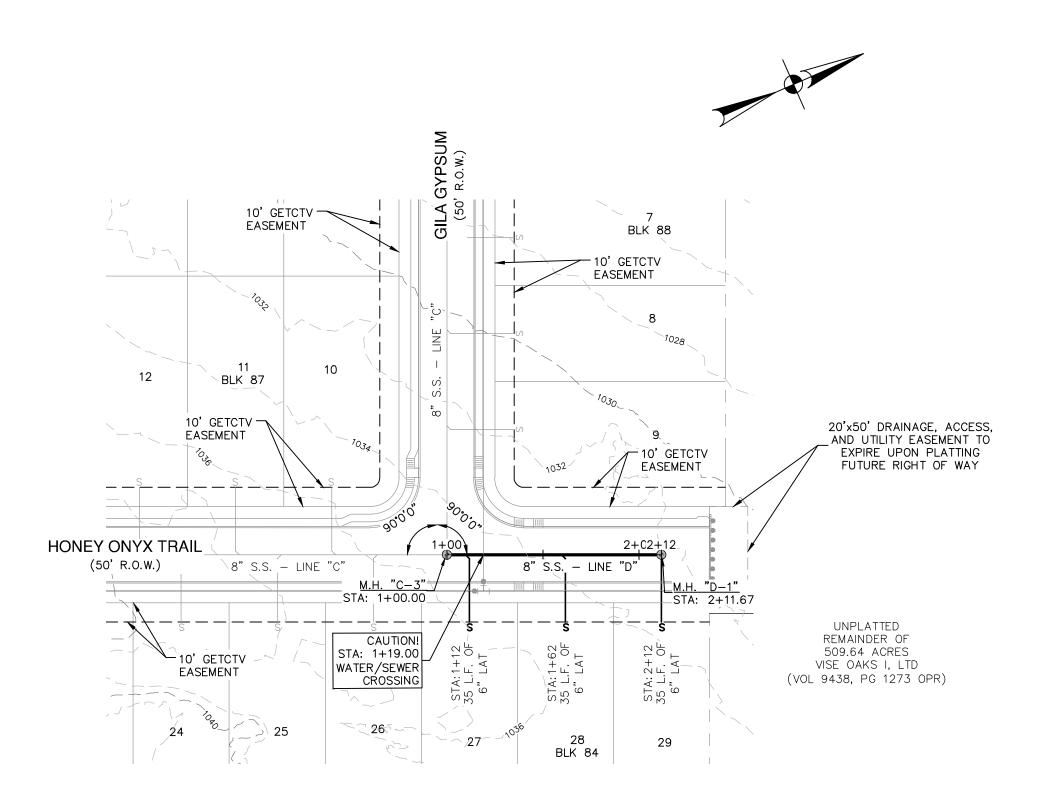


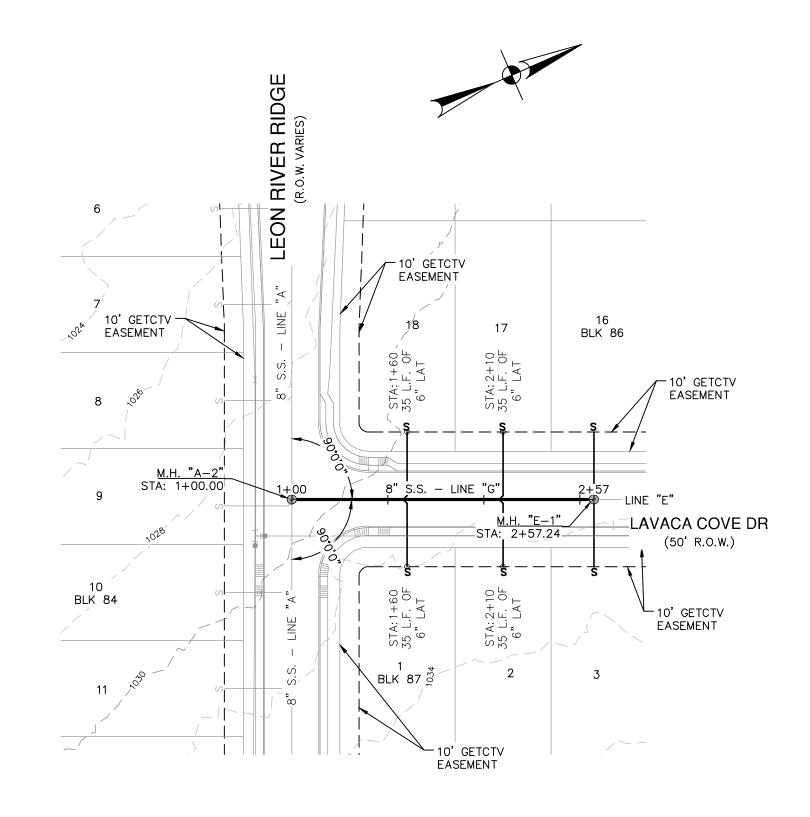

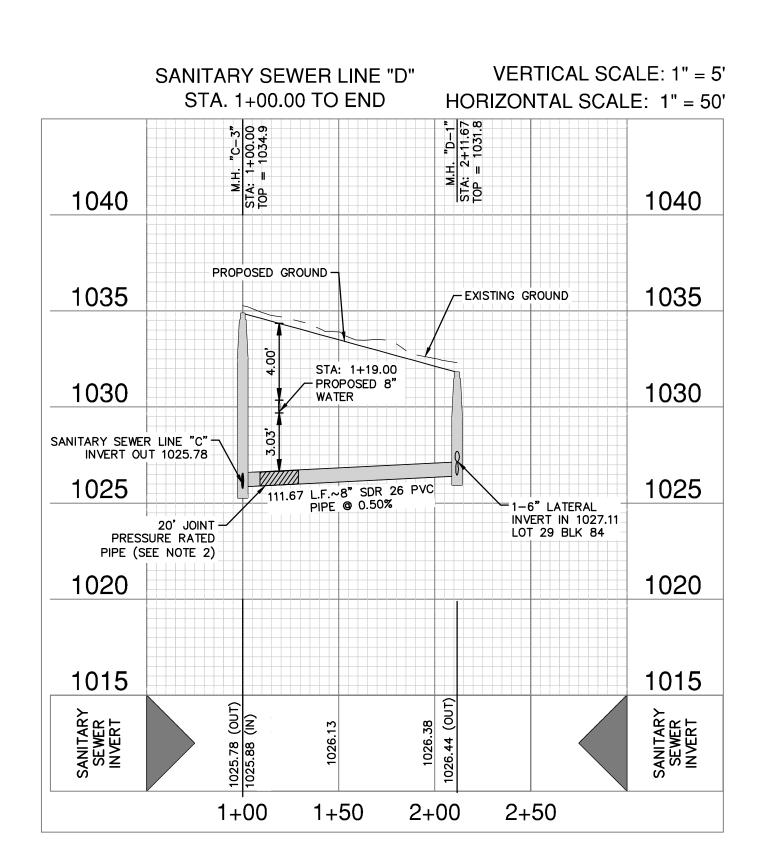

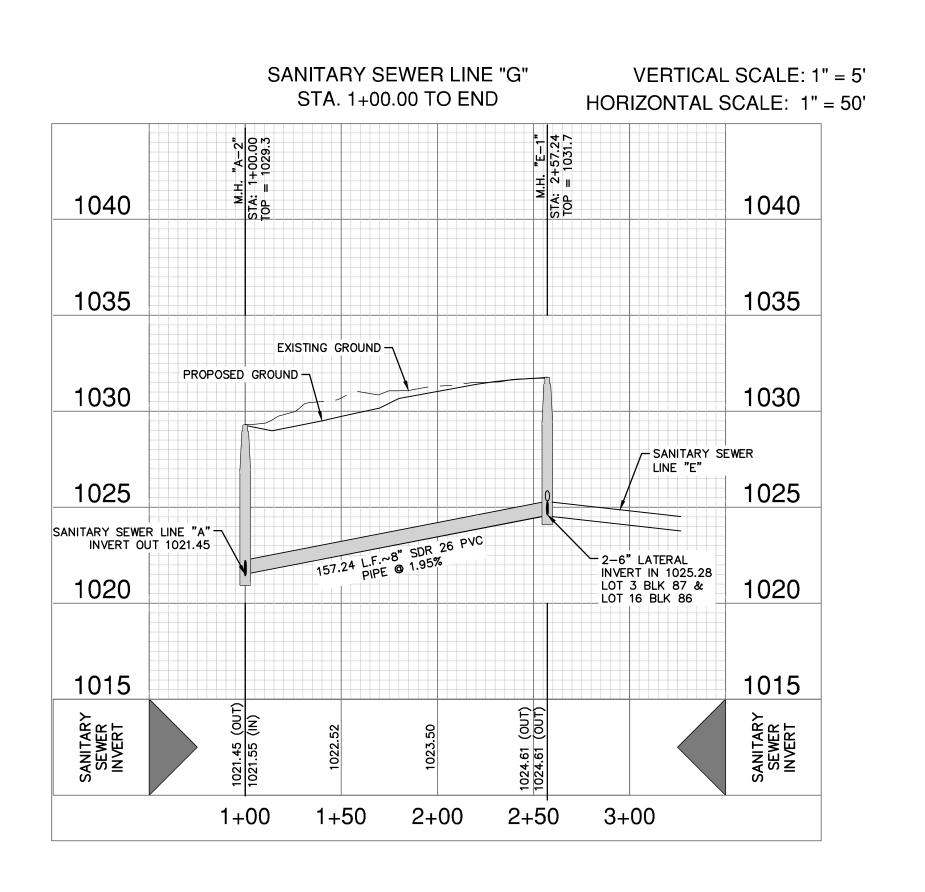

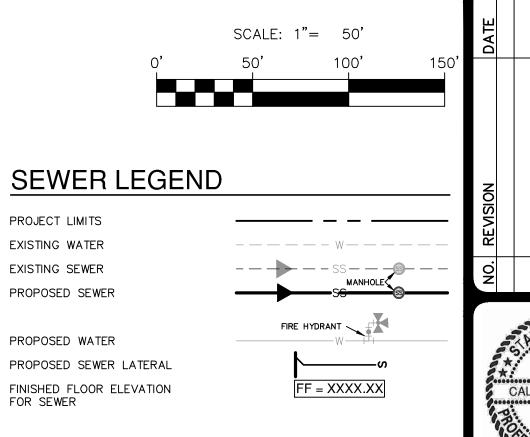



SON ST | 1/19/23 STH | DALLAS 1 210.375.9000 FIRM #10028800

FAPE-DAWS

ENGINEERS

AN ANTONIO I AUSTIN | HOUSTON I FORT WORTH I

PROFILE

Ω 4

LINE D & -00.00 TO

SANITARY

UNIT TEXAS

PROPOSED WATER LINE

WHERE SEWER PIPE CROSSES
A WATER LINE, THE SEWER
SHALL BE 160 PSI AND MEET
THE REQUIREMENTS OF ASTM
D2241 WITH ONE 20' JOINT
CENTERED AT THE WATER
CROSSING

PROPOSED SANITARY SEWER LINE

TYPICAL SANITARY
SEWER/WATER CROSSING DETAIL
NOT-TO-SCALE

#### CAUTION!!

CONTRACTOR SHALL BE REQUIRED TO LOCATE ALL PUBLIC OR PRIVATE UTILITIES INCLUDING BUT NOT LIMITING TO: WATER, SEWER, TELEPHONE AND FIBER OPTIC LINES, SITE LIGHTING ELECTRIC, SECONDARY ELECTRIC, PRIMARY ELECTRICAL DUCTBANKS, LANDSCAPE IRRIGATION FACILITIES, AND GAS LINES. ANY UTILITY CONFLICTS THAT ARISE SHOULD BE COMMUNICATED TO THE ENGINEER IMMEDIATELY AND PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL CONTACT 1-800-DIG-TESS A MINIMUM OF 48 HOURS PRIOR TO THE START OF CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THE REPAIR SHALL BE AT CONTRACTOR'S SOLE EXPENSE WHETHER THE UTILITY IS SHOWN ON THESE PLANS OR NOT.

#### TRENCH EXCAVATION SAFETY PROTECTION

CONTRACTOR AND/ OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/ GEOTECHNICAL/ SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND /OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.

SEWER: MEDIO CREEK WATERSHED - MEDIO CREEK W.R.C.

- 1	
	DEVELOPER'S NAME: CONTINENTAL HOMES OF TEXAS, L.P.
	ADDRESS: <u>5419 N LOOP 1604 E</u>
	CITY: SAN ANTONIO STATE: TX ZIP: 78218
	PHONE# <u>(210)-496-2668</u> FAX# <u>(210)-496-2668</u>
	SAWS BLOCK MAP# 74602 TOTAL EDU'S 86 TOTAL ACREAGE 17.125
	TOTAL LINEAR FOOTAGE OF PIPE: <u>8" 3,688.88 LF</u> PLAT NO. <u>22-11800298</u>
- 1	NUMBER OF LOTS 86 SAWS JOB NO. 22-1637

PLAT NO. 22-11800298


JOB NO. 11680-52


DATE MAY 2022


DESIGNER CB

CHECKED BL DRAWN CB

SHEET C5.05

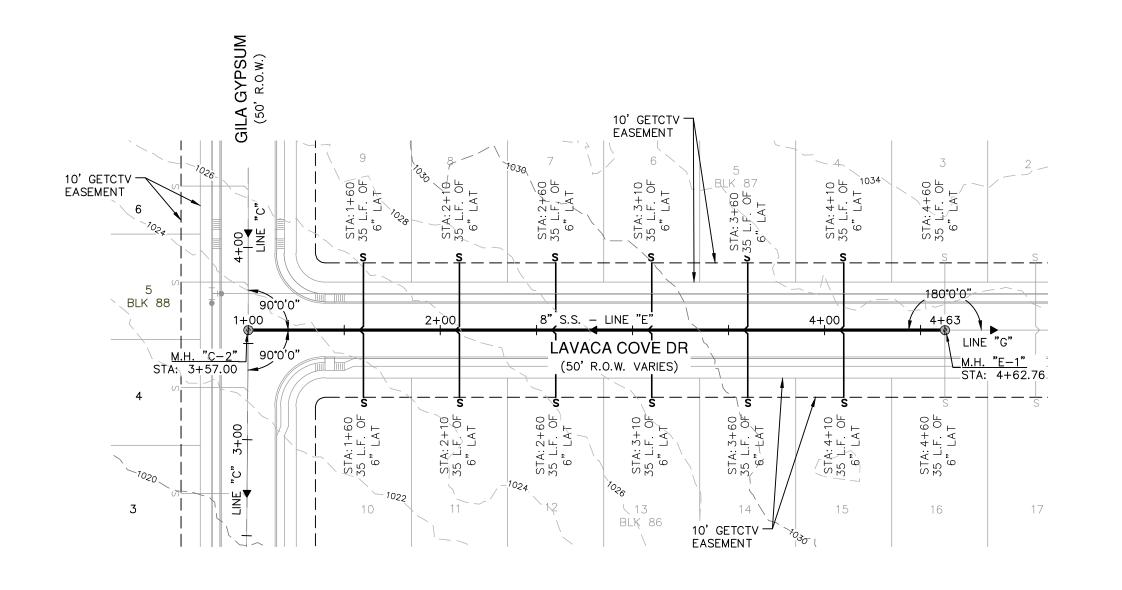

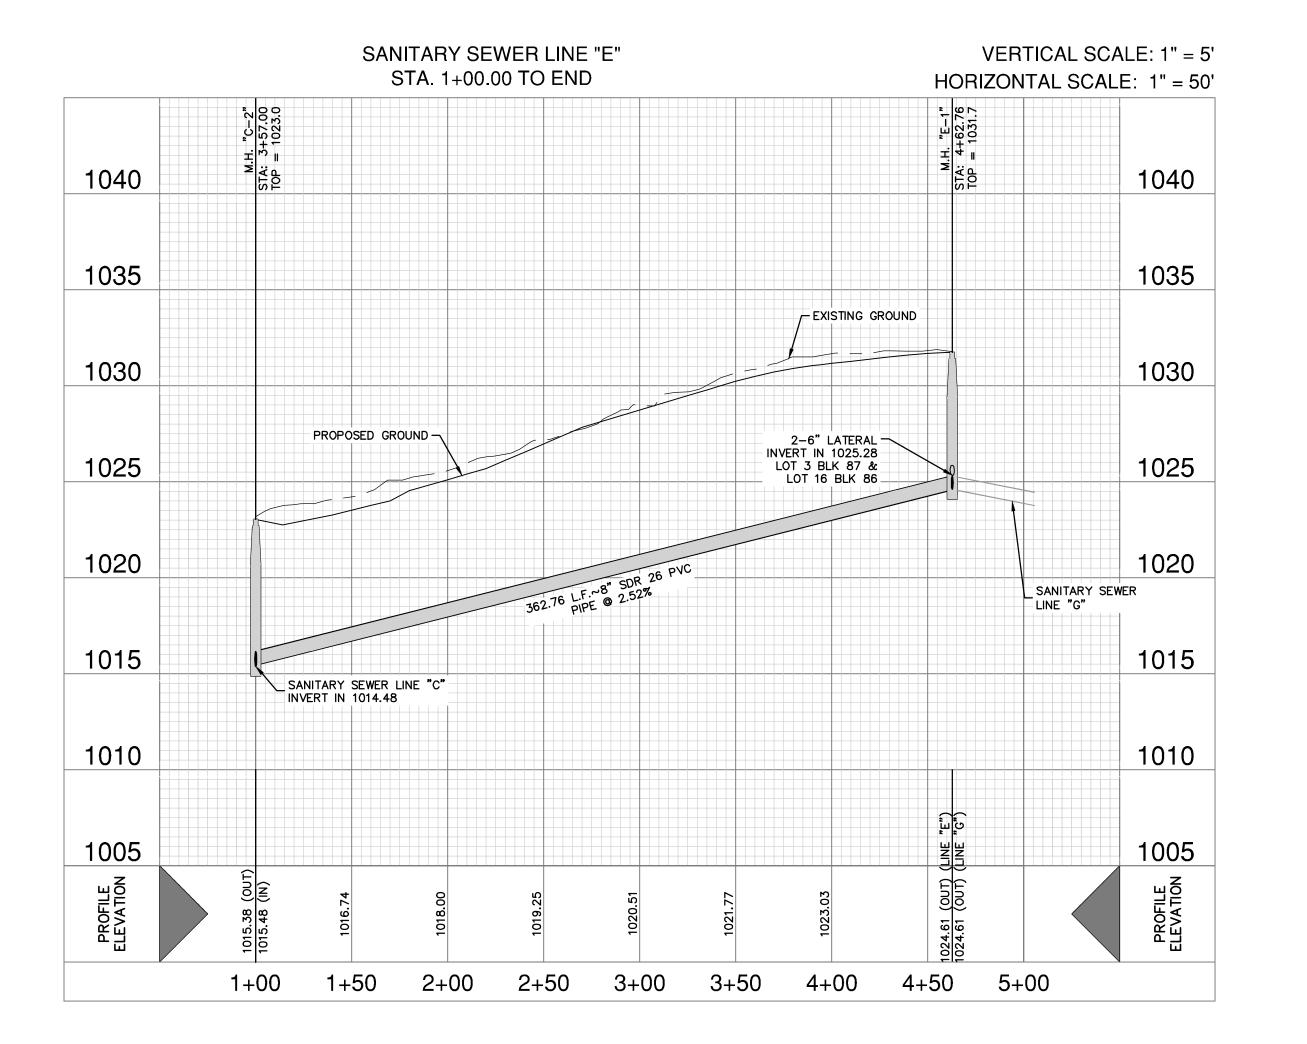




#### SEWER LEGEND

PROJECT LIMITS EXISTING WATER EXISTING SEWER


PROPOSED SEWER PROPOSED WATER

PROPOSED SEWER LATERAL FINISHED FLOOR ELEVATION FOR SEWER FF = XXXX.XX



PAPE-DAWSON ENGINEERS

PROFIL

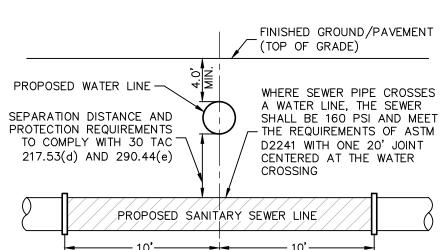

TYPICAL SANITARY SEWER/WATER CROSSING DETAIL NOT-TO-SCALE

#### CAUTION!!

CONTRACTOR SHALL BE REQUIRED TO LOCATE ALL PUBLIC OR PRIVATE UTILITIES INCLUDING BUT NOT LIMITING TO: WATER, SEWER, TELEPHONE AND FIBER OPTIC LINES, SITE LIGHTING ELECTRIC, SECONDARY ELECTRIC, PRIMARY ELECTRICAL DUCTBANKS, LANDSCAPE IRRIGATION FACILITIES, AND GAS LINES. ANY UTILITY CONFLICTS THAT ARISE SHOULD BE COMMUNICATED TO THE ENGINEER IMMEDIATELY AND PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL CONTACT 1-800-DIG-TESS A MINIMUM OF 48 HOURS PRIOR TO THE START OF CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THE REPAIR SHALL BE AT CONTRACTOR'S SOLE EXPENSE WHETHER THE UTILITY IS SHOWN ON THESE PLANS OR NOT.

#### TRENCH EXCAVATION SAFETY PROTECTION


CONTRACTOR AND/ OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/ GEOTECHNICAL/ SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND /OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFÉTY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.


#### SEWER: MEDIO CREEK WATERSHED - MEDIO CREEK W.R.C

DEVELOPER'S NAME: CONTINENTAL HOMES OF TEXAS, L.P.
ADDRESS: 5419 N LOOP 1604 E
CITY: SAN ANTONIO STATE: TX ZIP: 78218
PHONE# <u>(210)-496-2668</u> FAX# <u>(210)-496-2668</u>
SAWS BLOCK MAP# 74602 TOTAL EDU'S 86 TOTAL ACREAGE 17.12
TOTAL LINEAR FOOTAGE OF PIPE:8" 3,688.88 LF PLAT NO.22-11800298

\_\_ SAWS JOB NO.<u>22-1637</u>

PLAT NO. 22-11800298 11680-52 DESIGNER CHECKED BL DRAWN CB

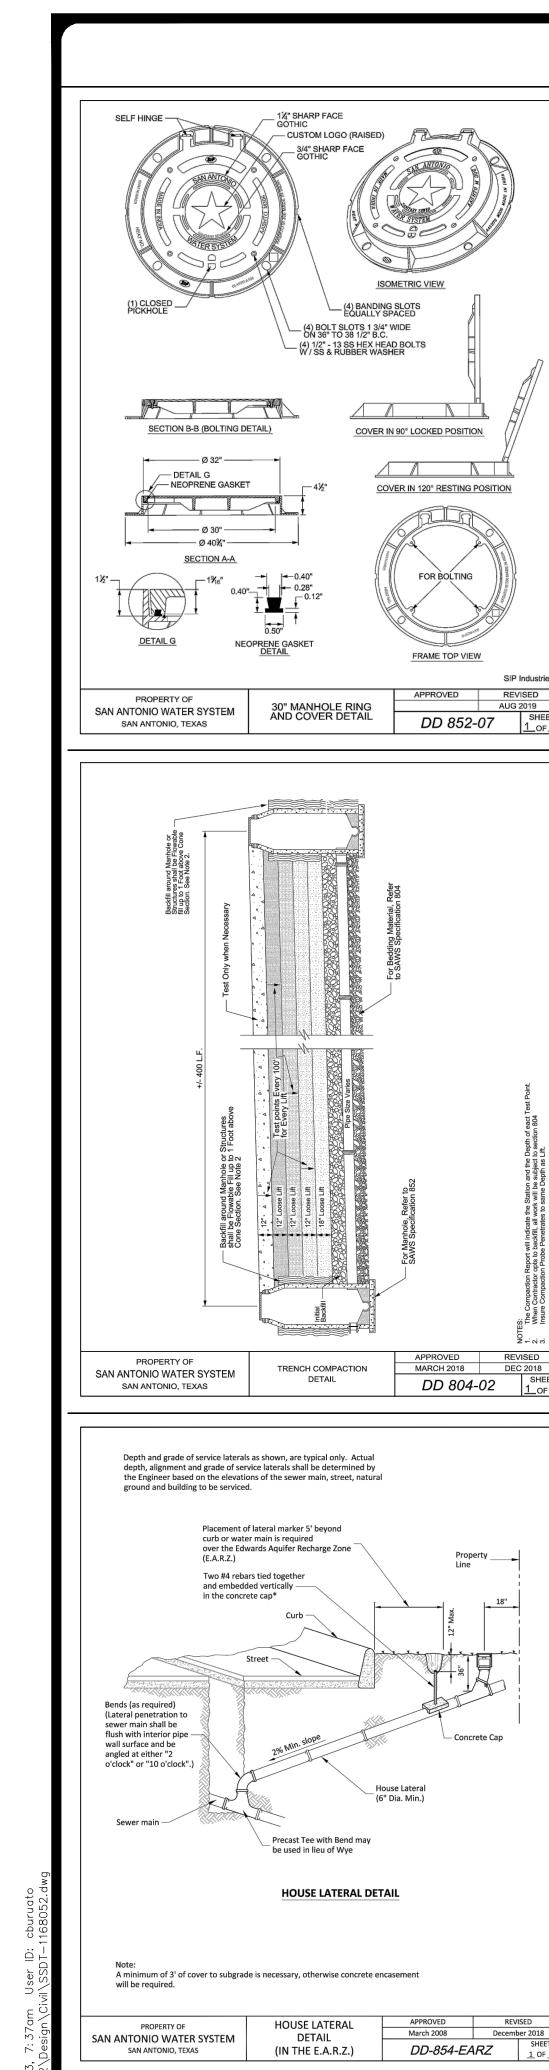

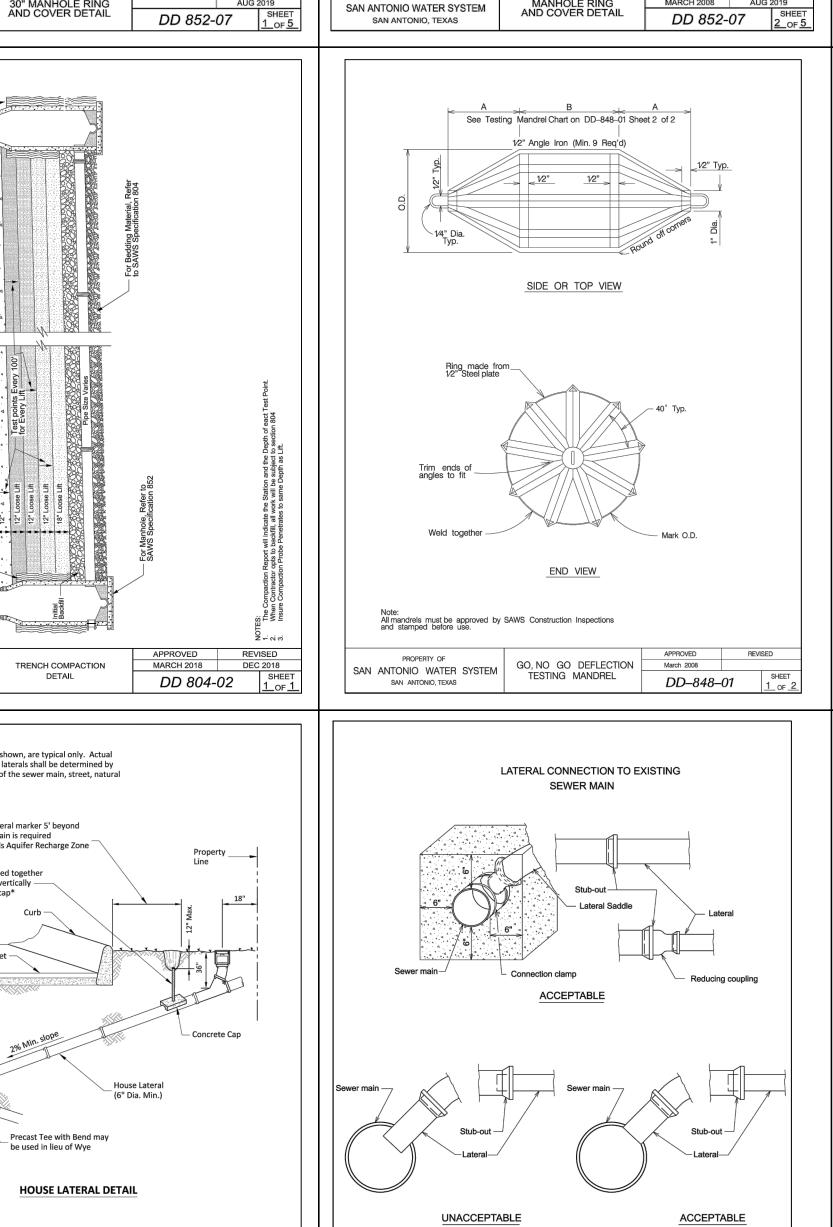

Note:
The saddle shall be permanently bonded to the existing main by the use of compounds or or clamps as recommended by the manufacturer.

LATERAL CONNECTION

SAN ANTONIO WATER SYSTEM

APPROVED

MARCH 2008 APRIL 2014

DD 954 02 SHEET


DD-854-03 SHEET 1\_0F\_1

LHD0102238 Flat Gasket w.out Sut —

PROPERTY OF

SIP Industries

FRAME SECTION A-A

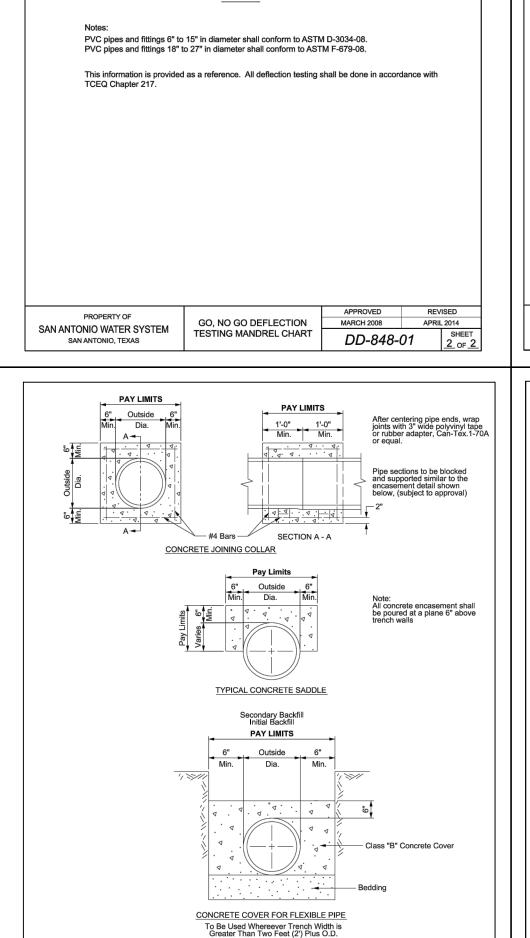

TYPICAL CONCRETE DETAILS

MARCH 2008 DEC 2018

DD 858-02

PROPERTY OF

SAN ANTONIO WATER SYSTEM

SAN ANTONIO, TEXAS

COVER IN 90° LOCKED POSITION

COVER IN 120° RESTING POSITION

REMOVE LIFT ASSIST BOLT & REMOVE COVER @ 90°

 APPROVED
 REVISEU

 MARCH 2008
 AUG 2019

 SHEET

DD 852-07

ERGO XL Assembly

— (4) Bolts Slots 1" Wide on 36" to 38½" B.C.

(4) ½" - 13 SS Hex Head Bolts

(1) Closed Pickhole (M-Pick) —

SECTION B-B

40¾" Dia.

SECTION A-A

PROPERTY OF

SAN ANTONIO WATER SYSTEM

SAN ANTONIO, TEXAS

COVER SECTION B-B

HINGE & GASKET VIEW


HINGE POSITIONS

ERGO Assembl

REVISED


FRAME SECTION B-B

— 1¼" Sharp Face Gothic

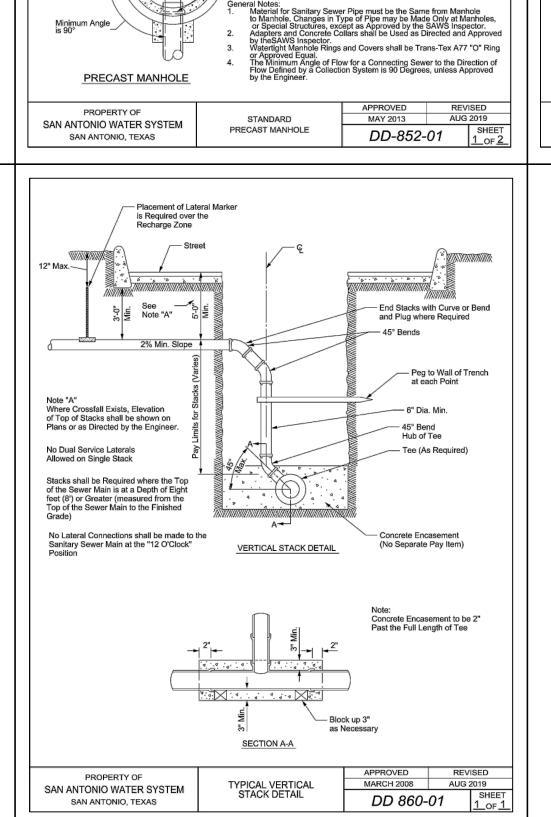


PRECAST MANHOLE

Concrete Cradle to Nearest
Point of all Lines Leaving or
Entering Manholes
All Pipe is Used, Provide
Rubber Gasket One Size Smaller
than Pipe at Each Wall Crossing
of Manhole, If HDPE Pipe is Used
a Non-Shrink Grout to be Applied
within the Wall Sections, Gasket
is also, Required.

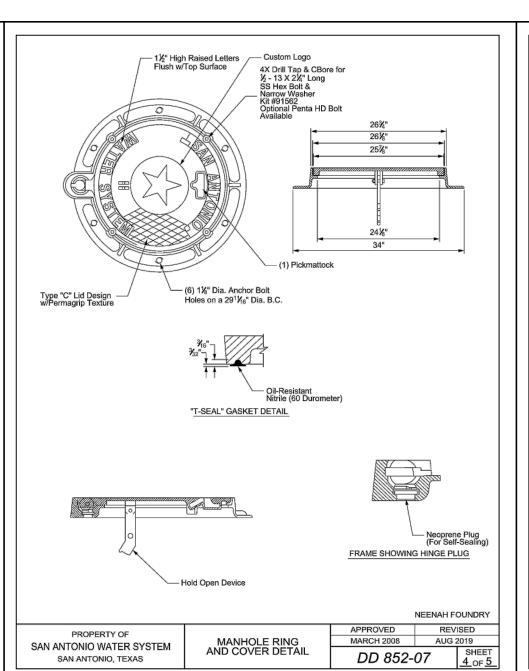

Manhole Ring and Cover (See DD 852-07)

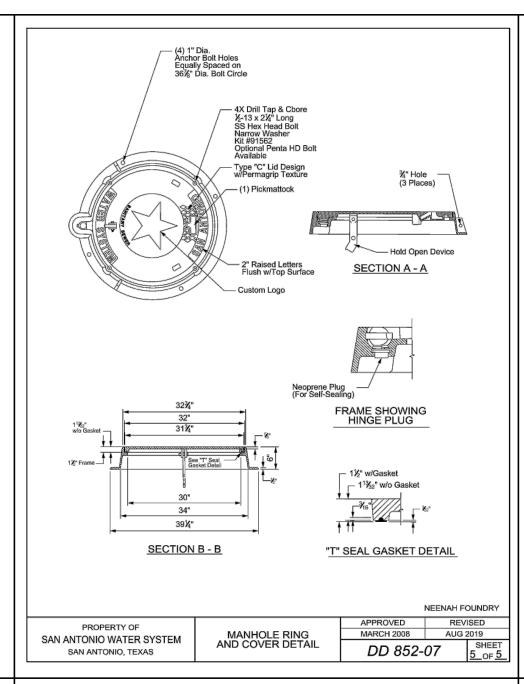

MONOLITHIC MANHOLE

aneral Notes:
Material for Sanitary Sewer Pipe Must be the Same from Manhole to Manhole. Changes in Type of Pipe May be Made only at Manholes, or Special Structures, Except as Approved by the Project Engineer. Adaptors and Concrete Collars shall be used as approved by the SAWS Project Engineer. Watertight Manhole Rings and Covers shall be Trans-Tex A77 "O" Ring or Approved Equal.

STANDARD

MONOLITHIC MANHOLE

Manhole Ring and Cor (See DD 852-02)

Backfill Around Manhole Shall be Flowable Fill up to \_ 1 Foot Above Cone Section.

Concrete Grout -

SAN ANTONIO WATER SYSTEM

SAN ANTONIO, TEXAS


— Bench ½-Inch per Foot


I & I Barrier Required as Per Specification


Press Seal Gasket

March 2008

DD 852-01

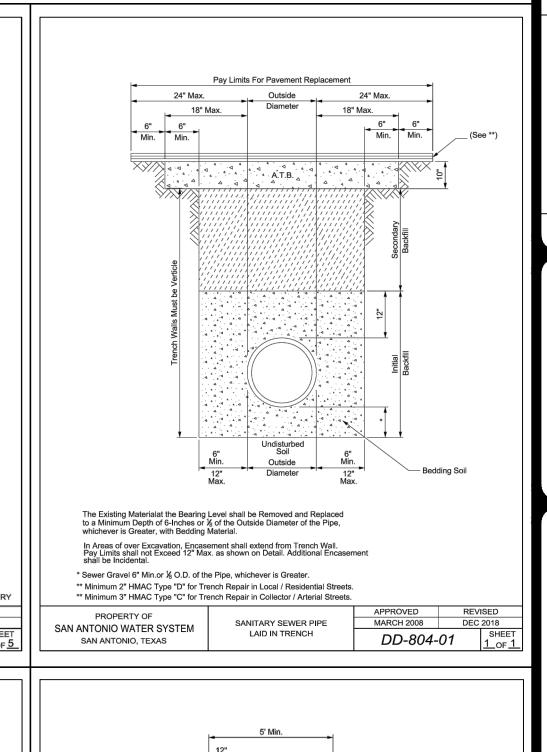

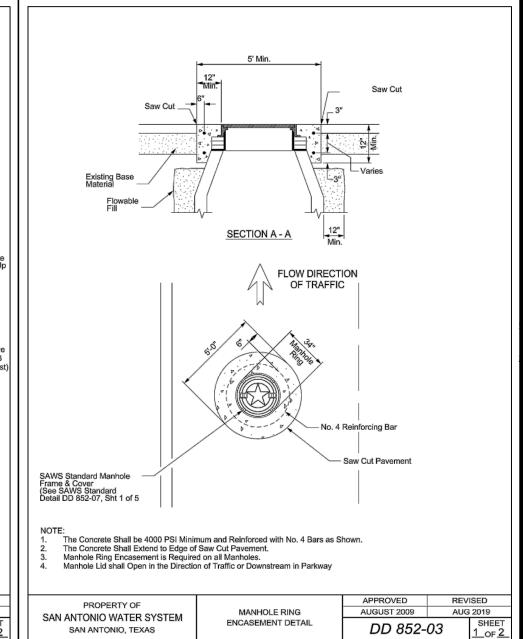

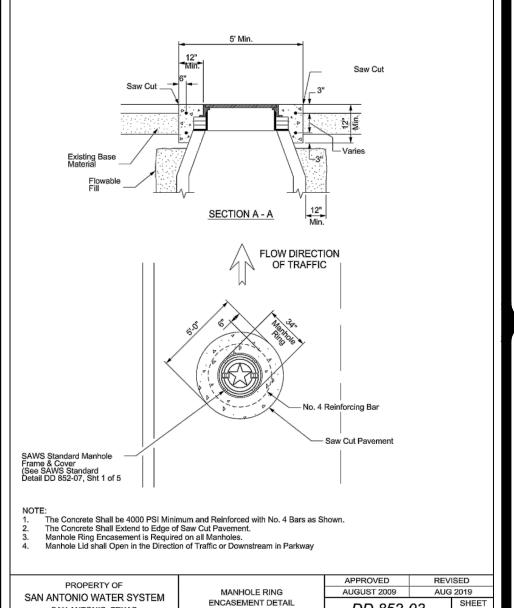



CALEB M. CHANCE

98401

PLAT NO.	22-11800298
JOB NO	11680-52
DATE	MAY 2022
DESIGNER	СВ
CHECKED_	BL DRAWN CB
SHEET	C5.10

SHEET

WER: MEDIO CREEK WATERSHED - MEDIO CREEK W.R.C
EVELOPER'S NAME: CONTINENTAL HOMES OF TEXAS, L.P.
DDRESS:         5419 N LOOP 1604 E           TY:         SAN ANTONIO         STATE:         TX         ZIP:         78218
HONE# <u>(210)-496-2668</u> FAX# <u>(210)-496-2668</u> AWS BLOCK MAP <u># 74602</u> TOTAL EDU'S <u>86</u> TOTAL ACREAGE <u>17.12</u> 5
OTAL LINEAR FOOTAGE OF PIPE: <u>8" 3,688.88 LF</u> PLAT NO. <u>22-11800298</u> UMBER OF LOTS <u>86</u> SAWS JOB NO. <u>22-1637</u>

SAWS CO		
SAWS GENERAL SE		
1. ALL MATERIALS AND CONS' CONTRACT SHALL BE APPRO' COMPLY WITH THE PLANS, FOLLOWING AS APPLICABLE:		
A.CURRENT TEXAS COMMIS CRITERIA FOR DOMESTI CODE (TAC) TITLE 30 WATER", TAC TITLE 30 F		
B.CURRENT TXDOT "STAI HIGHWAYS, STREETS AND C.CURRENT "SAN ANTONIC WATER AND SANITARY S		
WATER AND SANITARY SI D.CURRENT CITY OF SAN WORKS CONSTRUCTION". E.CURRENT CITY OF SAN (UECM).		
2. THE CONTRACTOR SHALL NO		
CONSTRUCTION PERMIT (GCP) SAWS CONSTRUCTION INSPEC ARRANGED A MEETING WITH REQUIREMENTS. WORK COMP COUNTER PERMIT AND/OR REPLACEMENT AT THE EXPEN		
3. THE CONTRACTOR SHALL OB WEBSITE, HTTP://WWW.SAWS.NOTED WITHIN THE DESIGN PL		
4. THE CONTRACTOR IS TO M INSPECTION DIVISION AT		
(210) 233-2973, ON NOTIFIC AFFECTED HOME RESIDENTS BEGINNING ANY WORK.		
5. LOCATION AND DEPTH OF E THE PLANS ARE UNDERSTO DEPTHS MUST BE FIELD VERIF CONSTRUCTION. IT SHALL I UTILITY SERVICE LINES AS R		
DURING CONSTRUCTION AT NO  6. THE CONTRACTOR SHALL VER  AND DRAINAGE STRUCTURES		
WHETHER SHOWN ON PLANS LOCATES REQUESTING PIPE FOLLOWING CONTACT INFORMA		
<ul> <li>SAWS UTILITY LOCATES:</li> <li>COSA DRAINAGE (210) 2</li> <li>COSA TRAFFIC SIGNAL O</li> <li>COSA TRAFFIC SIGNAL D</li> </ul>		
TEXAS STATE WIDE ONE  THE CONTRACTOR SHALL E CURBS, STREETS, DRIVEWAYS		
ORIGINAL OR BETTER CONDITION.		
8. ALL WORK IN TEXAS DEPAR COUNTY RIGHT—OF—WAY SH CONSTRUCTION SPECIFICATION		
9. THE CONTRACTOR SHALL GOVERNING MUNICIPALITY'S TR		
10. THE CONTRACTOR SHALL NO FLOOD PLAIN WITHOUT FIRST  11. HOLIDAY WORK: CONTRACTOR		
SAWS RECOGNIZED HOLIDAYS. CONSTWORKREQ@SAWS.ORG.		
WEEKEND WORK: CONTRACTO CONSTRUCTION DEPARTMENT REQUEST SHOULD BE SENT T		
ANY AND ALL SAWS UTILITY APPROVAL WILL BE SUBJECT		
12. COMPACTION NOTE (ITEM 8) MEETING THE COMPACTION PAYING FOR THE TESTS PER BE DONE AT ONE LOCATION		
SAWS INSPECTOR AND/OR T LIFT PER 400 LINEAR FEET A AND FINALIZED BY SAWS WIT PROVIDING ALL NECESSARY D		
13. A COPY OF ALL TESTING REINSPECTION DIVISION.		
Ī		

IS DOCUMENT HAS BEEN PRODUCED FROM MATERIAL THAT WAS STORED AND/OR TRANSMITTED ELECTRONICALLY AND MAY HAVE BEEN INADVERTENTLY ALTERED. RELY ONLY ON FINAL HARDCOPY MATERIALS BEARING THE CONSULTANT'S ORIGINAL SIGNATURE AND SEAL AERIAL IMAGERY PROVIDED BY GOOGLE® UNLESS OTHERWISE NOTED. Imagery © 2016,CAPCOG,Digital Globe,Texas Orthoimagery Program, USDA Farm Service Agency.

#### CONSTRUCTION NOTES (LAST REVISED JULY 2017)

#### SECTION

- CONSTRUCTION PROCEDURES WITHIN THE SCOPE OF THIS PROVED BY THE SAN ANTONIO WATER SYSTEM (SAWS) AND IS, SPECIFICATIONS, GENERAL CONDITIONS AND WITH THE
- MMISSION ON ENVIRONMENTAL QUALITY (TCEQ) 'DESIGN MESTIC WASTEWATER SYSTEM", TEXAS ADMINISTRATIVE 30 PART 1 CHAPTER 217 AND "PUBLIC DRINKING 30 PART 1 CHAPTER 290.
- "STANDARD SPECIFICATIONS FOR CONSTRUCTION OF AND DRAINAGE". TONIO WATER SYSTEM STANDARD SPECIFICATIONS FOR
- RY SEWER CONSTRUCTION". SAN ANTONIO "STANDARD SPECIFICATIONS FOR PUBLIC
- SAN ANTONIO "UTILITY EXCAVATION CRITERIA MANUAL"
- NOT PROCEED WITH ANY PIPE INSTALLATION WORK UNTIL OF THE APPROVED COUNTER PERMIT OR GENERAL GCP) FROM THE CONSULTANT AND HAS BEEN NOTIFIED BY SPECTION DIVISION TO PROCEED WITH THE WORK AND HAS WITH THE INSPECTOR AND CONSULTANT FOR THE WORK COMPLETED BY THE CONTRACTOR WITHOUT AN APPROVED OR A GCP WILL BE SUBJECT TO REMOVAL AND XPENSE OF THE CONTRACTORS AND/OR THE DEVELOPER.
- . OBTAIN THE SAWS STANDARD DETAILS FROM THE SAWS SAWS.ORG/BUSINESS\_CENTER/SPECS. UNLESS OTHERWISE
- TO MAKE ARRANGEMENTS WITH THE SAWS CONSTRUCTION OTIFICATION PROCEDURES THAT WILL BE USED TO NOTIFY ENTS AND/OR PROPERTY OWNERS 48 HOURS PRIOR TO
- OF EXISTING UTILITIES AND SERVICE LATERALS SHOWN ON RSTOOD TO BE APPROXIMATE. ACTUAL LOCATIONS AND VERIFIED BY THE CONTRACTOR AT LEAST 1 WEEK PRIOR TO LL BE THE CONTRACTOR'S RESPONSIBILITY TO LOCATE S REQUIRED FOR CONSTRUCTION AND TO PROTECT THEM AT NO COST TO SAWS.
- VERIFY THE EXACT LOCATION OF UNDERGROUND UTILITIES TURES AT LEAST 1-2 WEEKS PRIOR TO CONSTRUCTION ANS OR NOT. PLEASE ALLOW UP TO 7 BUSINESS DAYS FOR PIPE LOCATION MARKERS ON SAWS FACILITIES. TH ORMATION ARE SUPPLIED FOR VERIFICATION PURPOSES:
  - TES: HTTP://WWW.SAWS.ORG/SERVICE/LOCATES 0) 207-0724 OR (210) 207-6026
  - AL OPERATIONS (210) 206-8480 AL DAMAGES (210) 207-3951
- ONE CALL LOCATOR 1-800-545-6005 OR 811
- LL BE RESPONSIBLE FOR RESTORING EXISTING FENCES, WAYS, SIDEWALKS, LANDSCAPING AND STRUCTURES TO ITS ONDITION IF DAMAGES ARE MADE AS A RESULT OF THE
- EPARTMENT OF TRANSPORTATION (TXDOT) AND/OR BEXAR SHALL BE DONE IN ACCORDANCE WITH RESPECTIVE ATIONS AND PERMIT REQUIREMENTS.
- LL COMPLY WITH CITY OF SAN ANTONIO OR OTHER Y'S TREE ORDINANCES WHEN EXCAVATING NEAR TREES.
- NOT PLACE ANY WASTE MATERIALS IN THE 100-YEAR IRST OBTAINING AN APPROVED FLOOD PLAIN PERMIT.
- AYS. REQUEST SHOULD BE SENT TO

RACTORS ARE REQUIRED TO NOTIFY THE SAWS INSPECTION NT 48 HOURS IN ADVANCE TO REQUEST WEEKEND WORK. NT TO CONSTWORKREQ@SAWS.ORG.

LITY WORK INSTALLED WITHOUT HOLIDAY/WEEKEND JECT TO BE UNCOVERED FOR PROPER INSPECTION.

- M 804): THE CONTRACTOR SHALL BE RESPONSIBLE FOR ION RÉQUIREMENTS ON ALL TRENCH BACKFILL AND FOR PERFORMED BY A THIRD PARTY. COMPACTION TESTS WILL TION POINT RANDOMLY SELECTED, OR AS INDICATED BY THE OR THE TEST ADMINISTRATOR, PER EACH 12-INCH LOOSE ET AT A MINIMUM. THIS PROJECT WILL NOT BE ACCEPTED WITHOUT THIS REQUIREMENT BEING MET AND VERIFIED BY RY DOCUMENTED TEST RESULTS.
- REPORTS SHALL BE FORWARDED TO SAWS CONSTRUCTION

#### SAWS SEWER NOTES

- THE CONTRACTOR IS RESPONSIBLE FOR ENSURING THAT NO SANITARY SEWER OVERFLOW (SSO) OCCURS AS A RESULT OF THEIR WORK. ALL CONTRACTOR PERSONNEL RESPONSIBLE FOR SSO PREVENTION AND CONTROL SHALL BE TRAINED ON PROPER RESPONSE. SHOULD AN SSO OCCUR, THE CONTRACTOR SHALL:
- A. IDENTIFY THE SOURCE OF THE SSO AND NOTIFY SAWS EMERGENCY OPERATIONS CENTER (EOC) IMMEDIATELY AT (210) 233-2014. PROVIDE THE ADDRESS OF THE SPILL AND AN ESTIMATED VOLUME OR FLOW.
- B.ATTEMPT TO ELIMINATE THE SOURCE OF THE SSO. C.CONTAIN SEWAGE FROM THE SSO TO THE EXTENT OF PREVENTING A POSSIBLE CONTAMINATION OF WATERWAYS.
- D.CLEAN UP SPILL SITE (RETURN CONTAINED SEWAGE TO THE
- COLLECTION SYSTEM IF POSSIBLE) AND PROPERLY DISPOSE OF CONTAMINATED SOIL/MATERIALS.
- E.CLEAN THE AFFECTED SEWER MAINS AND REMOVE ANY DEBRIS. F.MEET ALL POST-SSO REQUIREMENTS AS PER THE EPA CONSENT DECREE, INCLUDING LINE CLEANING AND TELEVISING THE AFFECTED SEWER MAINS (AT SAWS DIRECTION) WITHIN 24 HOURS.

SHOULD THE CONTRACTOR FAIL TO ADDRESS AN SSO IMMEDIATELY AND TO SAWS SATISFACTION, THEY WILL BE RESPONSIBLE FOR ALL COSTS INCURRED BY SAWS, INCLUDING ANY FINES FROM EPA, TCEQ AND/OR ANY OTHER FEDERAL, STATE OR LOCAL AGENCIES.

NO SEPARATE MEASUREMENT OR PAYMENT SHALL BE MADE FOR THIS WORK. ALL WORK SHALL BE DONE ACCORDING TO GUIDELINES SET BY THE TCEQ

2. IF BYPASS PUMPING IS REQUIRED, THE CONTRACTOR SHALL PERFORM SUCH WORK IN ACCORDANCE WITH SAWS STANDARD SPECIFICATION FOR WATER AND SANITARY SEWER CONSTRUCTION, ITEM NO. 864, "BYPASS PUMPING".

PRIOR TO TIE-INS, ANY SHUTDOWNS OF EXISTING FORCE MAINS OF ANY SIZE MUST BE COORDINATED WITH THE SAWS CONSTRUCTION INSPECTION DIVISION AT (210) 233-2973 AT LEAST ONE WEEK IN ADVANCE OF THE SHUTDOWN. THE CONTRACTOR MUST ALSO PROVIDE A SEQUENCE OF WORK AS RELATED TO THE TIE-INS; THIS IS AT NO ADDITIONAL COST TO SAWS OR THE PROJECT AND IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO SEQUENCE THE WORK ACCORDINGLY.

SEWER PIPE WHERE WATER LINE CROSSES SHALL BE 160 PSI AND MEET THE REQUIREMENTS OF ASTM D2241, TAC 217.53 AND TCEQ 290.44(E)(4)(B). CONTRACTOR SHALL CENTER A 20' JOINT OF 160 PSI PRESSURÉ RATED PVC AT THE PROPOSED WATER CROSSING.

ELEVATIONS POSTED FOR TOP OF MANHOLES ARE FOR REFERENCE ONLY: IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO MAKE ALLOWANCES AND ADJUSTMENTS FOR TOP OF MANHOLES TO MATCH THE FINISHED GRADE OF THE PROJECT'S IMPROVEMENTS. (NSPI)

- 6. SPILLS, OVERFLOWS, OR DISCHARGES OF WASTEWATER: ALL SPILLS, OVERFLOWS, OR DISCHARGES OF WASTEWATER, RECYCLED WATER, PETROLEUM PRODUCTS, OR CHEMICALS MUST BE REPORTED IMMEDIATELY TO THE SAWS INSPECTOR ASSIGNED TO THE COUNTER PERMIT OR GENERAL CONSTRUCTION PERMIT (GCP). THIS REQUIREMENT APPLIES TO EVERY SPILL, OVERFLOW, OR DISCHARGE RÉGARDLESS OF SIZE.
- MANHOLE AND ALL PIPE TESTING (INCLUDING THE TV INSPECTION) MUST BE PERFORMED AND PASSED PRIOR TO FINAL FIELD ACCEPTANCE BY SAWS CONSTRUCTION INSPECTION DIVISION, AS PER THE SAWS SPECIFICATIONS FOR WATER AND SANITARY SEWER CONSTRUCTION.
- 8. ALL PVC PIPE OVER 14 FEET OF COVER SHALL BE EXTRA STRENGTH WITH MINIMUM PIPE STIFFNESS OF 115 PSI.

#### CTORS WILL NOT BE ALLOWED TO PERFORM SAWS WORK ON PROJECT SEWER NOTES

THE PROPERTY LINE.

- ALL RESIDENTIAL SEWER SERVICE LATERALS ARE 6" DIA. AND SHALL BE EXTENDED TO 10' PAST THE PROPERTY LINE AND CAPPED AND SEALED. CONTRACTOR SHALL INSTALL A 2" X 4" STAKE, FOUR (4) FEET LONG, TWO 2) FEET DEEP INTO THE GROUND AT THE END OF EACH SERVICE. NO SEPARATE PAY ITEM.
- CONTRACTOR TO INSTALL CLEANOUTS AT THE END OF ALL SEWER LATERALS, PER LATERAL DETAIL SHEET C5.10
- NO VERTICAL STACKS ALLOWED FOR ANY LOTS UNLESS OTHERWISE SPECIFIED BY THE ENGINEER.
- ALL 6" SEWER LATERALS WILL BE SET AT 2% GRADE FROM THE MAIN TO
- WHEN HORIZONTAL DISTANCE BETWEEN SEWER PIPES AND WATER MAIN IS LESS THAN 9 FOOT OF SEPARATION, SEWER MAIN SHALL BE INSTALLED WITH 150 PSI (MIN) PRESSURE PIPE AND FITTINGS IN ACCORDANCE WITH SAWS CONSTRUCTION CRITERIA FOR CONSTRUCTION OF SEWER MAINS IN THE VICINITY OF WATER MAINS.
- . CONTRACTOR SHALL ENSURE THAT MANHOLES OUTSIDE OF PAVED AREAS ARE SET WITH TOP ELEVATIONS 6" ABOVE FINISHED GRADE WITH CONCRETE
- 7. ALL SEWER PIPES SHALL BE 8" PVC (SDR 26), UNLESS OTHERWISE NOTED.
- 8. CONTRACTOR IS TO VERIFY EXISTING INVERT OF EXISTING SANITARY SEWER MAINS AND ALERT ENGINEER IMMEDIATELY OF ANY DIFFERENCE FROM INVERT SHOWN ON PLANS.
- 9. CONTRACTOR SHALL PROTECT ALL EXISTING FENCES. ANY FENCE DAMAGED BY THE CONTRACTOR SHALL BE REPAIRED BY THE CONTRACTOR AT THEIR
- 10. THE CONTRACTOR WILL BE RESPONSIBLE FOR DETERMINING EXACT LOCATION OF ALL UTILITIES AND DRAINAGE STRUCTURES WHETHER SHOWN ON THE PLANS OR NOT. THE CONTRACTOR SHALL UNCOVER EXISTING UTILITIES PRIOR TO CONSTRUCTION TO VERIFY SIZE, GRADE, AND LOCATION. THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY OF ANY DEVIATIONS FROM PLANS PRIOR TO BEGINNING CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES, WHETHER SHOWN ON THE PLANS OR NOT, SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO REPAIR, AT HIS EXPENSE.
- I. CONCRETE RING ENCASEMENT TO BE INSTALLED ON ALL MANHOLES AND, WITHIN LIMITS OF PAVEMENT, BE INSTALLED TO THE TOP OF THE BASE LAYER WITH A MINIMUM OF 2" OF ASPHALT ON TOP OF THE RING
- 12. MANHOLE OPENING INCREASED TO 30" AS PER TAC CHAPTER 217.55.
- 13. ALL SEWER PIPE LATERALS SHALL BE SDR 26 (CLASS 160) PVC PIPE.
- 14. IF THE GIVEN TOP OF MANHOLE ELEVATION DOES NOT AGREE ON ACTUAL GROUND SURFACE OR FINISH PAVEMENT, THE CONTRACTOR SHALL ADJUST ELEVATIONS SUCH THAT THE TOP OF MANHOLE SHALL BE 0.5' ABOVE EXISTING GROUND, OR FLUSH TO FINISH ASPHALT PAVEMENT.
- 15. ALL MANHOLES CONSTRUCTED OVER THE EDWARDS AQUIFER RECHARGE ZONE SHOULD BE WATERTIGHT.

SEWER: MEDIO CREEK WATERSHED - MEDIO CREEK W.R.C

DEVELOPER'S NAME: CONTINENTAL HOMES OF TEXAS, L.P. ADDRESS: <u>5419 N LOOP 1604 E</u> CITY: SAN ANTONIO STATE: TX ZIP: 78218 PHONE# (210)-496-2668 FAX# (210)-496-2668 SAWS BLOCK MAP# 74602 TOTAL EDU'S 86 TOTAL ACREAGE 17.125

TOTAL LINEAR FOOTAGE OF PIPE:<u>8" 3.688.88 LF</u> PLAT NO.<u>22-11800298</u>


NUMBER OF LOTS 86 SAWS JOB NO. 22-1637


22-11800298 11680-52 MAY 2022 DESIGNER

CALEB M. CHANCE


98401

CHECKED BL DRAWN CB

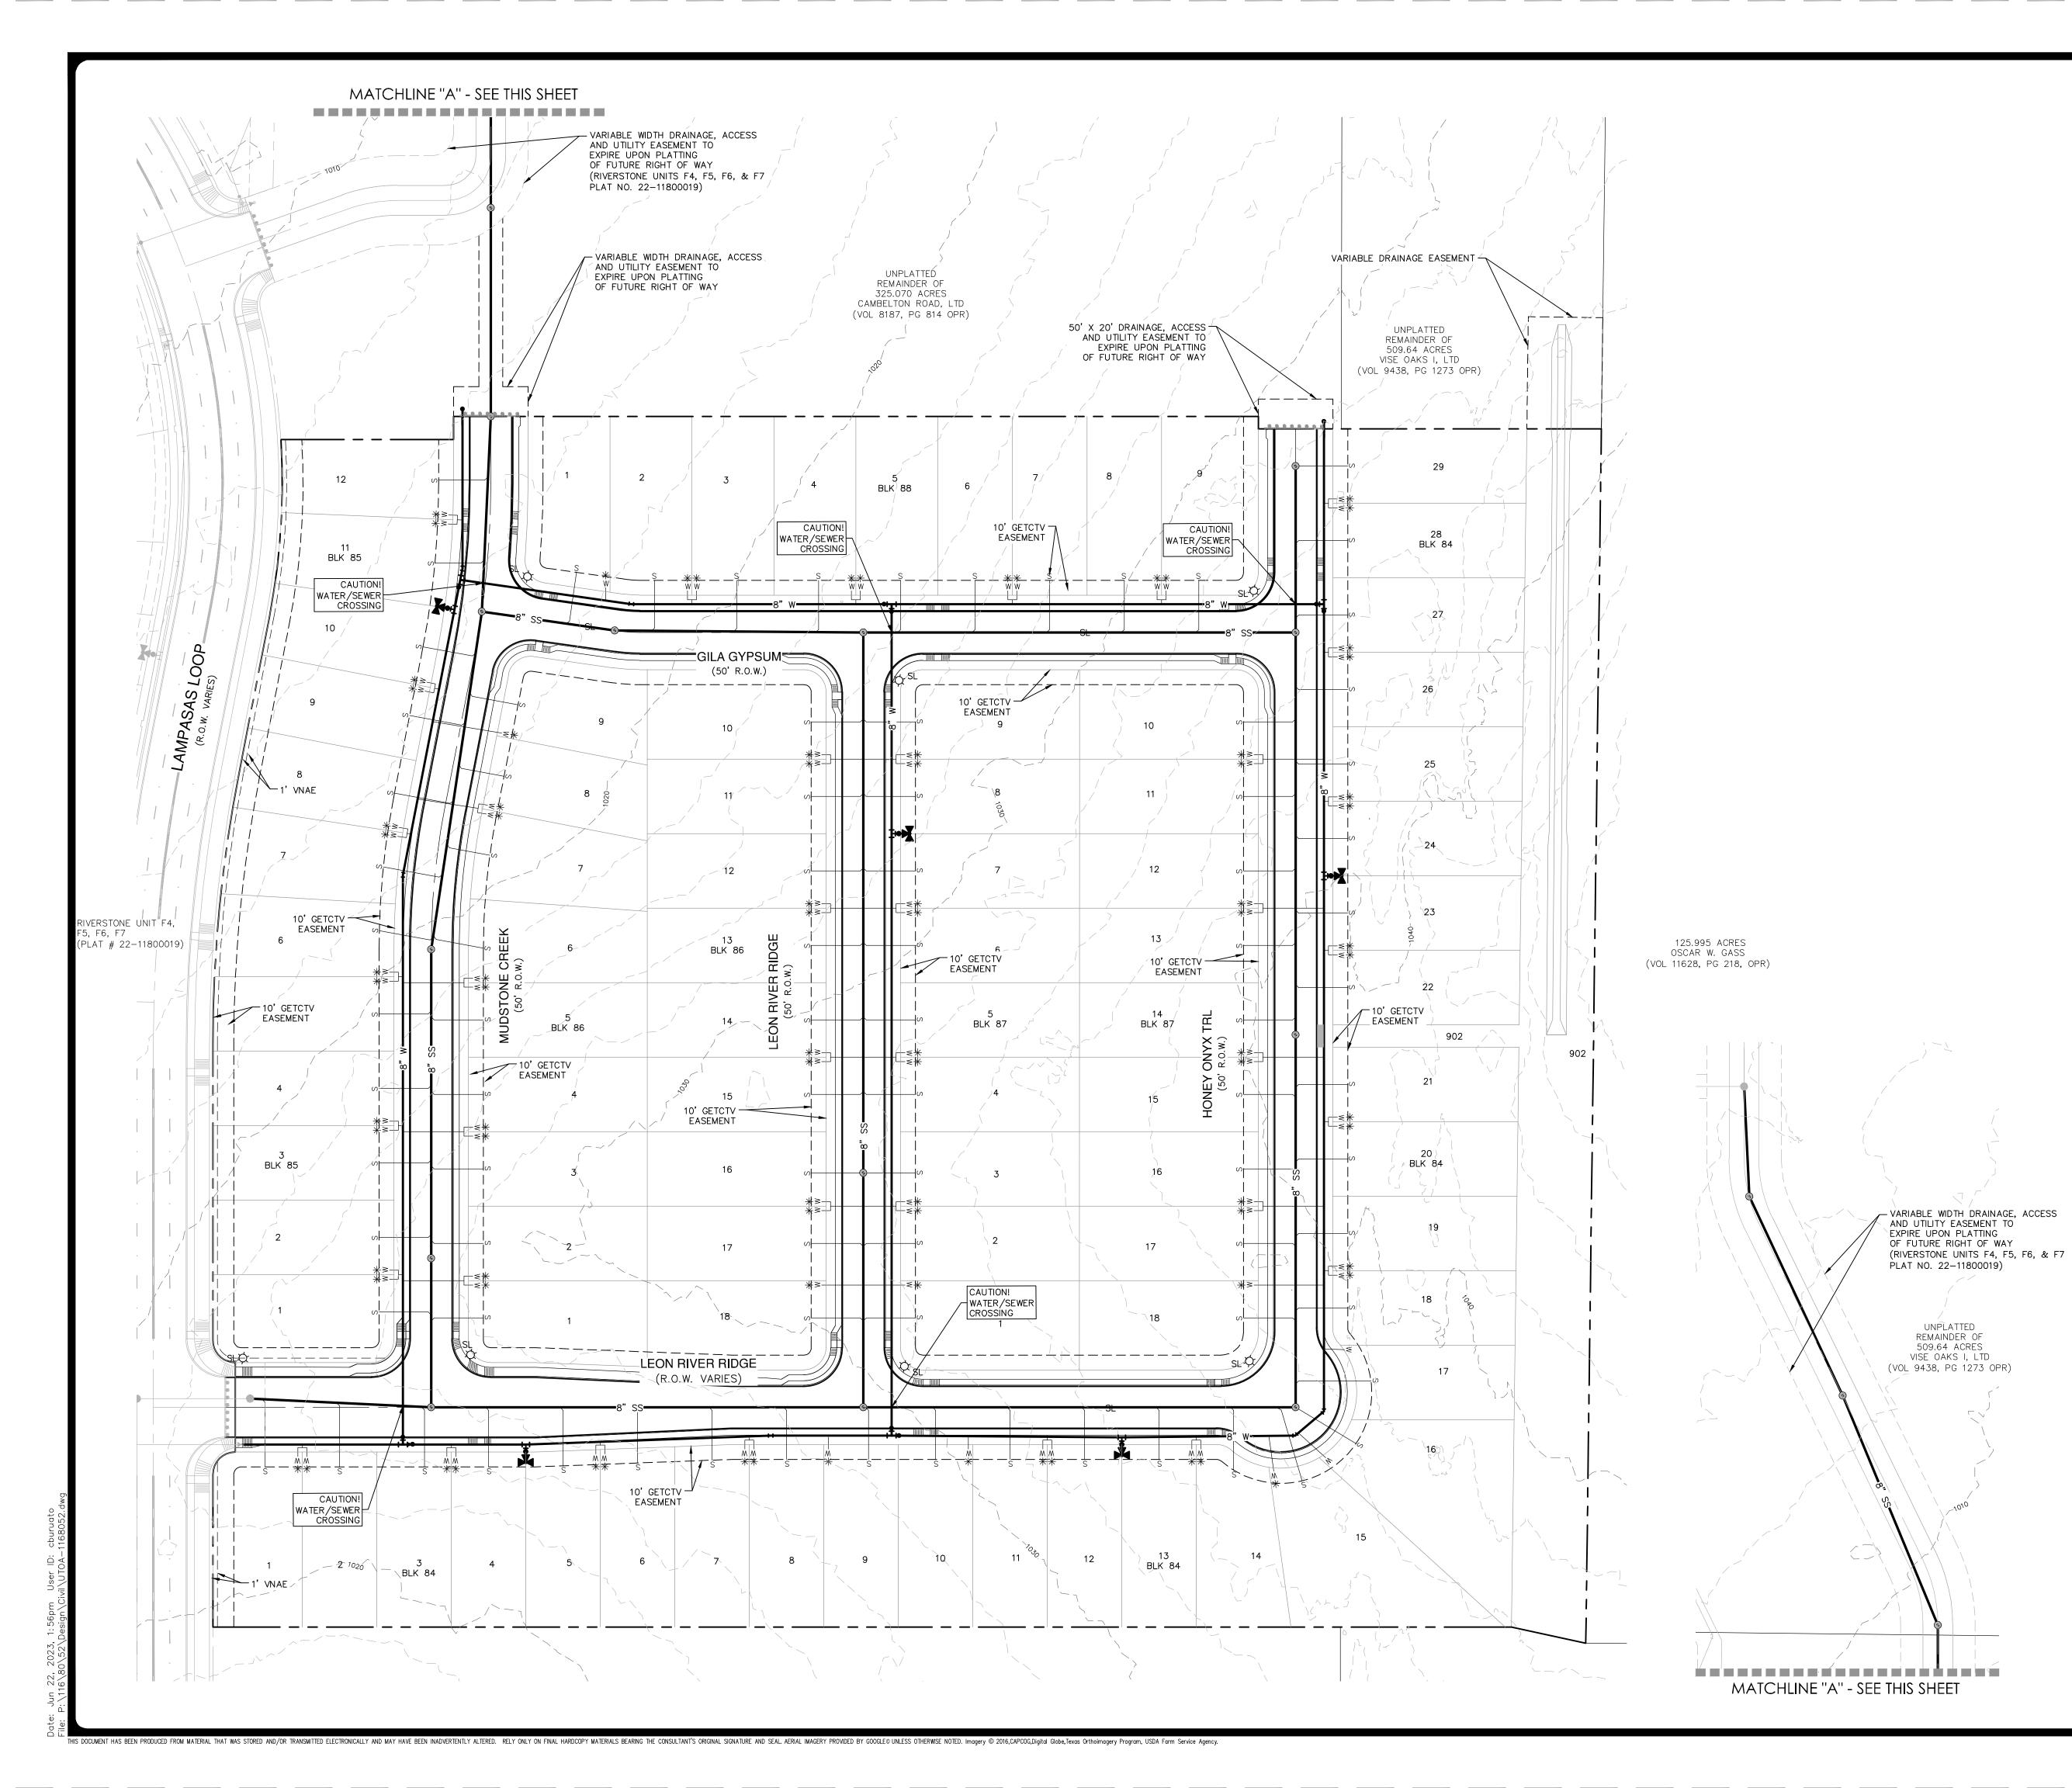


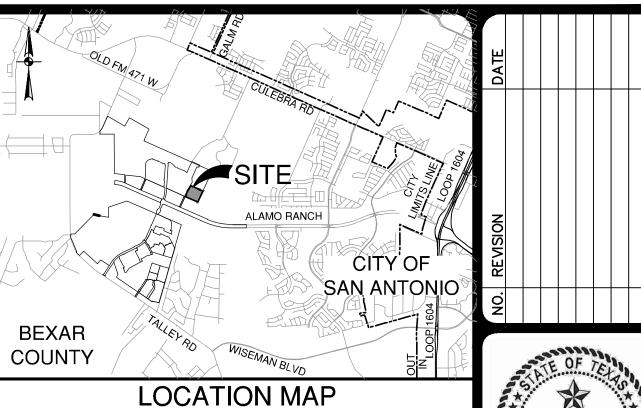

CALEB M. CHANCE

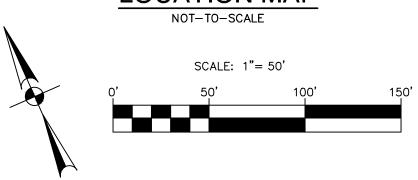

#### **UTILITY LEGEND**

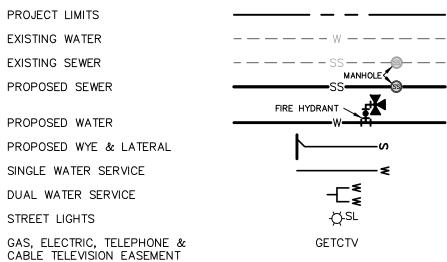

#### **CONDUIT NOTES:**

- 1. CONTRACTOR SHALL INSTALL PERMANENT MARKERS IN PROPOSED CURE
- WHERE CONDUITS CROSS THE ROADWAY (BOTH SIDES).
- CONDUITS SHALL BE PVC WITH MINIMUM BURY OF 36 INCHES BELOW PROPOSED FINISHED GRADE. SCHEDULE 80 TO BE USED FOR CPS CONDUITS, ALL OTHER CONDUITS ARE SCHEDULE 40.
- 3. ALL CONDUITS SHALL BE EXTENDED BEHIND CURBS OR PROPOSED SIDEWALKS A MINIMUM OF 3 FEET AND CAPPED FOR FUTURE USE.
- 4. ALL CONDUIT SLEEVES TO BE USED FOR ELECTRIC, GAS, OR TELECOMMUNICATION UTILITY CROSSINGS SHALL BE INSTALLED TO MEET OR EXCEED DESIGN REQUIREMENTS FOR THE UTILITY AGENCY WHICH THEY ARE SERVING, INCLUDING BUT NOT LIMITED TO THE DEPTH, TRENCH PLACEMENT, AND PROXIMITY TO OTHER UTILITIES. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR VERIFYING AND INSTALLING THE CONDUIT SLEEVES TO MEET THESE SPECIFICATIONS INCLUDING COORDINATING WITH THE UTILITY AGENCY FOR ANY REQUIRED

#### TRENCH EXCAVATION SAFETY PROTECTION:


CONTRACTOR AND/ OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/ GEOTECHNICAL/ SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND ANY AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITES WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND /OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFÉTY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION.


CONTRACTOR SHALL BE REQUIRED TO LOCATE ALL PUBLIC OR PRIVATE UTILITIES INCLUDING BUT NOT LIMITING TO: WATER, SEWER, TELEPHONE AND FIBER OPTIC LINES, SITE LIGHTING ELECTRIC, SECONDARY ELECTRIC, PRIMARY ELECTRICAL DUCTBANKS, LANDSCAPE IRRIGATION FACILITIES, AND GAS LINES. ANY UTILITY CONFLICTS THAT ARISE SHOULD BE COMMUNICATED TO THE ENGINEER IMMEDIATELY AND PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL CONTACT 1-800-DIG-TESS A MINIMUM OF 48 HOURS PRIOR TO THE START OF CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES SHALL B THE SOLE RESPONSIBILITY OF THE CONTRACTOR AND THE REPAIR SHALL BI AT CONTRACTOR'S SOLE EXPENSE WHETHER THE UTILITY IS SHOWN ON THESE PLANS OR NOT.


NO 22-11800298 11680-52

DESIGNER CHECKED BL DRAWN CB

C6.00

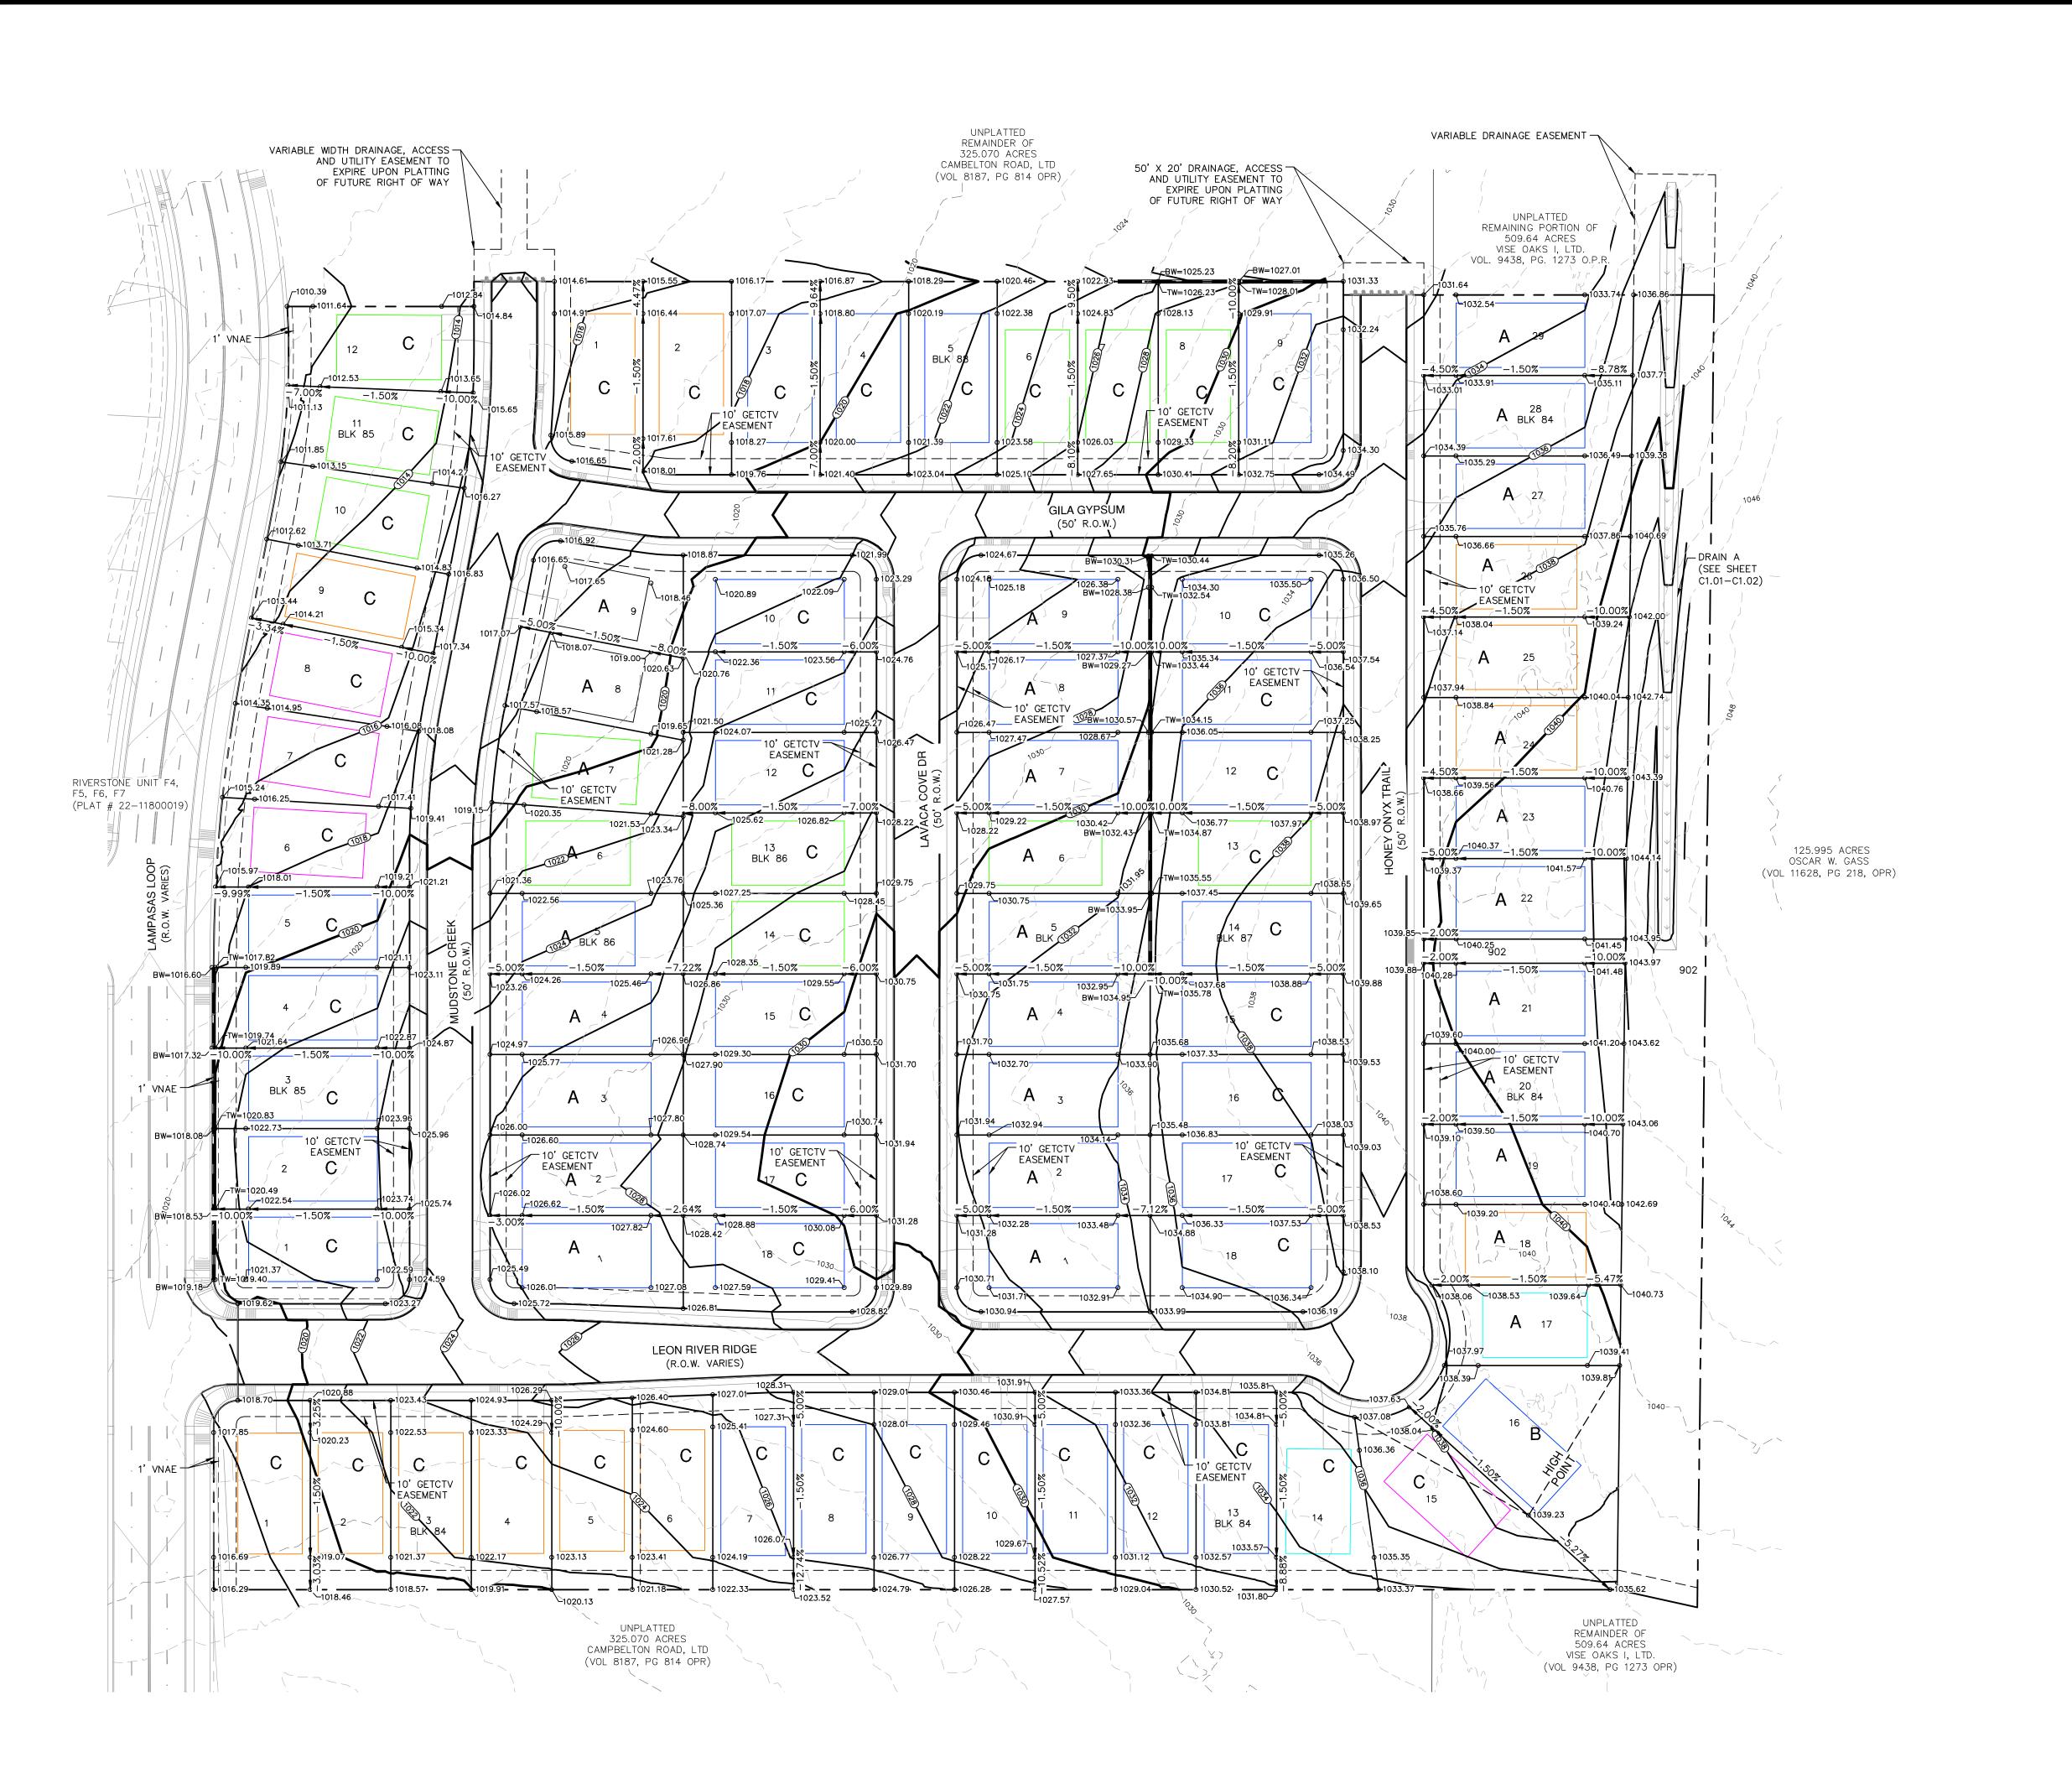

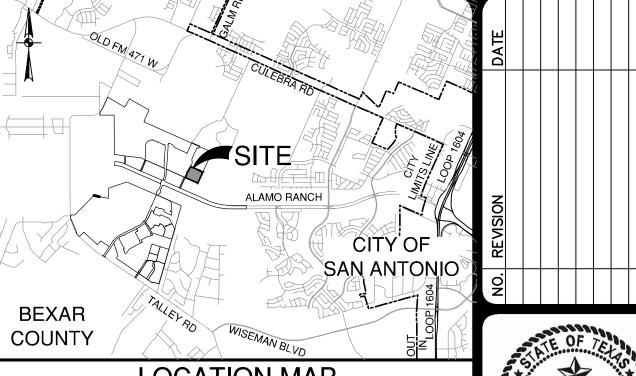

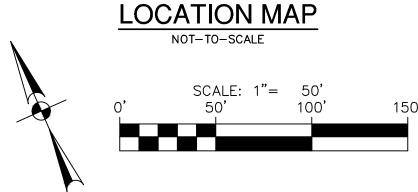

#### **GRADING LEGEND**

PROJECT LIMITS

100 YR FLOODPLAIN

EXISTING CONTOUR

PROPOSED CONTOUR

FLOW ARROW (EXISTING)

FLOW ARROW (PROPOSED)

FLOW ARROW (PROPOSED)

MINIMUM FINISHED FLOOR ELEVATION

FF = XXXX.XX

TREES TO REMAIN

EXPOSED ROCK WALL

#### **GRADING NOTES:**

1. ALL MATERIALS AND CONSTRUCTION PROCEDURES WITHIN THIS SCOPE OF WORK WHERE NOT SPECIFICALLY COVERED IN THE SPECIFICATIONS OR GEOTECHNICAL REPORT SHALL CONFORM TO ALL APPLICABLE CITY, COUNTY AND TXDOT STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION (LATEST EDITION).

2. SITE PREPARATION, GRADING, EXCAVATION AND FILL SHALL BE PERFORMED IN ACCORDANCE WITH THE PROJECT GEOTECHNICAL REPORT AND SPECIFICATIONS.

3. ALL SELECT FILL MATERIAL PROVIDED SHALL BE APPROVED BY THE GEOTECHNICAL ENGINEER PRIOR TO PLACING AND COMPACTING.

4. ALL ELEVATIONS AND PROPOSED CONTOURS SHOWN ON THIS GRADING PLAN REFLECT FINISHED GRADES. THE THICKNESS OF PAVING, BASE, GRASS, TOPSOIL, AND MULCH MUST BE SUBTRACTED TO OBTAIN SUBGRADE ELEVATIONS.

5. THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE ENGINEER OF ANY QUESTIONS THAT MAY ARISE CONCERNING THE INTENT, PLACEMENT, OR LIMITS OF DIMENSIONS OR GRADES NECESSARY FOR CONSTRUCTION OF THIS PROJECT.

6. THE CONTRACTOR SHALL VERIFY THE SUITABILITY OF ALL EXISTING AND PROPOSED SITE CONDITIONS INCLUDING GRADES AND DIMENSIONS BEFORE COMMENCEMENT OF CONSTRUCTION. THE ENGINEER SHALL BE NOTIFIED IMMEDIATELY OF ANY DISCREPANCIES.

7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ACQUIRING ALL PERMITS, TESTS, APPROVALS AND ACCEPTANCES REQUIRED TO COMPLETE CONSTRUCTION OF THIS PROJECT.

CONSTRUCTION OF THIS PROJECT.

8. THE CONTRACTOR SHALL REMOVE TOP SOIL, GRASS, ROOTS, DEBRIS, ETC. AND DISPOSE OFF SITE THOSE MATERIALS NOT SUITABLE FOR EMBANKMENT AND TOPSOIL. CLEAN STRIPPINGS AND TOPSOIL MAY BE STOCKPILED ON

SITE FOR REUSE IN A LOCATION SPECIFIED BY THE OWNER.

9. THE SITE CONTRACTOR SHALL BE RESPONSIBLE FOR SITE STABILIZATION.
ALL DISTURBED AREAS SHALL BE REVEGETATED IN ACCORDANCE WITH
PROJECT SPECIFICATIONS AND TPDES/SWPPP REQUIREMENTS. REFERENCE

10. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS (USE OF SILT FENCES, ETC.) TO KEEP DRAINAGE AND SILT FROM WASHING ONTO ADJACENT PROPERTY, STREETS, OR DRAINAGE WAYS. CONTRACTOR SHALL IMMEDIATELY REMOVE SILT/DEBRIS WHICH WASHES OFFSITE OR INTO EXISTING STORM DRAIN SYSTEMS. (SEE SWPPP PLANS & TPDES BOOK).

11. THE CONTRACTOR SHALL OBTAIN GRADES SHOWN HEREON WITHIN +/- ONE-TENTH (0.10) FOOT.

THE LANDSCAPE ARCHITECT'S PLAN, IF APPLICABLE.

12. IN PROPOSED PAVING AREAS, STREET DESIGN PLANS SHALL CONTROL. ALL EARTHEN SLOPES SHALL BE A MAXIMUM OF 3:1 AND A MINIMUM OF 1.0% UNLESS OTHERWISE SHOWN.

13. THE CONTRACTOR SHALL PROVIDE A SMOOTH TRANSITION BETWEEN EXISTING SITE AND PROPOSED IMPROVEMENTS.

14. THE CONTRACTOR SHALL BE RESPONSIBLE FOR RESTORING TO ITS ORIGINAL, OR BETTER, CONDITION ANY DAMAGE DONE TO EXISTING TREES, BUILDINGS, UTILITIES, FENCES, PAVEMENT, CURBS, OR DRIVEWAYS (NO SEPARATE PAY ITEMS).

15. THE CONTRACTOR SHALL EXERCISE EXTREME CAUTION IN WORKING NEAR UTILITIES, GAS LINES, SEWER, OR EXISTING APPURTENANCES. PRIOR TO PERFORMING ANY EXCAVATION, CONTRACTOR SHALL CONTACT ALL UTILITY COMPANIES AND ASSURE HIMSELF THAT ALL UTILITIES HAVE BEEN ADEQUATELY LOCATED AND IDENTIFIED. THE ENGINEER SHALL BE NOTIFIED IF ANY UTILITY CONFLICTS ARE DISCOVERED.

16. UTILITIES SHOWN ON THE PLANS ARE FROM INFORMATION SOURCES AVAILABLE AT THE TIME OF DESIGN BUT MAY NOT REPRESENT ALL EXISTING UTILITIES ON SITE. THE CONTRACTOR WILL BE RESPONSIBLE FOR DETERMINING EXACT LOCATION OF ALL UTILITIES WHETHER SHOWN ON THE PLANS OR NOT. THE CONTRACTOR SHALL UNCOVER EXISTING UTILITIES PRIOR TO CONSTRUCTION AND VERIFY SIZE, GRADE AND LOCATION. THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY OF ANY DEVIATIONS FROM PLANS PRIOR TO BEGINNING CONSTRUCTION. ANY DAMAGE TO EXISTING UTILITIES, WHETHER SHOWN ON THE PLANS OR NOT, SHALL BE THE CONTRACTORS RESPONSIBILITY TO REPAIR, AT HIS OWN EXPENSE.

17. POSITIVE DRAINAGE SHALL BE MAINTAINED THROUGHOUT THE SCOPE OF THE PROJECT. DRAINAGE SHALL BE DIRECTED AWAY FROM ALL BUILDING FOUNDATIONS. CONTRACTOR SHOULD TAKE PRECAUTIONS NOT TO ALLOW ANY PONDING OF WATER.

18. FOR FILL PLACEMENT ON HILL SIDES OR STEEP SLOPE AREAS, THE CONTRACTOR SHALL REFERENCE THE PROJECT SPECIFICATIONS AND GEOTECHNICAL REPORT FOR SPECIAL INSTRUCTIONS REGARDING BENCHING.

19. NO WORK SHALL BE PERFORMED IN A PUBLIC RIGHT—OF—WAY WITHOUT

A PERMIT.

RIVERSTONE UN SAN ANTONIO, TE

CALEB M. CHANCE

PLAT NO. 22-11800298

JOB NO. 11680-52

DATE OCTOBER 2023

DESIGNER CB


SPECIAL INSTRUCTIONS REGARDING BENCHING.

CHECKED BL DRAWN KO


REFORMED IN A PUBLIC RIGHT-OF-WAY WITHOUT

SHEET

C7.00

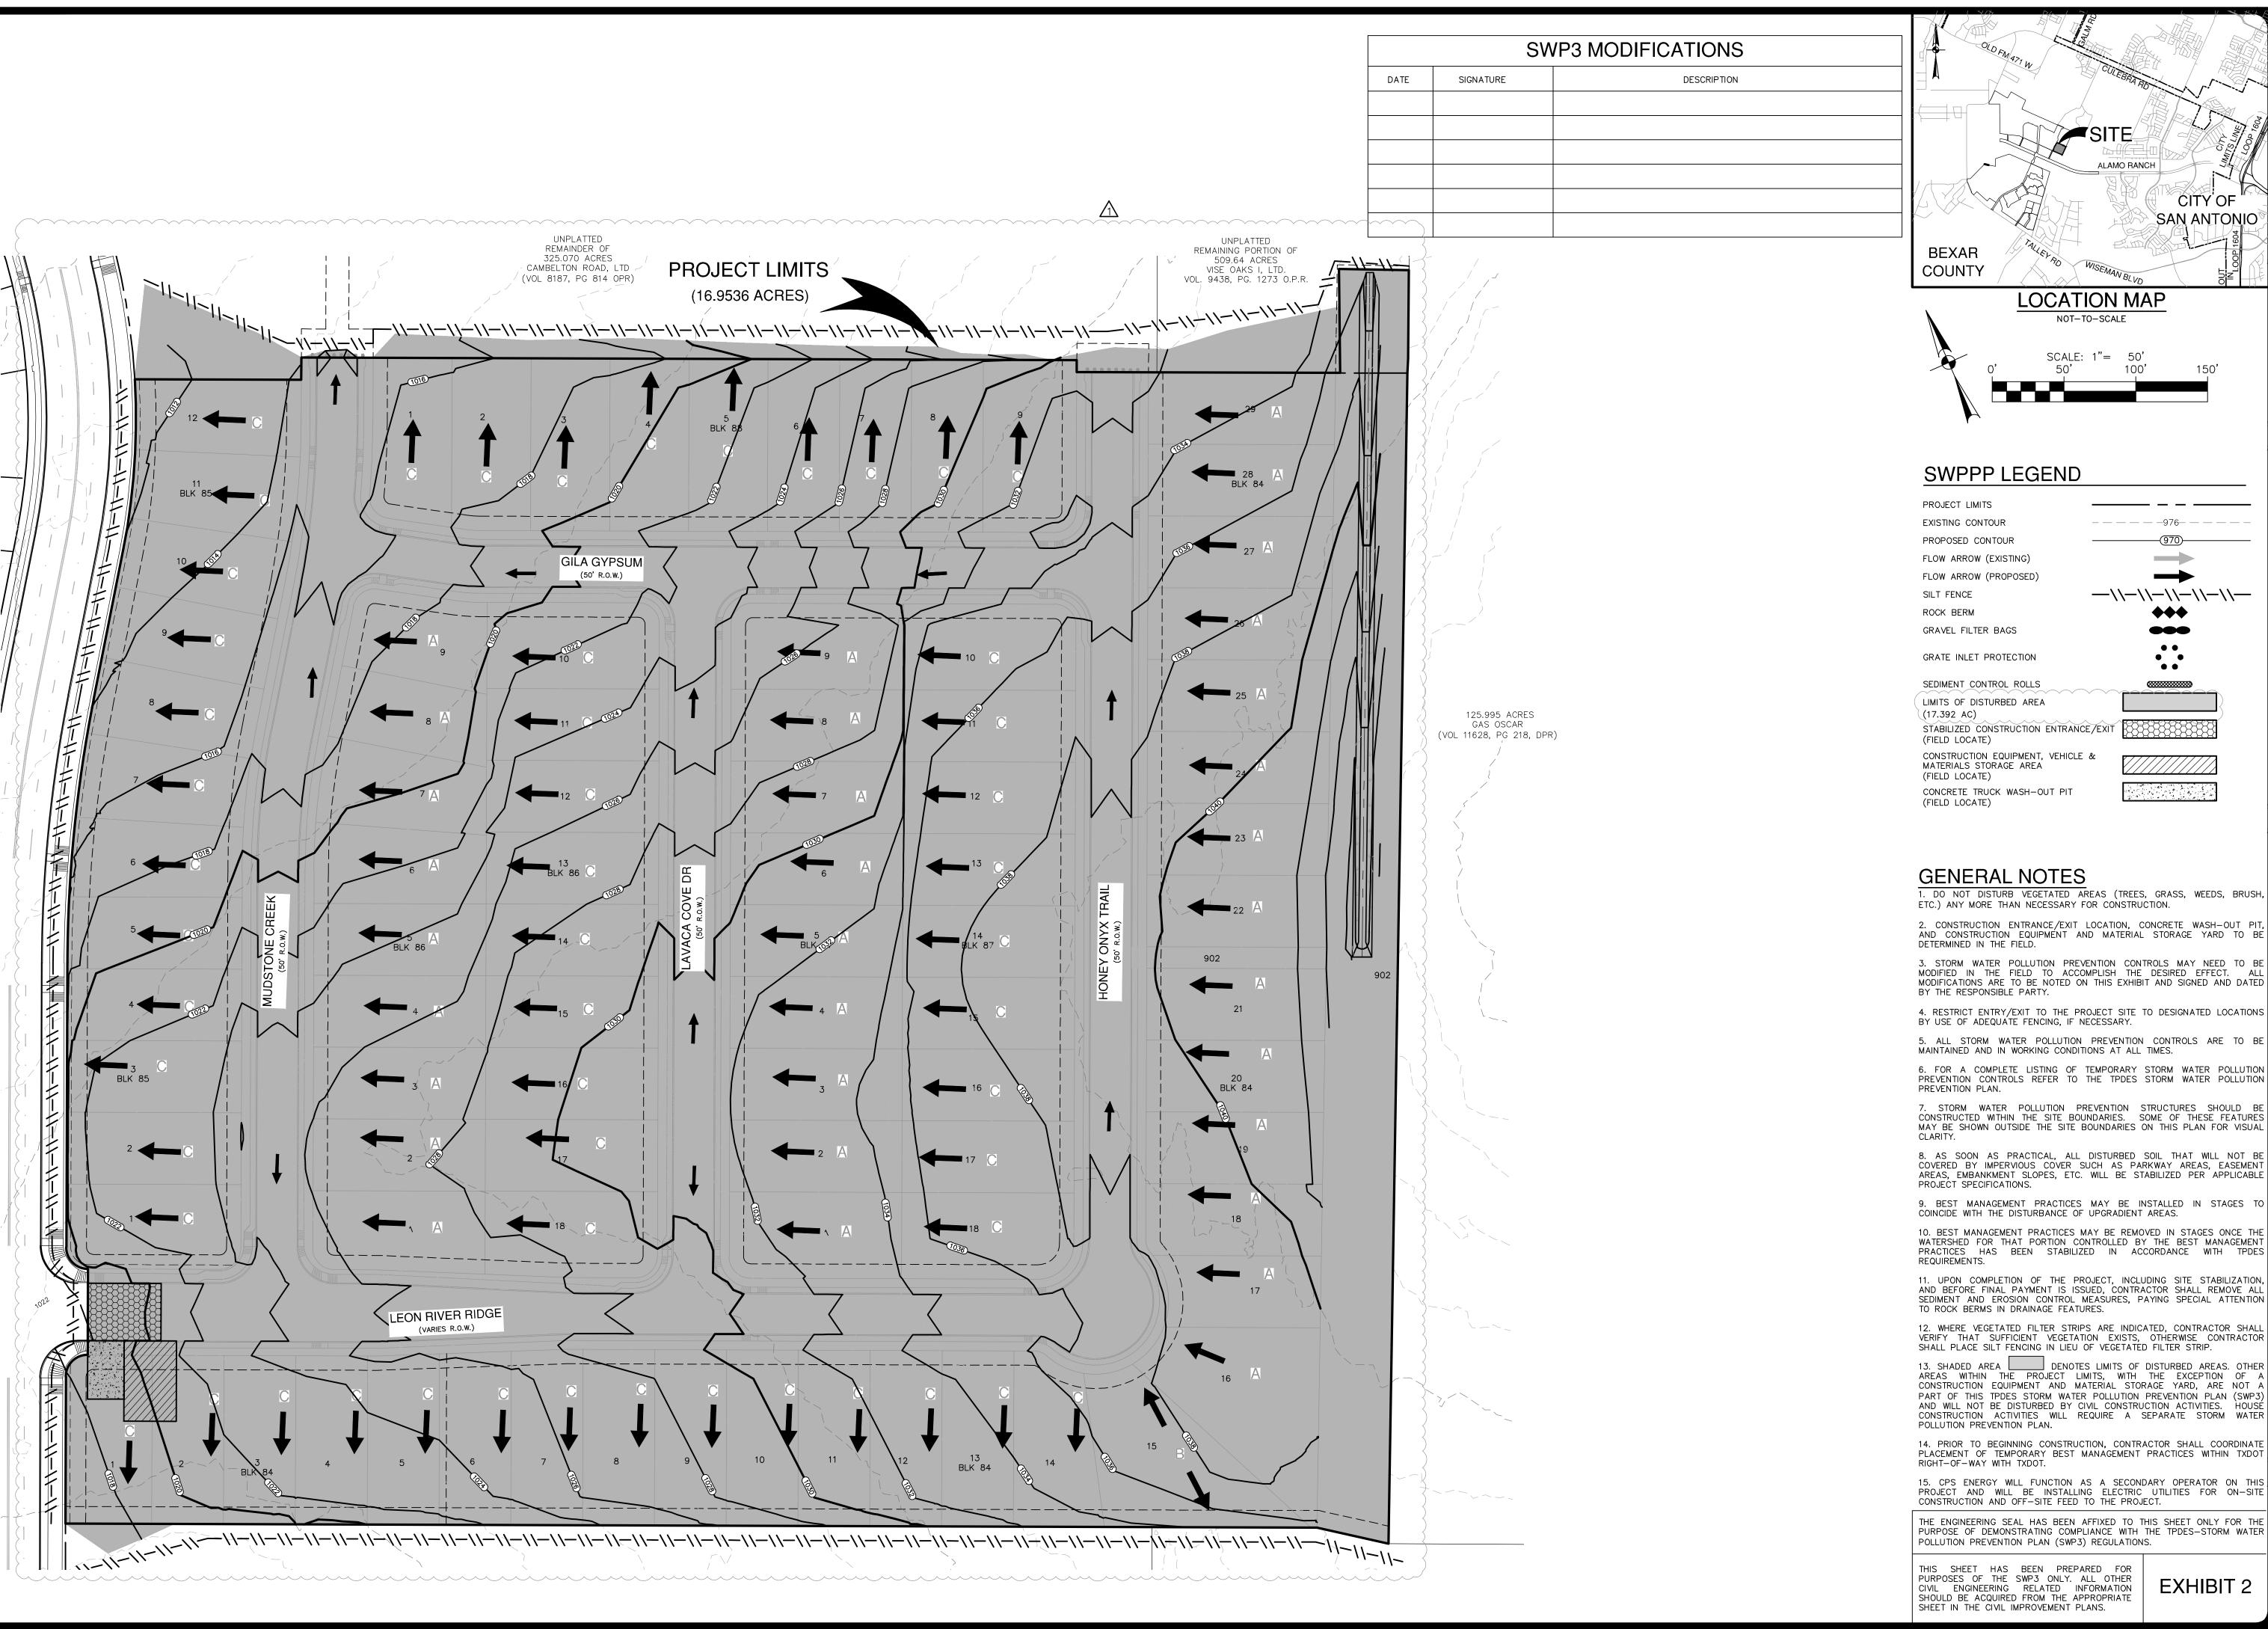

CALEB M. CHANCE

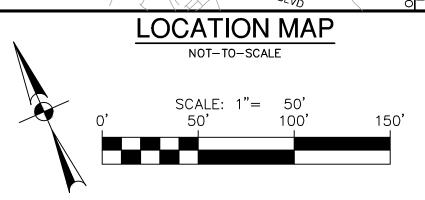

#### **SWPPP LEGEND**

PROPOSED CONTOUR FLOW ARROW (EXISTING) FLOW ARROW (PROPOSED) **\*\*\*** GRAVEL FILTER BAGS GRATE INLET PROTECTION SEDIMENT CONTROL ROLLS LIMITS OF DISTURBED AREA STABILIZED CONSTRUCTION ENTRANCE/EXIT CONSTRUCTION EQUIPMENT, VEHICLE & MATERIALS STORAGE AREA CONCRETE TRUCK WASH-OUT PIT

#### GENERAL NOTES

1. DO NOT DISTURB VEGETATED AREAS (TREES, GRASS, WEEDS, BRUSH, ETC.) ANY MORE THAN NECESSARY FOR CONSTRUCTION.

2. CONSTRUCTION ENTRANCE/EXIT LOCATION, CONCRETE WASH-OUT PIT, AND CONSTRUCTION EQUIPMENT AND MATERIAL STORAGE YARD TO BE DETERMINED IN THE FIELD.

3. STORM WATER POLLUTION PREVENTION CONTROLS MAY NEED TO E MODIFIED IN THE FIELD TO ACCOMPLISH THE DESIRED EFFECT. AL MODIFICATIONS ARE TO BE NOTED ON THIS EXHIBIT AND SIGNED AND DATED BY THE RESPONSIBLE PARTY.

4. RESTRICT ENTRY/EXIT TO THE PROJECT SITE TO DESIGNATED LOCATIONS BY USE OF ADEQUATE FENCING, IF NECESSARY.

5. ALL STORM WATER POLLUTION PREVENTION CONTROLS ARE TO BE MAINTAINED AND IN WORKING CONDITIONS AT ALL TIMES. 6. FOR A COMPLETE LISTING OF TEMPORARY STORM WATER POLLUTION PREVENTION CONTROLS REFER TO THE TPDES STORM WATER POLLUTION

7. STORM WATER POLLUTION PREVENTION STRUCTURES SHOULD CONSTRUCTED WITHIN THE SITE BOUNDARIES. SOME OF THESE FEATURES

8. AS SOON AS PRACTICAL, ALL DISTURBED SOIL THAT WILL NOT BE COVERED BY IMPERVIOUS COVER SUCH AS PARKWAY AREAS, EASEMENT AREAS, EMBANKMENT SLOPES, ETC. WILL BE STABILIZED PER APPLICABLE

9. BEST MANAGEMENT PRACTICES MAY BE INSTALLED IN STAGES COINCIDE WITH THE DISTURBANCE OF UPGRADIENT AREAS.

10. BEST MANAGEMENT PRACTICES MAY BE REMOVED IN STAGES ONCE TH WATERSHED FOR THAT PORTION CONTROLLED BY THE BEST MANAGEMENT PRACTICES HAS BEEN STABILIZED IN ACCORDANCE WITH TPDES

11. UPON COMPLETION OF THE PROJECT, INCLUDING SITE STABILIZATION AND BEFORE FINAL PAYMENT IS ISSUED, CONTRACTOR SHALL REMOVE ALL SEDIMENT AND EROSION CONTROL MEASURES, PAYING SPECIAL ATTENTION TO ROCK BERMS IN DRAINAGE FEATURES.

12. WHERE VEGETATED FILTER STRIPS ARE INDICATED, CONTRACTOR SHALL VERIFY THAT SUFFICIENT VEGETATION EXISTS, OTHERWISE CONTRACTOR SHALL PLACE SILT FENCING IN LIEU OF VEGETATED FILTER STRIP.

13. SHADED AREA DENOTES LIMITS OF DISTURBED AREAS. OTHER AREAS WITHIN THE PROJECT LIMITS, WITH THE EXCEPTION OF CONSTRUCTION EQUIPMENT AND MATERIAL STORAGE YARD, ARE NOT PART OF THIS TPDES STORM WATER POLLUTION PREVENTION PLAN (SWP3) AND WILL NOT BE DISTURBED BY CIVIL CONSTRUCTION ACTIVITIES. HOUSÉ CONSTRUCTION ACTIVITIES WILL REQUIRE A SEPARATE STORM WATER POLLUTION PREVENTION PLAN.

14. PRIOR TO BEGINNING CONSTRUCTION, CONTRACTOR SHALL COORDINATE PLACEMENT OF TEMPORARY BEST MANAGEMENT PRACTICES WITHIN TXDOT RIGHT-OF-WAY WITH TXDOT.

15. CPS ENERGY WILL FUNCTION AS A SECONDARY OPERATOR ON THI PROJECT AND WILL BE INSTALLING ELECTRIC UTILITIES FOR ON-SITE CONSTRUCTION AND OFF-SITE FEED TO THE PROJECT.

THE ENGINEERING SEAL HAS BEEN AFFIXED TO THIS SHEET ONLY FOR TH PURPOSE OF DEMONSTRATING COMPLIANCE WITH THE TPDES-STORM WATER POLLUTION PREVENTION PLAN (SWP3) REGULATIONS.

THIS SHEET HAS BEEN PREPARED FOR PURPOSES OF THE SWP3 ONLY. ALL OTHER CIVIL ENGINEERING RELATED INFORMATION SHOULD BE ACQUIRED FROM THE APPROPRIATE

**EXHIBIT 2** 

NO 22-11800298 11680-52 ESIGNER HECKED\_BL\_DRAWN\_CB

C8.00

SCHEMATIC OF TEMPORARY CONSTRUCTION ENTRANCE/EXIT

### **MATERIALS**

THE AGGREGATE SHOULD CONSIST OF 4-INCH TO 8-INCH WASHED STONE OVER A STABLE FOUNDATION AS SPECIFIED IN THE PLAN. 2. THE AGGREGATE SHOULD BE PLACED WITH A MINIMUM THICKNESS OF

8-INCHES. 3. THE GEOTEXTILE FABRIC SHOULD BE DESIGNED SPECIFICALLY FOR USE AS A SOIL FILTRATION MEDIA WITH AN APPROXIMATE WEIGHT OF 6 OZ/YD2, A MULLEN BURST RATING OF 140 LB/IN2, AND AN EQUIVALENT OPENING SIZE GREATER THAN A NUMBER 50 SIEVE.

4. IF A WASHING FACILITY IS REQUIRED, A LEVEL AREA WITH A MINIMUM OF 4-INCH DIAMETER WASHED STONE OR COMMERCIAL ROCK SHOULD BE INCLUDED IN THE PLANS. DIVERT WASTEWATER TO A SEDIMENT TRAP OF

#### INSTALLATION

DRAINAGE

CORRECTLY.

**MATERIALS** 

OF 36 HOURS.

SHOOT GROWTH AND THATCH.

SITE PREPARATION

TIGHTLY (SEE FIGURE ABOVE).

TORN OR UNEVEN PADS SHOULD NOT BE ACCEPTABLE.

SUSPENDED FROM A FIRM GRASP ON ONE END OF THE SECTION.

TO FINAL GRADE IN ACCORDANCE WITH THE APPROVED PLAN.

**INSTALLATION IN CHANNELS** 

INTERFERE WITH PLANTING, FERTILIZING OR MAINTENANCE OPERATIONS.

1. AVOID CURVES ON PUBLIC ROADS AND STEEP SLOPES. REMOVE VEGETATION AND OTHER OBJECTIONABLE MATERIAL FROM THE FOUNDATION AREA. GRADE CROWN FOUNDATION FOR POSITIVE DRAINAGE.

2. THE MINIMUM WIDTH OF THE ENTRANCE/EXIT SHOULD BE 12 FEET OR THE FULL WIDTH OF EXIT ROADWAY, WHICHEVER IS GREATER. 3. THE CONSTRUCTION ENTRANCE SHOULD BE AT LEAST 50 FEET LONG.

THE SLOPE TOWARD THE ROAD EXCEEDS 2%, CONSTRUCT A RIDGE 6-INCHES TO 8-INCHES HIGH WITH 3:1 (H: V) SIDE SLOPES, ACROSS THE FOUNDATION APPROXIMATELY 15 FEET FROM THE ENTRANCE TO DIVERT RUNOFF AWAY FROM THE PUBLIC ROAD.

5. PLACE GEOTEXTILE FABRIC AND GRADE FOUNDATION TO IMPROVE STABILITY, ESPECIALLY WHERE WET CONDITIONS ARE ANTICIPATED.

6. PLACE STONE TO DIMENSIONS AND GRADE SHOWN ON PLANS. LEAVE

SURFACE SMOOTH AND SLOPE FOR DRAINAGE.

LAY SOD IN A STAGGERED PATTERN. BUTT

THE STRIPS TIGHTLY AGAINST EACH OTHER.

DO NOT LEAVE SPACES AND DO NOT

OVERLAP. A SHARPENED MASON'S TROWEL

IS A HANDY TOOL FOR TUCKING DOWN THE

AUTOMATIC SOD CUTTER MUST BE MATCHED

ANGLED ENDS CAUSED BY THE

ENDS AND TRIMMING PIECES.

7. DIVERT ALL SURFACE RUNOFF AND DRAINAGE FROM THE STONE PAD TO A SEDIMENT TRAP OR BASIN.

PIPE UNDER PAD AS NEEDED TO MAINTAIN PROPER PUBLIC ROAD

#### GEOTEXTILE FABRIC TO STABILIZE FOUNDATION SECTION "A-A" OF A

## CONSTRUCTION ENTRANCE/EXIT

#### COMMON TROUBLE POINTS

CONDITION AS STONE IS PRESSED INTO SOIL.

1. INADEQUATE RUNOFF CONTROL-SEDIMENT WASHES ONTO PUBLIC ROAD. . STONE TOO SMALL OR GEOTEXTILE FABRIC ABSENT, RESULTS IN MUDDY

PAD TOO SHORT FOR HEAVY CONSTRUCTION TRAFFIC-EXTEND PAD BEYOND THE MINIMUM 50-FOOT LENGTH AS NECESSARY. 4. PAD NOT FLARED SUFFICIENTLY AT ROAD SURFACE, RESULTS IN MUD BEING TRACKED ON TO ROAD AND POSSIBLE DAMAGE TO ROAD.

5. UNSTABLE FOUNDATION - USE GEOTEXTILE FABRIC UNDER PAD AND/OR IMPROVE FOUNDATION DRAINAGE.

#### INSPECTION AND MAINTENANCE GUIDELINES THE ENTRANCE SHOULD BE MAINTAINED IN A CONDITION, WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY.

THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND AND REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT


2. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY SHOULD BE REMOVED IMMEDIATELY BY CONTRACTOR. 3. WHEN NECESSARY, WHEELS SHOULD BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHT-OF-WAY.

5. ALL SEDIMENT SHOULD BE PREVENTED FROM ENTERING ANY STORM DRAIN,

DITCH OR WATER COURSE BY USING APPROVED METHODS.

4. WHEN WASHING IS REQUIRED, IT SHOULD BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE THAT DRAINS INTO AN APPROVED SEDIMENT TRAP OR SEDIMENT BASIN.

> 6. THE ROCK BERM SHOULD BE LEFT IN PLACE UNTIL ALL UPSTREAM AREAS ARE STABILIZED AND ACCUMULATED SILT REMOVED.

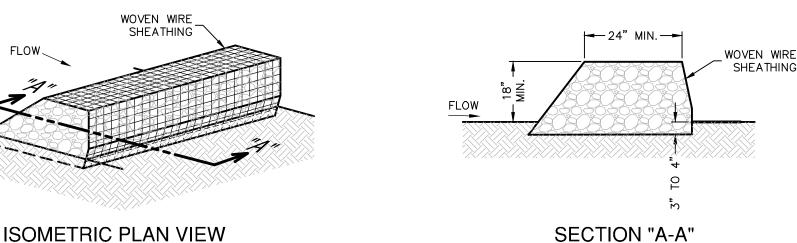

#### **ROCK BERMS**

THE PURPOSE OF A ROCK BERM IS TO SERVE AS A CHECK DAM IN AREAS OF CONCENTRATED FLOW, TO INTERCEPT SEDIMENT—LADEN RUNOFF, DETAIN THE SEDIMENT AND RELEASE THE WATER IN SHEET FLOW. THE ROCK BERM SHOULD BE USED WHEN THE CONTRIBUTING DRAINAGE AREA IS LESS THAN 5 ACRES. ROCK BERMS ARE USED IN AREAS WHERE THE VOLUME OF RUNOFF IS TOO GREAT FOR A SILT FENCE TO CONTAIN. THEY ARE LESS EFFECTIVE FOR SEDIMENT REMOVAL THAN SILT FENCES, PARTICULARLY FOR FINE PARTICLES, BUT ARE ABLE TO WITHSTAND HIGHER FLOWS THAN A SILT FENCE. AS SUCH, ROCK BERMS ARE OFTEN USED IN AREAS OF CHANNEL FLOWS (DITCHES, GULLIES, ETC.). ROCK BERMS ARE MOST EFFECTIVE AT REDUCING BED LOAD IN CHANNELS AND SHOULD NOT BE SUBSTITUTED FOR OTHER EROSION AND SEDIMENT CONTROL MEASURES FARTHER UP THE WATERSHED.

ISOMETRIC PLAN VIEW

#### INSPECTION AND MAINTENANCE GUIDELINES

INSPECTION SHOULD BE MADE WEEKLY AND AFTER EACH RAINFALL BY THE RESPONSIBLE PARTY. FOR INSTALLATIONS IN STREAMBEDS, ADDITIONAL DAILY INSPECTIONS SHOULD BE MADE.

. REMOVE SEDIMENT AND OTHER DEBRIS WHEN BUILDUP REACHES 6 INCHES AND DISPOSE OF THE ACCUMULATED SILT IN AN APPROVED MANNER THAT WILL NOT CAUSE ANY ADDITIONAL SILTATION.

3. REPAIR ANY LOOSE WIRE SHEATHING.

4. THE BERM SHOULD BE RESHAPED AS NEEDED DURING INSPECTION

5. THE BERM SHOULD BE REPLACED WHEN THE STRUCTURE CEASES TO FUNCTION AS INTENDED DUE TO SILT ACCUMULATION AMONG THE ROCKS, WASHOUT, CONSTRUCTION TRAFFIC DAMAGE, ETC.

#### **MATERIALS**

SHEATHING HAVING MAXIMUM OPENING OF 1 INCH AND A MINIMUM WIRE DIAMETER OF 20 GAUGE GALVANIZED AND SHOULD BE SECURED WITH SHOAT 2. CLEAN, OPEN GRADED 3-INCH TO 5-INCH DIAMETER ROCK SHOULD BE USED, EXCEPT IN AREAS WHERE HIGH VELOCITIES OR LARGE VOLUMES OF

FLOW ARE EXPECTED, WHERE 5-INCH TO 8-INCH DIAMETER ROCKS MAY BE

THE BERM STRUCTURE SHOULD BE SECURED WITH A WOVEN WIRE

#### INSTALLATION

A HEIGHT NOT LESS THAN 18"

1. LAY OUT THE WOVEN WIRE SHEATHING PERPENDICULAR TO THE FLOW LINE. THE SHEATHING SHOULD BE 20 GAUGE WOVEN WIRE MESH WITH 1 INCH

2. BERM SHOULD HAVE A TOP WIDTH OF 2 FEET MINIMUM WITH SIDE SLOPES BEING 2:1 (H: V) OR FLATTER. 3. PLACE THE ROCK ALONG THE SHEATHING AS SHOWN IN THE DIAGRAM TO

4. WRAP THE WIRE SHEATHING AROUND THE ROCK AND SECURE WITH TIE WIRE SO THAT THE ENDS OF THE SHEATHING OVERLAP AT LEAST 2 INCHES, AND THE BERM RETAINS ITS SHAPE WHEN WALKED UPON. 5. BERM SHOULD BE BUILT ALONG THE CONTOUR AT ZERO PERCENT GRADE OR AS NEAR AS POSSIBLE

6. THE ENDS OF THE BERM SHOULD BE TIED INTO EXISTING UPSLOPE GRADE AND THE BERM SHOULD BE BURIED IN A TRENCH APPROXIMATELY 3 TO 4 INCHES DEEP TO PREVENT FAILURE OF THE CONTROL.


#### COMMON TROUBLE POINTS

. INSUFFICIENT BERM HEIGHT OR LENGTH (RUNOFF QUICKLY ESCAPES OVER THE TOP OR AROUND THE SIDES OF BERM).

2. BERM NOT INSTALLED PERPENDICULAR TO FLOW LINE (RUNOFF ESCAPING AROUND ONE SIDE).

#### **ROCK BERM DETAIL**

NOT-TO-SCALE

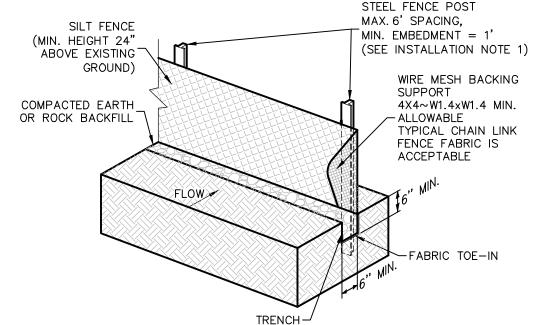

INCORRECT

SOD INSTALLATION

USE PEGS OR STAPLES TO FASTEN SOD

FIRMLY - AT THE ENDS OF STRIPS AND

IN THE CENTER. OR EVERY 3-4 FEET IF

THE STRIPS ARE LONG. WHEN READY TO

MOW, DRIVE PEGS OR STAPLES FLUSH

CORRECT

APPEARANCE OF GOOD SOD 1. ROLL SOD IMMEDIATELY TO ACHIEVE FIRM CONTACT WITH THE SOIL.

STABILIZED CONSTRUCTION ENTRANCE/EXIT DETAIL

NOT-TO-SCALE

SHOOTS OR GRASS BLADES.

CUTTING HEIGHT.

GRASS SHOULD BE GREEN AND

- THATCH- GRASS CLIPPINGS AND

ROOT ZONE - SOIL AND ROOTS.

DEAD LEAVES, UP TO 1/2" THICK.


SHOULD BE 1/2"-3/4" THICK, WITH

DENSE ROOT MAT FOR STRENGTH.

HEALTHY; MOWED AT A 2"-3"

2. WATER TO A DEPTH OF 4" AS NEEDED. WATER WELL AS SOON AS THE SOD IS LAID.

3. MOW WHEN THE SOD IS ESTABLISHED - IN 2-3 WEEKS. SET THE MOWER HIGH (2"-3").

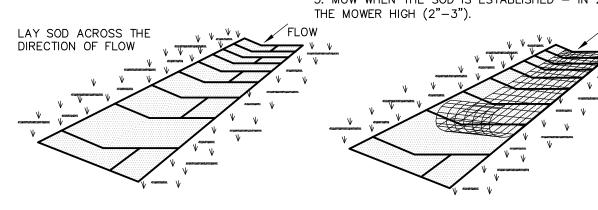

1. SOD SHOULD BE MACHINE CUT AT A UNIFORM SOIL THICKNESS OF 3/4" INCH

STANDARD SIZE SECTIONS OF SOD SHOULD BE STRONG ENOUGH TO

SUPPORT THEIR OWN WEIGHT AND RETAIN THEIR SIZE AND SHAPE WHEN

4. SOD SHOULD BE HARVESTED, DELIVERED, AND INSTALLED WITHIN A PERIOD

PRIOR TO SOIL PREPARATION, AREAS TO BE SODDED SHOULD BE BROUGHT

THE SURFACE SHOULD BE CLEARED OF ALL TRASH, DEBRIS AND OF ALL

FERTILIZE ACCORDING TO SOIL TESTS. FERTILIZER NEEDS CAN BE

DETERMINED BY A SOIL TESTING LABORATORY OR REGIONAL RECOMMENDATIONS

CAN BE MADE BY COUNTY AGRICULTURAL EXTENSION AGENTS. FERTILIZER

SHOULD BE WORKED INTO THE SOIL TO A DEPTH OF 3 INCHES WITH A DISC,

FINAL HARROWING OR DISCING OPERATION SHOULD BE ON THE CONTOUR.

SPRINGTOOTH HARROW OR OTHER SUITABLE EQUIPMENT. ON SLOPING LAND, THE

SOD STRIPS IN WATERWAYS SHOULD BE LAID PERPENDICULAR TO THE

DIRECTION OF FLOW. CARE SHOULD BE TAKEN TO BUTT ENDS OF STRIPS

2. AFTER ROLLING OR TAMPING, SOD SHOULD BE PEGGED OR STAPLED TO

RESIST WASHOUT DURING THE ESTABLISHMENT PERIOD. MESH OR OTHER

NETTING MAY BE PEGGED OVER THE SOD FOR EXTRA PROTECTION IN CRITICAL

(± 1/4" INCH) AT THE TIME OF CUTTING. THIS THICKNESS SHOULD EXCLUDE

IN CRITICAL AREAS, SECURE SOD WITH NETTING. USE STAPLES.

## GENERAL INSTALLATION (VA. DEPT. OF

SOD ALSO SHOULD NOT BE LAID ON SOIL SURFACES THAT ARE FROZEN. 2. PIECES OF SOD SHOULD BE CUT TO THE SUPPLIER'S STANDARD WIDTH AND LENGTH. WITH A MAXIMUM ALLOWABLE DEVIATION IN ANY DIMENSION OF 5%.

> THE FIRST ROW OF SOD SHOULD BE LAID IN A STRAIGHT LINE WITH SUBSEQUENT ROWS PLACED PARALLEL TO AND BUTTING TIGHTLY AGAINST EACH OTHER. LATERAL JOINTS SHOULD BE STAGGERED TO PROMOTE MORE UNIFORM GROWTH AND STRENGTH. CARE SHOULD BE EXERCISED TO ENSURE THAT SOD IS NOT STRETCHED OR OVERLAPPED AND THAT ALL JOINTS ARE BUTTED TIGHT IN ORDER TO PREVENT VOIDS WHICH WOULD CAUSE DRYING OF THE ROOTS

> 4. ON SLOPES 3:1 OR GREATER, OR WHEREVER EROSION MAY BE A PROBLEM, SOD SHOULD BE LAID WITH STAGGERED JOINTS AND SECURED BY STAPLING OR OTHER APPROVED METHODS. SOD SHOULD BE INSTALLED WITH THE LENGTH PERPENDICULAR TO THE SLOPE (ON CONTOUR).

5. AS SODDING OF CLEARLY DEFINED AREAS IS COMPLETED, SOD SHOULD BE ROOTS, BRUSH, WIRE, GRADE STAKES AND OTHER OBJECTS THAT WOULD ROLLED OR TAMPED TO PROVIDE FIRM CONTACT BETWEEN ROOTS AND SOIL. AFTER ROLLING, SOD SHOULD BE IRRIGATED TO A DEPTH SUFFICIENT THAT THE UNDERSIDE OF THE SOD PAD AND THE SOIL 4 INCHES BELOW THE SOD IS

> OFTEN AS NECESSARY TO MAINTAIN MOIST SOIL TO A DEPTH OF AT LEAST 4 8. THE FIRST MOWING SHOULD NOT BE ATTEMPTED UNTIL THE SOD IS FIRMLY ROOTED, USUALLY 2-3 WEEKS. NOT MORE THAN ONE THIRD OF THE GRASS LEAF SHOULD BE REMOVED AT ANY ONE CUTTING.

#### NSPECTION AND MAINTENANCE GUIDELINES SOD SHOULD BE INSPECTED WEEKLY AND AFTER EACH RAIN EVENT TO LOCATE AND REPAIR ANY DAMAGE.

. DAMAGE FROM STORMS OR NORMAL CONSTRUCTION ACTIVITIES SUCH AS TIRE RUTS OR DISTURBANCE OF SWALE STABILIZATION SHOULD BE REPAIRED AS SOON AS PRACTICAL.

SOD INSTALLATION DETAIL

NOT-TO-SCALE

## CONSERVATION, 1992

SOD SHOULD NOT BE CUT OR LAID IN EXCESSIVELY WET OR DRY WEATHER. 2. DURING PERIODS OF HIGH TEMPERATURE, THE SOIL SHOULD BE LIGHTLY IRRIGATED IMMEDIATELY PRIOR TO LAYING THE SOD, TO COOL THE SOIL AND REDUCE ROOT BURNING AND DIEBACK.

(SEE FIGURE ABOVE).


WITH THE GROUND.

UNTIL SUCH TIME A GOOD ROOT SYSTEM BECOMES DEVELOPED, IN THE

ABSENCE OF ADEQUATE RAINFALL, WATERING SHOULD BE PERFORMED AS

SILT FENCE DETAIL

NOT-TO-SCALE

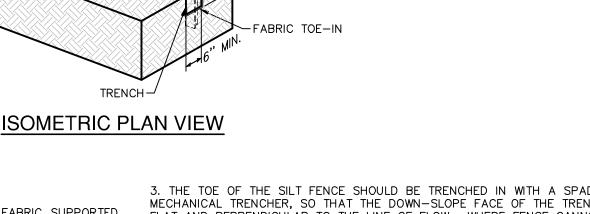

#### SILT FENCE

A SILT FENCE IS A BARRIER CONSISTING OF GEOTEXTILE FABRIC SUPPORTED BY METAL POSTS TO PREVENT SOIL AND SEDIMENT LOSS FROM A SITE. WHEN PROPERLY USED, SILT FENCES CAN BE HIGHLY EFFECTIVE AT CONTROLLING SEDIMENT FROM DISTURBED AREAS. THEY CAUSE RUNOFF TO POND, ALLOWING HEAVIER SOLIDS TO SETTLE OUT. IF NOT PROPERLY INSTALLED, SILT FENCES ARE NOT LIKELY TO BE EFFECTIVE.

THE PURPOSE OF A SILT FENCE IS TO INTERCEPT AND DETAIN WATER-BORN SEDIMENT FROM UNPROTECTED AREAS OF A LIMITED EXTENT. SILT FENCE IS USED DURING THE PERIOD OF CONSTRUCTION NEAR THE PERIMETER OF A DISTURBED AREA TO INTERCEPT SEDIMENT WHILE ALLOWING WATER TO PERCOLATE THROUGH. THIS FENCE SHOULD REMAIN IN PLACE UNTIL THE DISTURBED AREA IS PERMANENTLY STABILIZED. SILT FENCE SHOULD NOT BE USED WHERE THERE IS A CONCENTRATION OF WATER IN A CHANNEL OF DRAINAGE WAY. IF CONCENTRATED FLOW OCCURS AFTER INSTALLATION, CORRECTIVE ACTION MUST BE TAKEN SUCH AS PLACING A ROCK BERM IN THE AREAS OF CONCENTRATED FLOW.

SILT FENCING WITHIN THE SITE MAY BE TEMPORARILY MOVED DURING THE DAY TO ALLOW CONSTRUCTION ACTIVITY PROVIDED IT IS REPLACED AND PROPERLY ANCHORED TO THE GROUND AT THE END OF THE DAY. SILT FENCES ON THE PERIMETER OF THE SITE OR AROUND DRAINAGE WAYS SHOULD NOT BE MOVED AT ANY TIME.

. SILT FENCE MATERIAL SHOULD BE POLYPROPYLENE, POLYETHYLENE, OR POLYAMIDE WOVEN OR NONWOVEN FABRIC. THE FABRIC SHOULD BE 36 INCHES, WITH A MINIMUM UNIT WEIGHT OF 4.5 OZ/YD, MULLEN BURST STRENGTH EXCEEDING 190 LB/IN2, ULTRAVIOLET STABILITY EXCEEDING 70%, AND MINIMUM APPARENT OPENING SIZE OF U.S. SIEVE NUMBER 30.

FENCE POSTS SHOULD BE MADE OF HOT ROLLED STEEL, AT LEAST 4 FEET LONG WITH TEE OR Y-BAR CROSS SECTION, SURFACE PAINTED OR GALVANIZED, MINIMUM WEIGHT 1.25 LB/FT, AND BRINDELL HARDNESS

3. WOVEN WIRE BACKING TO SUPPORT THE FABRIC SHOULD BE GALVANIZED 2" X 4" WELDED WIRE, 12 GAUGE MINIMUM.

#### INSTALLATION

1. STEEL POSTS, WHICH SUPPORT THE SILT FENCE, SHOULD BE INSTALLED ON A SLIGHT ANGLE TOWARD THE ANTICIPATED RUNOFF SOURCE. POSTS MUST BE EMBEDDED A MINIMUM OF 1-FOOT DEEP AND SPACED NOT MORE THAN 8 FEET ON CENTER. WHERE WATER CONCENTRATES, THE MAXIMUM SPACING SHOULD BE 6 FEET.

. LAY OUT FENCING DOWN-SLOPE OF DISTURBED AREA, FOLLOWING THE CONTOUR AS CLOSELY AS POSSIBLE. THE FENCE SHOULD BE SITED SO THAT THE MAXIMUM DRAINAGE AREA IS 1/4 ACRE/100 FEET OF FENCE.

3. THE TOE OF THE SILT FENCE SHOULD BE TRENCHED IN WITH A SPADE OR MECHANICAL TRENCHER, SO THAT THE DOWN-SLOPE FACE OF THE TRENCH IS FLAT AND PERPENDICULAR TO THE LINE OF FLOW. WHERE FENCE CANNOT BE TRENCHED IN (E.G., PAVEMENT OR ROCK OUTCROP), WEIGHT FABRIC FLAP WITH 3 INCHES OF PEA GRAVEL ON UPHILL SIDE TO PREVENT FLOW FROM SEEPING UNDER FENCE.

TO ALLOW FOR THE SILT FENCE FABRIC TO BE LAID IN THE GROUND AND BACKFILLED WITH COMPACTED MATERIAL. 5. SILT FENCE SHOULD BE SECURELY FASTENED TO EACH STEEL SUPPORT POST OR TO WOVEN WIRE, WHICH IS IN TURN ATTACHED TO THE STEEL FENCE POST. THERE SHOULD BE A 3-FOOT OVERLAP, SECURELY FASTENED WHERE

4. THE TRENCH MUST BE A MINIMUM OF 6 INCHES DEEP AND 6 INCHES WIDE

ENDS OF FABRIC MEET. 6. SILT FENCE SHOULD BE REMOVED WHEN THE SITE IS COMPLETELY STABILIZED SO AS NOT TO BLOCK OR IMPEDE STORM FLOW OR DRAINAGE.

#### COMMON TROUBLE POINTS FENCE NOT INSTALLED ALONG THE CONTOUR CAUSING WATER TO CONCENTRATE AND FLOW OVER THE FENCE.

2. FABRIC NOT SEATED SECURELY TO GROUND (RUNOFF PASSING UNDER FENCE). 3. FENCE NOT INSTALLED PERPENDICULAR TO FLOW LINE (RUNOFF ESCAPING

4. FENCE TREATING TOO LARGE AN AREA, OR EXCESSIVE CHANNEL FLOW (RUNOFF OVERTOPS OR COLLAPSES FENCE).

#### INSPECTION AND MAINTENANCE GUIDELINES 1. INSPECT ALL FENCING WEEKLY, AND AFTER RAINFALL


#### 2. REMOVE SEDIMENT WHEN BUILDUP REACHES 6 INCHES.

3. REPLACE TORN FABRIC OR INSTALL A SECOND LINE OF FENCING PARALLEL TO THE TORN SECTION.

4. REPLACE OR REPAIR SECTIONS CRUSHED OR COLLAPSED IN THE COURSE OF CONSTRUCTION ACTIVITY. IF A SECTION OF FENCE IS OBSTRUCTING VEHICULAR ACCESS, CONSIDER RELOCATING IT TO A SPOT WHERE IT WILL PROVIDE EQUAL PROTECTION, BUT WILL NOT OBSTRUCT VEHICLES. A TRIANGULAR FILTER DIKE MAY BE PREFERABLE TO A SILT FENCE AT COMMON VEHICLE ACCESS POINTS. WHEN CONSTRUCTION IS COMPLETE, THE SEDIMENT SHOULD BE DISPOSED . HOLES, DEPRESSIONS OR OTHER GROUND DISTURBANCES CAUSED BY THE REMOVAL OF THE TEMPORARY CONCRETE WASHOUT FACILITIES SHOULD BE

OF IN A MANNER THAT WILL NOT CAUSE ADDITIONAL SILTATION AND THE PRIOR LOCATION OF THE SILT FENCE SHOULD BE REVEGETATED. THE FENCE ITSELF SHOULD BE DISPOSED OF IN AN APPROVED LANDFILL.

PIT DETAIL

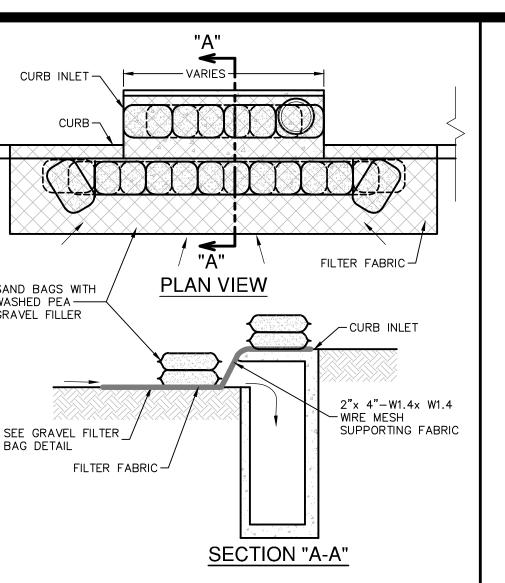

#### **GENERAL NOTES**

A MANNER THAT IT WILL NOT ERODE.

SAND BAGS WITH WASHED PEA-GRAVEL FILLER

BAG DETAIL

. CONTRACTOR TO INSTALL 2"x4"-W1.4xW1.4 WIRE MESH SUPPORTING FILTER FABRIC OVER THE INLET OPENING. FABRIC MUST BE SECURED TO WIRE BACKING WITH CLIPS OR WIRE TIES AT THIS LOCATION. SAND BAGS FILLED WITH WASHED PEA GRAVEL SHOULD BE PLACED ON TOP OF WIRE MESH ON TOP OF THE INLET AS SHOWN ON THIS DETAIL TO HOLD WIRE MESH IN PLACE. SANDBAGS FILLED WITH WASHED PEA GRAVEL SHOULD ALSO BE PLACED ALONG THE GUTTER AS SHOWN ON THIS DETAIL TO HOLD WIRE MESH IN PLACE. SAND BAGS TO BE STACKED TO FORM A CONTINUOUS BARRIER AROUND INLETS.

2. THE BAGS SHOULD BE TIGHTLY ABUTTED AGAINST EACH OTHER TO PREVENT RUNOFF FROM FLOWING BETWEEN THE BAGS.

INSPECTION AND MAINTENANCE GUIDELINES I. INSPECTION SHOULD BE MADE WEEKLY AND AFTER EACH RAINFALL. REPAIR OR REPLACEMENT SHOULD BE MADE PROMPTLY AS NEEDED BY THE


2. REMOVE SEDIMENT WHEN BUILDUP REACHES A DEPTH OF 3 INCHES. REMOVED SEDIMENT SHOULD BE DEPOSITED IN A SUITABLE AREA AND IN SUCH

3. CHECK PLACEMENT OF DEVICE TO PREVENT GAPS BETWEEN DEVICE AND


4. INSPECT FILTER FABRIC AND PATCH OR REPLACE IF TORN OR MISSING. 5. STRUCTURES SHOULD BE REMOVED AND THE AREA STABILIZED ONLY AFTER THE REMAINING DRAINAGE AREA HAS BEEN PROPERLY STABILIZED.

#### BAGGED GRAVEL CURB INLET PROTECTION DETAIL

NOT-TO-SCALE

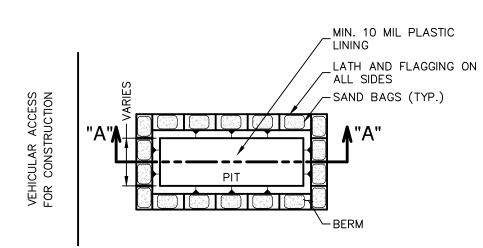

#### **PLAN VIEW**

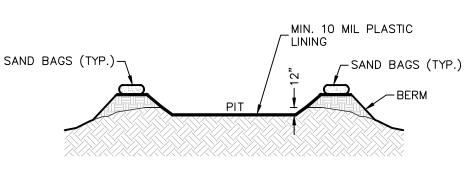

#### GENERAL NOTES

DETAIL ABOVE ILLUSTRATES MINIMUM DIMENSIONS. PIT CAN BE INCREASED IN SIZE DEPENDING ON EXPECTED FREQUENCY OF USE. 2. WASHOUT PIT SHALL BE LOCATED IN AN AREA EASILY ACCESSIBLE TO

SECTION "A-A'

CONSTRUCTION TRAFFIC. WASHOUT PIT SHALL NOT BE LOCATED IN AREAS SUBJECT TO INUNDATION FROM STORM WATER RUNOFF. 4. LOCATE WASHOUT AREA AT LEAST 50 FEET FROM SENSITIVE FEATURES,

STORM DRAINS, OPEN DITCHES OR WATER BODIES. . TEMPORARY CONCRETE WASHOUT FACILITY SHOULD BE CONSTRUCTED WITH SUFFICIENT QUANTITY AND VOLUME TO CONTAIN ALL LIQUID AND CONCRETE WASTE GENERATED BY WASHOUT OPERATIONS.

#### MATERIALS

PLASTIC LINING MATERIAL SHOULD BE A MINIMUM OF 10 MIL IN POLYETHYLENE SHEETING AND SHOULD BE FREE OF HOLES, TEARS, OR OTHER DEFECTS THAT COMPROMISE THE IMPERMEABILITY OF THE MATERIAL


#### **MAINTENANCE** WHEN TEMPORARY CONCRETE WASHOUT FACILITIES ARE NO LONGER


BACKFILLED AND REPAIRED.


REQUIRED FOR THE WORK, THE HARDENED CONCRETE SHOULD BE REMOVED AND DISPOSED OF. . MATERIALS USED TO CONSTRUCT TEMPORARY CONCRETE WASHOUT FACILITIES SHOULD BE REMOVED FROM THE SITE OF THE WORK AND DISPOSED

CONCRETE TRUCK WASHOUT

NOT-TO-SCALE

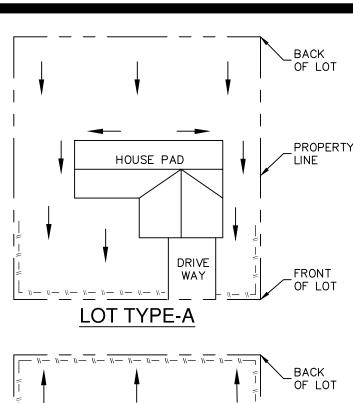


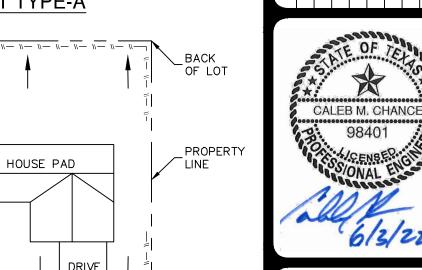

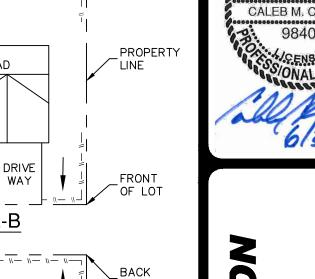

LEGEND

**SECTION "A-A"** 

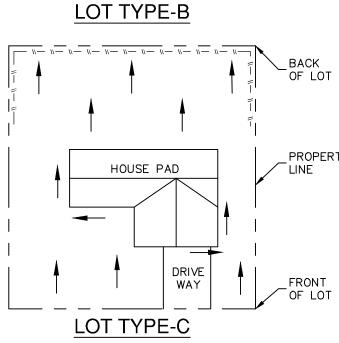


DOWNGRADIENT SIDE OF EACH LOT LINE —" -" -" SILT FENCE → DRAINAGE FLO OR LIMITS OF CLEARING AS GENERALLY SHOWN ON THE OVERALL SITE PLAN. TYPICAL HOUSE LOT LAYOUTS

NOTE: SILT FENCE TO BE INSTALLED PER

THESE DETAILS AND LOCATED ON THE

PLAN VIEW

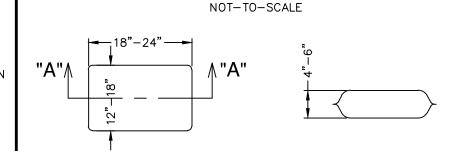


THE FILTER BAG MATERIAL SHALL BE MADE OF POLYPROPYLENE, POLYETHYLENE OR POLYAMIDE WOVEN FABRIC, MIN. UNIT WEIGHT OF 4 OUNCES/SY, HAVE A MULLEN BURST STRENGTH EXCEEDING 300 PSI AND ULTRAVIOLET STABILITY EXCEEDING 70%.

THE FILTER BAG SHALL BE FILLED WITH CLEAN, MEDIUM WASHED PEA GRAVEL TO COARSE GRAVEL (0.31 TO 0.75 INCH DIAMETER). 3. SAND SHALL <u>NOT</u> BE USED TO FILL THE FILTER BAGS.

### GRAVEL FILTER BAG DETAIL

NOT-TO-SCALE

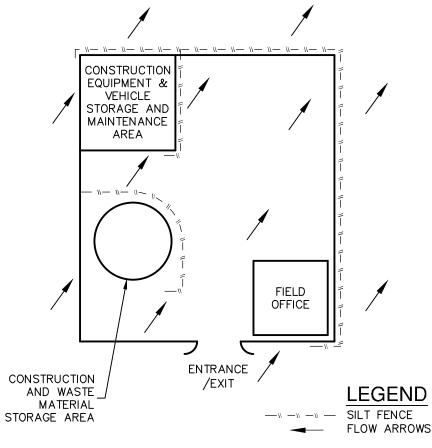

## CONSTRUCTION STAGING AREA

NOT-TO-SCALE

THE ENGINEERING SEAL HAS BEEN AFFIXED TO THIS SHEET ONLY FOR THE PURPOSE OF DEMONSTRATING COMPLIANCE WITH THE TPDES-STORM WATER POLLUTION PREVENTION PLAN (SWP3) REGULATIONS.

THIS SHEET HAS BEEN PREPARED FOR PURPOSES OF THE SWP3 ONLY. ALL OTHER CIVIL ENGINEERING RELATED INFORMATION SHOULD BE ACQUIRED FROM THE APPROPRIATE SHEET IN THE CIVIL IMPROVEMENT PLANS.

**EXHIBIT** 

22-1180029 11680-52 SIGNER IECKED BL DRAWN CB

C8.10