

Fire Hydrant Flow Test Form

Required fields highlighted in blue.

Auto-populated Fields:

% Pressure Drop, Total Water Loss, Residual Flow, Fire Flow at 20PSI, and NFPA 291 Standard Color Code.

I. Project Information	
Name: V.K. Knowlton Construction & Utilities, Inc.	Phone: (210) 651-6860
Company Address: 18225 FM 2252, San Antonio, Texas 78266	
Project Name: STEELWOOD TRAIL UNIT 4	
NBU Work Order Numbers: W-209398	

TEST # 6

II. Flow Test Data		Click Reset Fields to recalculate auto-populated fields.	
Test Hydrant	NBU FH ID #: ID #1	Plan Sheet/Hydrant #: C6.00 / ID #1	Private: No
	Location Description: Moon Hill Road west of Foggy Pass Drive		
	Size and Material of Main: 8" C900 (DR-18)		
	Manufacturer: CLOW		OEM Year: 2024
	Static PSI: 78	Residual PSI: 54	% Pressure Drop: 30.77 Date and Time: 9/16/2025 10:22 am
Flow Hydrant 1	NBU FH ID #: ID #12	Plan Sheet/Hydrant #: C6.00 / ID #12	Diameter: 2.5
	Size and Material of Main: 8" C900 (DR-18)		
	Pitot PSI: 25	Observed Flow: 839	Minutes Flowed: 2
	Total Water Loss: 1678		
Flow Hydrant 2 (OPTIONAL)	NBU FH ID #: ID #12	Plan Sheet/Hydrant #: C6.00 / ID #12	Diameter: 2.5
	Size and Material of Main: ***flowing both outlets of hydrant***		
	Pitot PSI: 25	Observed Flow: 839	Minutes Flowed: 2
	Total Water Loss: 1678		

III. Calculations (Auto-populated)	
Residual Flow $Q_r = 29.83 \times c_d \times D^2 \sqrt{P_p \times H_f}$	Fire Flow at 20 PSI $Q_f = Q_r \times ((P_s - 20) / (P_s - P_r))^{0.54}$
Cd = 0.9	Qr = 1678
D = 2.5	Ps = 78
Pp = 25	Pr = 54
Hf = 2	Qf = 2702
Qr = 1678	NFPA 291 Standard Color Code: 1500 GPM & Above = Light Blue

IV. Tester/Company Information	
Flow Test Conducted by: Protection Development, Incorporated	Phone: (210) 828-7533
Business License #: Texas Registered Engineering Firm (F-2816)	
Company Address: 8620 North New Braunfels Avenue, Suite 100, San Antonio, Texas 78217	
Print Name: Alex Akeroyd and Geoff Owens	Date: 09/16/2025

Handwritten signatures of Alex Akeroyd and Geoff Owens

2025-0223


V. NBFD Fire Hydrant Flow Requirements (To be completed by Fire Department)		
Print Name:	Title:	Accepted: <input type="checkbox"/>
Signature:		Date and Time:

Fire Hydrant Flow Test Form




VI. Sketch (Attach any additional calculations and graphs made by testing company)

Label Hydrant Numbers and Street Names

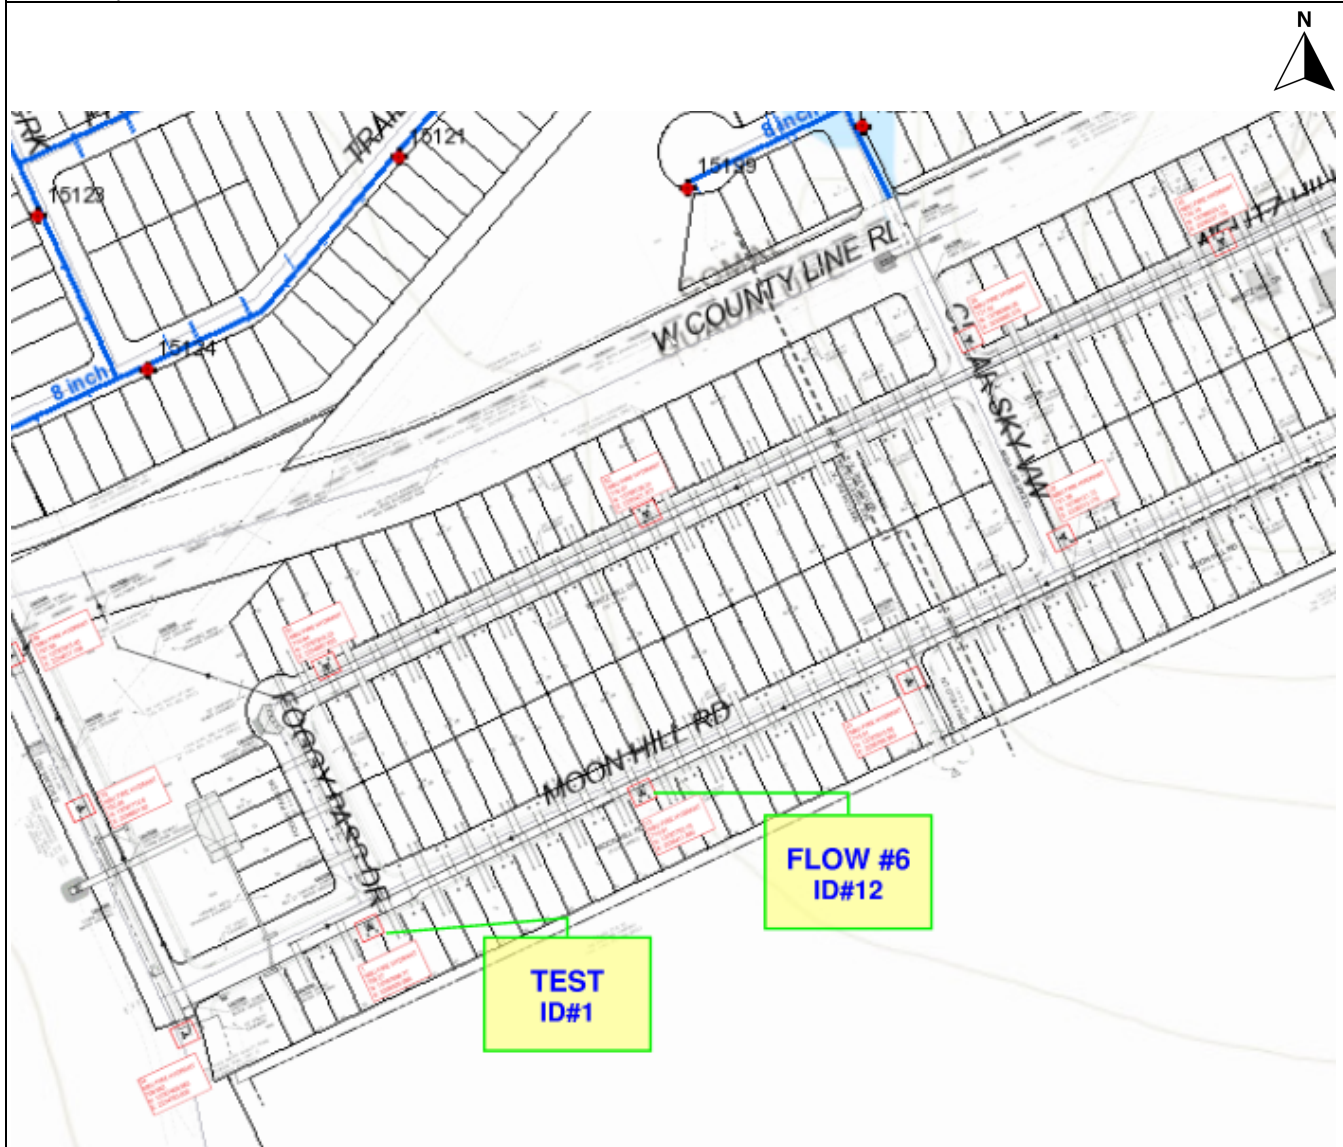



Project Name:	Steelwood Trail Unit 4 - Test #6
Project Number:	25-0223
Test Date:	September 16, 2025
City:	New Braunfels

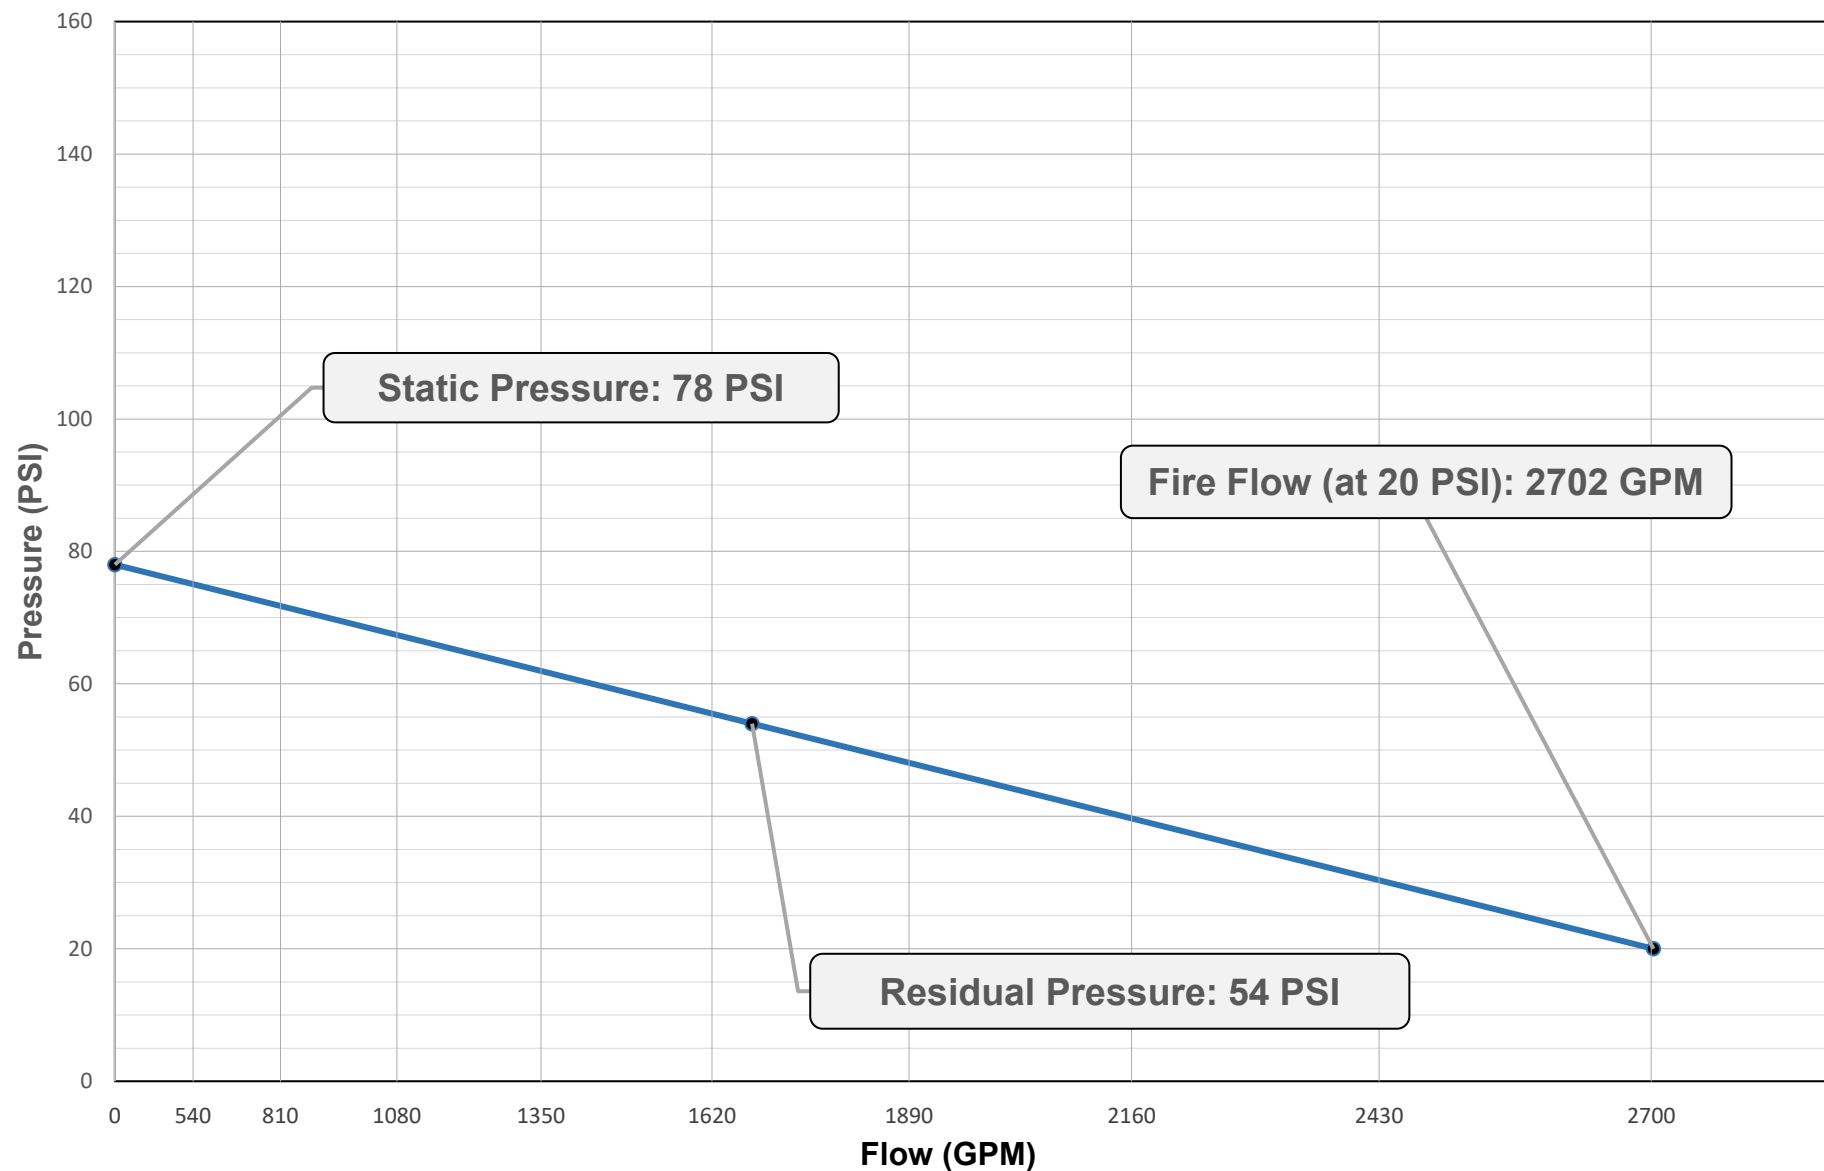

Static Pressure:	78 PSI	Residual Pressure:	54 PSI	Flow Test @ Residual Pressure:	1,678 GPM	Fire Flow (at 20 PSI):	2,702 GPM
------------------	--------	--------------------	--------	--------------------------------	-----------	------------------------	-----------