

Fire Hydrant Flow Test Form

Required fields highlighted in blue.

Auto-populated Fields:

% Pressure Drop, Total Water Loss, Residual Flow, Fire Flow at 20PSI, and NFPA 291 Standard Color Code.

I. Project Information							
Name: V.K. Knowlton Construction & Utilities, Inc.						Phone: (210) 651-6860	
Company Address: 18225 FM 2282 San Antonio, TX 78266							
Project Name: THE LANDING - UNIT 1							
NBU Work Order Numbers:							

Point #	Grid Easting	Grid Northing	Elevation	Code	FH#	Test #:
9	13811205.1000	2273390.2290	666.127	F/H	1	1

II. Flow Test Data							
Click Reset Fields to recalculate auto-populated fields.							
Test Hydrant	NBU FH ID #:		Plan Sheet/Hydrant #: Sheet C6.2 2			Private: No	
	Location Description: Jet Place at Airfoil Trail						
	Size and Material of Main: 12 inch main C-900 (200)						
	Manufacturer: CLOW			OEM Year: 2023			
	Static PSI: 94		Residual PSI: 53		% Pressure Drop: 43.62		Date and Time: 2/13/2025 9:25 am
Flow Hydrant 1	NBU FH ID #:		Plan Sheet/Hydrant #: Sheet C6.2 1			Diameter: 2.5	
	Size and Material of Main: 12 inch main C-900 (200)						
	Pitot PSI: 34		Observed Flow: 978		Minutes Flowed: 2		
	Total Water Loss: 1956						
Flow Hydrant 2 (OPTIONAL)	NBU FH ID #:		Plan Sheet/Hydrant #: Sheet C6.2 1			Diameter: 2.5	
	Size and Material of Main: ~~FLOWING BOTH OUTLETS OF HYDRANT 1~~						
	Pitot PSI: 34		Observed Flow: 978		Minutes Flowed: 2		
	Total Water Loss: 1956						

III. Calculations (Auto-populated)	
Residual Flow $Q_r = 29.83 \times c_d \times D^2 \sqrt{P_p \times H_f}$	Fire Flow at 20 PSI $Q_f = Q_r \times ((P_s - 20) / (P_s - P_r))^{0.54}$
Cd = 0.9	Qr = 1957
D = 2.5	Ps = 94
Pp = 34	Pr = 53
Hf = 2	Qf = 2692
Qr = 1957	NFPA 291 Standard Color Code : 1500 GPM & Above = Light Blue


IV. Tester/Company Information	
Flow Test Conducted by: PROTECTION DEVELOPMENT, INCORPORATED	Phone: (210) 828-7533
Business License #: Texas Registered Engineering Firm (F-2816)	
Company Address: 8620 North New Braunfels Avenue, Suite 100, San Antonio, Texas 78217	
Print Name: Alex Akeroyd and Nicholas Balanciere	Date: 02/13/2025

V. NBFD Fire Hydrant Flow Requirements (To be completed by Fire Department)		
Print Name:	Title:	Accepted: <input type="checkbox"/>
Signature:	Date and Time:	


Fire Hydrant Flow Test Form

VI. Sketch (Attach any additional calculations and graphs made by testing company)

Label Hydrant Numbers and Street Names

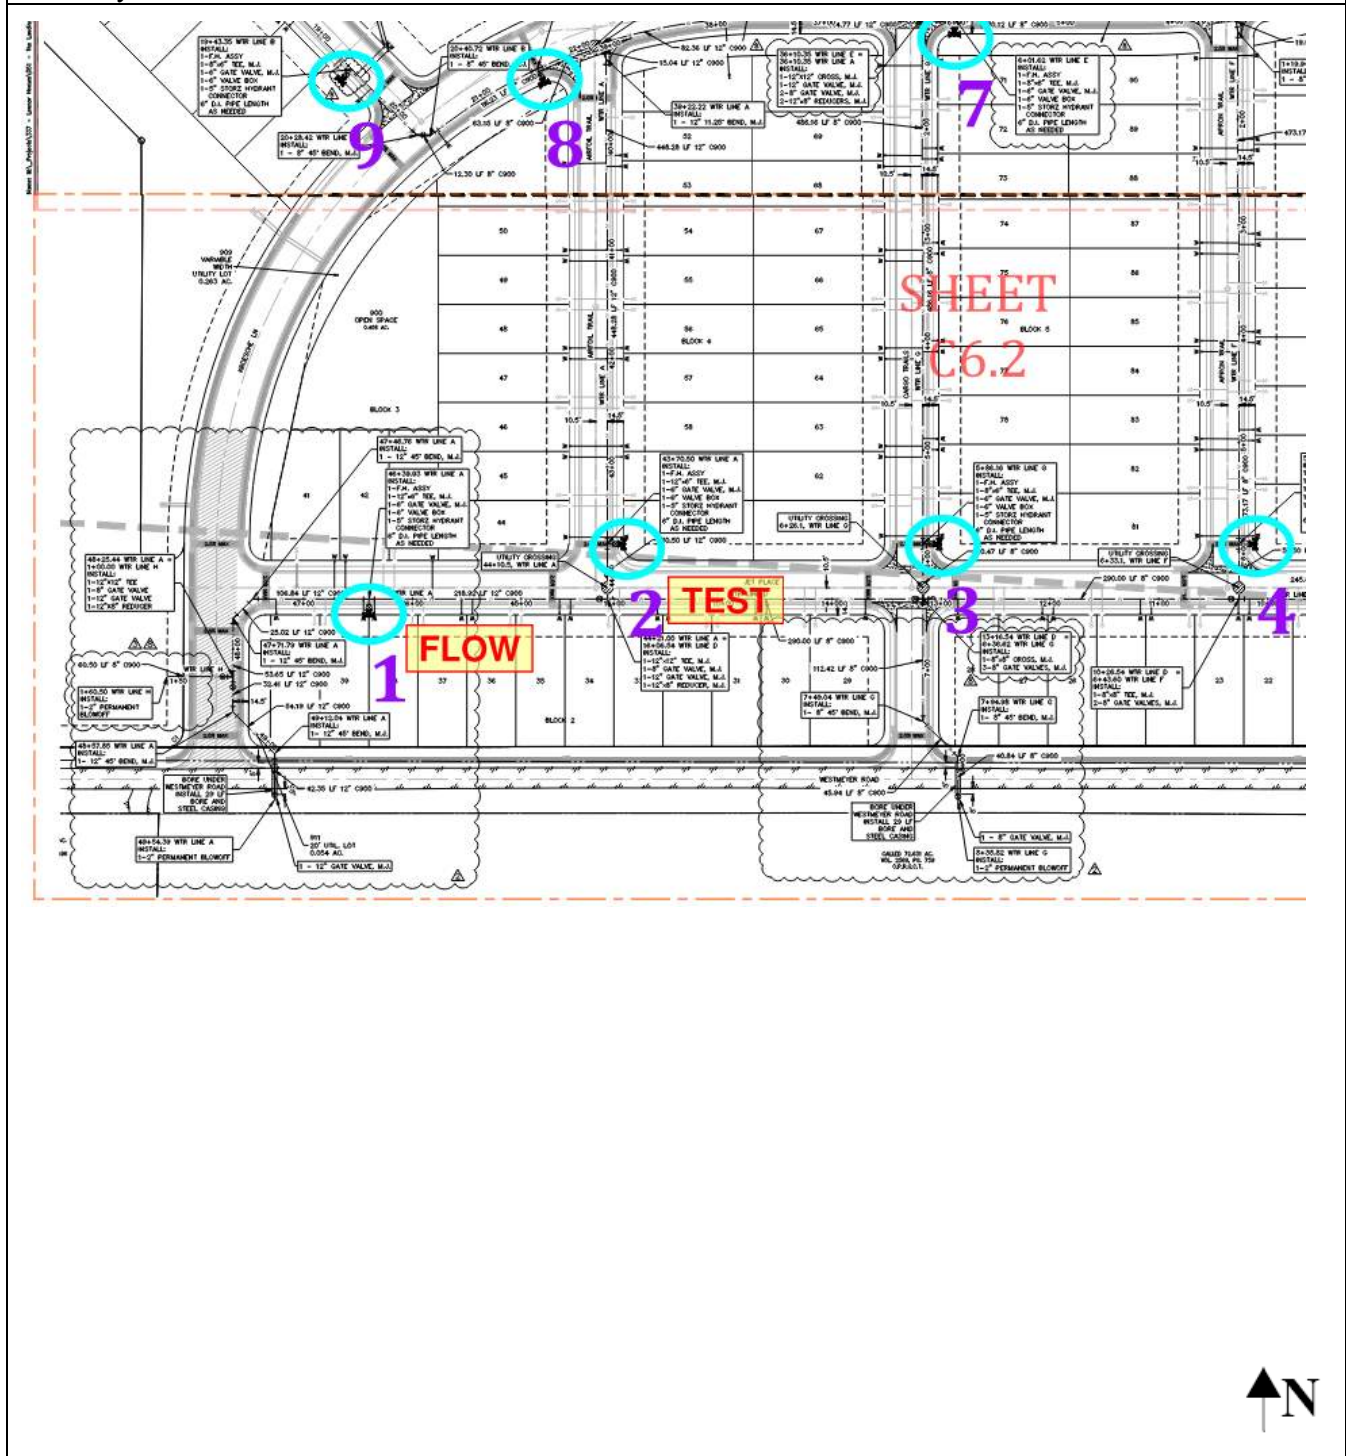

Project Name:	The Landing Unit 1 - Test #1
Project Number:	25-0033
Test Date:	February 13, 2025
City:	New Braunfels

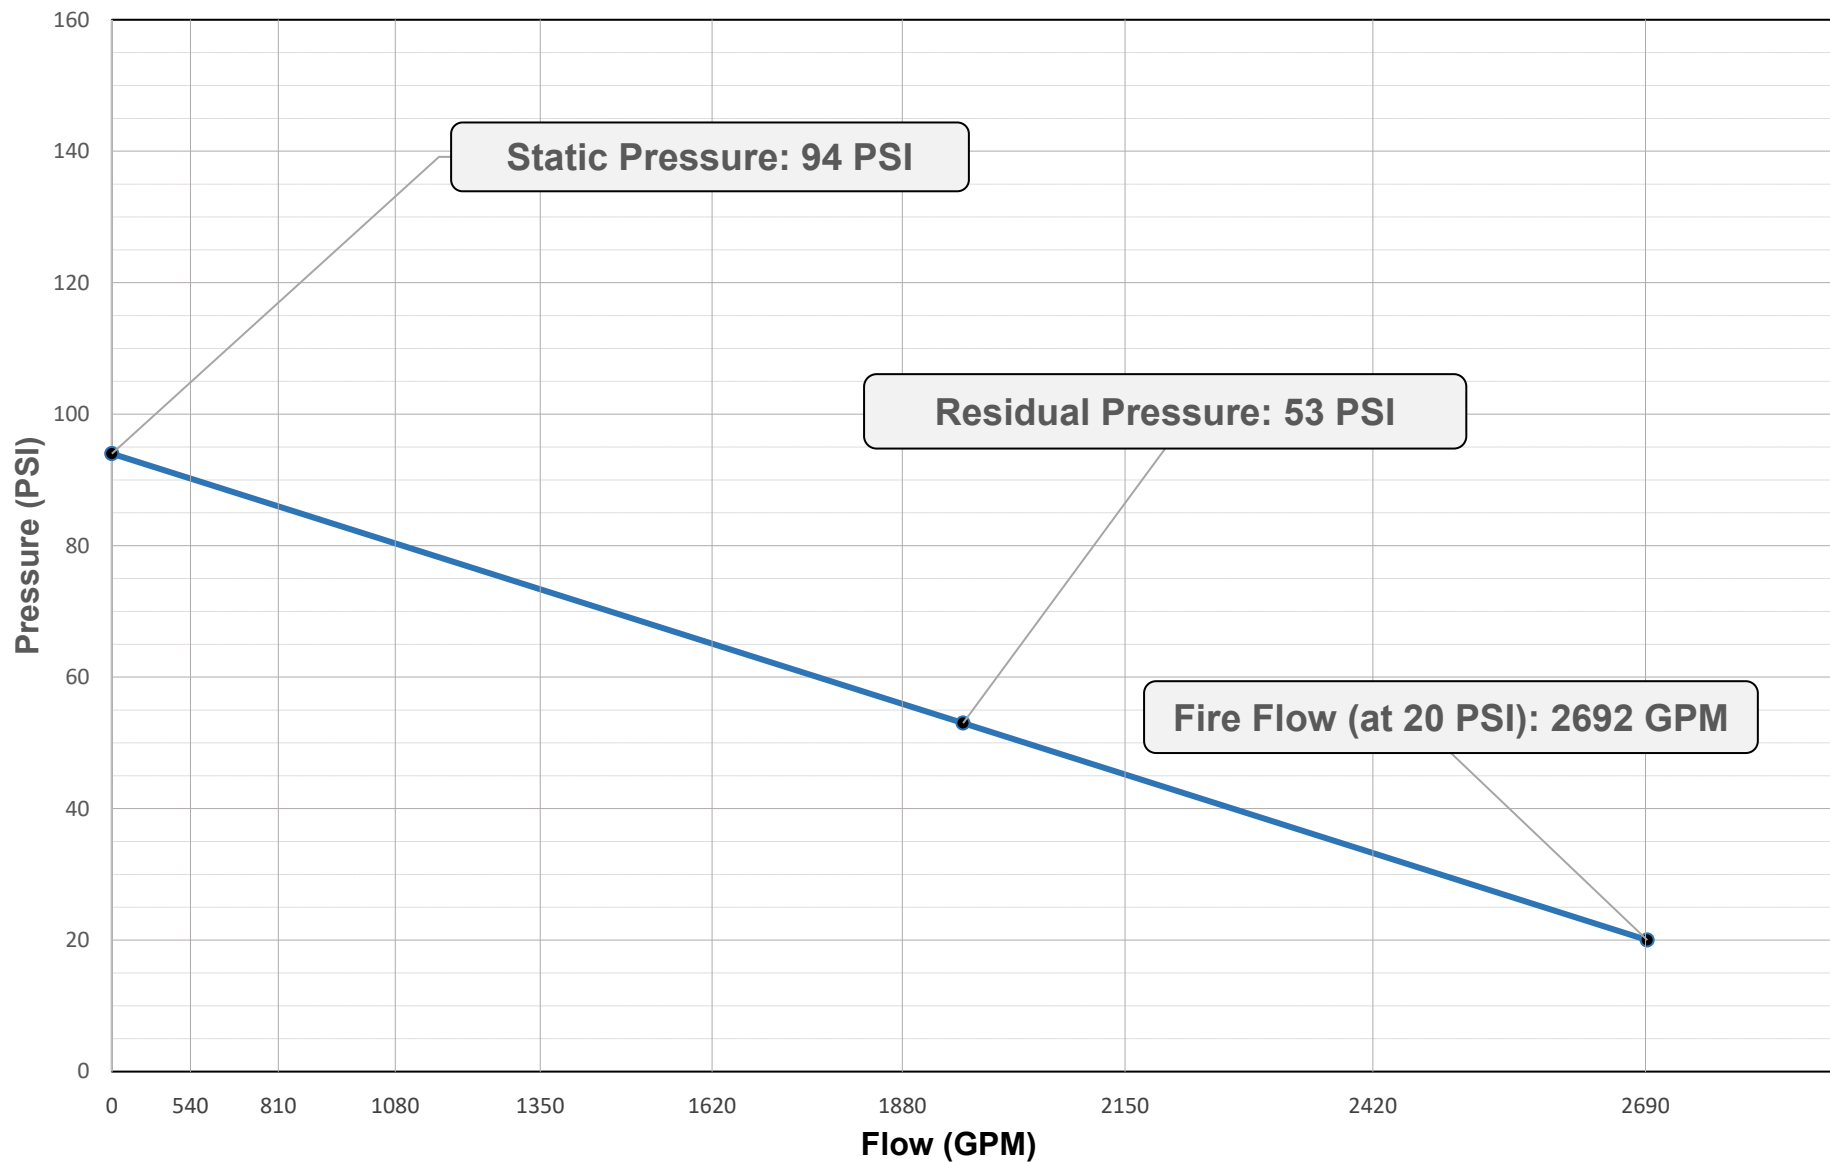

Static Pressure: 94 PSI	Residual Pressure: 53 PSI	Flow Test @ Residual Pressure: 1,957 GPM	Fire Flow (at 20 PSI): 2,692 GPM
-------------------------	---------------------------	--	----------------------------------