

Fire Hydrant Flow Test Form

Required fields highlighted in blue.

Auto-populated Fields:

% Pressure Drop, Total Water Loss, Residual Flow, Fire Flow at 20PSI, and NFPA 291 Standard Color Code.

| I. Project Information | |
|---|------------------------------|
| Name: V.K. Knowlton Construction & Utilities, Inc. | Phone: (210) 651-6860 |
| Company Address: 18225 FM 2282 San Antonio, TX 78266 | |
| Project Name: THE LANDING - UNIT 1 | |
| NBU Work Order Numbers: | |

| Point # | Grid Easting | Grid Northing | Elevation | Code | FH# | Test #: |
|---------|---------------|---------------|-----------|------|-----|-----------|
| 86 | 13814332.7700 | 2272090.0350 | 660.089 | F/H | 19 | 19 |

| II. Flow Test Data | | Click Reset Fields to recalculate auto-populated fields. | |
|---------------------------|---|---|--|
| Test Hydrant | NBU FH ID #: | Plan Sheet/Hydrant #: Sheet C6.0 | Private: No |
| | Location Description: Old Kruesche Lane south of Mountain Mint | | |
| | Size and Material of Main: 12 inch main C-900 (200) | | |
| | Manufacturer: CLOW OEM Year: 2023 | | |
| | Static PSI: 102 | Residual PSI: 64 | % Pressure Drop: 37.25 Date and Time: 2/13/2025 11:35 am |
| Flow Hydrant 1 | NBU FH ID #: | Plan Sheet/Hydrant #: Sheet C6.0 | Diameter: 2.5 |
| | Size and Material of Main: 12 inch main C-900 (200) | | |
| | Pitot PSI: 32 | Observed Flow: 949 | Minutes Flowed: 2 |
| | Total Water Loss: 1898 | | |
| Flow Hydrant 2 (OPTIONAL) | NBU FH ID #: | Plan Sheet/Hydrant #: Sheet C6.0 | Diameter: 2.5 |
| | Size and Material of Main: ~~FLOWING BOTH OUTLETS OF HYDRANT 1~~ | | |
| | Pitot PSI: 32 | Observed Flow: 949 | Minutes Flowed: 2 |
| | Total Water Loss: 1898 | | |

| III. Calculations (Auto-populated) | |
|---|--|
| Residual Flow $Q_r = 29.83 \times c_d \times D^2 \sqrt{P_p \times H_f}$ | Fire Flow at 20 PSI $Q_f = Q_r \times ((P_s - 20) / (P_s - P_r))^{0.54}$ |
| Cd = 0.9 | Qr = 1898 |
| D = 2.5 | Ps = 102 |
| Pp = 32 | Pr = 64 |
| Hf = 2 | Qf = 2876 |
| Qr = 1898 | NFPA 291 Standard Color Code : 1500 GPM & Above = Light Blue |


| IV. Tester/Company Information | |
|--|------------------------------|
| Flow Test Conducted by: PROTECTION DEVELOPMENT, INCORPORATED | Phone: (210) 828-7533 |
| Business License #: Texas Registered Engineering Firm (F-2816) | |
| Company Address: 8620 North New Braunfels Avenue, Suite 100, San Antonio, Texas 78217 | |
| Print Name: Alex Akeroyd and Nicholas Balanciere | Date: 02/13/2025 |

| V. NBFD Fire Hydrant Flow Requirements (To be completed by Fire Department) | | |
|---|----------------|------------------------------------|
| Print Name: | Title: | Accepted: <input type="checkbox"/> |
| Signature: | Date and Time: | |

Fire Hydrant Flow Test Form


VI. Sketch (Attach any additional calculations and graphs made by testing company)

Label Hydrant Numbers and Street Names

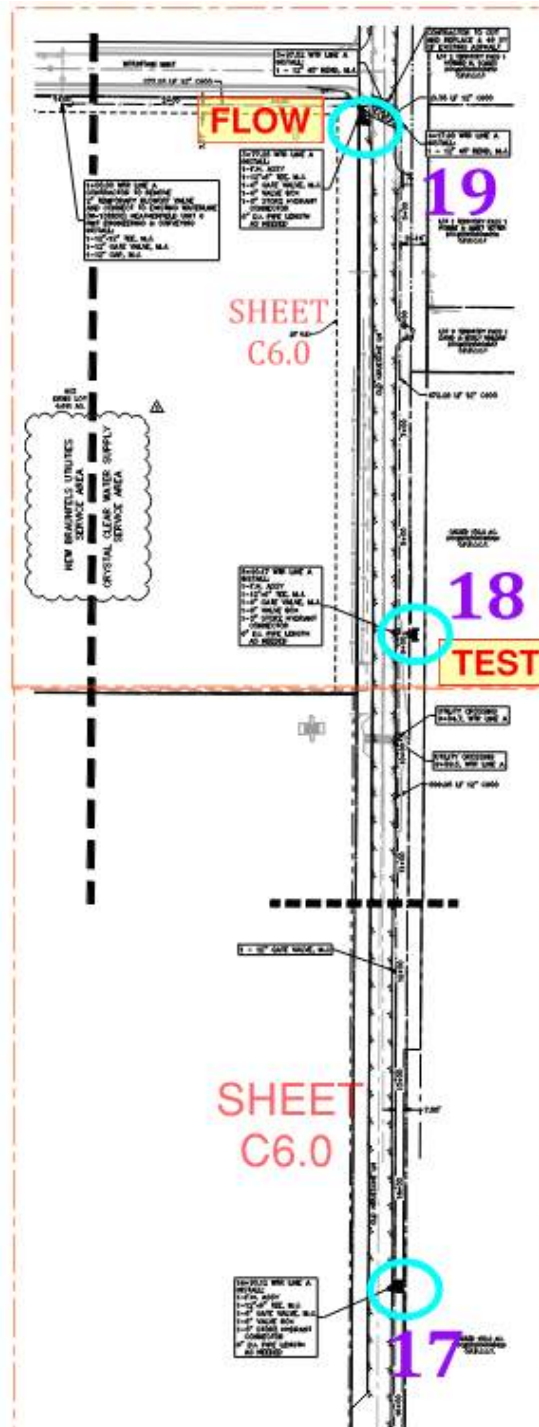



| | |
|-----------------|-------------------------------|
| Project Name: | The Landing Unit 1 - Test #19 |
| Project Number: | 25-0033 |
| Test Date: | February 13, 2025 |
| City: | New Braunfels |

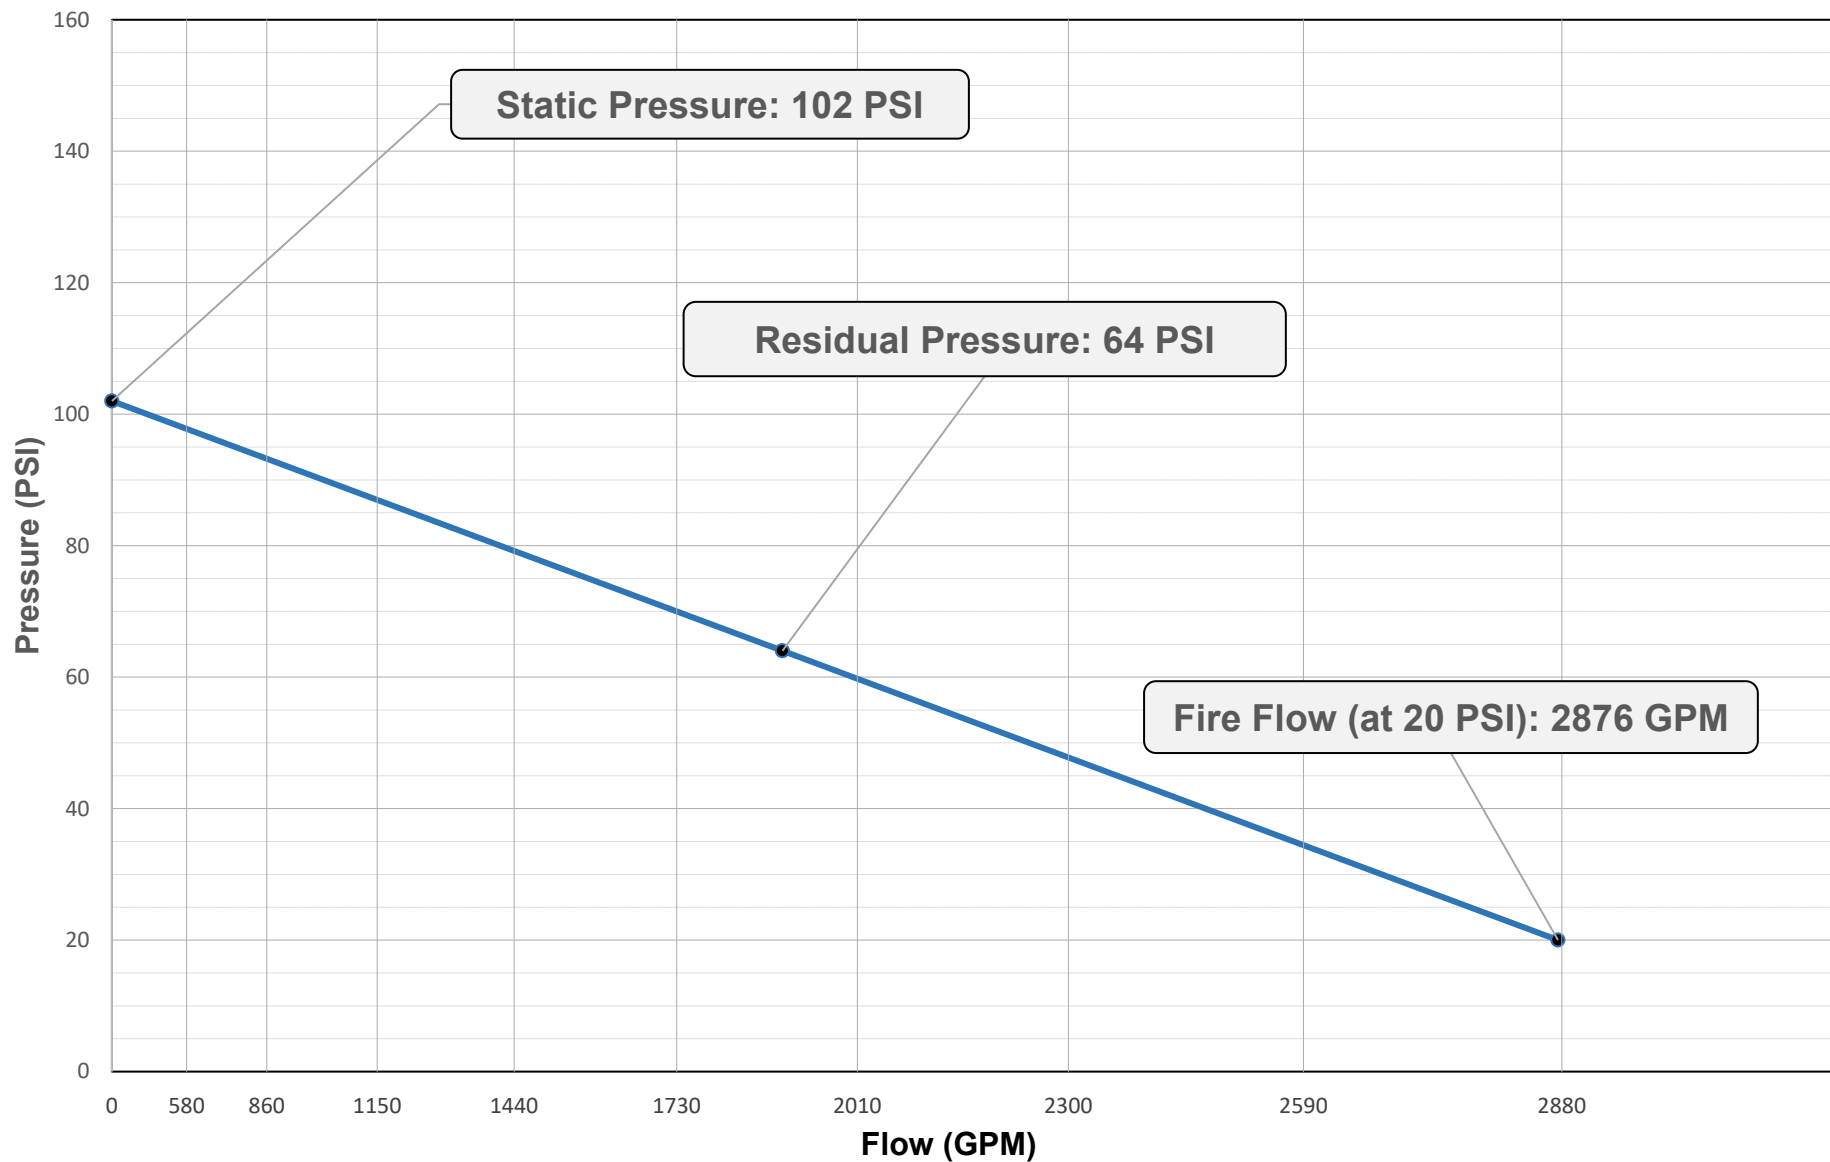

| | | | |
|--------------------------|---------------------------|--|----------------------------------|
| Static Pressure: 102 PSI | Residual Pressure: 64 PSI | Flow Test @ Residual Pressure: 1,898 GPM | Fire Flow (at 20 PSI): 2,876 GPM |
|--------------------------|---------------------------|--|----------------------------------|