


WL#	WORK FUNCTION	INSTRUCTION
1	Note	Existing Fiber Box
1	Contractor	Install (1) 2" Fiber Conduit to WL# 2
2	Contractor	Install Secondary Pullbox Install (1) 2" Fiber Conduit to WL# 3
3	Contractor	Install Secondary Pullbox Install (1) 2" Fiber Conduit to WL# 4
4	Contractor	Install Secondary Pullbox Install (1) 2" Fiber Conduit to WL# 5
5	Contractor	Install Secondary Pullbox Install (1) 2" Fiber Conduit to WL# 6
6	Contractor	Install Secondary Pullbox Install (1) 2" Fiber Conduit to WL# 7
7	Contractor	Install Secondary Pullbox

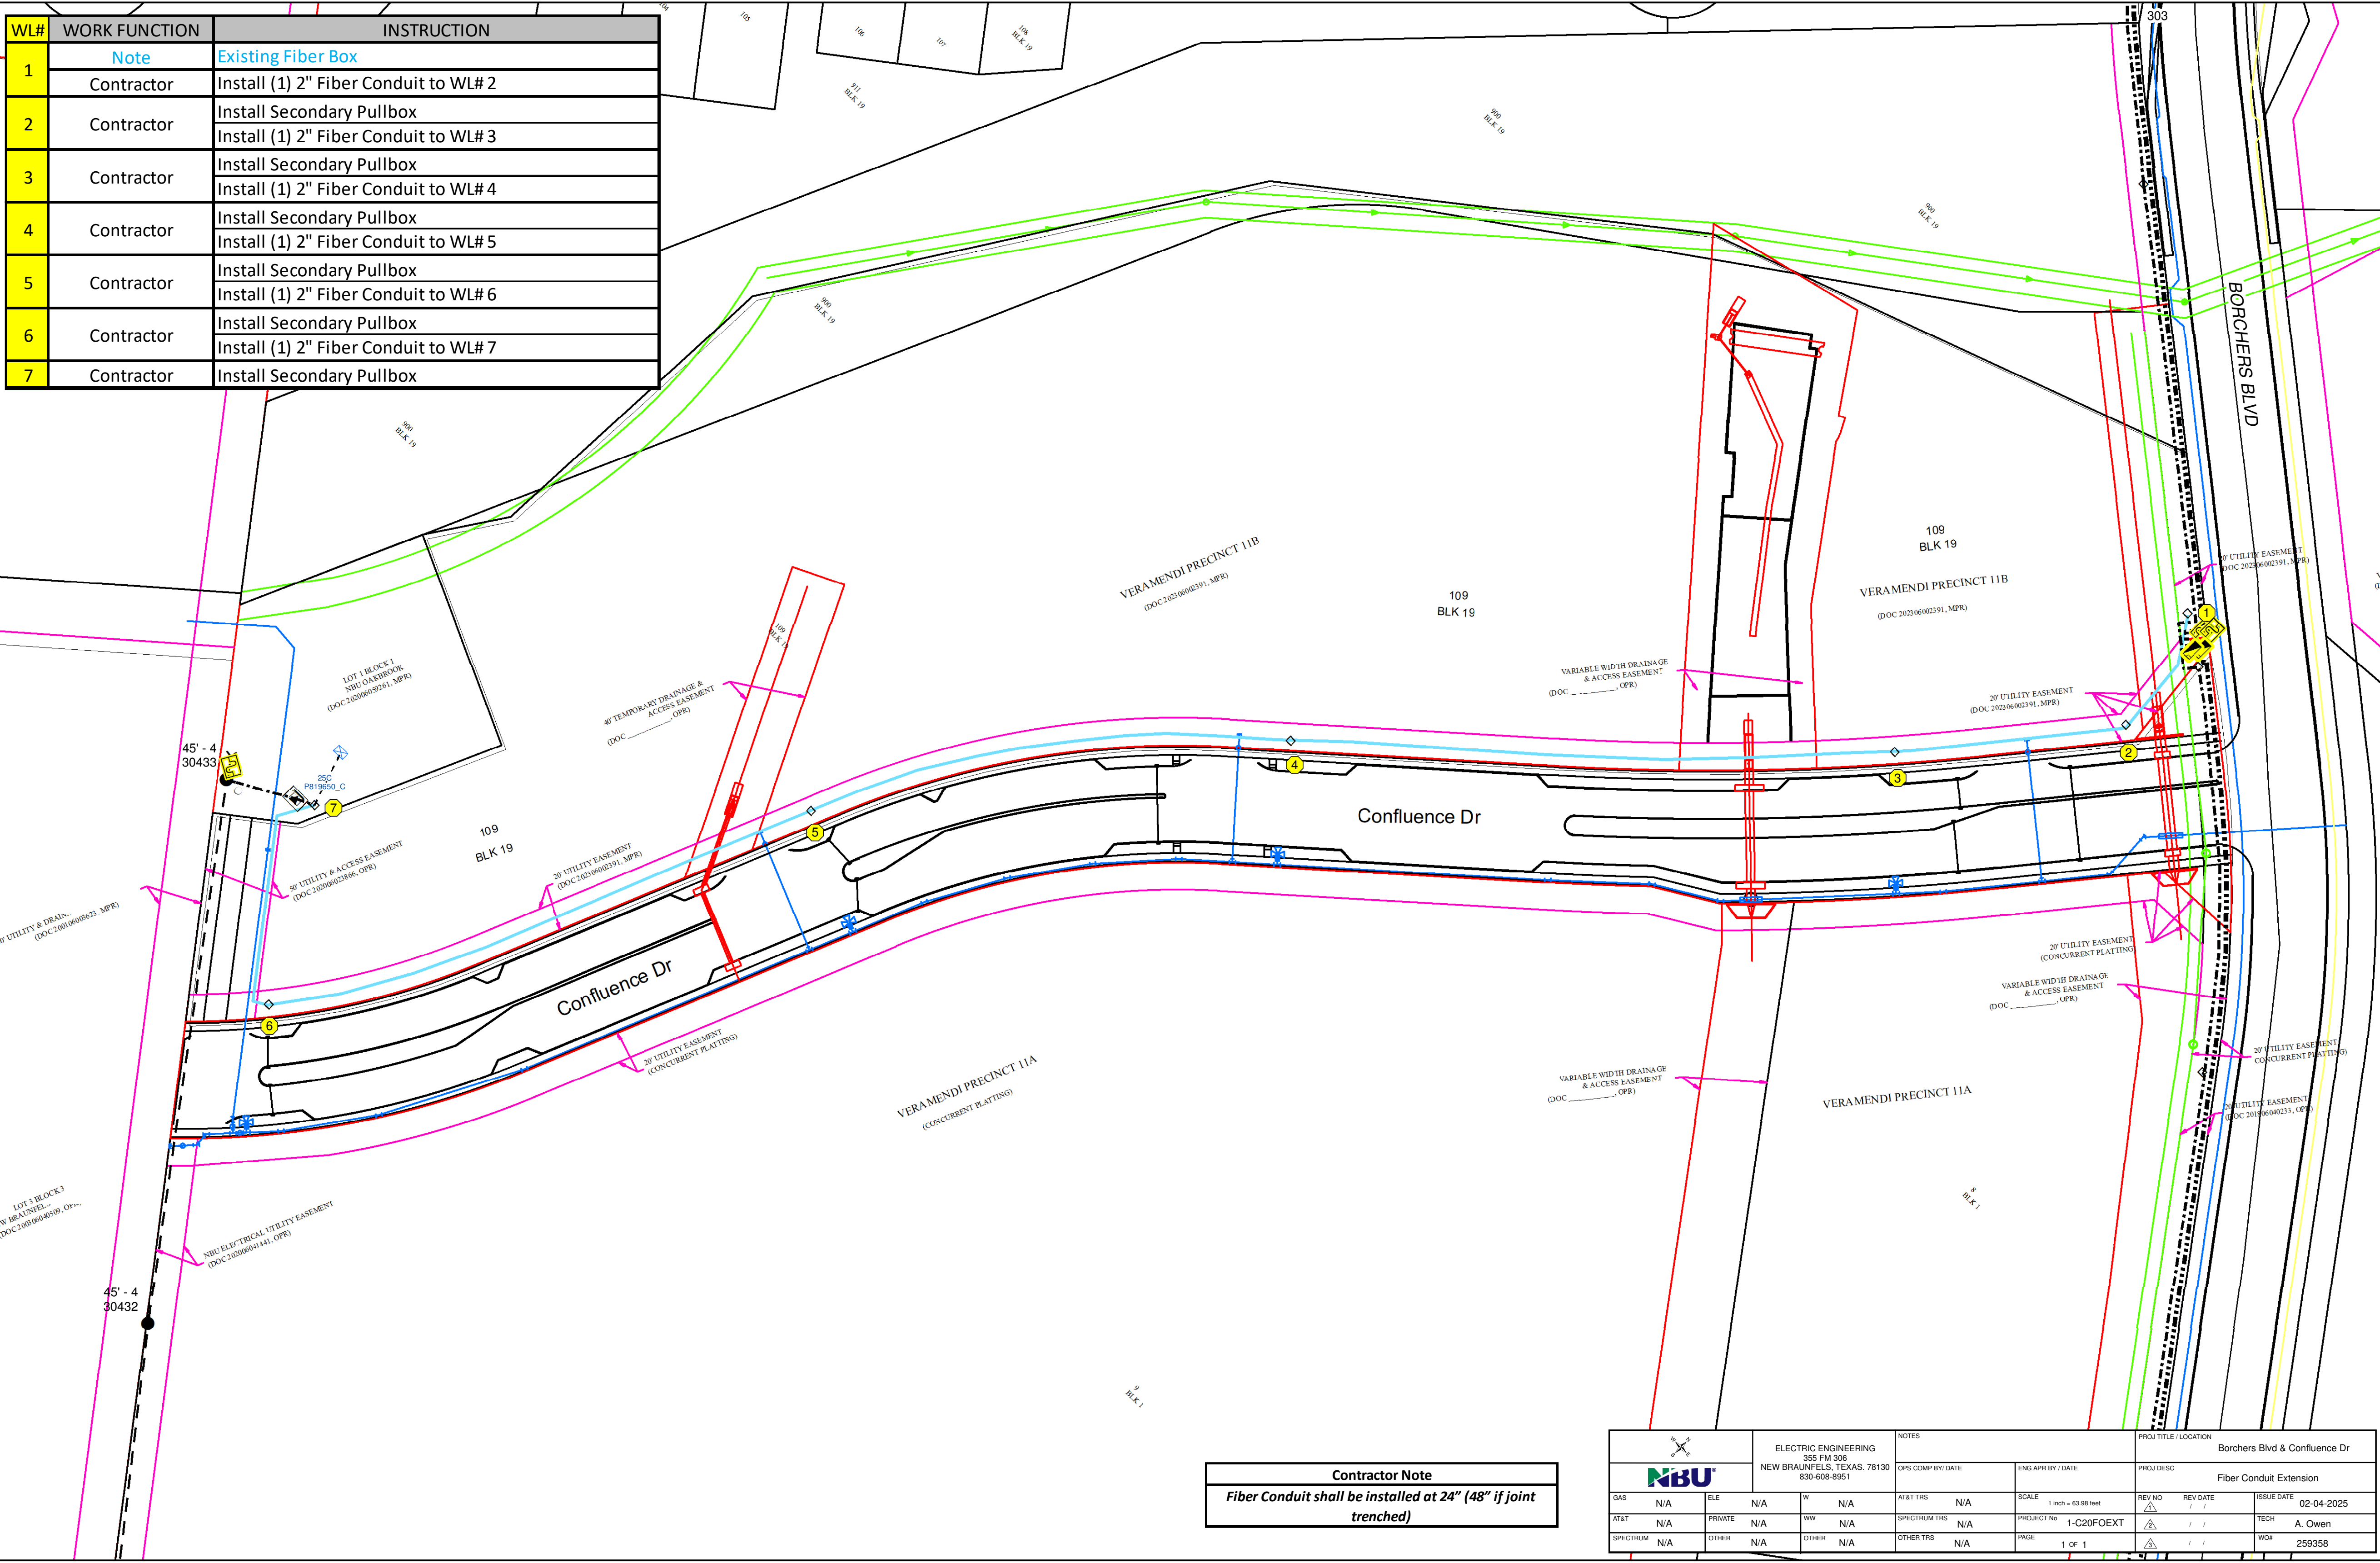

Contractor Note
Fiber Conduit shall be installed at 24" (48" if joint
trenched)

			ELECTRIC ENGINEERING 355 FM 306 NEW BRAUNFELS, TEXAS. 78130 830-608-8951			NOTES			PROJ TITLE / LOCATION Borchers Blvd & Confluence Dr					
						OPS COMP BY / DATE			ENG APR BY / DATE					
									PROJ DESC Fiber Conduit Extension					
GAS	N/A	ELE	N/A	W	N/A	AT&T TRS	N/A	SCALE	1 inch = 63.98 feet		REV NO	REV DATE	ISSUE DATE	02-04-2025
AT&T	N/A	PRIVATE	N/A	WW	N/A	SPECTRUM TRS	N/A	PROJECT NO	1-C20FOEXT				TECH	A. Owen
SPECTRUM	N/A	OTHER	N/A	OTHER	N/A	OTHER TRS	N/A	PAGE	1 OF 1				WOF#	259358