


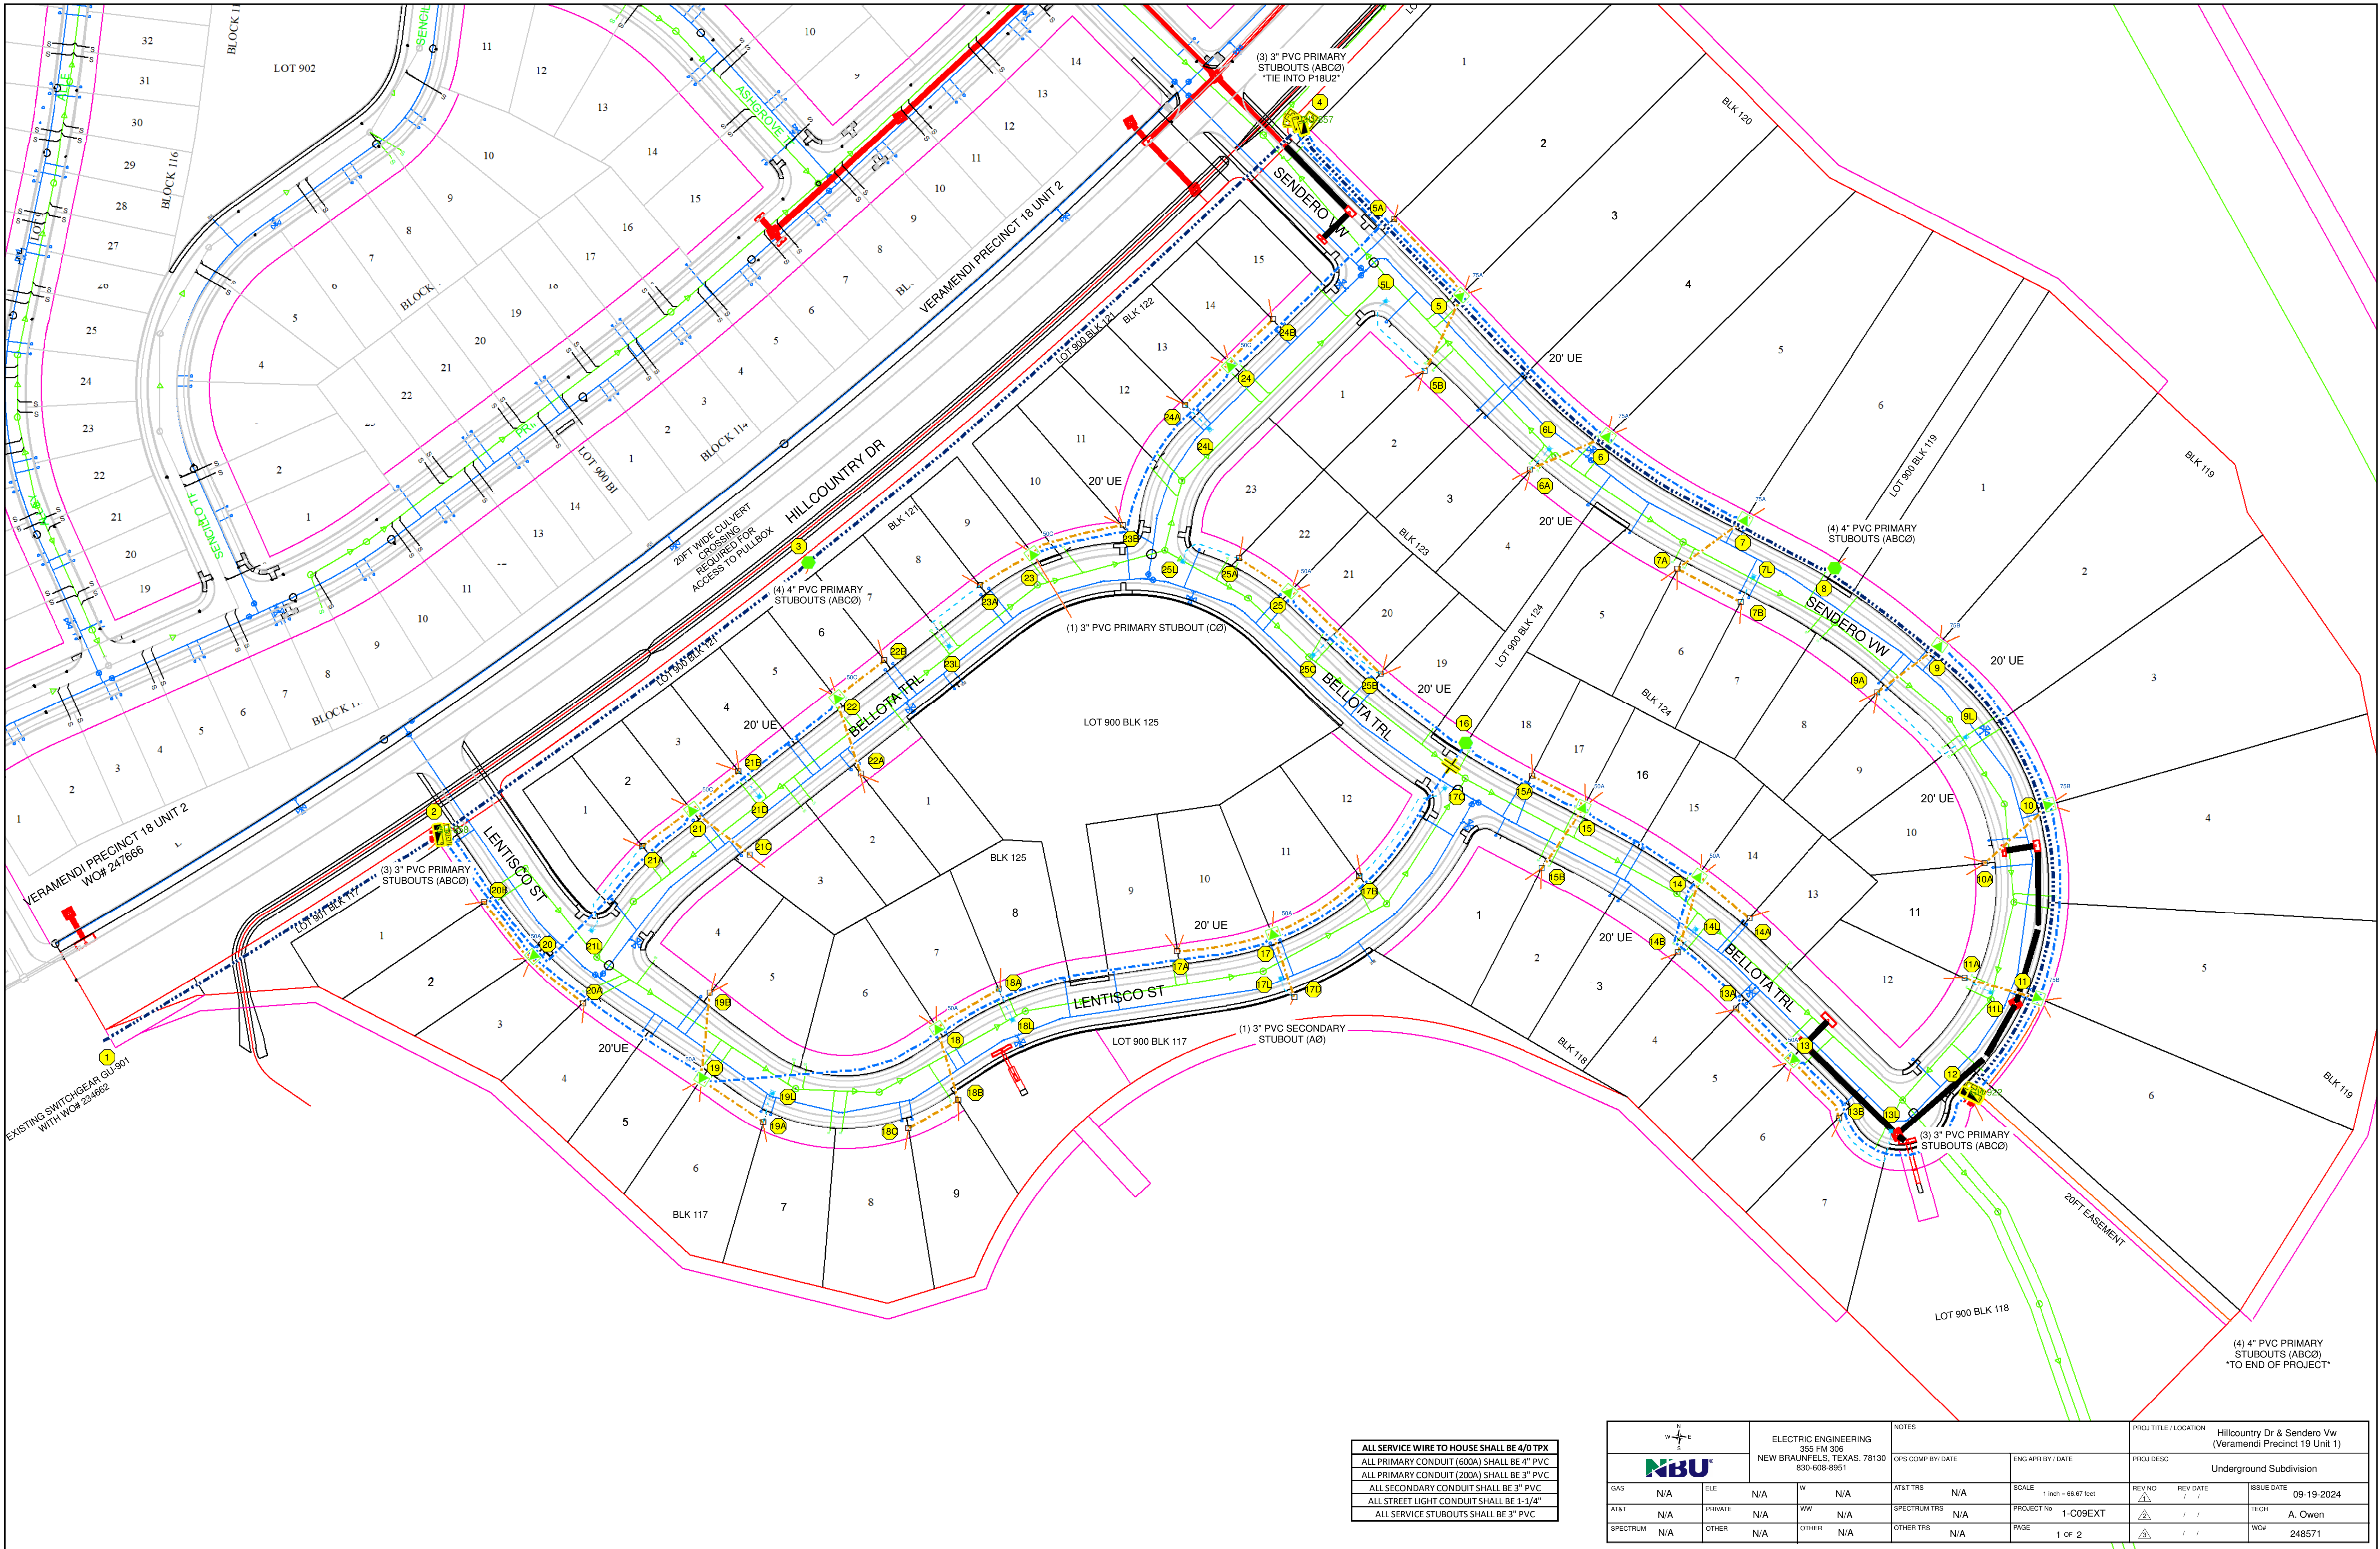

ALL SERVICE WIRE TO HOUSE SHALL BE 4/0 TPX
ALL PRIMARY CONDUIT (600A) SHALL BE 4" PVC
ALL PRIMARY CONDUIT (200A) SHALL BE 3" PVC
ALL SECONDARY CONDUIT SHALL BE 3" PVC
ALL STREET LIGHT CONDUIT SHALL BE 1-1/4"
ALL SERVICE STUBOUTS SHALL BE 3" PVC

		ELECTRIC ENGINEERING 355 FM 306 NEW BRAUNFELS, TEXAS, 78130 830-608-8951		NOTES OPS COMP BY / DATE ENG APR BY / DATE		PROJ TITLE / LOCATION Hillcountry Dr & Sendero Vw (Veramendi Precinct 19 Unit 1)	
GAS N/A		ELE N/A		W N/A		AT&T TRS N/A	
AT&T N/A		PRIVATE N/A		WW N/A		SCALE 1 inch = 66.67 feet	
SPECTRUM N/A		OTHER N/A		OTHER TRS N/A		PROJECT No 1-C09EXT	
						PAGE 1 OF 2	
						REV NO 1	
						REV DATE / /	
						ISSUE DATE 09-19-2024	
						TECH A. Owen	
						WOP 248571	