

GU-960 AT WL# 25


ALL CUSTOMER INSTALLATIONS REQUIRE INSPECTION BY NBU.

UNDERGROUND CONDUIT TO BE INSTALLED ACCORDING TO NBU SPECIFICATION EU-910. **CONDUIT TO BE SIZED BY NBU** AND HAVE 1" PROJECTION ABOVE CONCRETE, 36" RADIUS, 90° SWEEPS. PULL STRING TO BE INSTALLED BY CUSTOMER IN EACH CONDUIT.


COPPER-CLAD GROUND RODS, 5/8" X 8', 2 REQUIRED, TO HAVE 4" PROJECTION ABOVE TOP ON CONCRETE.

CONCRETE TO BE MIN. 3000 PSI.

TOP VIEW

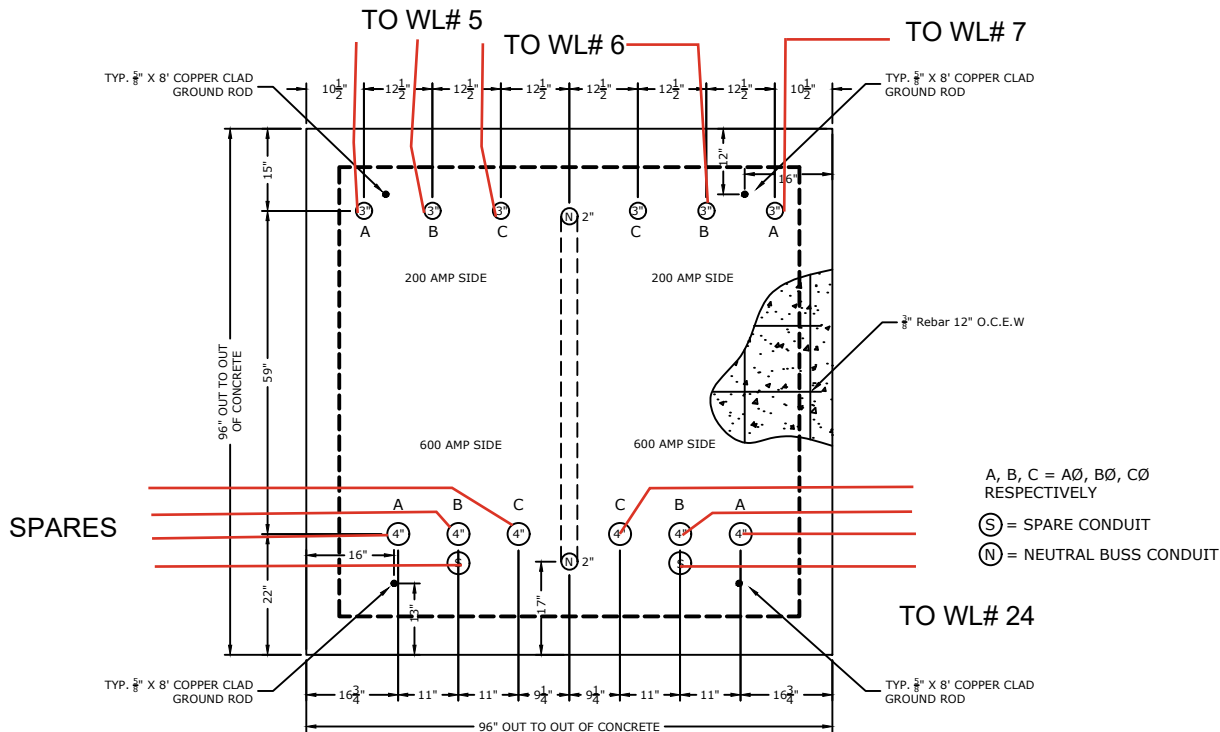

RIVER RD

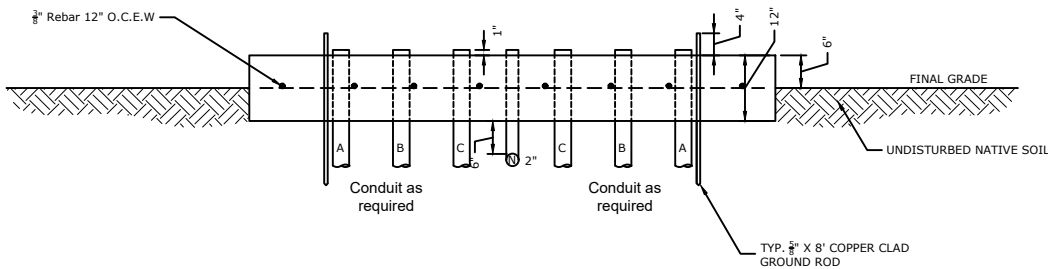

COMPACTED TxDOT GRADE 4, TYPE A, FLEXIBLE BASE MATERIAL, OR OTHER APPROVED MATERIAL FROM BOTTOM OF TRENCH TO BOTTOM OF PAD.

	Electric Engineering 355 FM 306 PO Box 310289 New Braunfels, TX 78131-0289 830-608-8951		PSE-9 SWITCH GEAR FOUNDATION		
	ISSUED APRIL 2019	SCALE NTS	DRAWING BY M. NAJERA		